156786 21 19 189

Sampling Results As Of 6-28-85

Sample	0-6	6-12	12-18	18-24	24-30	30-36	36-42	42-48	48-54	
*A	NR	NR	NR	NR	3.0	NR	0.77	NR	0	
*B	NR	NR	161	NR	86.0	NR	5.4	NR	BEING RUN.	
*C	NR	NR	NR	NR	107	NR	12	NR	0	
*D	0	NR	(*)	NR	(*)	NR	NR	NR	NR	
*E	NR	NR	3.2	NR	NR	NR	NR	NR	NR	✓
*F	NR	NR	0.31	NR	0	NR	NR	NR	NR	
*G	NR	NR	1.6	NR	NR	NR	NR	NR	NR	
H	0.98	NR	0.57	NR	0.08	NR	NR	NR	NR	
*I	NR	NR	2.4	NR	39.0	NR	NR	NR	NR	✓
J	0	NR	(*)	NR	NR	NR	NR	NR	NR	
*K	6.2	NR	0.24	NR	NR	NR	NR	NR	NR	
L	0	NR	(*)	NR	(*)	NR	NR	NR	NR	
M	1.3	NR	0.43	NR	NR	NR	NR	NR	NR	
N	NR	NR	0	NR	NR	NR	NR	NR	NR	
O	See 4/85 Analysis Sp#12 1.8	NR	0.24	NR	NR	NR	NR	NR	NR	
P	NR	NR	2.3	NR	NR	NR	NR	NR	NR	✓
Q	0	NR	(*)	NR	NR	NR	NR	NR	NR	
R	1.7	NR	0	NR	NR	NR	NR	NR	NR	
S	NR	NR	0	NR	NR	NR	NR	NR	NR	
T	3.6	NR	NR	NR	NR	NR	NR	NR	NR	
*U	0	NR	0	NR	0.34	NR	0.5	NR	0.69	✓

* - Tetra thru Octa

NR - Not Required

(*) Not Run - Previous level was 0

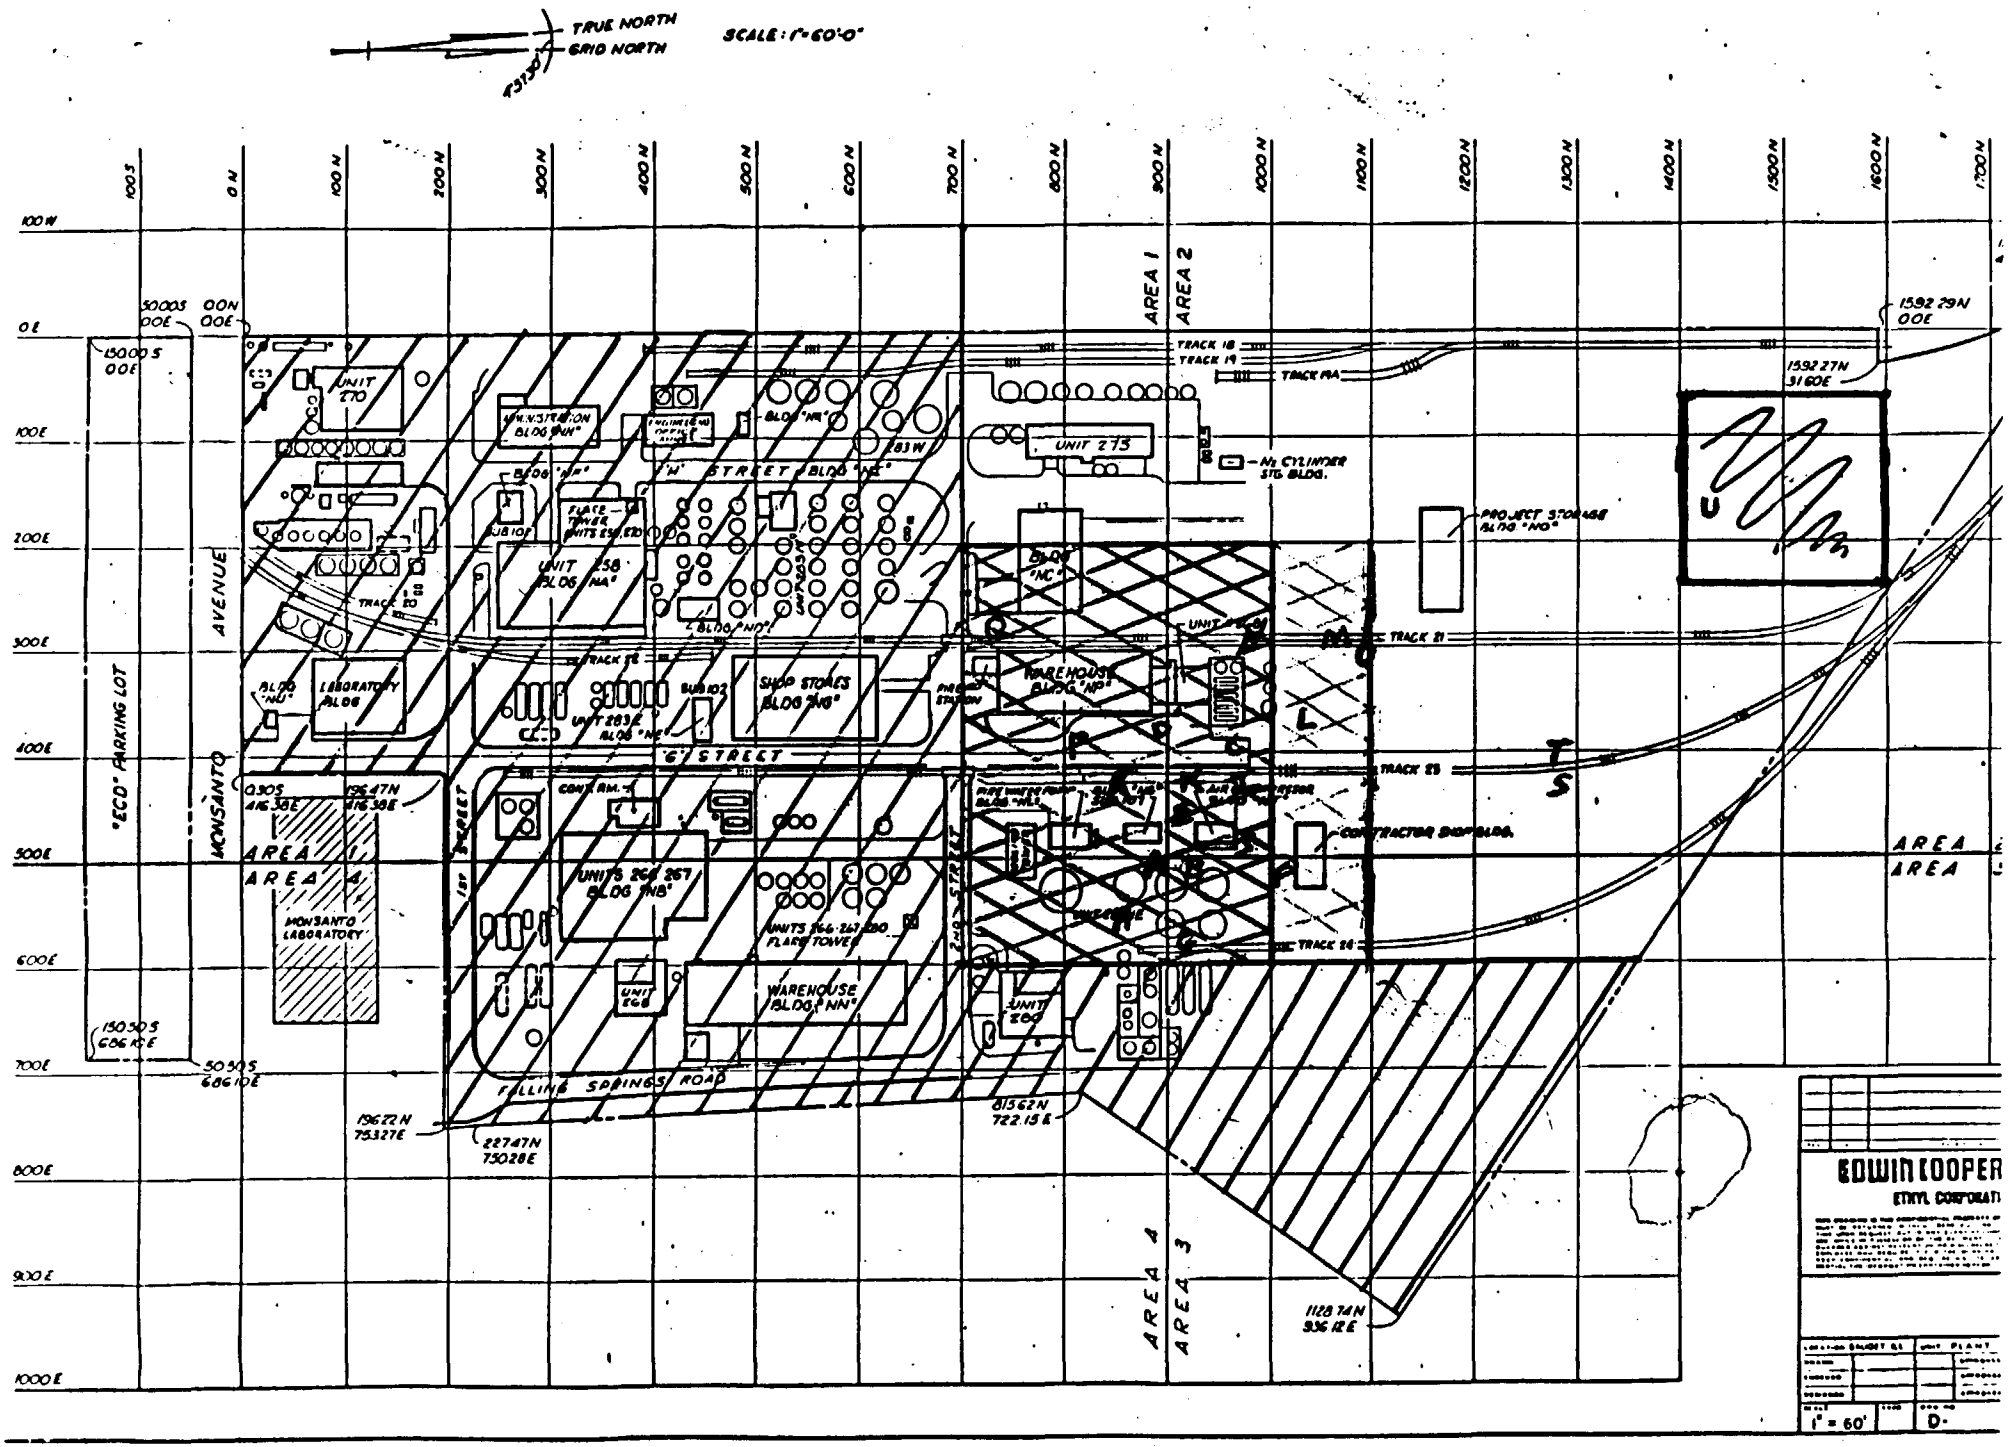

TRUE NORTH
GRID NORTH
SCALE: 1"=60'-0"
AREA 1
AREA 2
AREA 3
AREA 4
"ECD" PARKING LOT
MONSANTO AVENUE
MONSANTO LABORATORY
FALLING SPRINGS ROAD
1ST STREET
2ND STREET
'H' STREET
'G' STREET
UNIT 270
UNIT 275
UNIT 258 BLDG "NA"
UNIT 283E BLDG "NE"
UNITS 266 267 BLDG "NB"
UNITS 266-267-280 FLARE TOWER
WAREHOUSE BLDG "NN"
SHOP STORES BLDG "NG"
WAREHOUSE BLDG "NP"
LABORATORY BLDG
PROJECT STORAGE BLDG "NO"
CONTRACTOR SHOP BLDG.
N2 CYLINDER STG. BLDG.
TRACK 18
TRACK 19
TRACK 19A
TRACK 20
TRACK 21
TRACK 23
TRACK 24
1592.29N 00E
1592.27N 31.60E
1128.74N 936.12E
815.62N 722.15E
196.22N 753.27E
227.47N 750.28E
150.50S 686.10E
50.50S 686.10E
EDWIN COOPER
ETHYL CORPORATI
1" = 60'
D-