PORSF
11.3, 18.1 V7

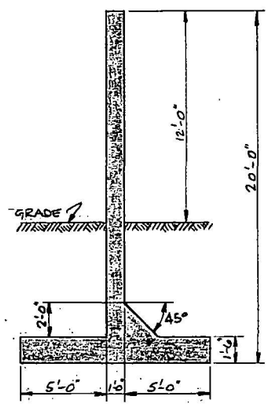

SECTION "A-A"
SCALE 1/4"=1'-0"

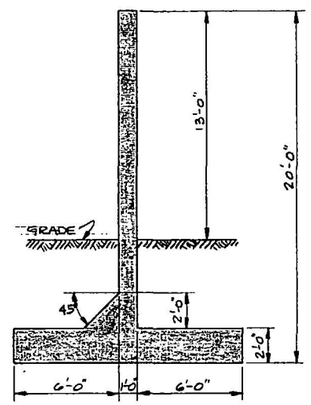

SECTION "B-B"
SCALE 1/4"=1'-0"

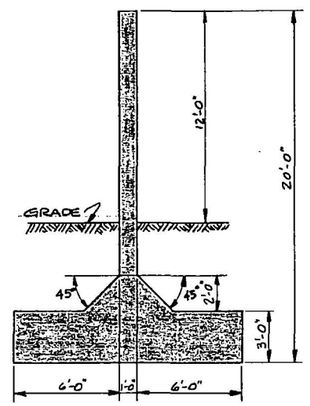

SECTION "C-C"
SCALE 1/4"=1'-0"

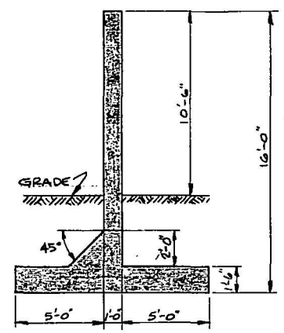

SECTION "D-D"
SCALE 1/4"=1'-0"

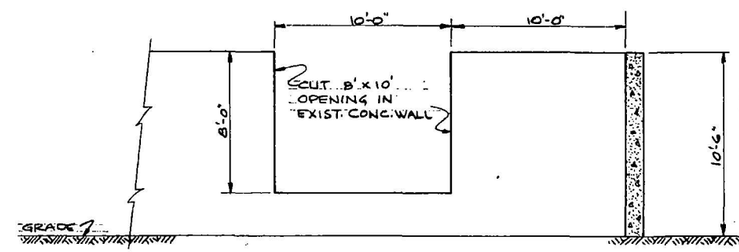

SECTION "E-E"
SCALE 1/4"=1'-0"

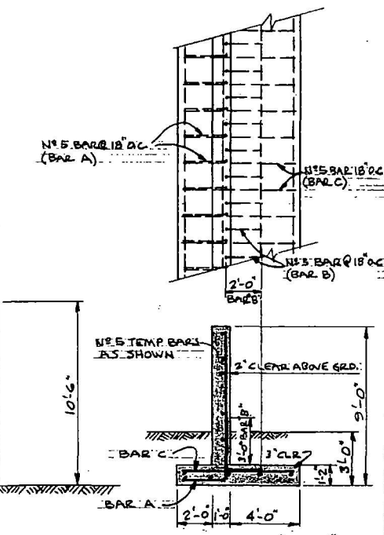

SECTION "F-F"
SCALE 1/4"=1'-0"

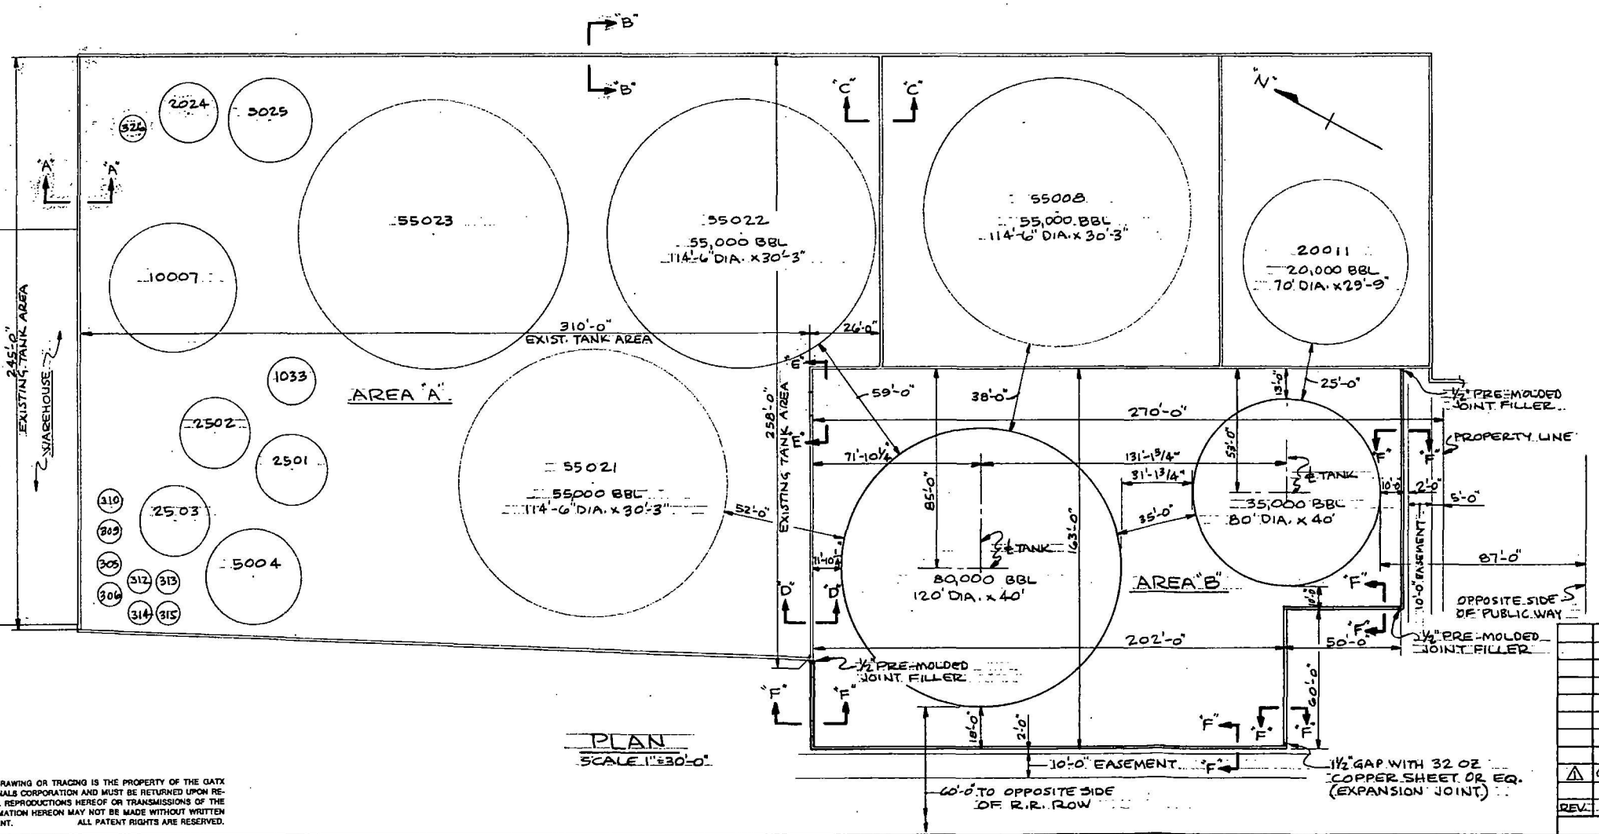

PLAN
SCALE 1"=30'-0"

USEPA SF
1288401

NOTES:
ALL CONCRETE TO BE 3000 PSI IN 28 DAYS
ALL REINFORCING BARS TO BE DEFORMED TYPE OF ASTM A-15 MATERIAL
BACK FILL TO BE COMPACTED TO 95% PROCT

REV.	DATE	BY	DESCRIPTION
1	6/25/79	R.O.	SECT'S. A-A & D-D WERE SHOWN OPA HAND. PRE-MOLDED JOINT FILLER SHOWN AT A THIRD SPOT & DIM'S. LOCATING NEW TANK CENTERLINES ADDED.

REVISIONS

PROPOSED NEW TANK ARRANGEMENT AND REINFORCED CONCRETE DIKE
PORTLAND TERMINAL

GATX TERMINALS CORPORATION
CHICAGO

DRAWN: R.O.SAB.
CHECKED: J. Mitchell
APPROVED:
ISSUE
REF. DWGS.
DATE 6/27/79
SCALE NOTED
MICRO RATIO
PRINTOUT SIZE
DWG. NO. SK-D-062279-1

PROJ. No. 068-78-4-100

THIS DRAWING OR TRACING IS THE PROPERTY OF THE GATX TERMINALS CORPORATION AND MUST BE RETURNED UPON REQUEST. REPRODUCTIONS HEREOF OR TRANSMISSIONS OF THE INFORMATION HEREON MAY NOT BE MADE WITHOUT WRITTEN CONSENT. ALL PATENT RIGHTS ARE RESERVED.