Preliminary Aquifer Drawdown Analysis for City of Victoria (COV) Ground Water Supply System
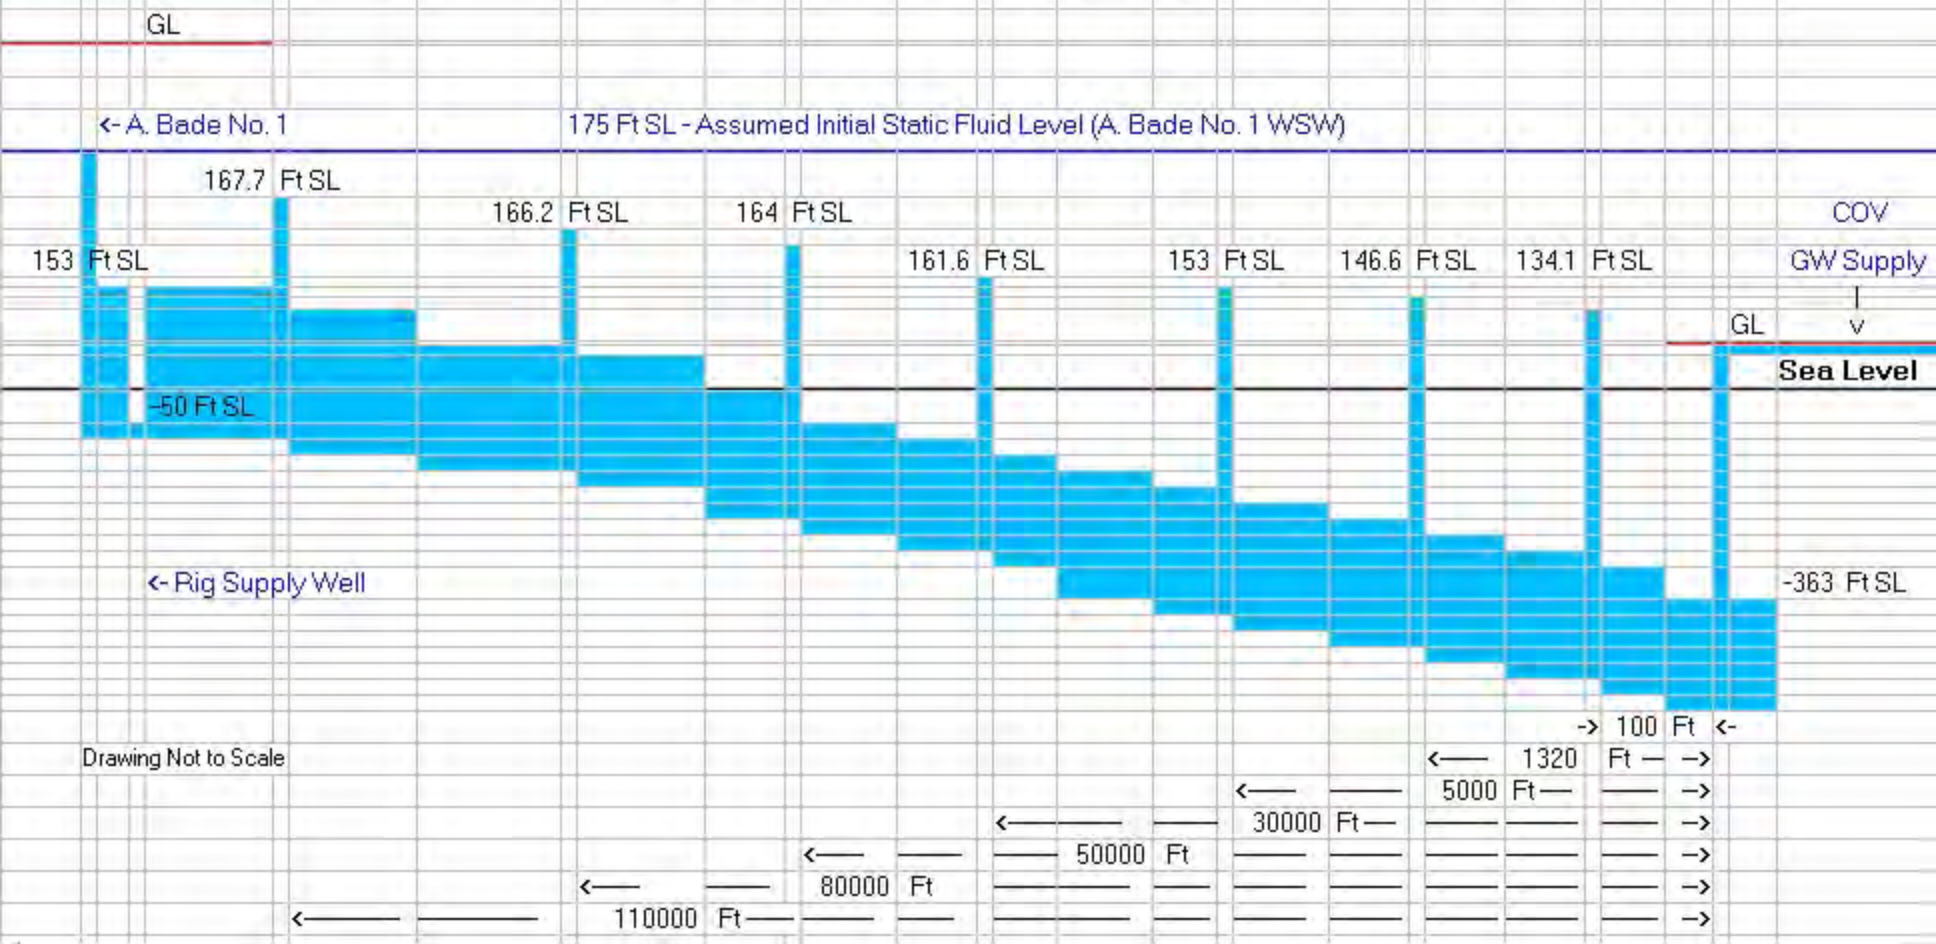
Model Results For 50 Years of Operation at 1000 Ac-Ft/Yr Water Production Rate