7/1/93

COLSF 7.4 V2

RECEIVED
AUG 30 1993
SUPERFUND REMEDIAL BRANCH

COLBERT LANDFILL WELL SAMPLING PROGRAM
JULY, 1993
SUMMARY SHEET

NAME	DATE	WELL NO.	TCA	DCE	DCA	TCE	PCE	MC
(b) (6)	07/07/93	2373E-2	ND	ND	ND	ND	ND	**
	07/01/93	1073J-1	2.1	ND	ND	ND	ND	**
	07/01/93	1073G-1	ND	ND	ND	ND	ND	ND
	07/07/93	1573E-1	ND	ND	ND	ND	ND	ND
	07/06/93	1573H-2	ND	ND	ND	ND	ND	ND
	07/02/93	1473M-1	0.9	ND	ND	ND	ND	ND
	07/07/93	1673H-1	ND	ND	ND	ND	ND	ND
	07/02/93	2373E-1	ND	ND	ND	ND	ND	ND
	07/01/93	0273E-2	ND	ND	ND	ND	ND	ND
	07/02/93	0273C-5	ND	ND	ND	ND	ND	ND

Units reported in ug/L (ppb).

Sample results are from North Creek Analytical Laboratory. These results have been condensed and simplified.

** Methylene Chloride, detected at low levels, is due to lab contamination.

USEPA SF
1407097

COLBERT LANDFILL WELL SAMPLING PROGRAM
JULY, 1993
SUMMARY SHEET

NAME	DATE	WELL NO.	TCA	DCE	DCA	TCE	PCE	MC
(b) (6)	06/30/93	1073E-2	4.1	ND	ND	ND	ND	**
	06/30/93	1073E-2	4.4	ND	ND	ND	ND	**
	07/07/93	1573C-2	ND	ND	ND	ND	ND	ND
	07/06/93	1573Q-1	ND	ND	ND	ND	ND	ND
	07/06/93	0373A-4	ND	ND	ND	ND	ND	ND
	06/30/93	1073E-1	34	ND	1.1	ND	ND	**
	07/06/93	1573C-8	ND	ND	ND	ND	ND	ND

Units reported in ug/L (ppb).

Sample results are from North Creek Analytical Laboratory. These results have been condensed and simplified.

** Methylene Chloride, detected at low levels, is due to lab contamination.

Preformance Standards

Maximum ALLOWABLE CONTAMINANT CONCENTRATIONS

Health Protection Levels

Health protedtion levels are not to be exceeded during opperational life of remedial action in effluents from groundwater treatment systems. Permenant reduction of contominant concentrations below these levels throughout the site will indicate completion of the remedial action.

Contominant		Maximum concentration ports per billion (ug/L)	Basis
1,1,1,-Trichloroethane	(TCA)	200.0	HCL
1,1, -Dichloroethylene	(DCE)	7.0	HCL
1,1, -Dichloroethane	(DCA)	4050.0	HCA
Trichloroethylene	(TCE)	5.0	HCL
Tetrachloroethylene	(PCE)	0.7	10-5 C.R.
Methylene Chloride	(MC)	2.5	10-5 C.R.

C.R.=cancer risk

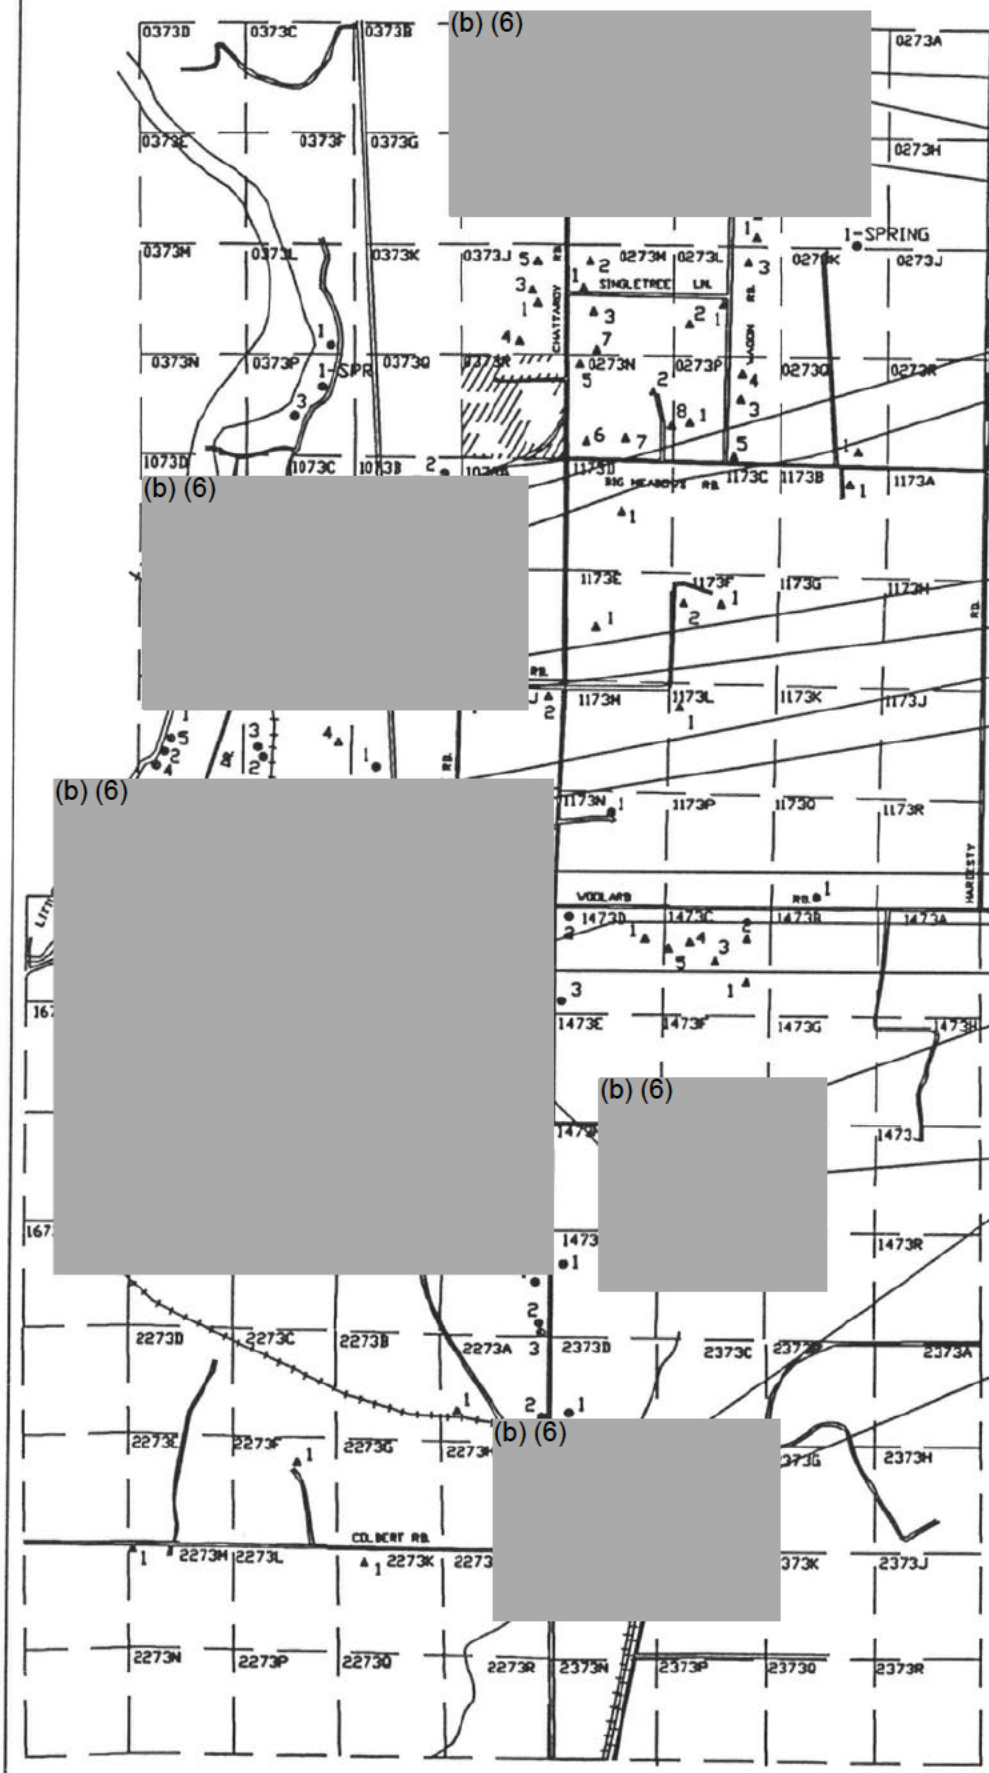

Lower 7/02/93

WELL #	TCA	DCE	DCA	TCE	PCE	MC
0273C-5	ND	ND	ND	ND	ND	ND
0373A-4	ND	ND	ND	ND	ND	ND
0273E-2	ND	ND	ND	ND	ND	ND

Upper 6/30/93

WELL #	TCA	DCE	DCA	TCE	PCE	MC
1073E-1	34	ND	1.1	ND	ND	B
1073E-2	4.1	ND	ND	ND	ND	B

Lower 7/01/93

WELL #	TCA	DCE	DCA	TCE	PCE	MC
1073G-1	ND	ND	ND	ND	ND	ND
1073J-1	2.1	ND	ND	ND	ND	B
1673H-1	ND	ND	ND	ND	ND	ND
1573H-1	ND	ND	ND	ND	ND	ND

Upper 7/02/93

WELL #	TCA	DCE	DCA	TCE	PCE	MC
573C-2	ND	ND	ND	ND	ND	ND
573C-8	ND	ND	ND	ND	ND	ND
1573D-1	ND	ND	ND	ND	ND	ND
1473M-1	0.9	ND	ND	ND	ND	ND

Lower 7/07/93

WELL #	TCA	DCE	DCA	TCE	PCE	MC
1573H-2	ND	ND	ND	ND	ND	ND
2373E-2	ND	ND	ND	ND	ND	B

Upper 7/02/93

WELL #	TCA	DCE	DCA	TCE	PCE	MC
2373E-1	ND	ND	ND	ND	ND	ND

SCALE-NONE

SYMBOL	LAYER	DESCRIPTION
	GRID	1/16 SECTIONS
	LOT_BLK	SHORT PLOTS
●	SHALLOW	WELLS UNDER 120' DEEP
▲	DEEP	WELLS OVER 120' DEEP
○	OTHER	WELLS OVER OTHER AQUIFER
▨		DESIGNATE COLBERT LANDFILL