8.7.3.2

RECEIVED

MAR 07 1997

Environmental Cleanup Office

Colbert Residential Well Sampling Program 04-Mar-97

Summary Sheet

January 1997

Customer	Sample Date	Well No.	TCA	DCE	DCA	TCE	PCE	MC
(b) (6)	1/14/97	0373A-1	1.7	ND	ND	ND	ND	ND
	1/14/97	1573C-5	ND	ND	ND	ND	ND	ND
	1/15/97	1073J-1	5	ND	ND	ND	ND	ND
	1/16/97	1573B-5	ND	ND	ND	ND	ND	ND
	1/14/97	1073G-1	ND	ND	ND	ND	ND	ND
	1/14/97	1473M-1	ND	ND	ND	ND	ND	ND
	1/15/97	1173B-1	ND	ND	ND	ND	ND	ND
	1/14/97	1573H-1	ND	ND	ND	ND	ND	ND
	1/14/97	1073M-3	ND	ND	ND	ND	ND	ND
North Glen Estates,	1/14/97	1073D-2	32	1.2	3.9	ND	ND	ND
NORTH MEADOWS	1/15/97	1073Q-4	5.1	ND	ND	ND	ND	ND
(b) (6)	1/14/97	1073E-2	ND	ND	ND	ND	ND	ND
	1/15/97	1573Q-1	ND	ND	ND	ND	ND	ND

USEPA SF
1480552

Preformance Standards

Maximum ALLOWABLE CONTAMINANT CONCENTRATIONS

Health Protection Levels

Health protedtion levels are not to be exceeded during opperational life of remedial action in effluents from groundwater treatment systems. Permenant reduction of contaminant concentrations below these levels throughout the site will indicate completion of the remedial action.

Contaminant		Maximum concentration parts per billion (ug/L)	Basis
1,1,1,-Trichloroethane	(TCA)	200.0	HCL
1,1, -Dichloroethylene	(DCE)	7.0	HCL
1,1, -Dichloroethane	(DCA)	4050.0	HCA
Trichloroethylene	(TCE)	5.0	HCL
Tetrachloroethylene	(PCE)	0.7	10-5 C.R.
Methylene Chloride	(MC)	2.5	10-5 C.R.

C.R.=cancer risk

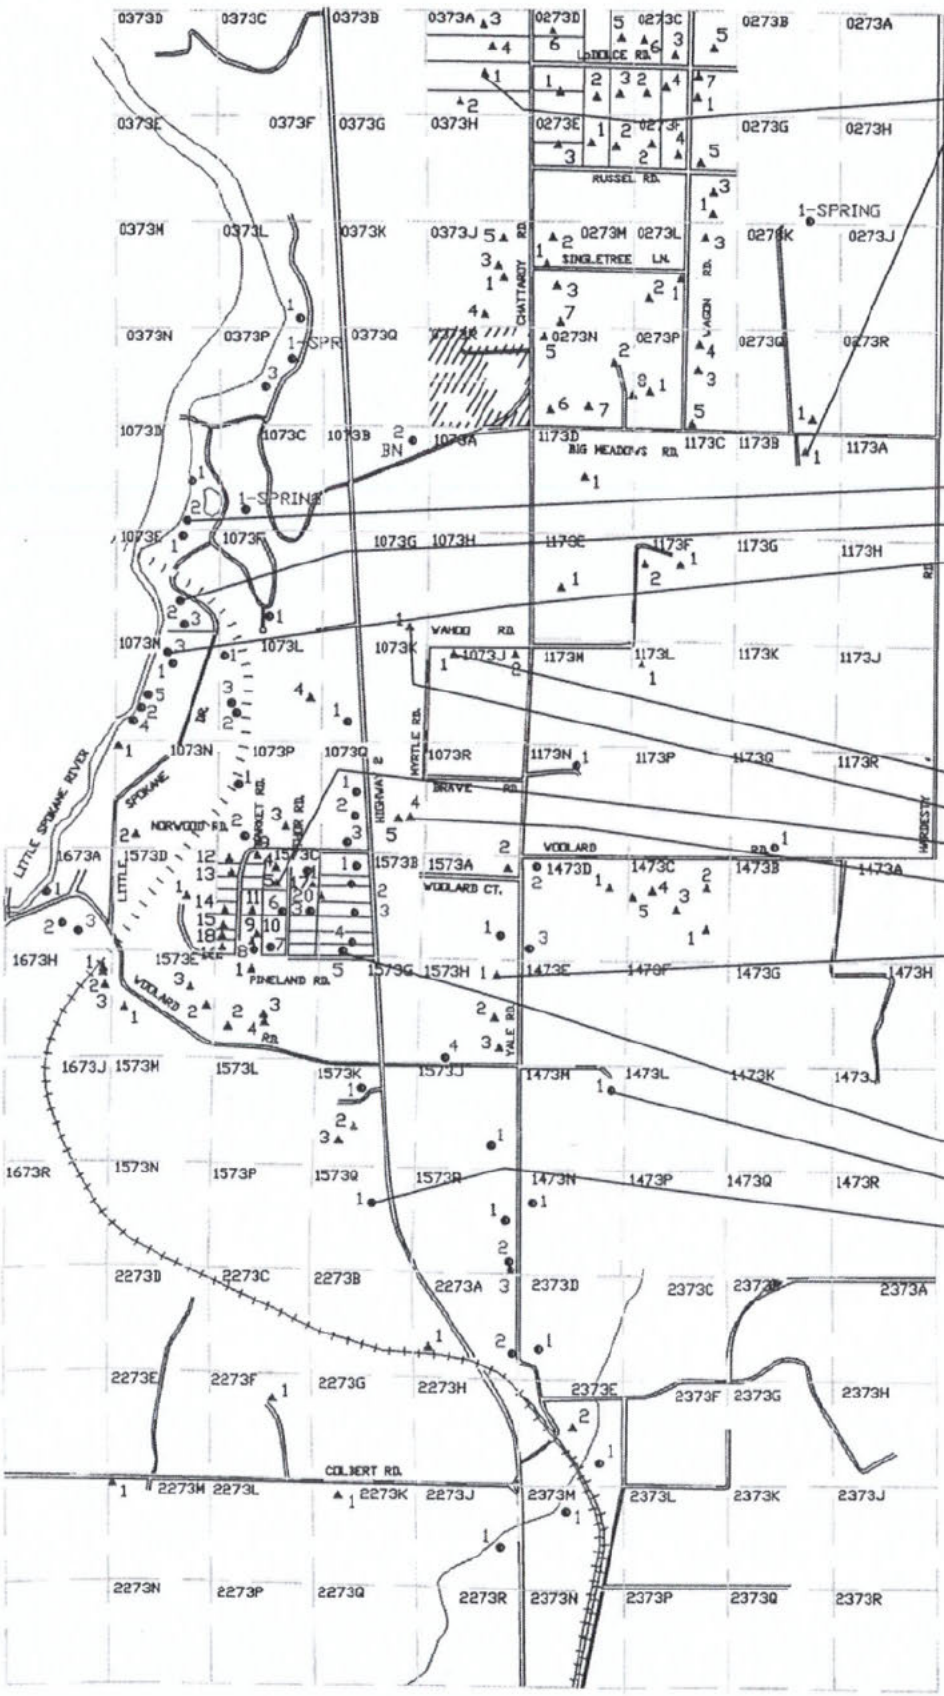

Lower 01/14/97

WELL #	TCA	DCE	DCA	TCE	PCE	MC
(b) (6) 0373A-1	1.7	ND	ND	ND	ND	ND
1173B-1	ND	ND	ND	ND	ND	ND

Upper 01/14/97

WELL #	TCA	DCE	DCA	TCE	PCE	MC
N. Glen 1073D-2	32.0	1.2	3.9	ND	ND	ND
(b) (6) 1073E-2	ND	ND	ND	ND	ND	ND
1073M-3	ND	ND	ND	ND	ND	ND

Lower 01/14/97

WELL #	TCA	DCE	DCA	TCE	PCE	MC
(b) (6) 1073J-1	5.0	ND	ND	ND	ND	ND
1073G-1	ND	ND	ND	ND	ND	ND
1573C-5	ND	ND	ND	ND	ND	ND
N. Meadow 1073Q-4	5.1	ND	ND	ND	ND	ND
(b) (6) 1573H-1	ND	ND	ND	ND	ND	ND

Upper 01/15/97

WELL #	TCA	DCE	DCA	TCE	PCE	MC
(b) (6) 1573B-5	ND	ND	ND	ND	ND	ND
1473M-1	ND	ND	ND	ND	ND	ND
1573Q-1	ND	ND	ND	ND	ND	ND

SCALE-NONE

SYMBOL	LAYER	DESCRIPTION
	GRID	1/16 SECTIONS
	LOT_BLK	SHORT PLOTS
●	SHALLOW	WELLS UNDER 120' DEEP
▲	DEEP	WELLS OVER 120' DEEP
-O-	OTHER	WELLS OVER OTHER AQUIFER
//////////		DESIGNATE COLBERT LANDFILL