ALASKAN COPPER CO.
WEEKLY EFFLUENT REPORT FOR 3200 6th ave. s.

starting date 7-24-81

Ending date 7/31/89

Technician RAPHAEL / LARRY-H.

TOTAL NUMBER OF GALLONS USED.
CAUSTIC - 17.0 x1.7=28.9- WEEKLY.

BARRELL MONITOR IN INCHES. 19.0 - 3 +1 = 17.0

Monday
Check PH of Hoppers
Check PH of Sumps
Check Caustic & Beta Levels
Drain & clean Hoppers
Took Reading & Reset Controller
Blowdown Boiler
Cleaned the area
Timer on at 11HRS.

TUESDAY
Drain & clean Hoppers
Checked PH Hoppers
Checked PH sumps
Check Caustic level
Check Betafloc level
Reset Controller
Blowdown Boiler
Clean Seriously

WEDNESSDAY
~~Checked PH of~~
Drain & clean Hopper
Checked PH of Hoppers
Checked PH of Sumps
Check caustic & Betafloc levels
Reset Controller
Blow down Boiler
Set timer @ 11HRS.

THURSDAY
Check PH of Hoppers
Check PH of Sumps
Drain & clean Hoppers
Check & Reset Controller
Check caustic levels
Blow down Boiler
Set timer.

FRIDAY
Check PH of Hoppers & Sumps
Check and Reset PH-Readings
Drain and Clean Hoppers
Check Caustic levels
Check Betafloc levels
Blowdown Boiler
Set timer.

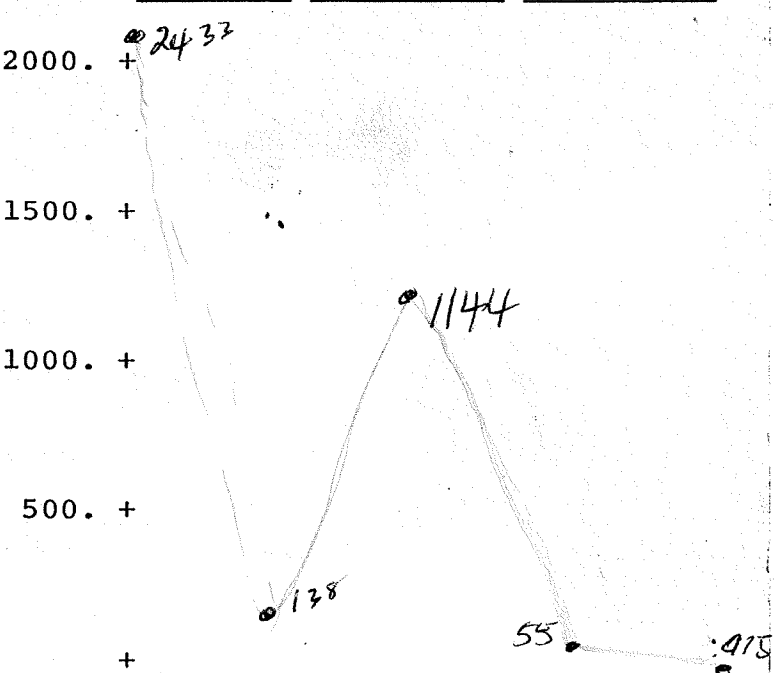

	MON	TUE	WED	THU	FRI
CYCLES.	75	68	46	35	15
DAILY INCHES	15	11.0	8.0	3/21	20
HOPPER A pH.	11.0	10.1	10.0	11.0	10.0
HOPPER B pH.	11.0	10.0	10.0	11.0	10.0
BETA	22.0	14.0	32	26.0	13

AKC-0014962