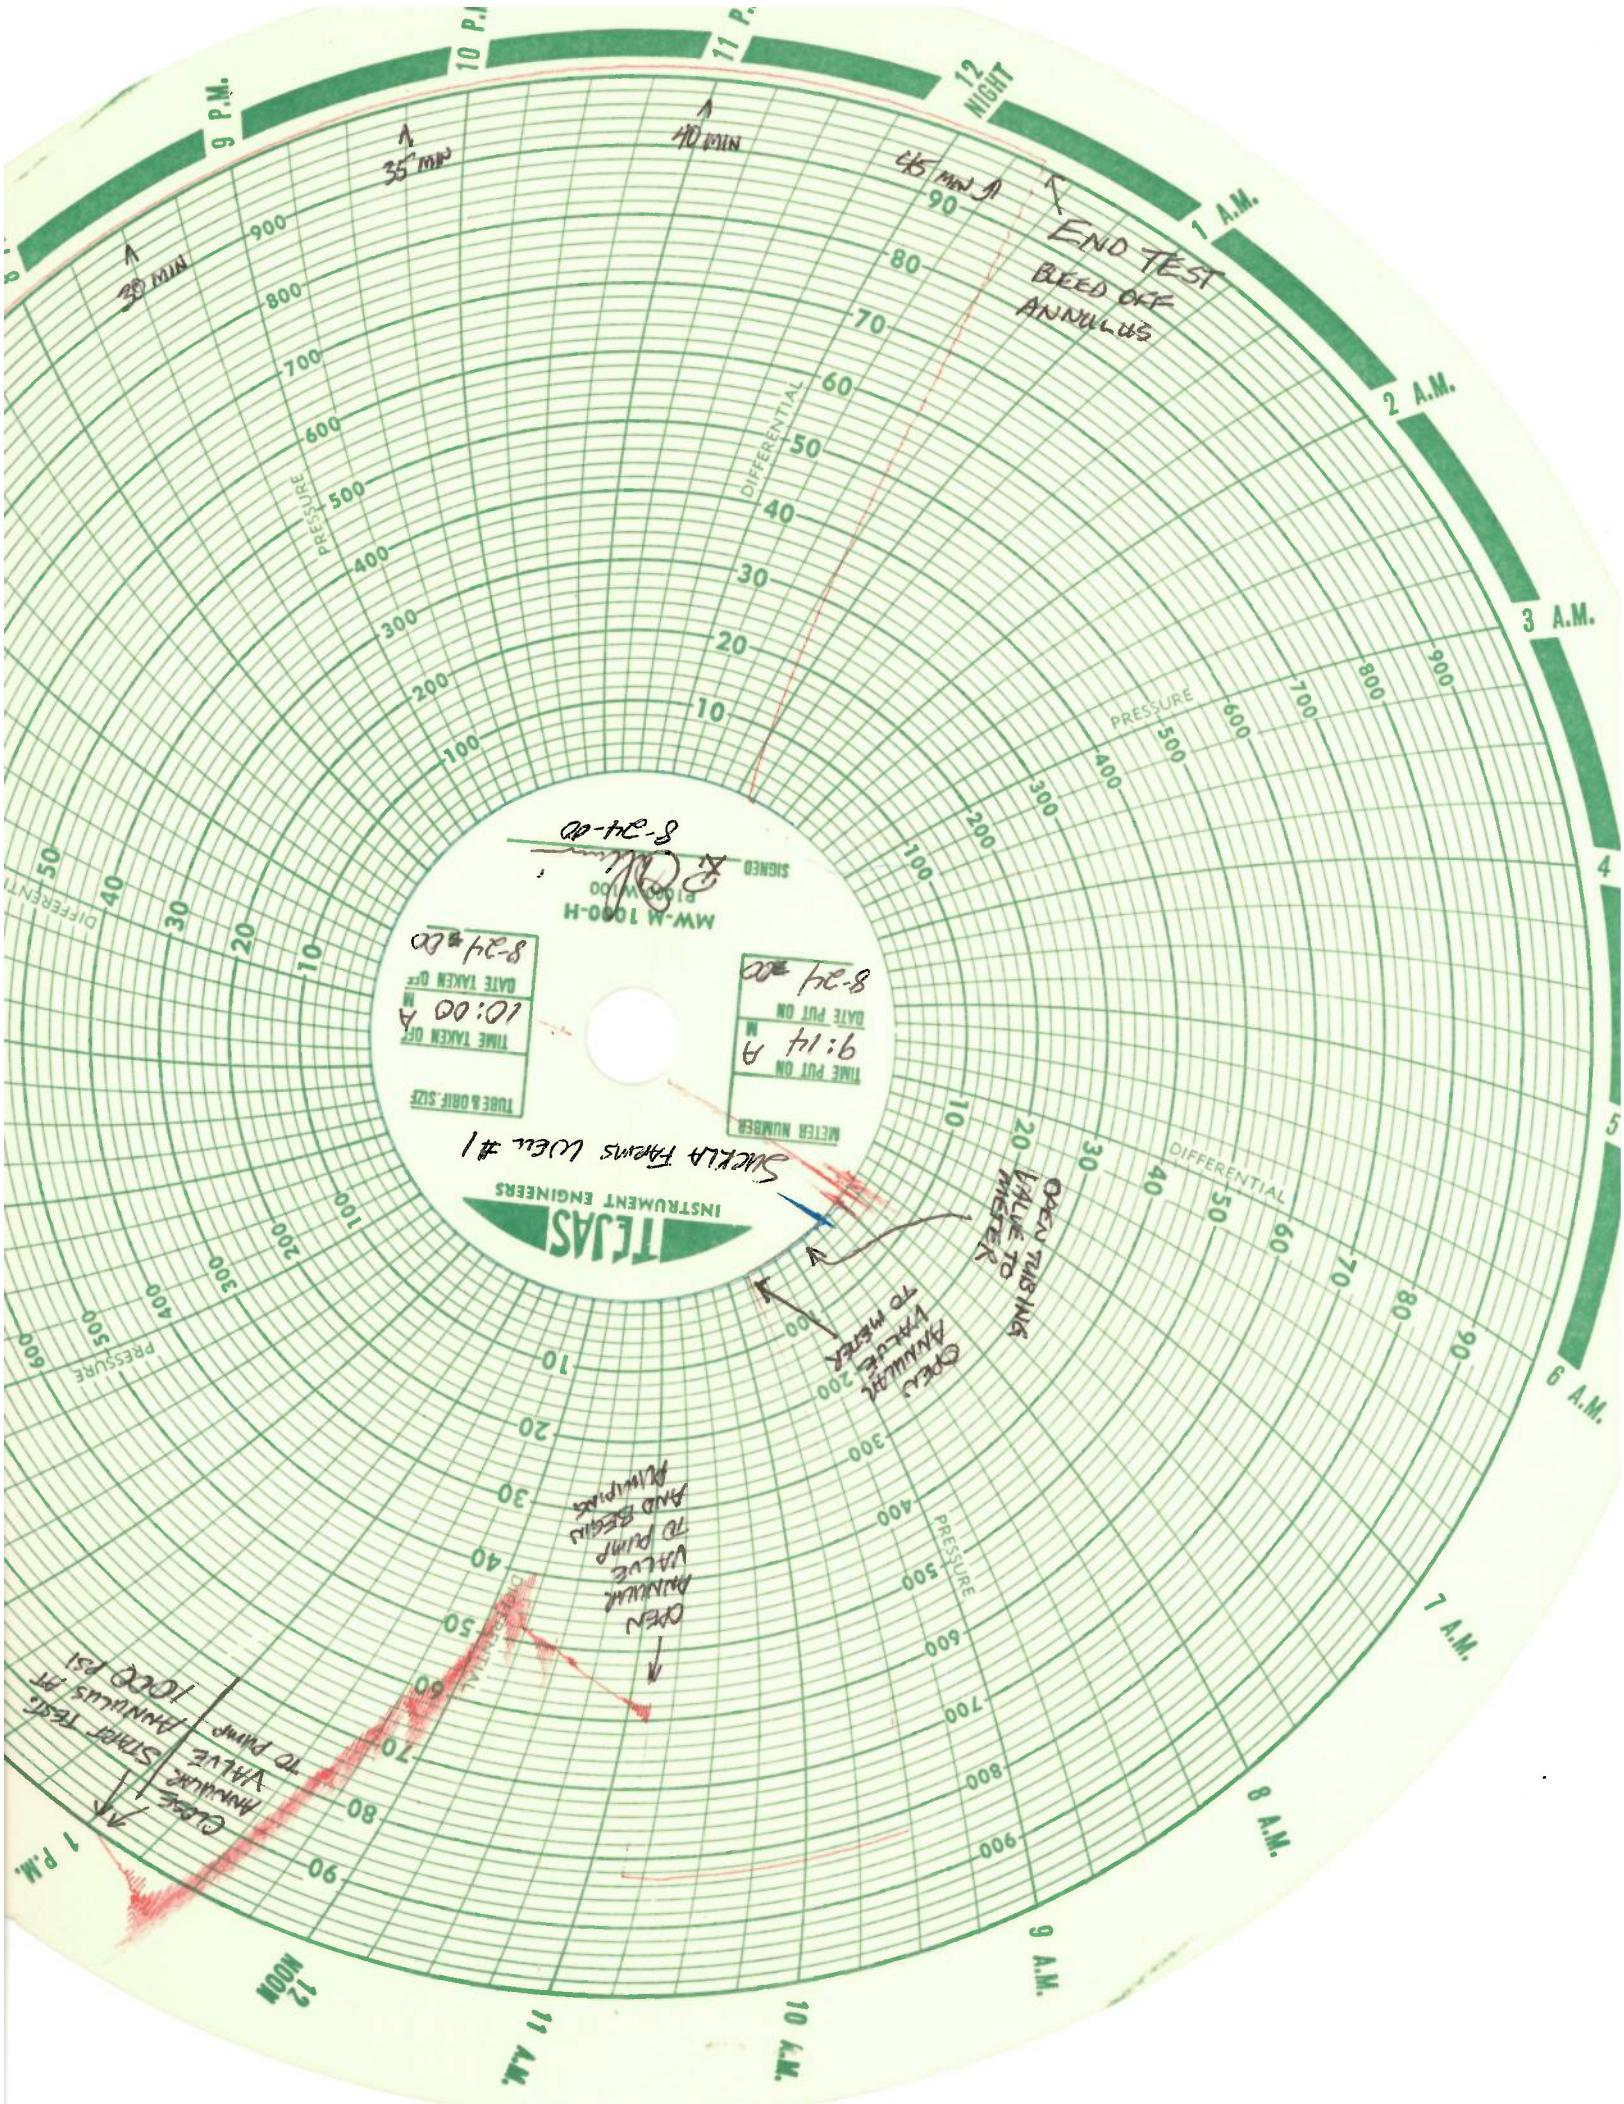

TEJAS
INSTRUMENT ENGINEERS
MW-M 1000-H
SIGNED
8-24-00
TUBE & ORIF. SIZE
TIME TAKEN OFF
10:00 A M
DATE TAKEN OFF
8-24-00
METER NUMBER
TIME PUT ON
9:14 A M
DATE PUT ON
8-24-00
SUCKLA FARMS WELL #1
OPEN TUBING VALVE TO METER
OPEN ANNULAR VALVE TO PUMP AND BEGIN PUMPING
CLOSE ANNULAR VALVE TO PUMP
START TEST ANNULUS AT 1000 PSI
END TEST
BLEED OFF ANNULUS
30 MIN
35 MIN
40 MIN
45 MIN
PRESSURE
DIFFERENTIAL
1 P.M.
2 P.M.
3 P.M.
4 P.M.
5 P.M.
6 P.M.
7 P.M.
8 P.M.
9 P.M.
10 P.M.
11 P.M.
12 NIGHT
1 A.M.
2 A.M.
3 A.M.
4 A.M.
5 A.M.
6 A.M.
7 A.M.
8 A.M.
9 A.M.
10 A.M.
11 A.M.
12 NOON