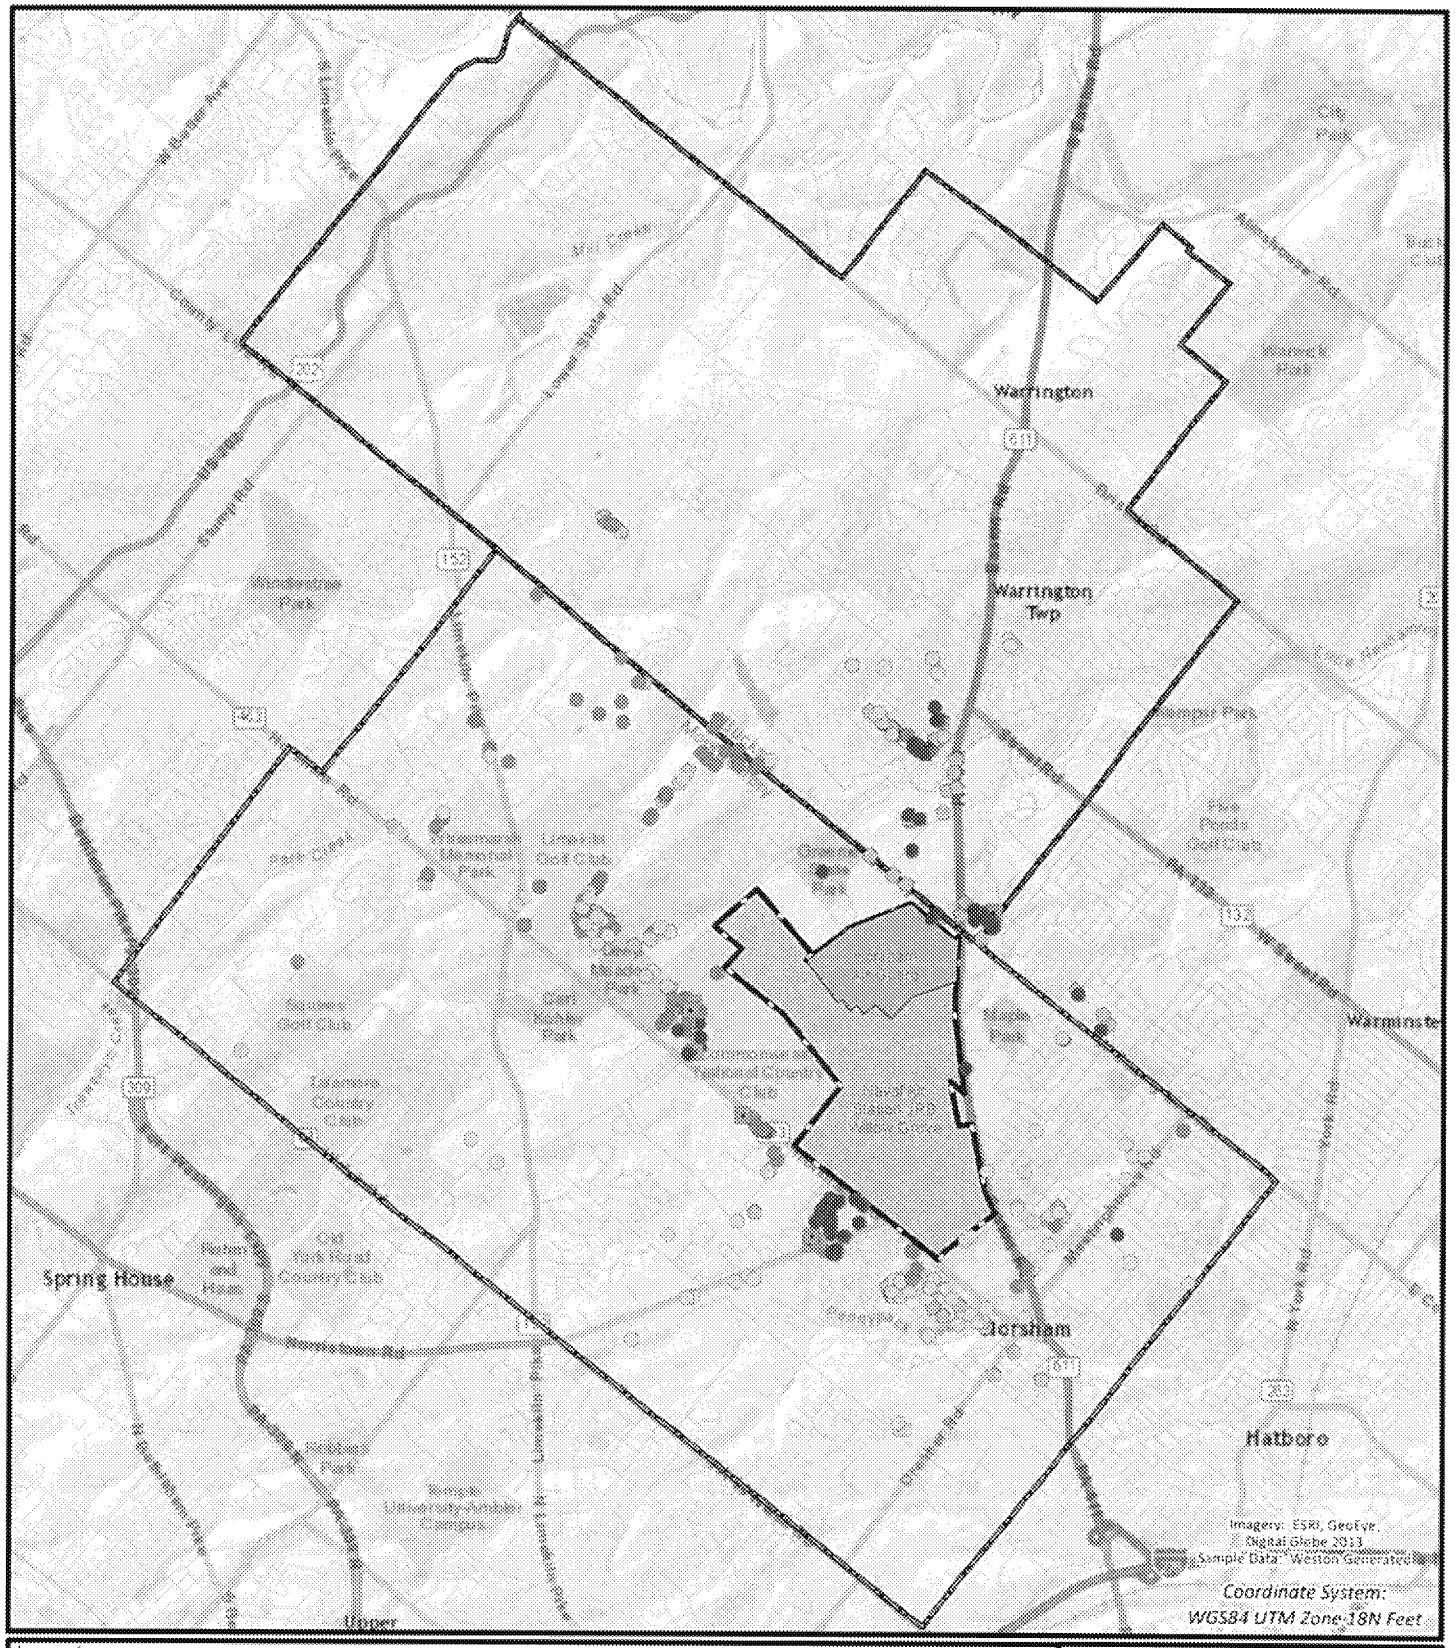

Legend

Provisional Health Advisory Level (PHAL)
PFOA 0.4 µg/L, PFOS 0.2 µg/L

- PFOS and/or PFOA detected at/above the PHALs
- PFOS and/or PFOA detected at/above ¼ the PHALs
- PFOS and/or PFOA detected at/above ¼ the PHALs (supplied water)
- PFOS and/or PFOA detected but below ¼ the PHALs
- Non-detect for PFOS or PFOA
- Location sampled (no results yet)
- Not scheduled for sampling yet

0 — 8,000 Feet

- Horsham Township
- Warrington Township
- Horsham Air Guard
- Former NAS JRB Willow Grove

N

Willow Grove Naval Air Station Site

Figure 1
PFC Sample Location Map
as of 04/30/2015

TDD#: WS01-14-08-0004
Contract: EP-S3-10-05
Prepared: 5/4/2015

WESTON

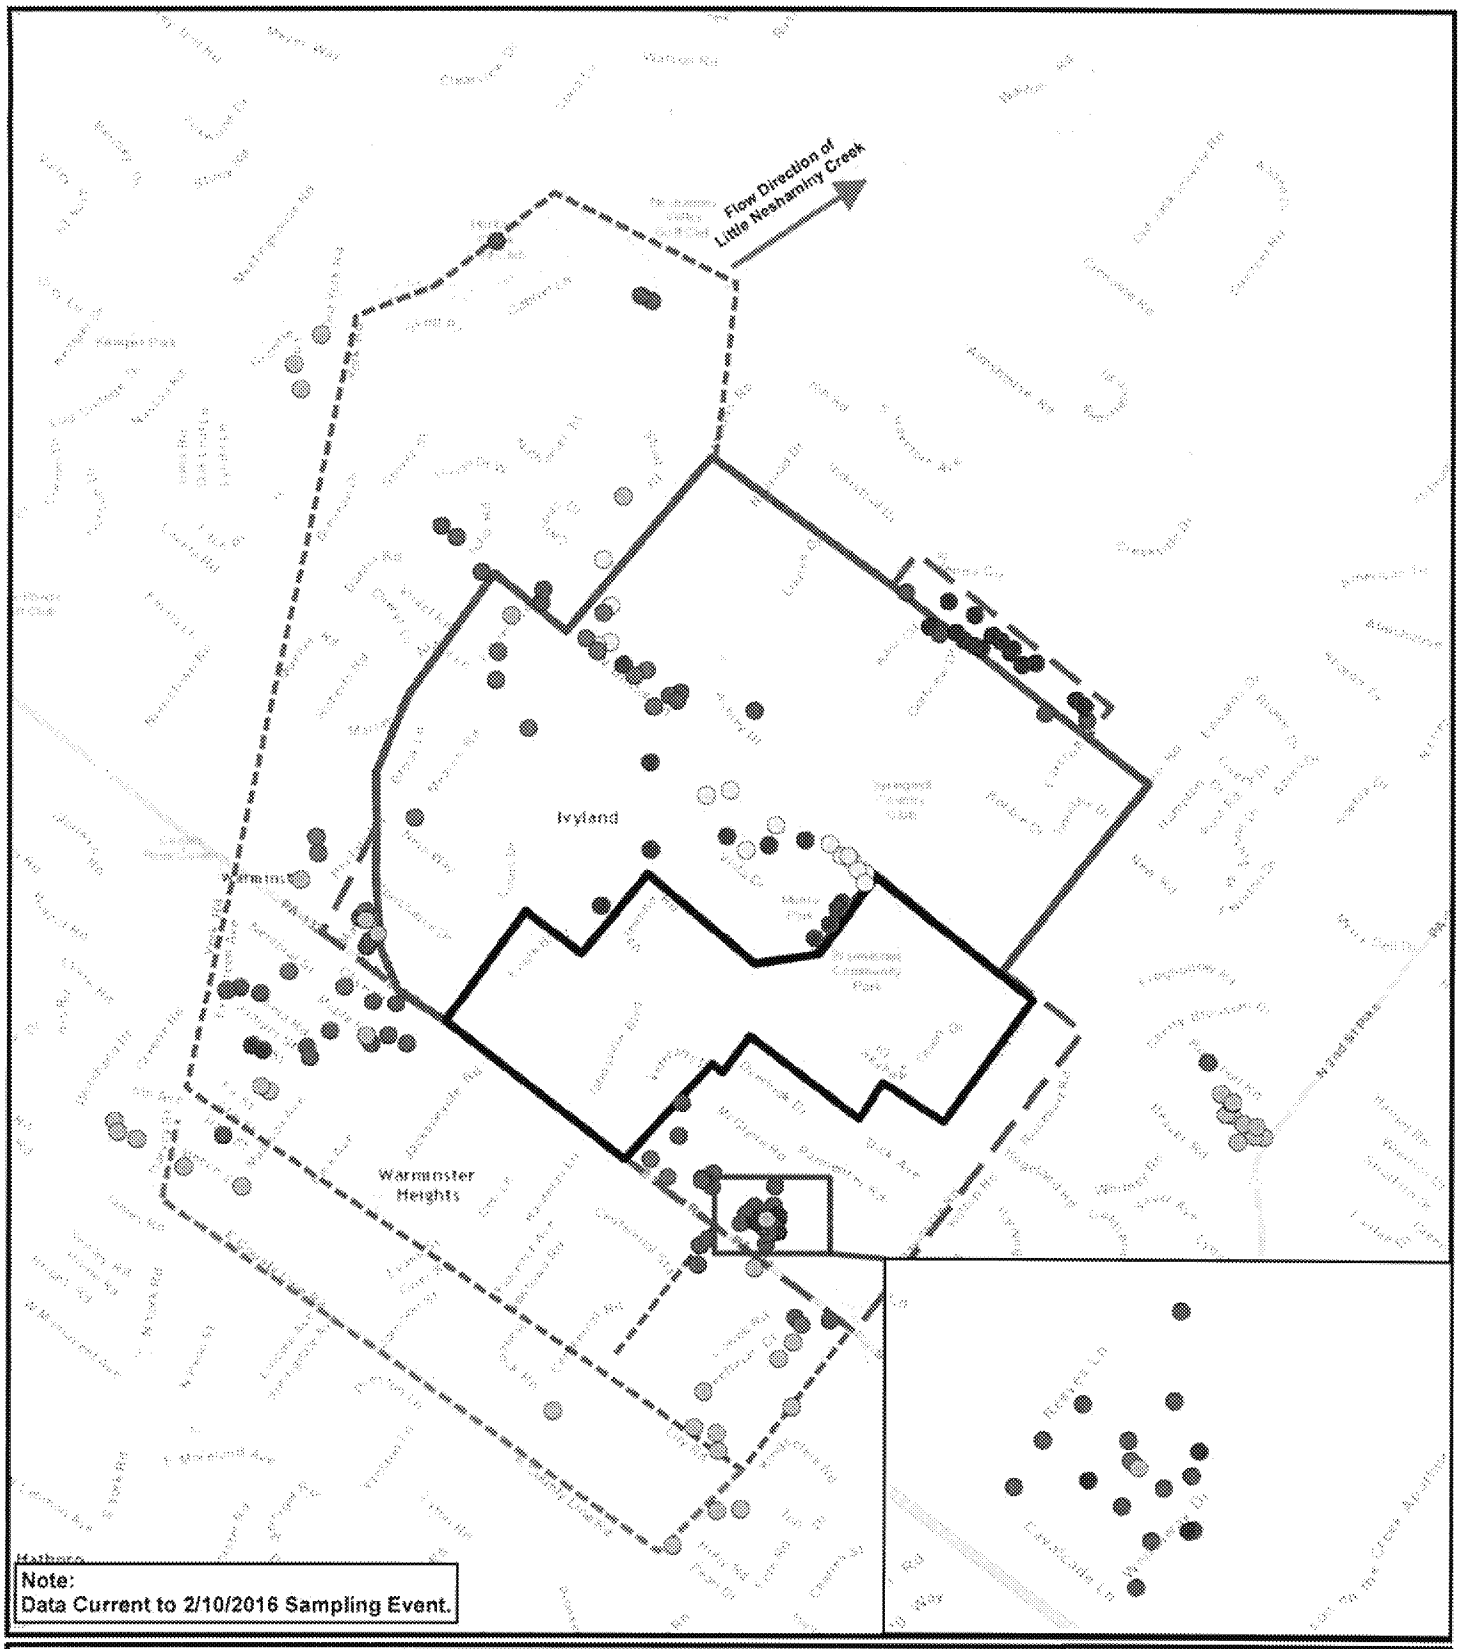

Legend
Provisional Health Advisory Level (PHAL)
PFOA 0.4 µg/L, PFOS 0.2 µg/L

- Above 0.15 PFOS/ 0.35 PFOA
- Above 0.05ug/L PFOS/ 0.1 ug/L PFOA
- Above 0.025ug/L PFOS or PFOA
- Above 0.01ug/L PFOS or PFOA
- Detected below 0.01 ug/L for PFOS/PFOA
- ND for PFOS/PFOA
- Pending results

Former Naval Air Warfare Center
Expanded Sampling Area
Initial Investigation Area

Coordinate System:
WGS84 UTM Zone 18N Feet

Imagery: ESRI, GeoEye, Digital Globe 2013

N 0 3,000

Warminster, Bucks County, PA

Figure 1
PFC Sample Location Map

TDD#: WS01-14-06-001
Contract: EP-S3-10-05
Prepared: 4/6/2016

WESTON

File: Y:\EPA_Region_III\Naval_Air_Development_Center\MXD\PFC_sample_location_04052016_Concentrations.mxd, 4/6/2016 10:10:38 AM, jphno