US EPA RECORDS CENTER REGION 5
452131

7.5 minute USGS TOPOS:
ENGLEWOOD - 1956 REV 72+80
BERWYN 1963 REV 1972

3 mile RADIUS FOR
Sinclair & Valentine
ROS-8410-01
Chicago, IL
IL 0327

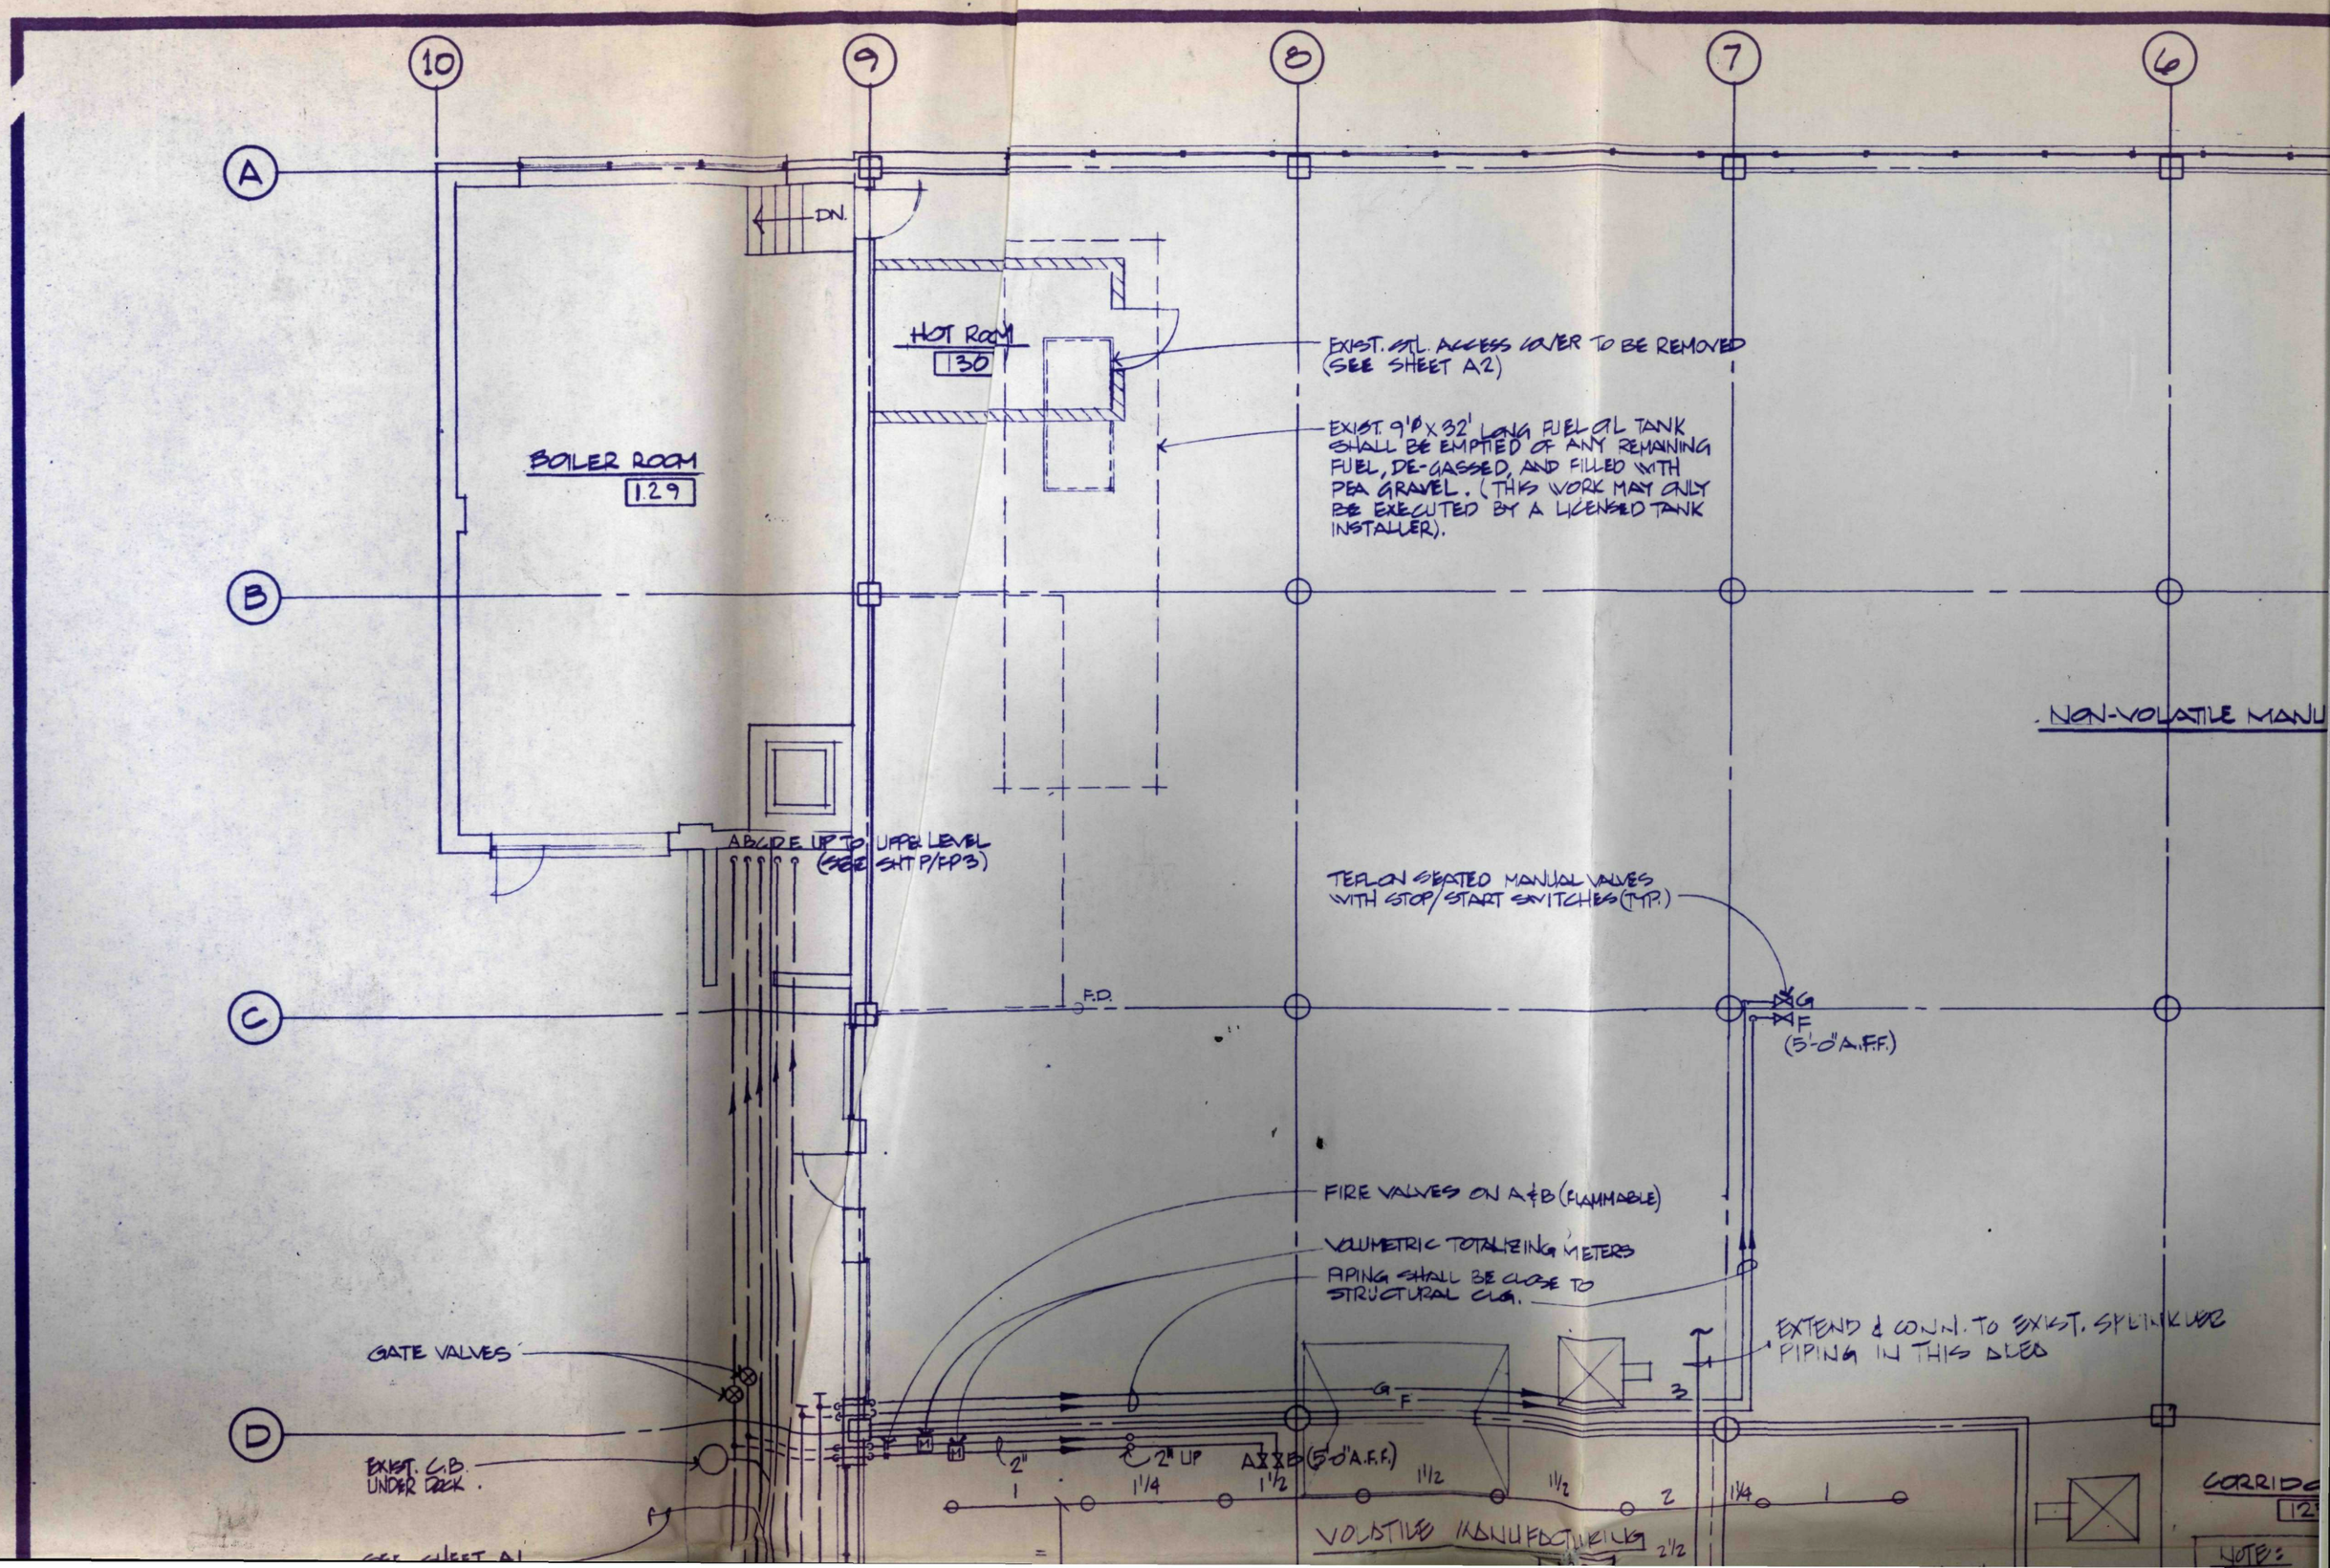
10
9
8
7
6
A
B
C
D
DN.
HOT ROOM
130
BOILER ROOM
129
EXIST. STL. ACCESS COVER TO BE REMOVED (SEE SHEET A2)
EXIST. 9'Ø X 32' LONG FUEL OIL TANK SHALL BE EMPTIED OF ANY REMAINING FUEL, DE-GASSED, AND FILLED WITH PEA GRAVEL. (THIS WORK MAY ONLY BE EXECUTED BY A LICENSED TANK INSTALLER).
NON-VOLATILE MANU
ABOVE UP TO UPPER LEVEL (SEE SHT P/FP3)
TEFLON SEATED MANUAL VALVES WITH STOP/START SWITCHES (TYP.)
F.D.
G
F
(5'-0" A.F.F.)
FIRE VALVES ON A & B (FLAMMABLE)
VOLUMETRIC TOTALIZING METERS
PIPING SHALL BE CLOSE TO STRUCTURAL CLG.
EXTEND & CONN. TO EXIST. SPRINKLER PIPING IN THIS AREA
GATE VALVES
EXIST. C.B. UNDER DECK
2"
2" UP
A B (5'-0" A.F.F.)
1
1 1/4
1 1/2
1 1/2
1 1/2
2
1 1/4
1
3
2 1/2
VOLATILE MANUFACTURING
CORRIDO
12
NOTE: