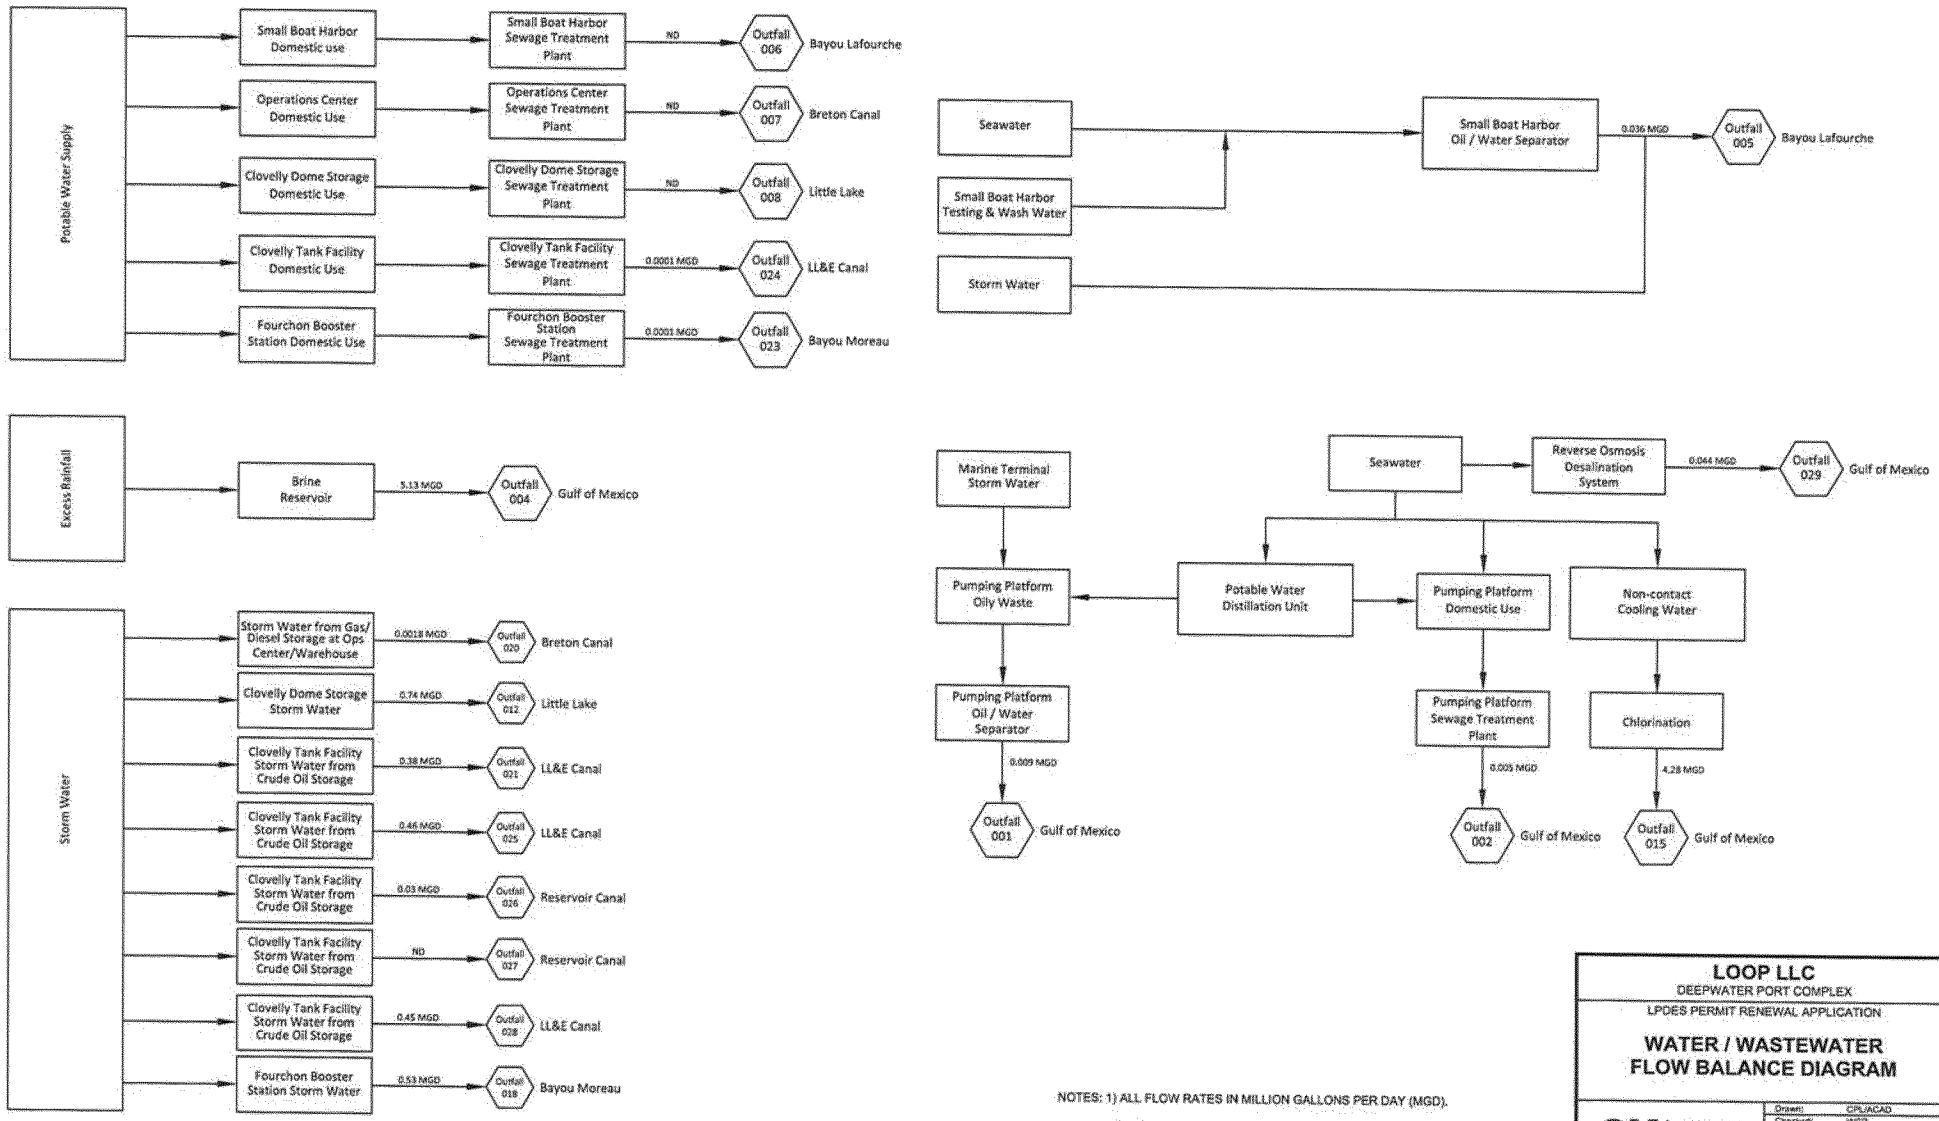

NOTES: 1) ALL FLOW RATES IN MILLION GALLONS PER DAY (MGD).

2) ALL FLOW RATES ARE LONG-TERM AVERAGES (WHEN DISCHARGING).

3) ND = NO DISCHARGE

LOOP LLC

DEEPWATER PORT COMPLEX

LPDES PERMIT RENEWAL APPLICATION

WATER / WASTEWATER FLOW BALANCE DIAGRAM

CK ASSOCIATES

Drawn:	CPL/ACAD
Checked:	WCD
Approved:	DJL
Date:	08/07/2015
Dwg. No.:	B8873-15

FIGURE 14

ED_001774D_00023016-00001