STATE OF CALIFORNIA

GEORGE DEUKMEJIAN, Governor

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD—
LOS ANGELES REGION
101 CENTRE PLAZA DRIVE
MONTEREY PARK, CALIFORNIA 91754-2156
(213) 266-7500

RECEIVED
MAY 8 1990
WCC-SANTA ANA

May 7, 1990

Mr. Daniel Palacios
Environmental Compliance
Douglas Aircraft
3855 Lakewood Boulevard
Long Beach, CA 90846

ONE-TIME DISCHARGE OF TREATED GROUND WATER TO STORM DRAIN AT DOUGLAS AIRCRAFT COMPANY'S C6 TORRANCE FACILITY (I.D.# 905020025), 19503 SOUTH NORMANDIE AVENUE, TORRANCE, CA

We have reviewed a letter dated April 18, 1990 requesting permission to discharge treated ground water, collected during aquifer testing, to the storm drain. In review of your request, and the included water analysis, we have the following comments:

Woodward-Clyde Consultants provided this Regional Board with the aquifer test analysis. According to this analysis, none of the constituents exceeded the Department of Health Services' Action Levels. Based on this effluent analysis, permission is conditionally granted to discharge treated effluent to the storm drain.

The discharge shall be limited to the approximate 22,000 gallons currently stored on-site. The discharger shall submit a report summarizing discharge operations to this Board by June 11, 1990. If discharge conditions change, this Board must be notified for further review and approval before discharging. Any permit that may be required by a local agency shall be obtained prior to any discharge.

If you have any questions, please contact me at (213) 266-7522.

Joshua M. Walters

for HANK H. YACOUB
Supervising Water Resource
Control Engineer

cc: Mr. Gary Yamamoto, Department of Health Services, Sanitary Engineering Branch
Mr. Carl Sjoberg, County of Los Angeles, Department of Public Works, Underground Tank Unit
Dr. Alistaire Callender, Woodward-Clyde Consultants

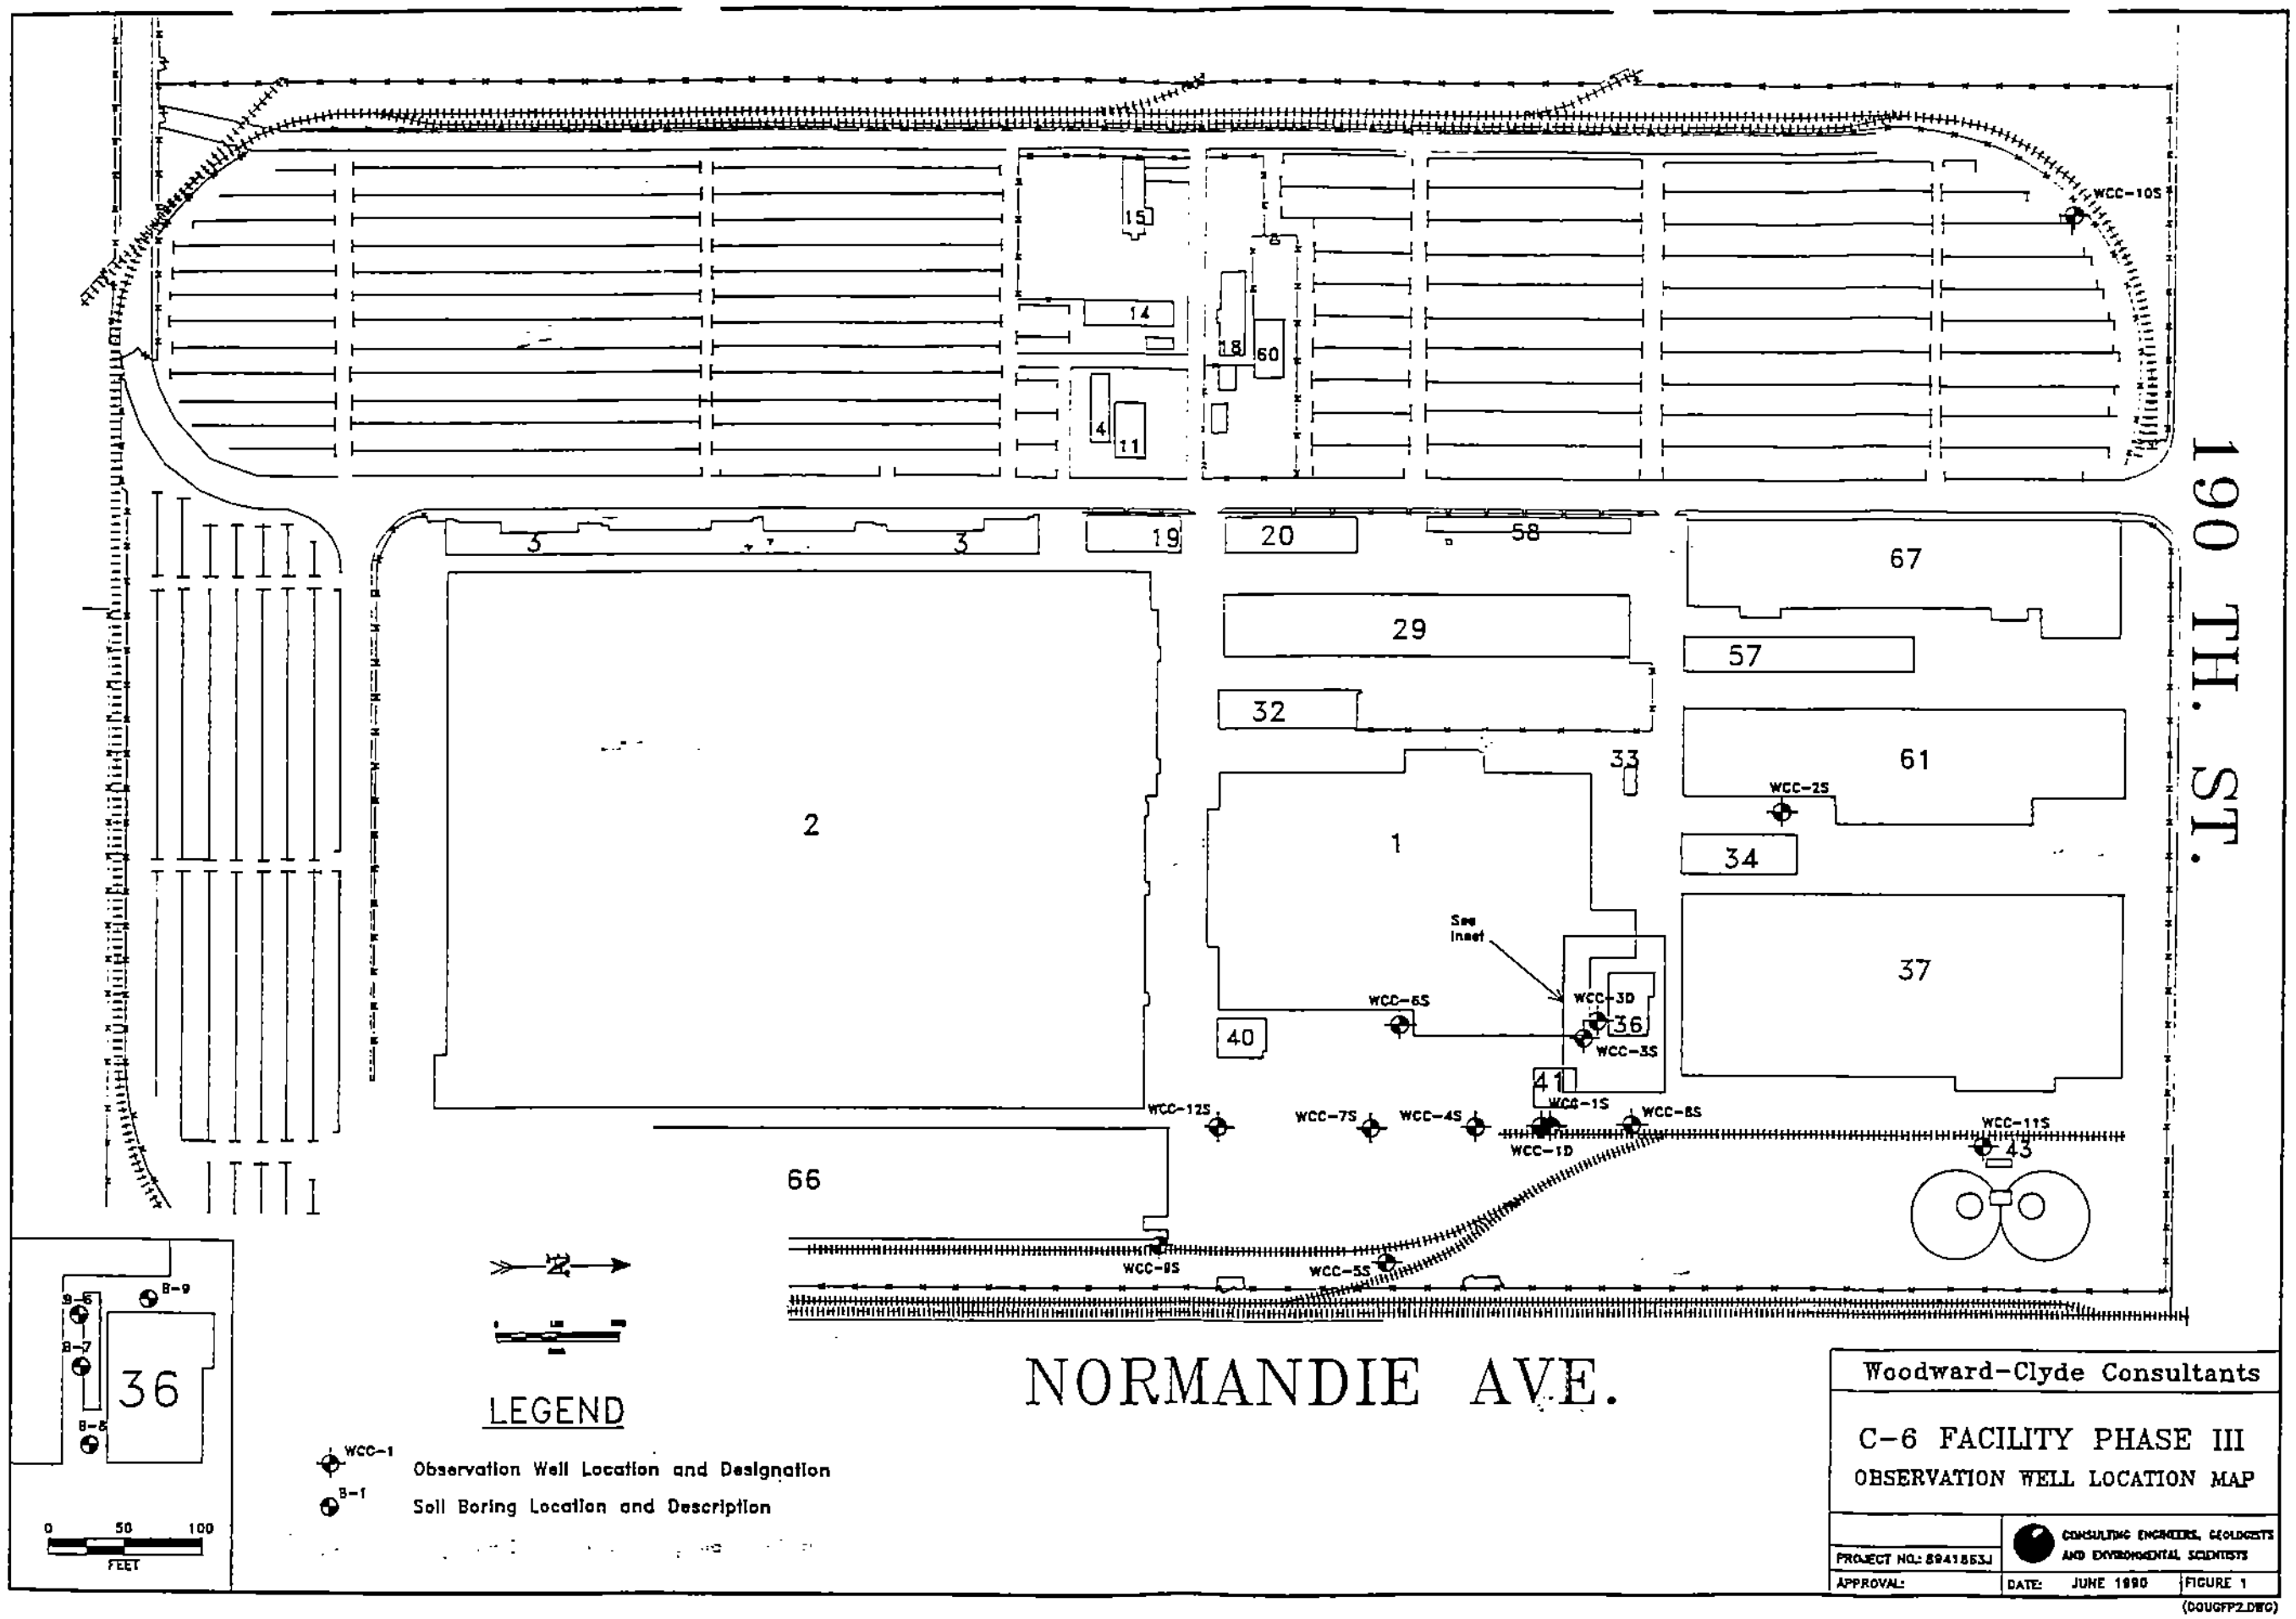

BOE-C6-0140911

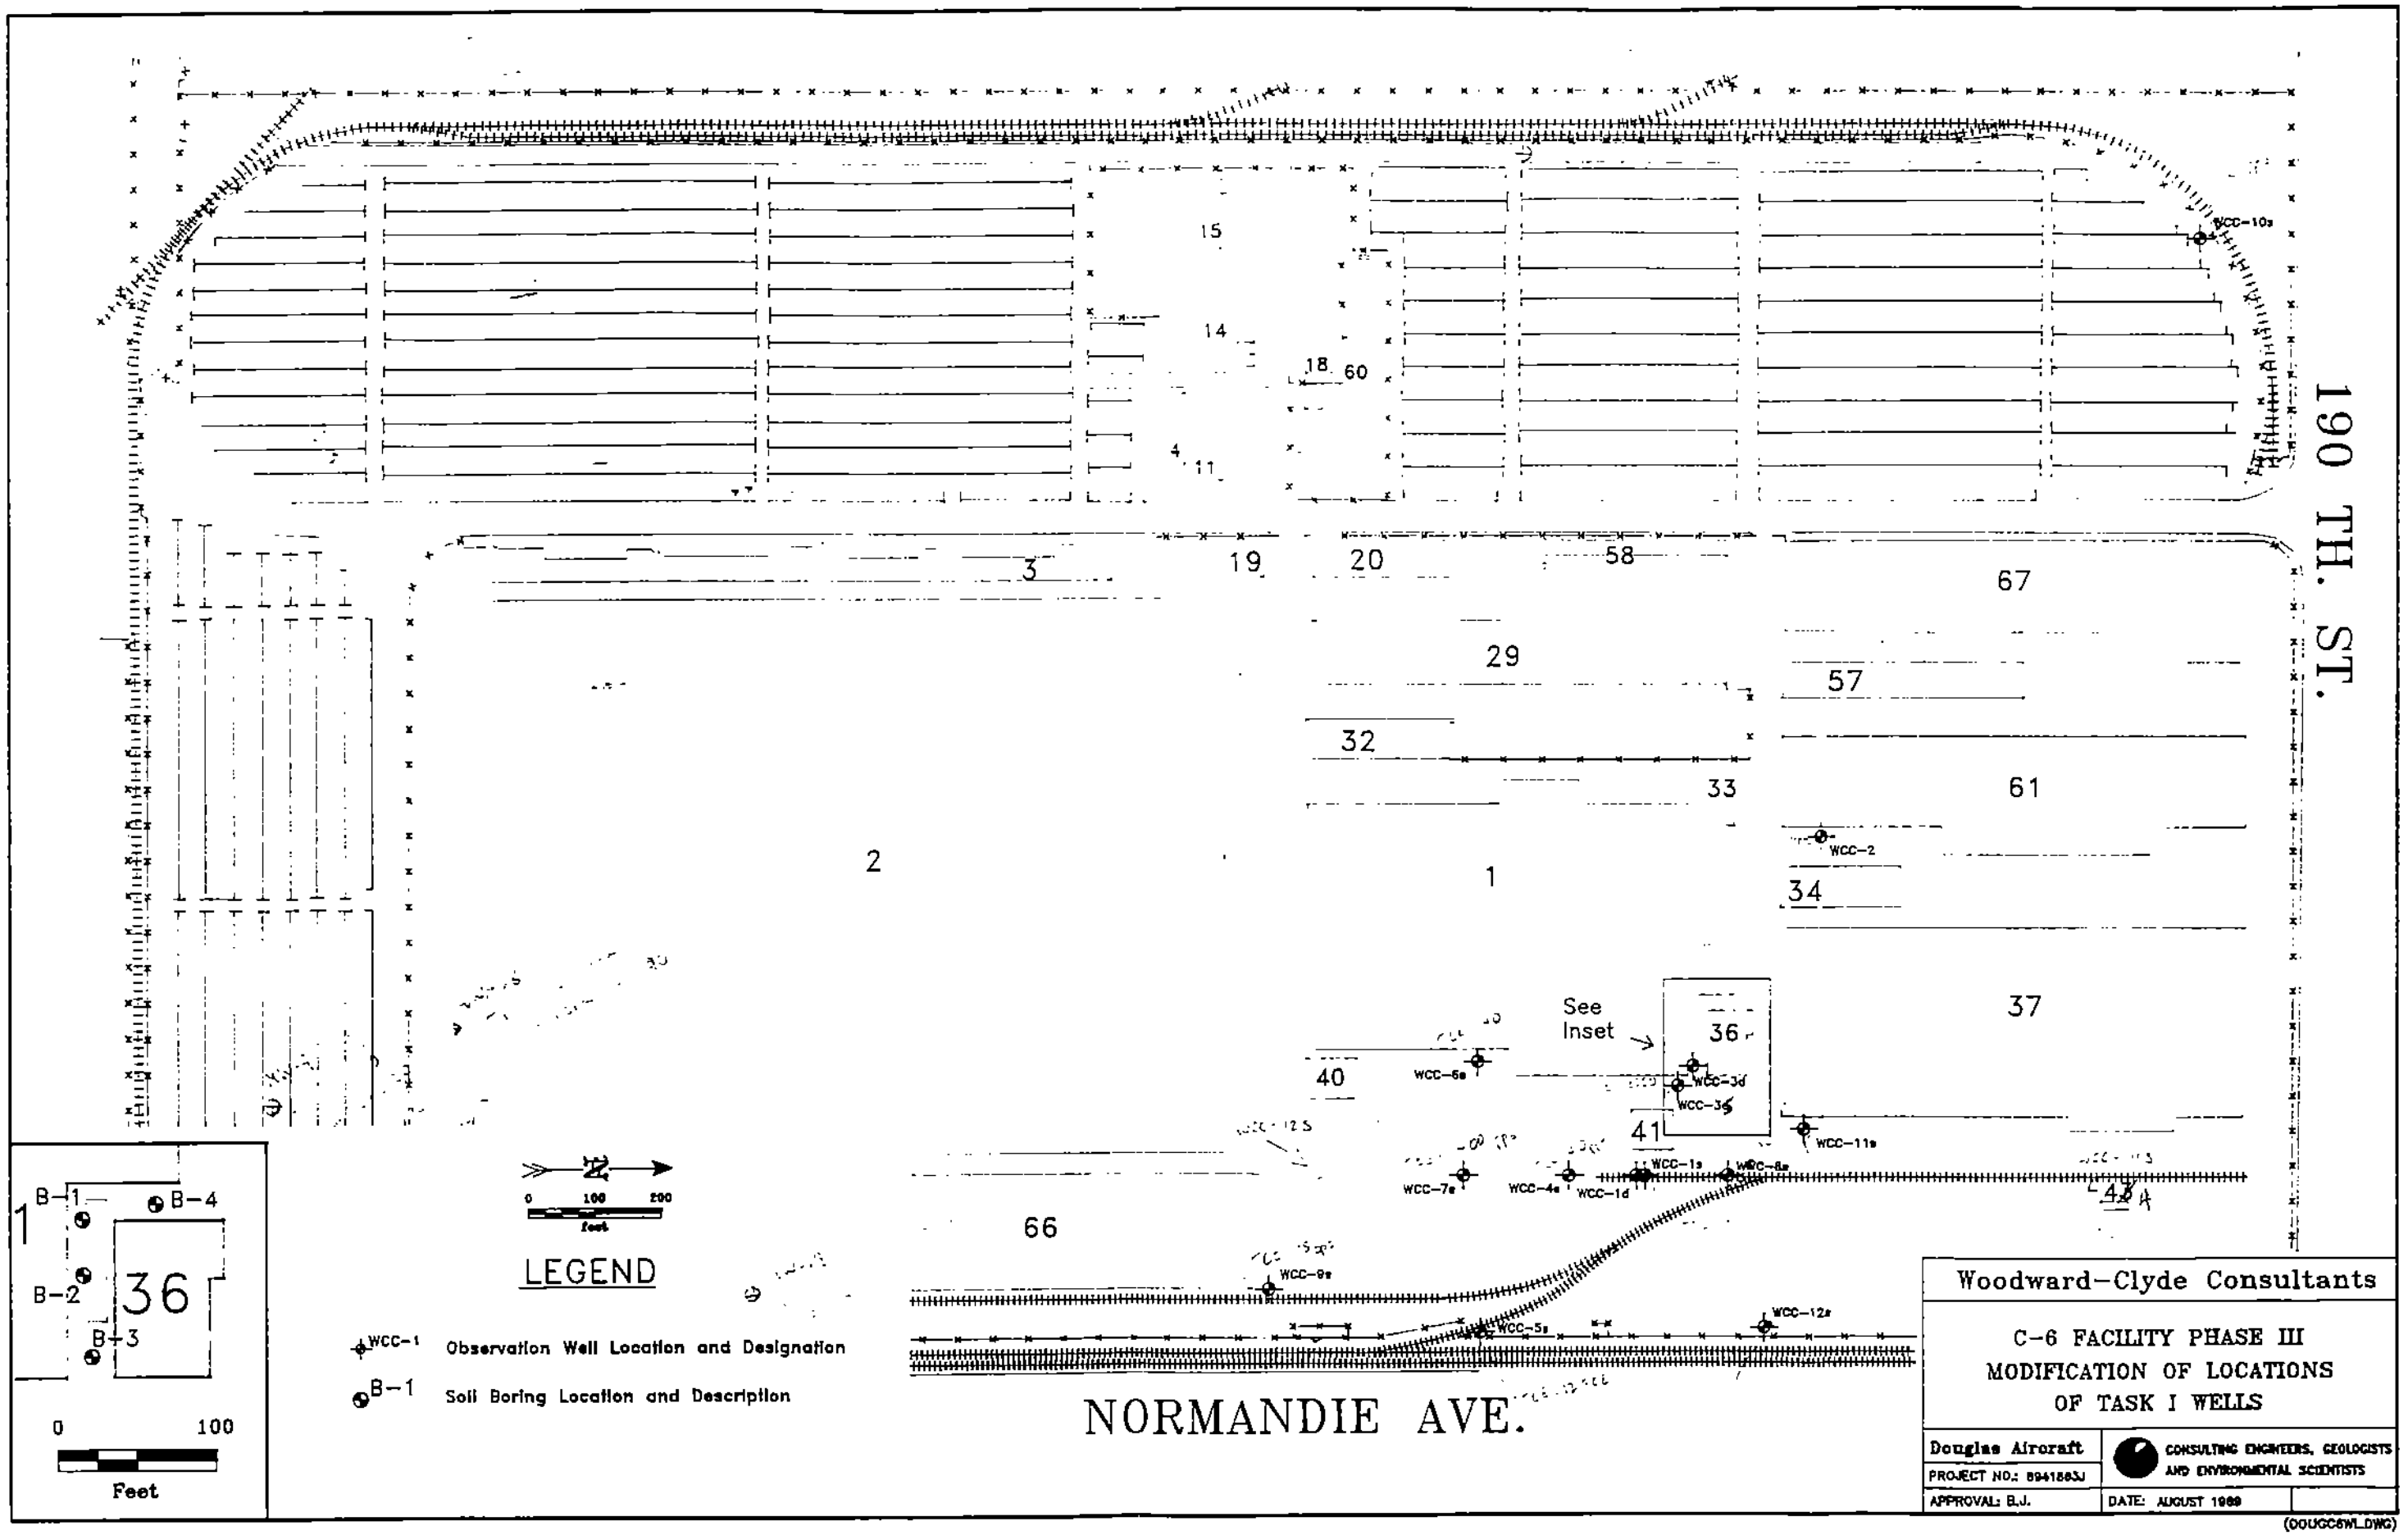
190 TH. ST.
NORMANDIE AVE.
15
14
18
60
4
11
3
19
20
58
67
29
57
32
33
61
2
1
WCC-2
34
37
See Inset
36
40
41
66
WCC-6s
WCC-3d
WCC-3s
WCC-11s
WCC-7s
WCC-4s
WCC-1d
WCC-1s
WCC-8s
WCC-9s
WCC-5s
WCC-12s
WCC-10s
B-1
B-2
B-3
B-4
0
100
Feet
LEGEND
WCC-1 Observation Well Location and Designation
B-1 Soil Boring Location and Description
Woodward-Clyde Consultants
C-6 FACILITY PHASE III
MODIFICATION OF LOCATIONS
OF TASK I WELLS
Douglas Aircraft
PROJECT NO.: 8941883J
APPROVAL: B.J.
DATE: AUGUST 1989
CONSULTING ENGINEERS, GEOLOGISTS AND ENVIRONMENTAL SCIENTISTS
(DOUGC6WL.DWG)

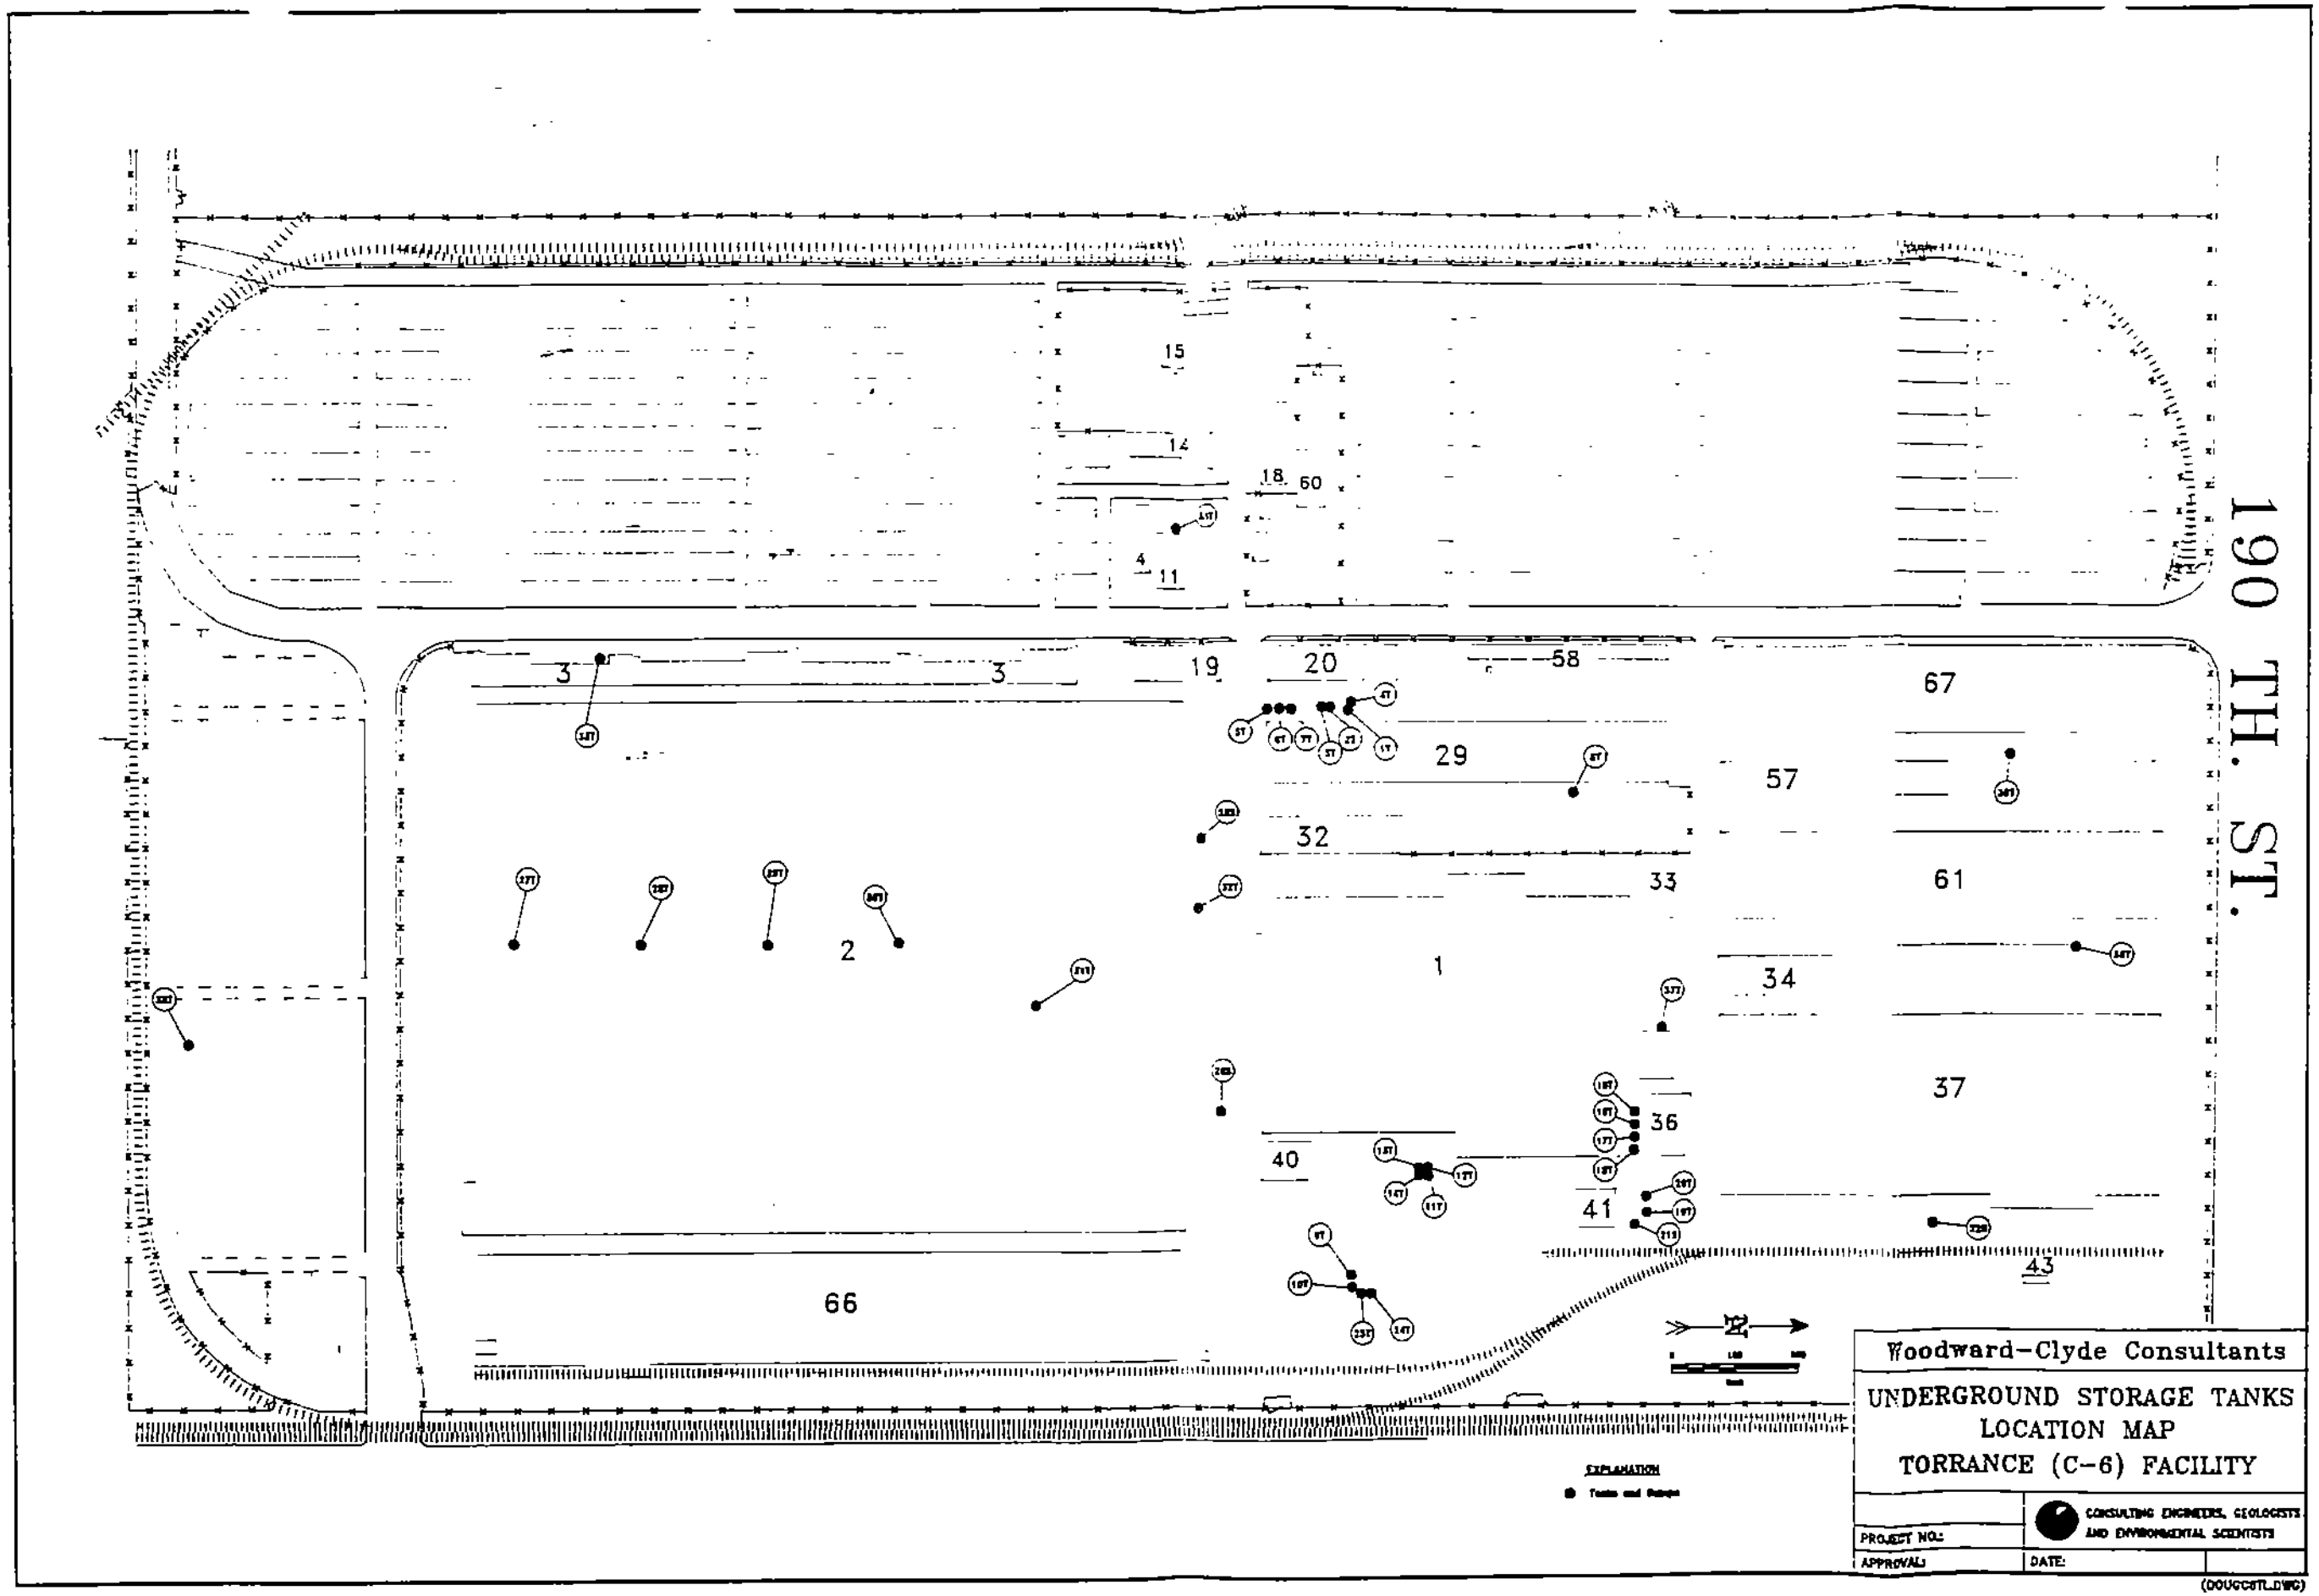

BOE-C6-0140913

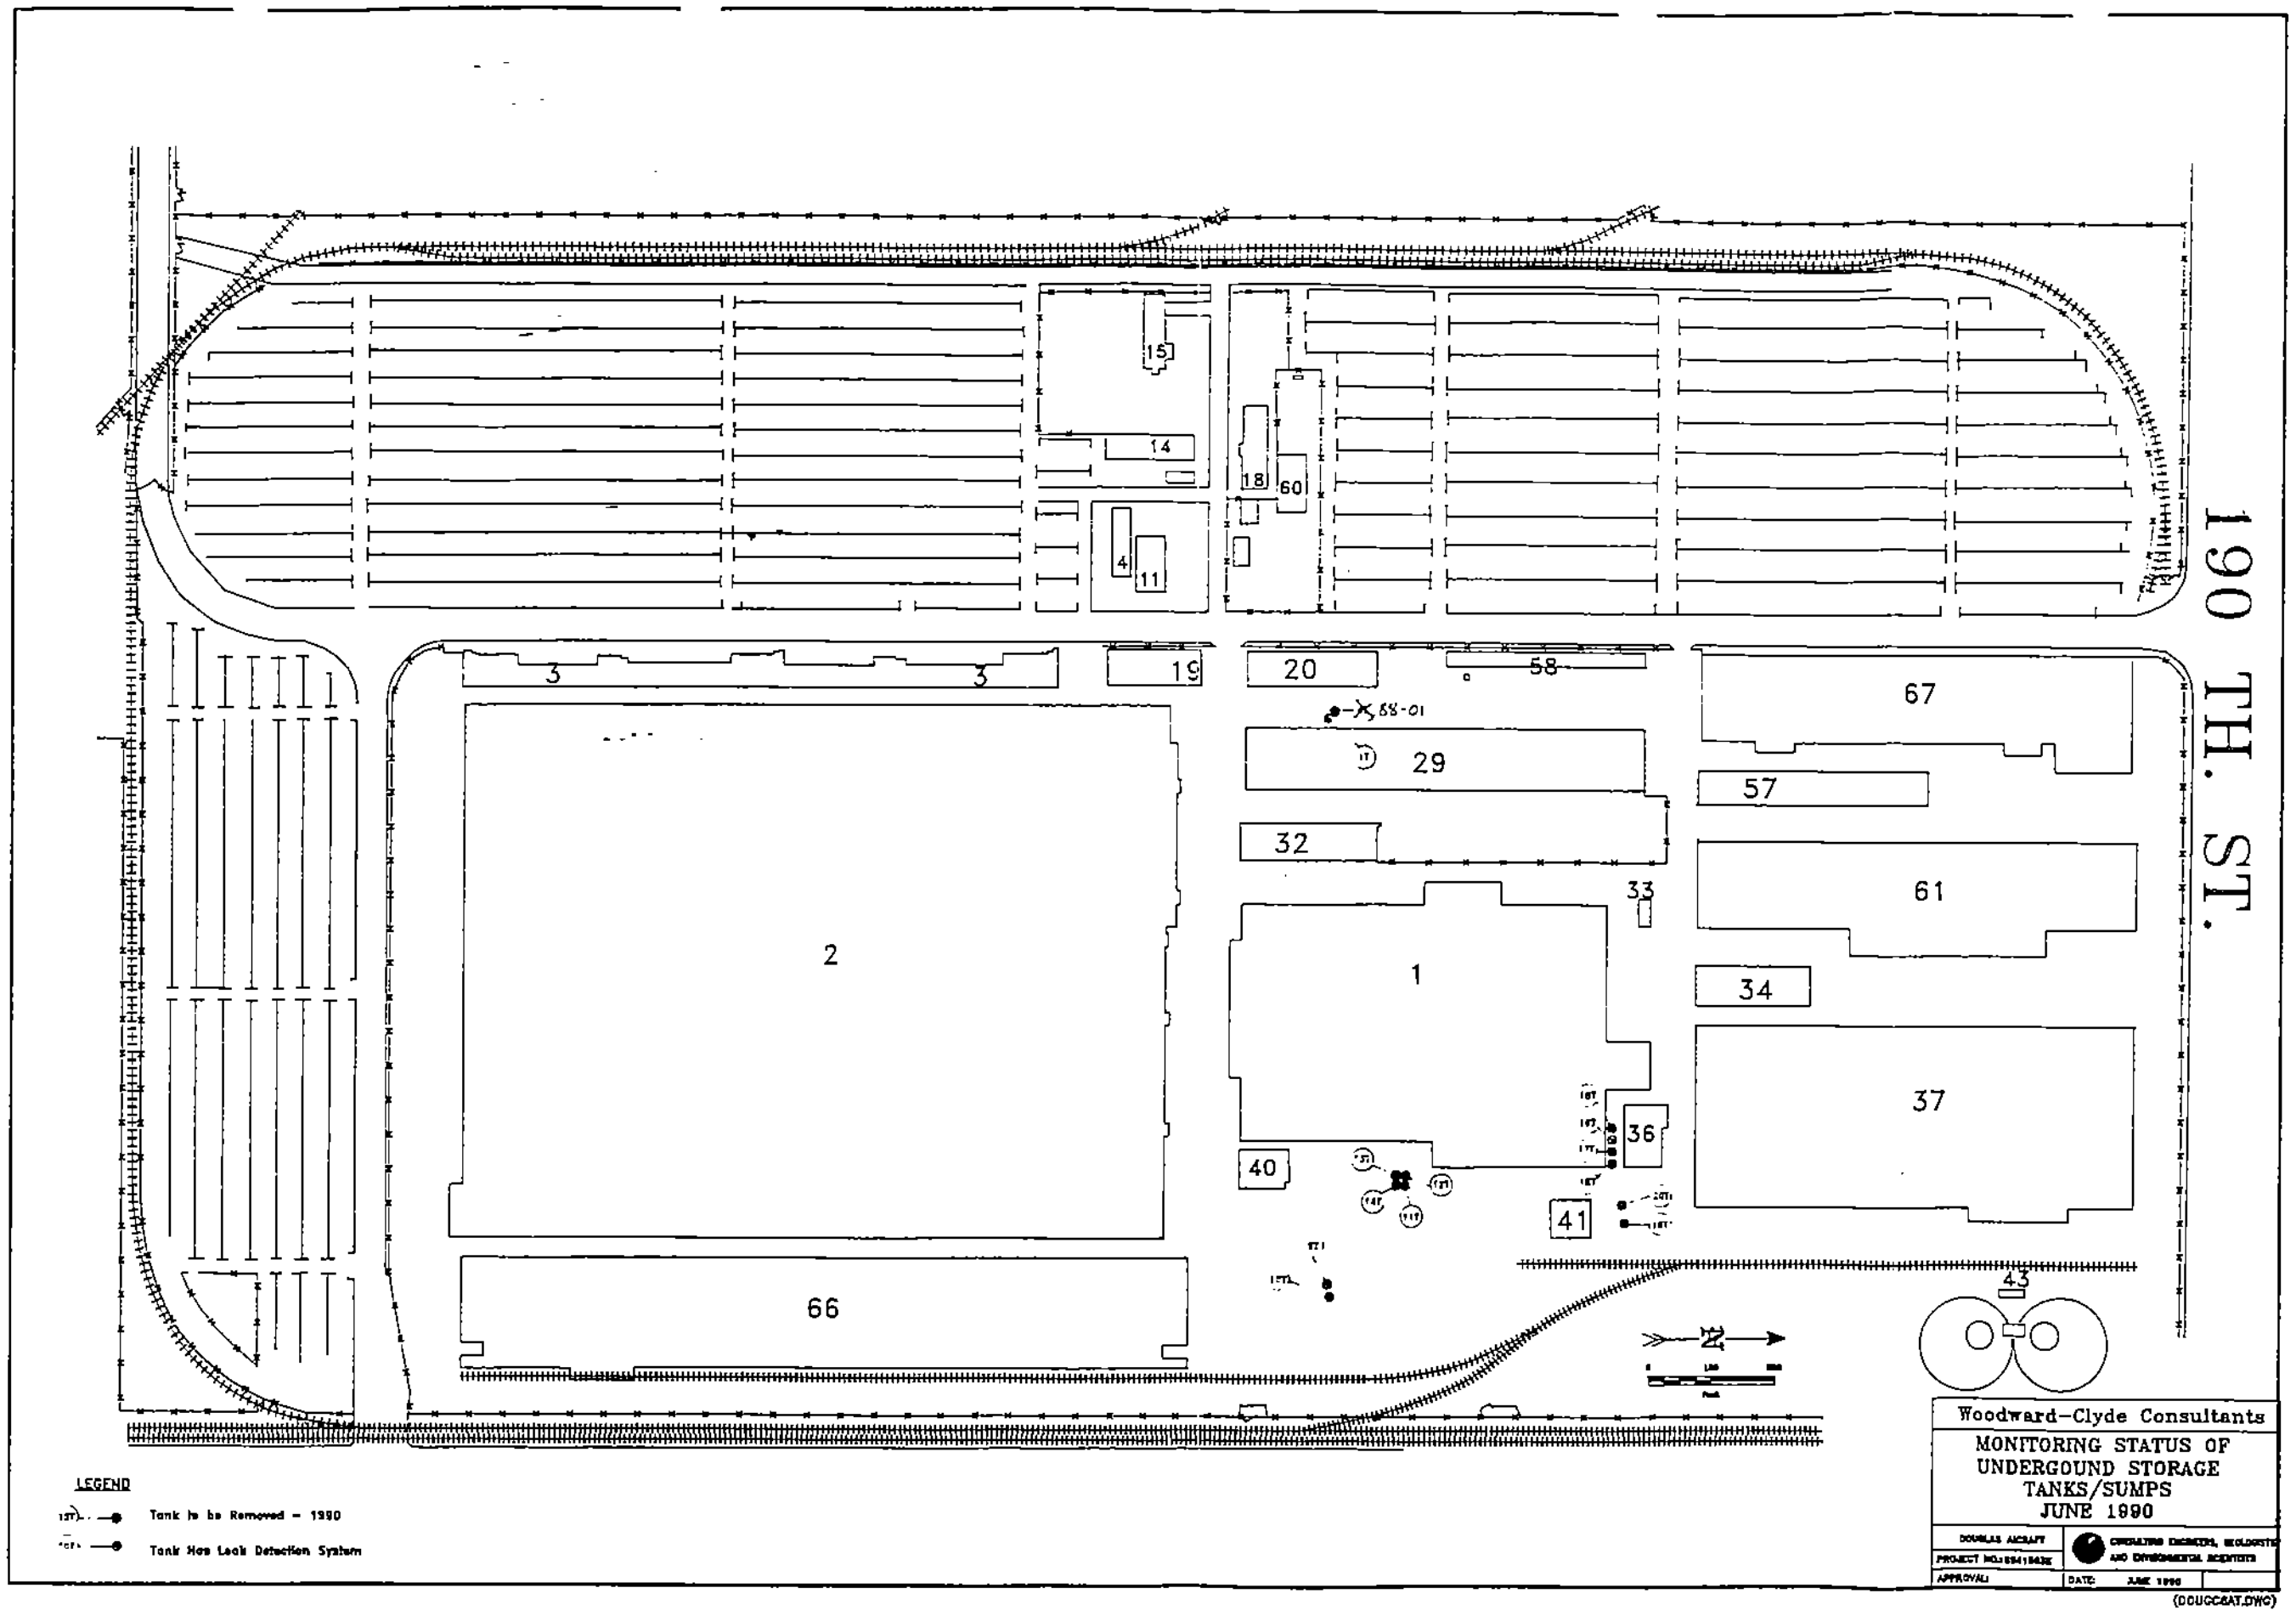

BOE-C6-0140914