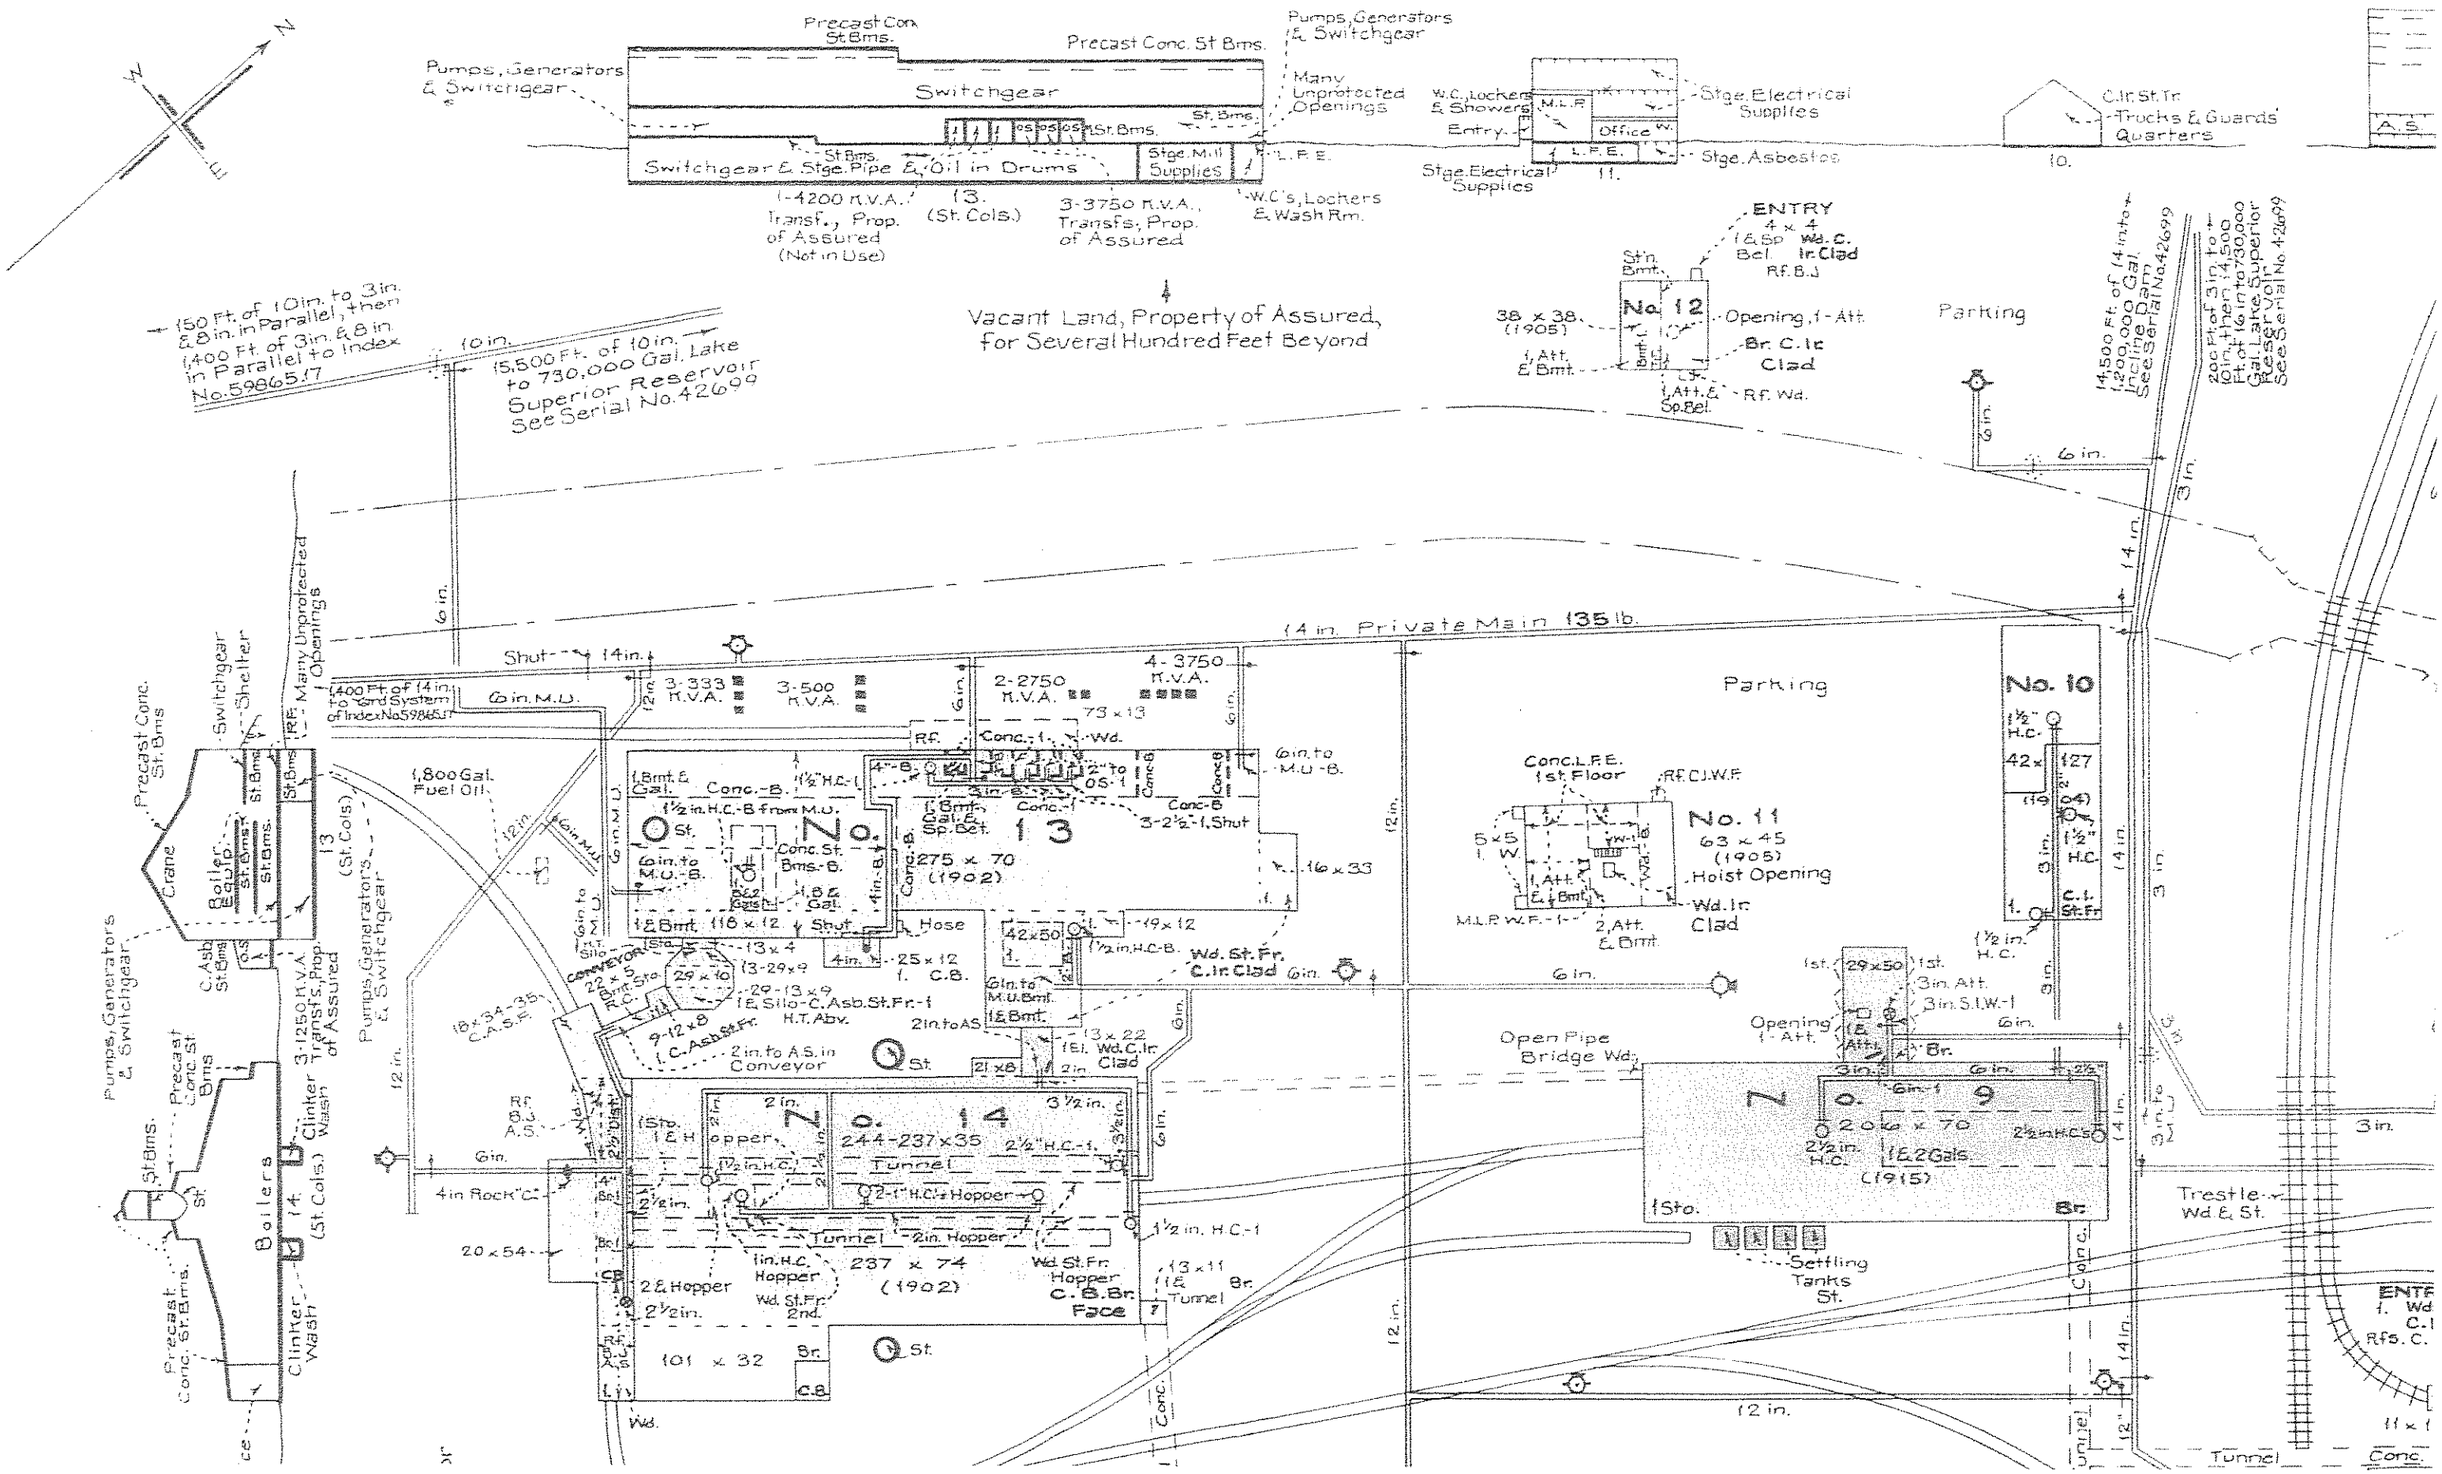

Precast Con. St. Bms.
Precast Conc. St Bms.
Pumps, Generators & Switchgear
Switchgear
Many Unprotected Openings
Switchgear & Stge. Pipe & Oil in Drums
Stge. Mill Supplies
1-4200 K.V.A. Transf., Prop. of Assured (Not in Use)
13. (St. Cols.)
3-3750 K.V.A. Transfs, Prop. of Assured
W.C's, Lockers & Wash Rm.
W.C., Lockers & Showers
Entry
Office
Stge. Electrical Supplies
Stge. Asbestos
11.
10.
C.Ir. St. Tr.
Trucks & Guards' Quarters
A.S.
Vacant Land, Property of Assured, for Several Hundred Feet Beyond
ENTRY
4 x 4
Wd. C. Ir. Clad
No. 12
38 x 38 (1905)
Opening, 1-Att.
Br. C. Ir. Clad
Parking
150 Ft. of 10 in. to 3 in. & 8 in. in Parallel, then 1,400 Ft. of 3 in. & 8 in. in Parallel to Index No. 59865.17
15,500 Ft. of 10 in. to 730,000 Gal. Lake Superior Reservoir See Serial No. 42699
14,500 Ft. of 14 in. to 1,200,000 Gal. Incline Dam See Serial No. 42699
200 Ft. of 3 in. to 10 in., then 14,500 Ft. of 16 in. to 730,000 Gal. Lake Superior Reservoir See Serial No. 42699
14 in. Private Main 135 lb.
Shut
14 in.
3-333 K.V.A.
3-500 K.V.A.
2-2750 K.V.A.
4-3750 K.V.A.
73 x 13
No. 13
275 x 70 (1902)
No. 10
42 x 127 (1904)
No. 11
63 x 45 (1905)
Hoist Opening
Wd. Ir. Clad
Conc. L.F.E. 1st Floor
Rf. C.I.W.F.
Parking
Open Pipe Bridge Wd.
No. 14
244-237 x 35
Tunnel
237 x 74 (1902)
101 x 32
No. 9
206 x 70
1 & 2 Gals. (1915)
Settling Tanks St.
Trestle Wd. & St.
Boilers
Clinker Wash
Pumps, Generators & Switchgear
Precast Conc. St. Bms.
Crane
Switchgear Shelter
Many Unprotected Openings
1,800 Gal. Fuel Oil
3-1250 K.V.A. Transfs, Prop. of Assured
Conveyor
Hose
Wd. St. Fr. C. Ir. Clad
Wd. St. Fr. Hopper C. B. Br. Face
4 in Rock "C"
20 x 54
12 in.
14 in.
3 in.
6 in.