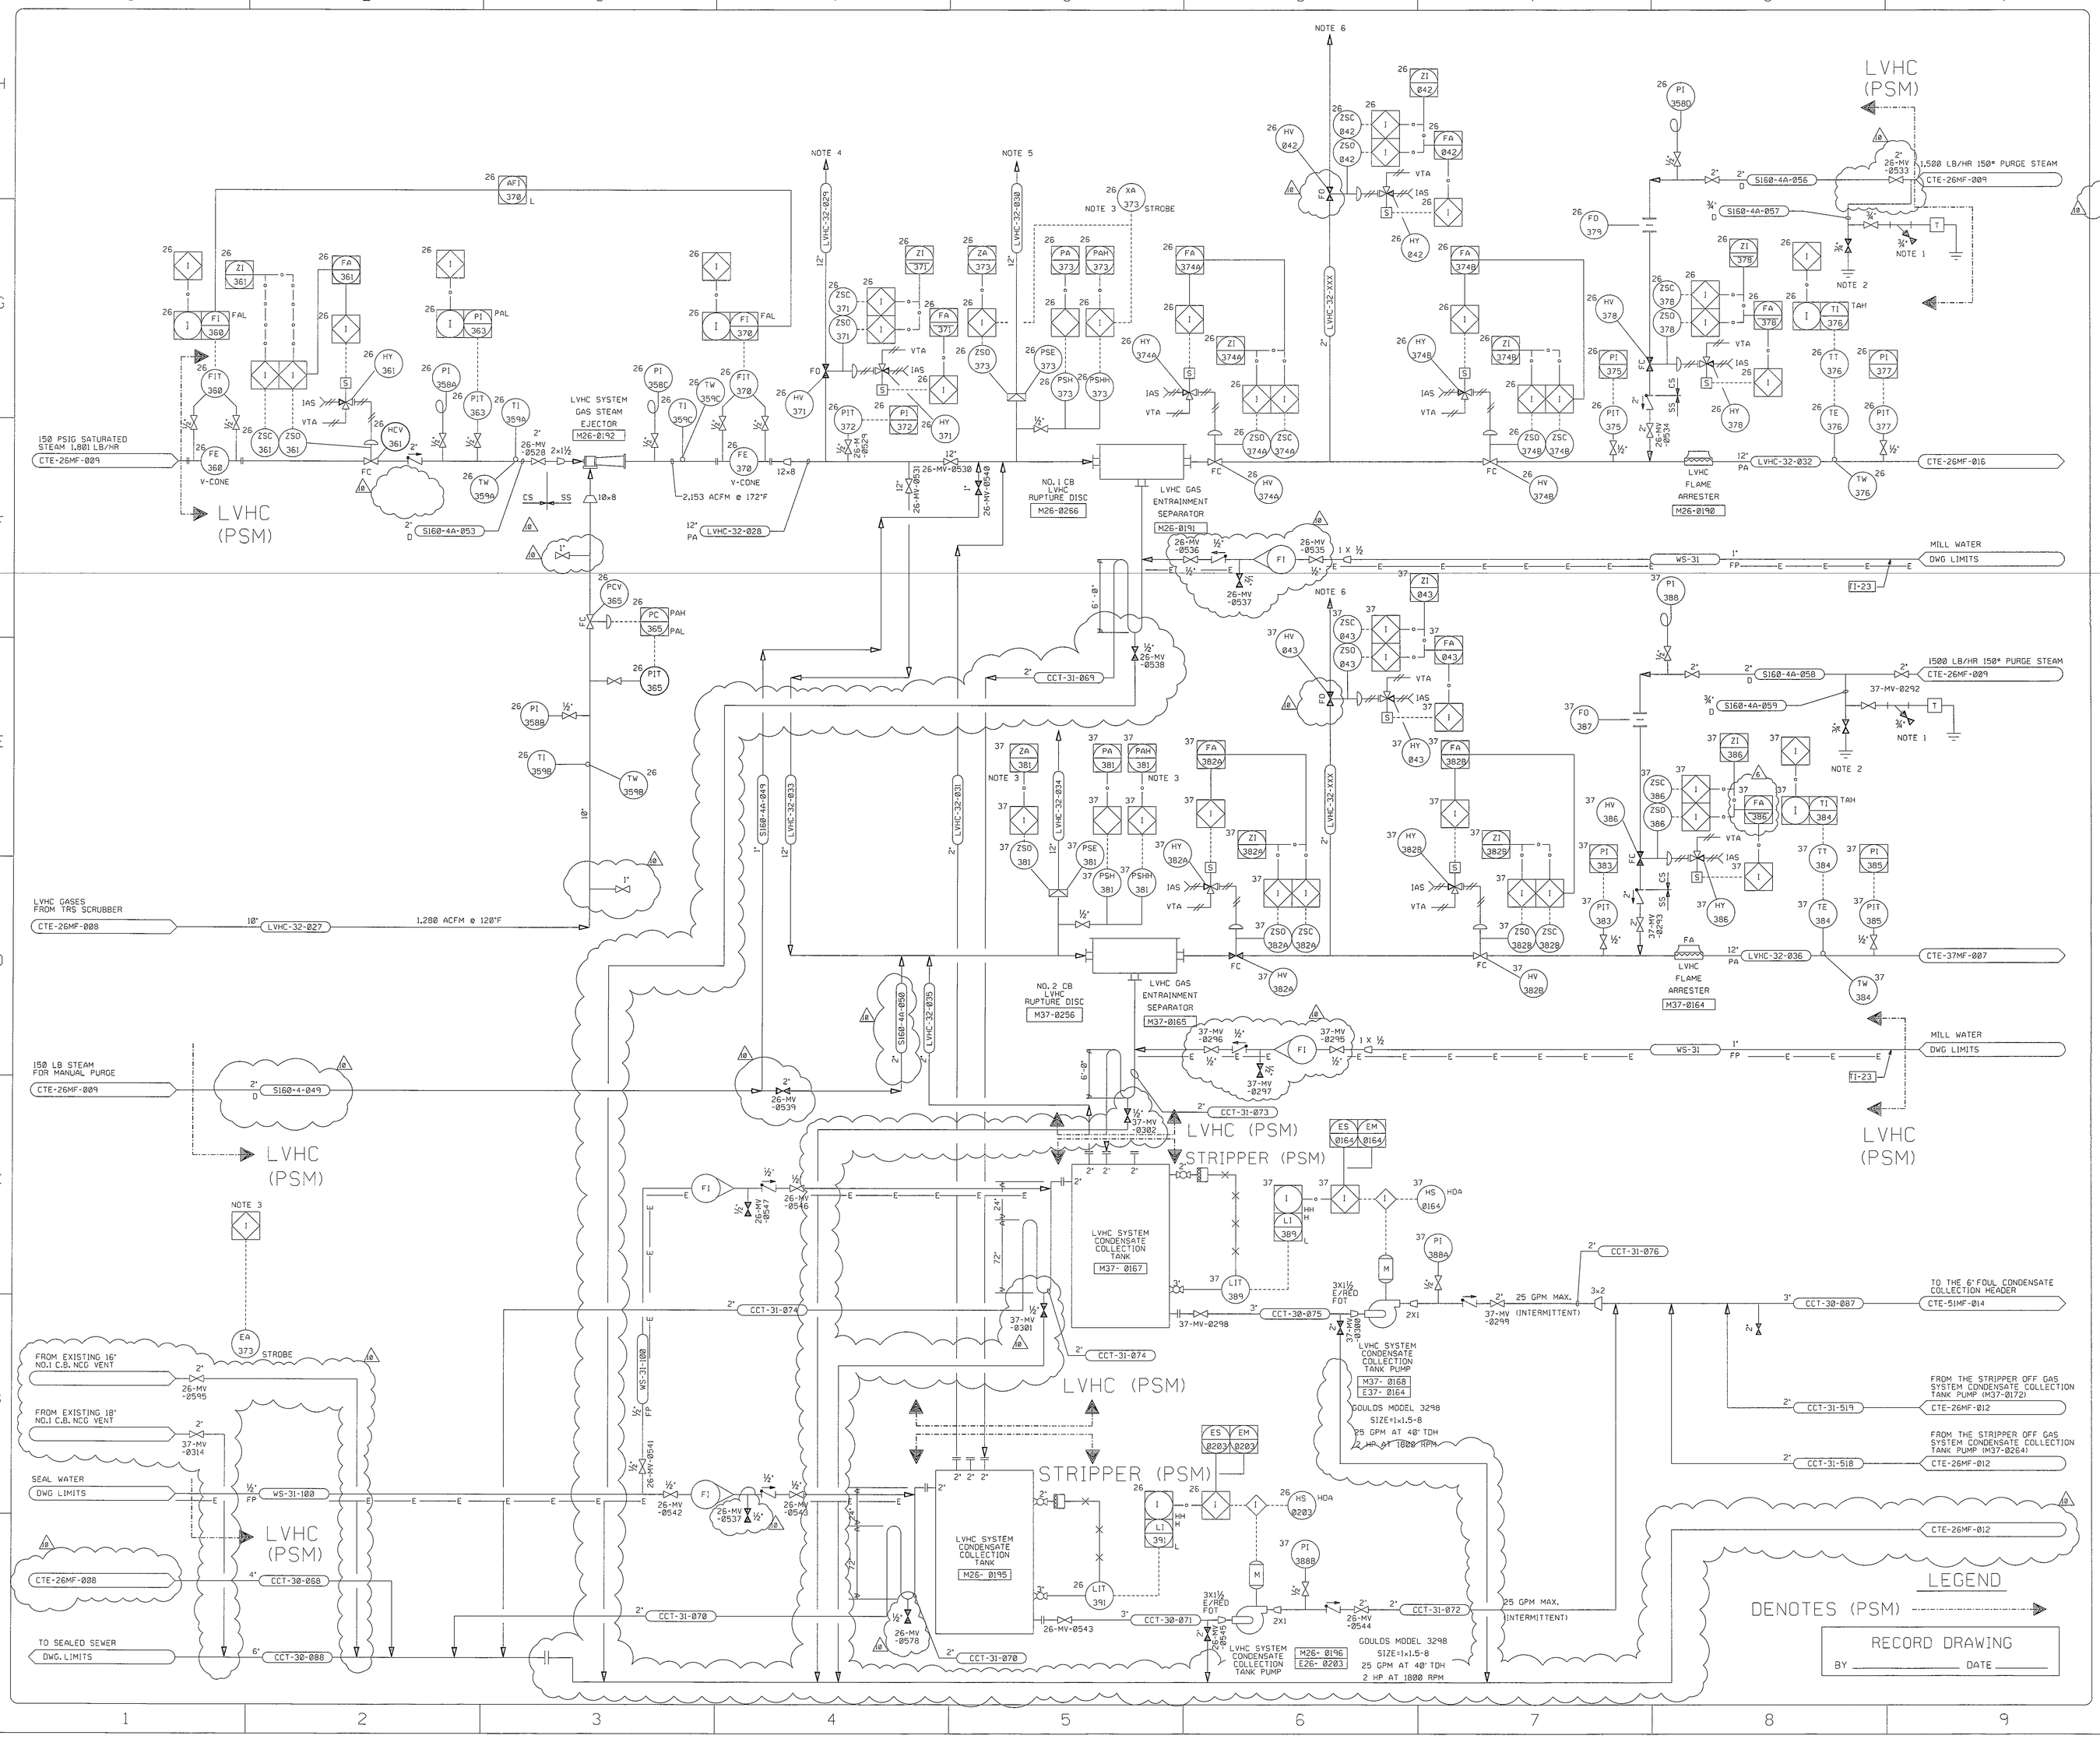

NOTES

1. THE PIPING DRAWING WILL SHOW THE ARRANGEMENT AND LOCATION OF EACH STEAM TRAP STATION.
2. DIRECT CONDENSATE DRAINS AWAY FROM PERSONNEL AND EQUIPMENT.
3. ACTIVATES RUPTURE DISC STROBE LIGHT 26-XA-373, LOCATED IN COMBINATION BOILER AREA, NEAR COL. M36.
4. THIS VENT LINE TIES INTO THE EXISTING "HIGH" VENT. THE VENT WILL DIRECT ALL GASES AWAY FROM PERSONNEL.
5. THIS VENT WILL BE DIRECTED AWAY FROM PERSONNEL
6. VENT TO BE TIED INTO 6" CCT-30-088.

REV. NO.	CODE	CIRCLES	DATE	DESCRIPTION	CHECKED BY	APPROVED	APPROVED
11	RRB	-	09 25 01	ADDED (PSM) PER GAH			
10	TTC	G	- 11 27 01	RELEASED FOR RECORD			
9	CAW	B	3 05 22 01	ADDED DOUBLE BLOCK AND BLEED			
8	TGT	B	9 01 26 01	CHANGED INSTRUMENT TAGS ADDED DRAIN			
7	TGT	B	18 12 21 00	ADDED LINE NUMBER, VALVES & CCT-30-068; REMOVED TIE-IN 28			
6	TGT	B	14 11 16 00	ADDED LOOP SEALS AND REMOVED THE INCENERATION NOZZLES			
5	TGT	B	4 08 09 00	RELEASED FOR DESIGN			
4	TGT	B	24 07 28 00	INCORPORATED HAZOP COMMENTS RELEASED FOR DESIGN			
3	TGT	B	30 06 12 00	RELEASED FOR DESIGN			
2	TGT	B	10 05 04 00	GENERAL REVISIONS	TGT	JDC	
1	TGT	B	03 27 00	ADDED INSTRUMENT NO.'S	TGT	JDC	
0	TGT	B	0 03 02 00	RELEASED FOR DESIGN	TGT	JDC	
A	TGT	A	02 07 00	RELEASED FOR CLIENT APPROVAL	TGT	JDC	

NOTE: CIRCLE ALL REVISIONS, IDENTIFY WITH DIAMOND, NUMBER AND ARROW. REMOVE ONLY CIRCLE AND ARROW BEFORE NEXT REVISION.

ISSUE CODE			
A	PRELIMINARY	C	MAT'L T.O.
B	DESIGN	D	MAT'L PURC.
		E	BIDS
		F	CONST'N
		G	RECORD

SEAL

SIGNATURE

DATE

BE&K ENGINEERING OF NORTH CAROLINA, INC.
2000 PERIMETER PARK DRIVE, SUITE 100
MORRISVILLE, NORTH CAROLINA 27560

DR. E. HYSINGER	DATE 01/05/00
DSGN. T. TOMPKINS	FILE NUMBER
CK.	
DPE T. TOMPKINS	JOB NO. 99-2069
Cadfile Name: 26MF010.DGN	

BOWATER
COATED PAPER & PULP DIV.
P.O. Box 7, Catawba, South Carolina 29704

DRAWING TITLE
CLUSTER RULE PROJECT
LVHC COLLECTION SYS.
NO.1 & 2 COMB.BOILER
P & I DIAGRAM

BE&K DRAWING NUMBER
069-P0-005

CLIENT DRAWING NUMBER
CTE-26MF-010