EXHIBIT "A"

DISTRICT FACILITIES & EXPORT PIPELINE

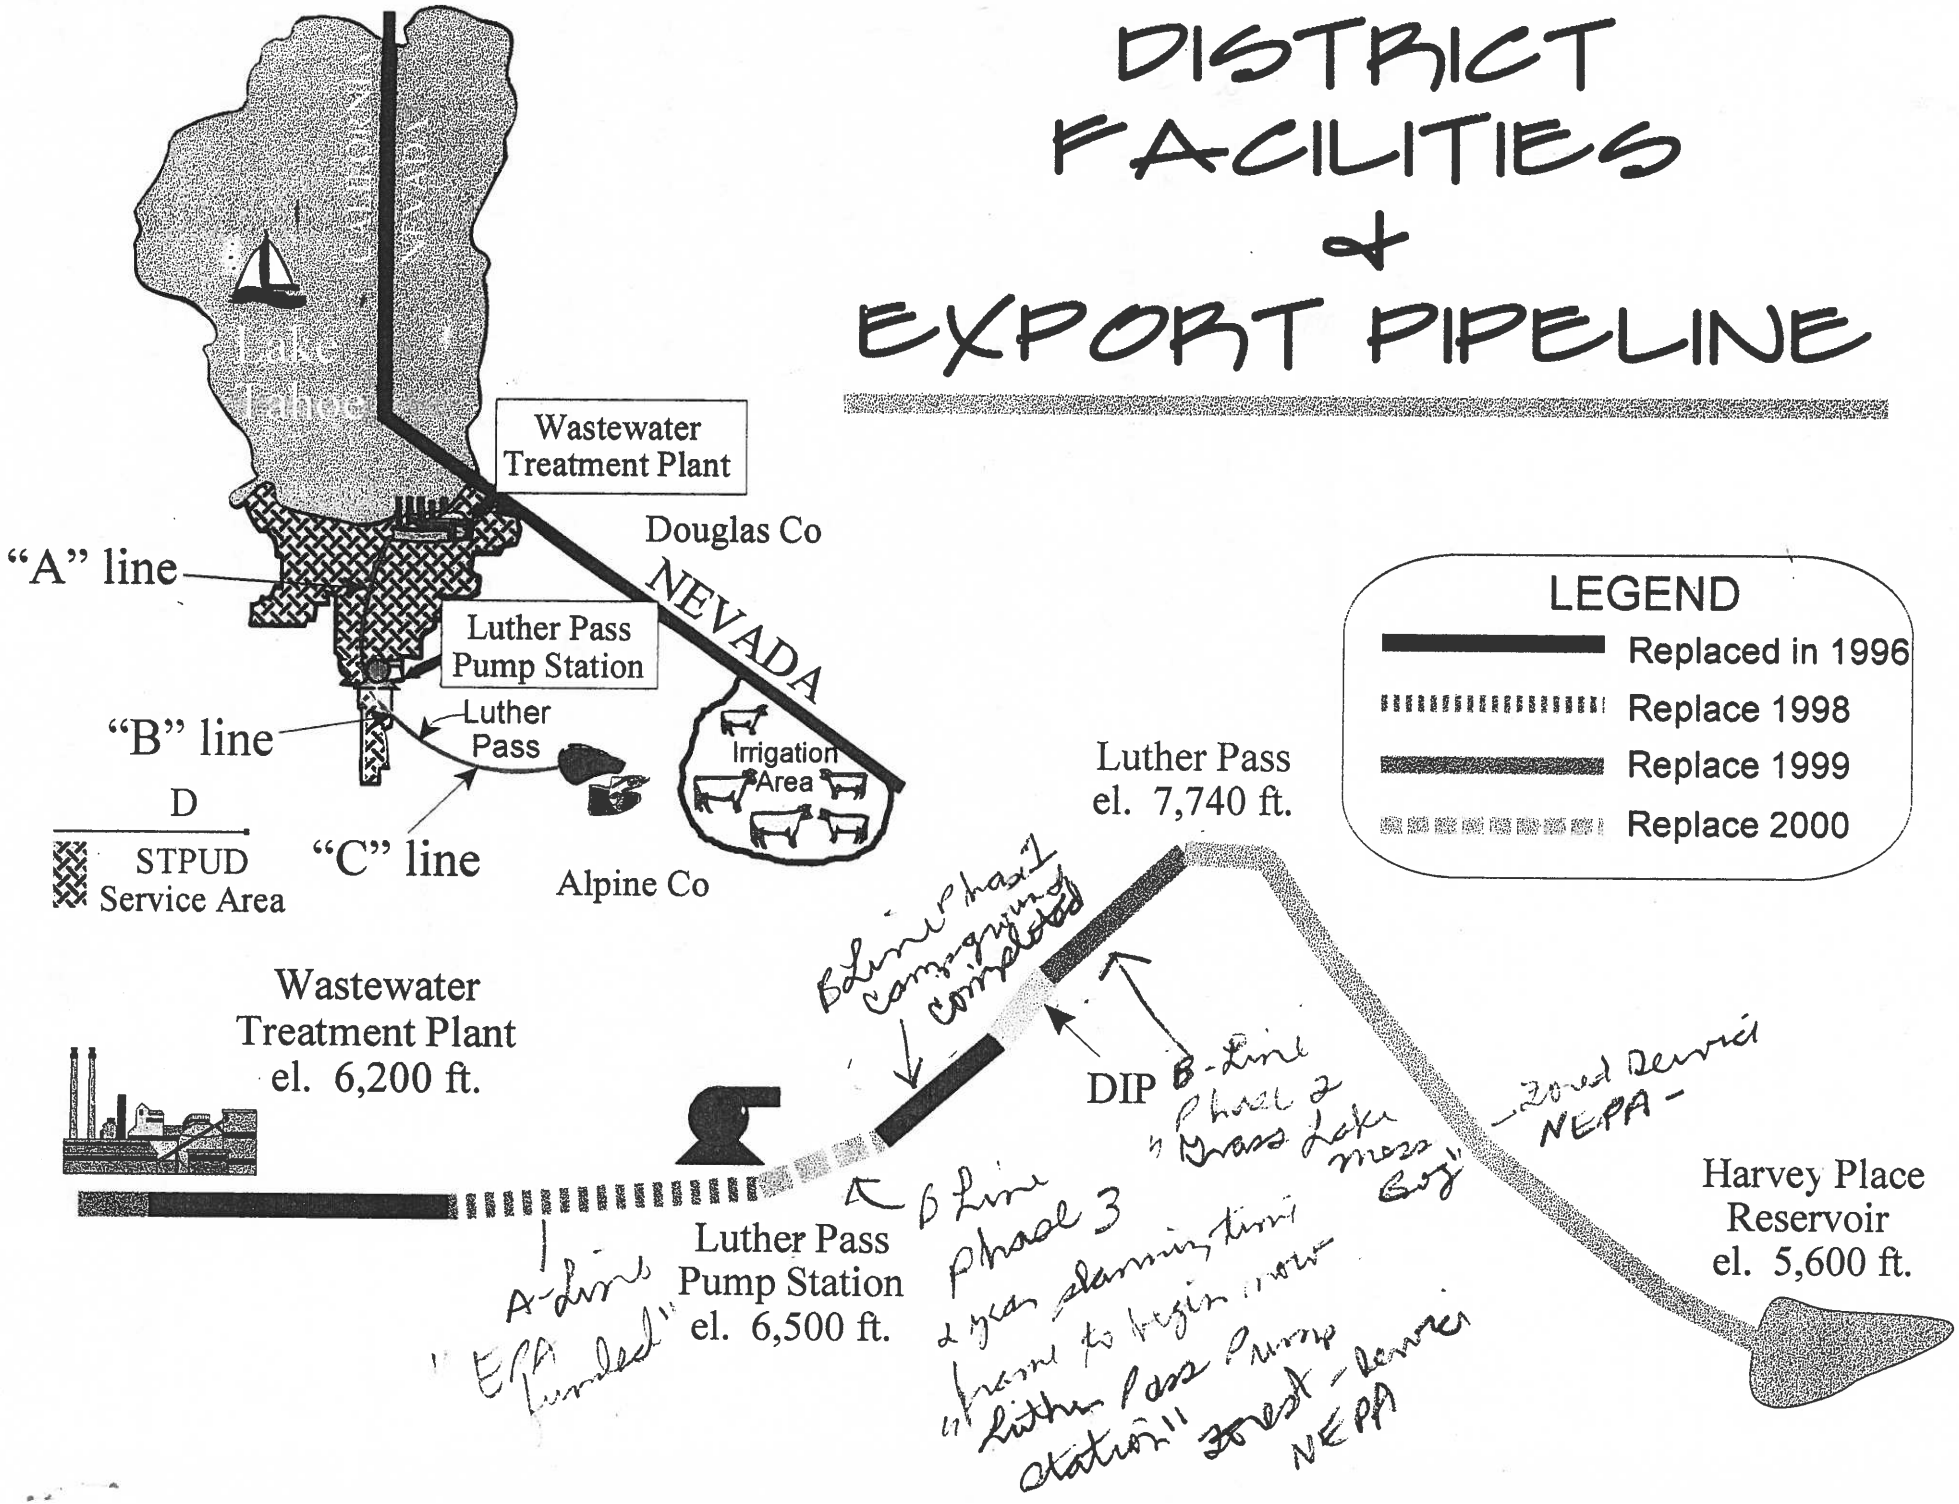

ERB - increased pipeline size to deal w/ stormwater overflow - only few day retention

Plant - Luther Pump station - A

Luther pump - top of pass - B

top to woodfords - C

electric pumps at plant & Luther pump stat.

1982 - spill .. lost electricity

emergency power - helped deal w/:

Lahontan - agreed to do emergency back up -
- ERB
- Power
- surge tank

1980s

Inspect line every month - full 28 miles

Trout Creek - area - directional drilling
750 - 850 / foot
300 - 400 / foot - normal costs

May 1 - Oct 15 - construction time

design 1st yr, build 2nd yr