Figure 2.
AMTL Watertown
Total VOC Concentrations in Groundwater(>MCL for PCE and TCE 5 µg/l)

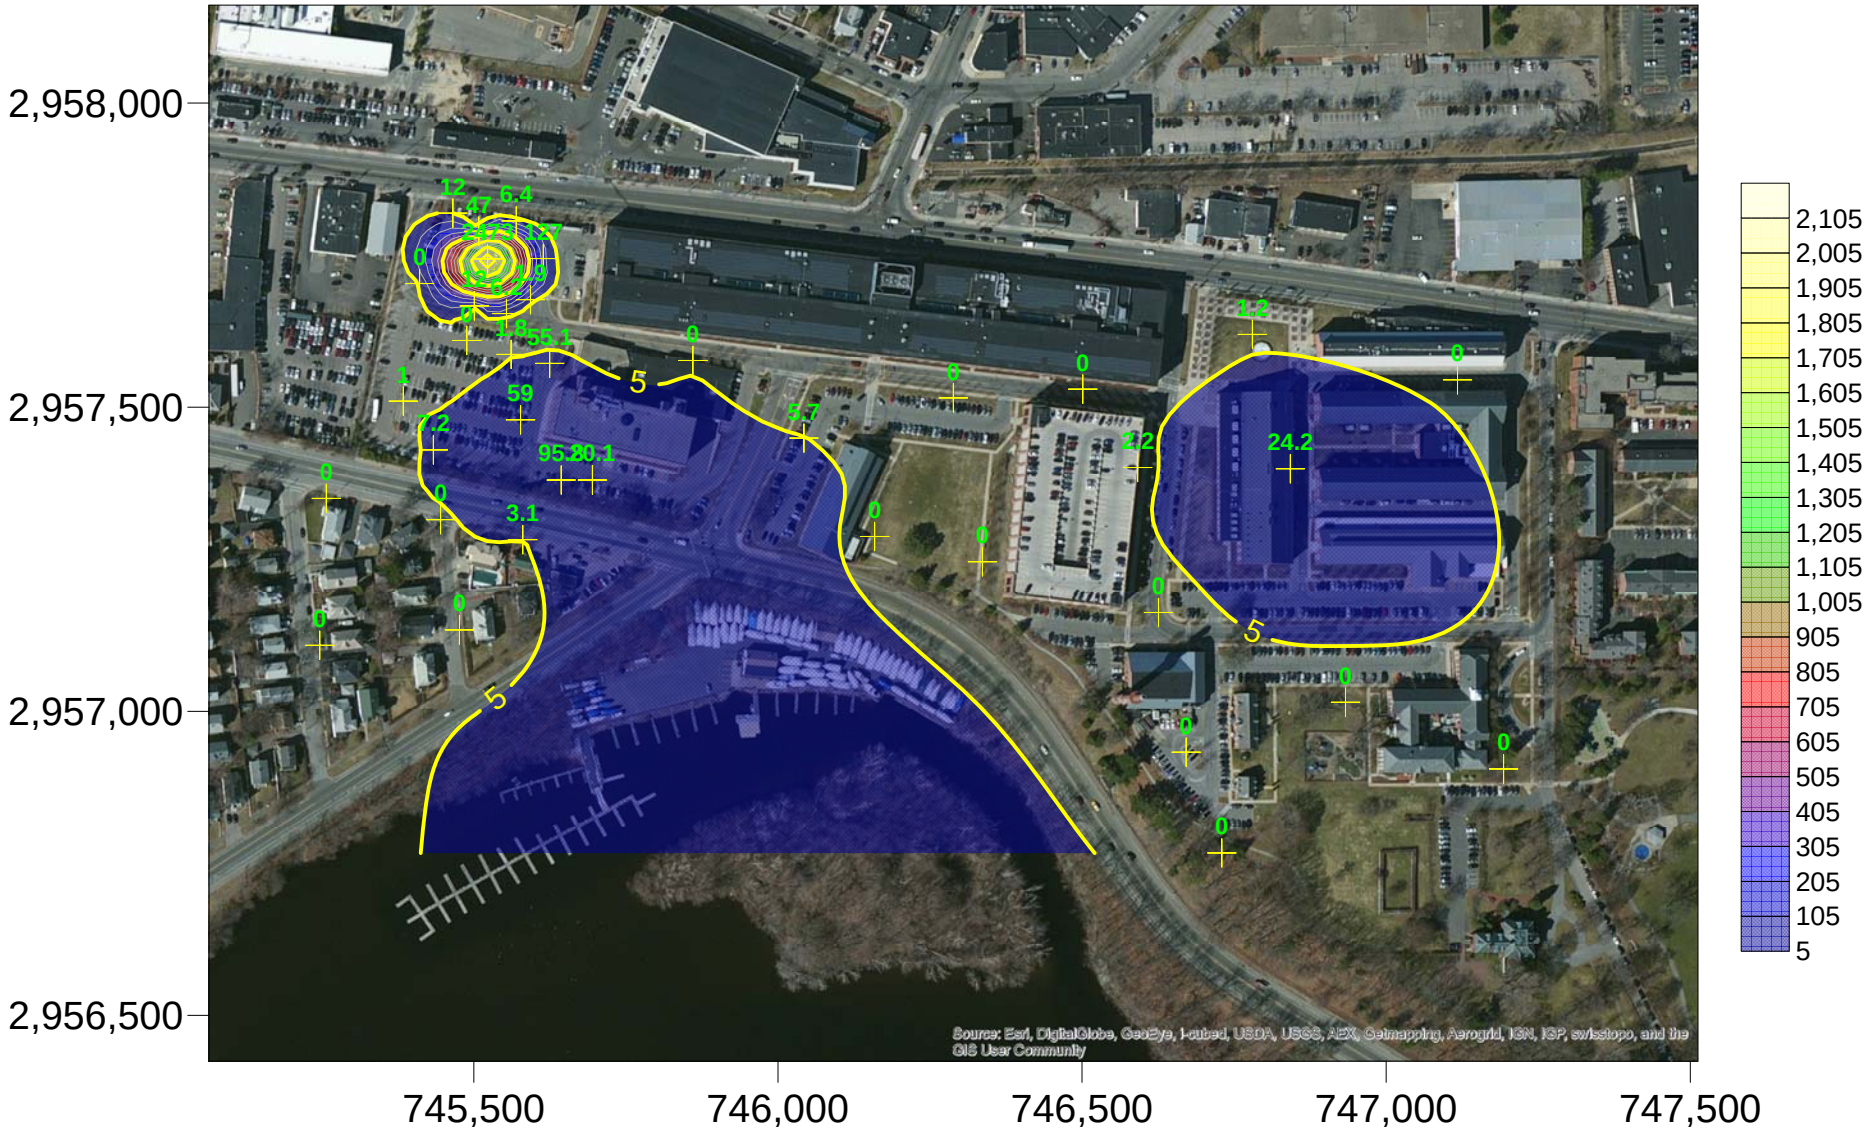

NAD_1983_StatePlane_Massachusetts_Mainland_Feet

Figure 3.
AMTL Watertown
PCE Concentrations in Groundwater (>VISL 24 µg/l)

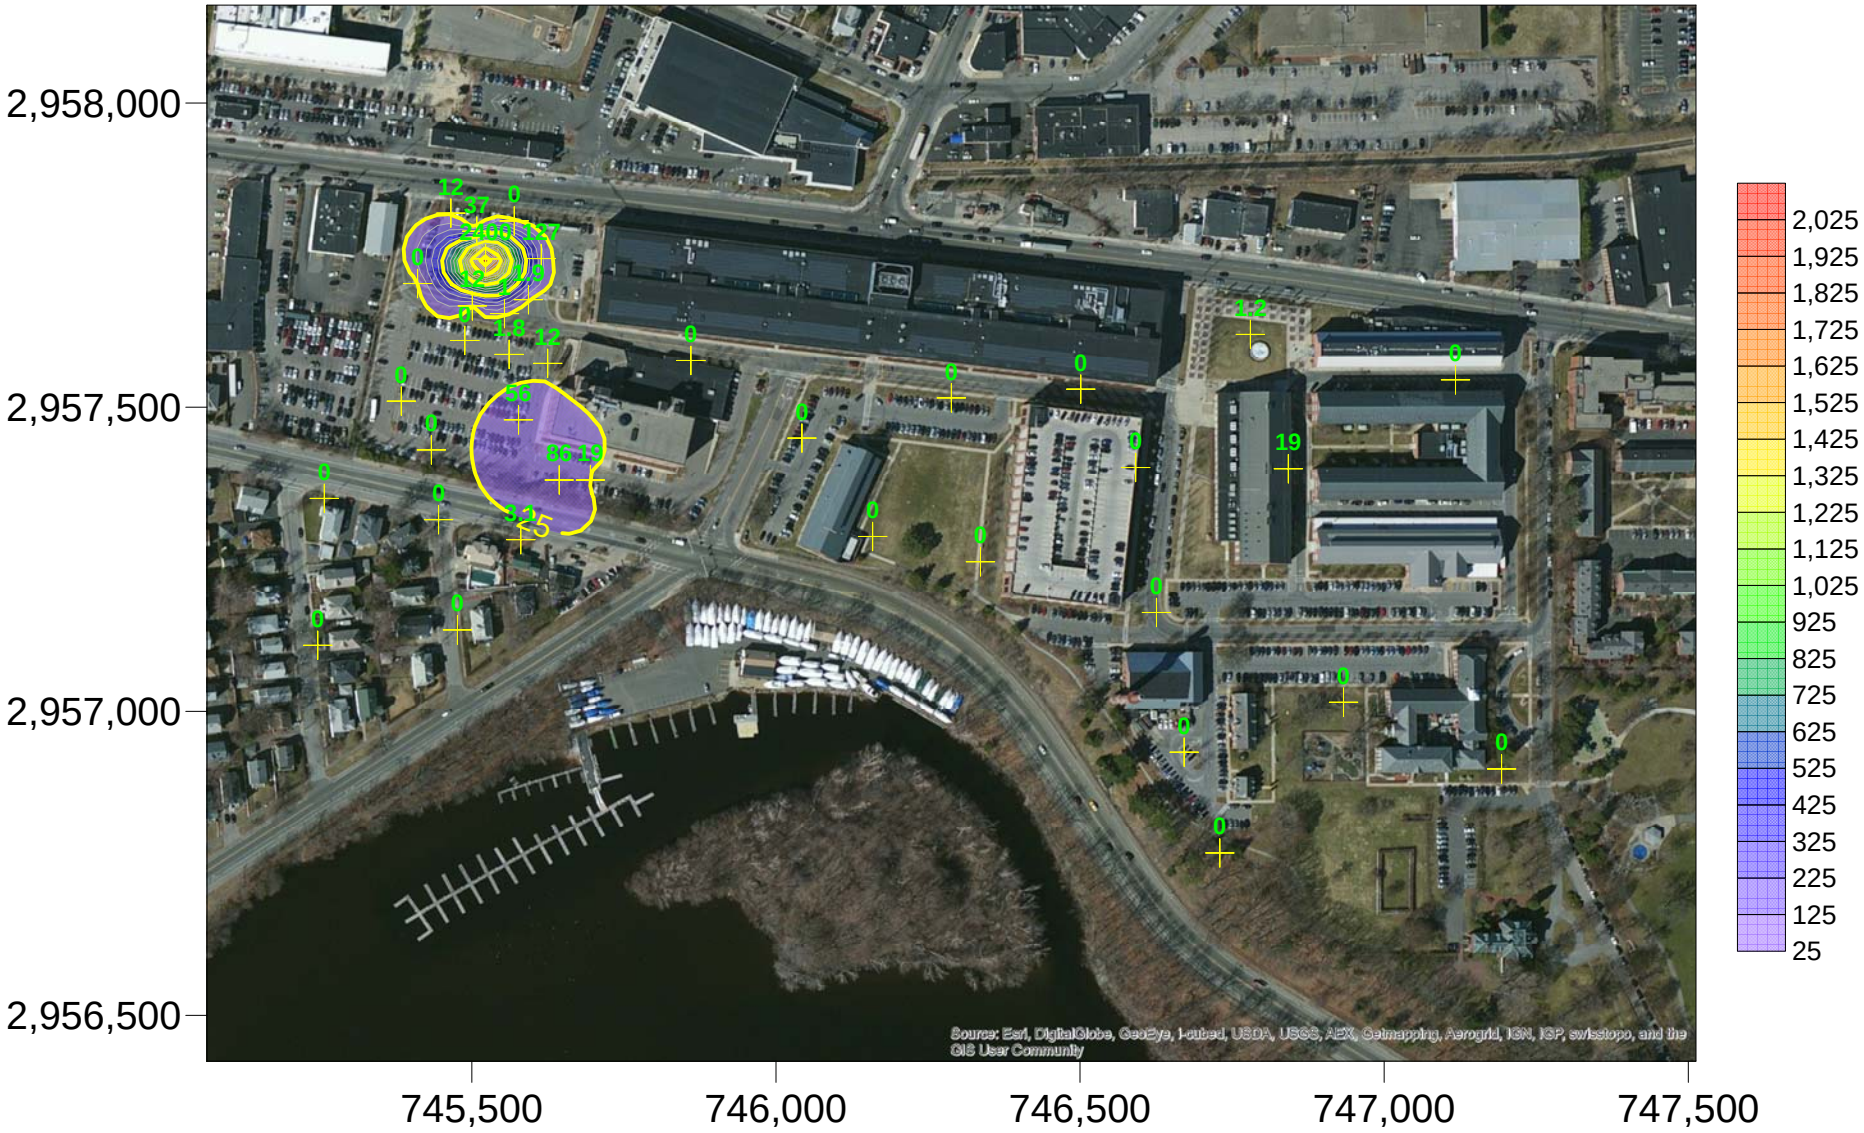

Figure 4.
AMTL Watertown
PCE>VISL in Groundwater
(Ratio of PCE Concentration/VISL)

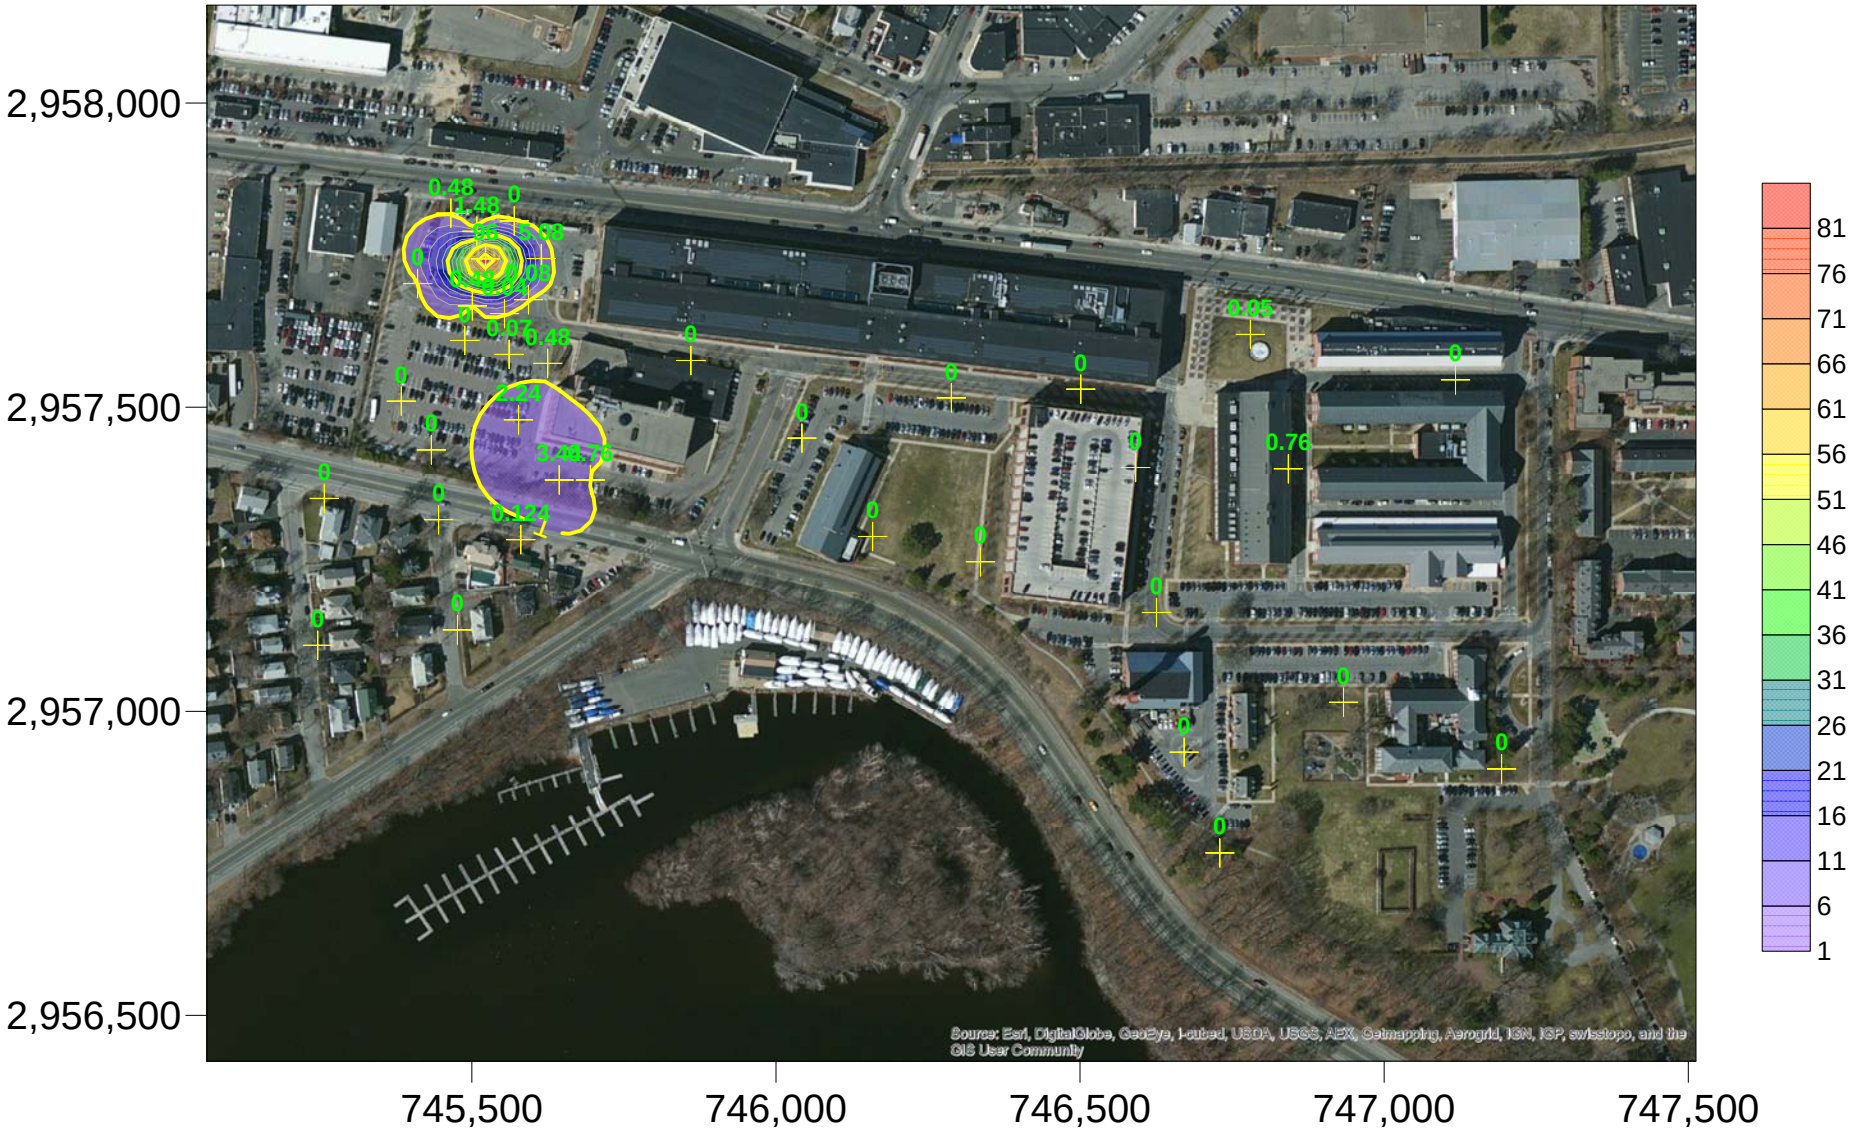

NAD_1983_StatePlane_Massachusetts_Mainland_Feet

Figure 5.
AMTL Watertown TCE Concentrations
in Groundwater (>VISL 2.2 µg/l)

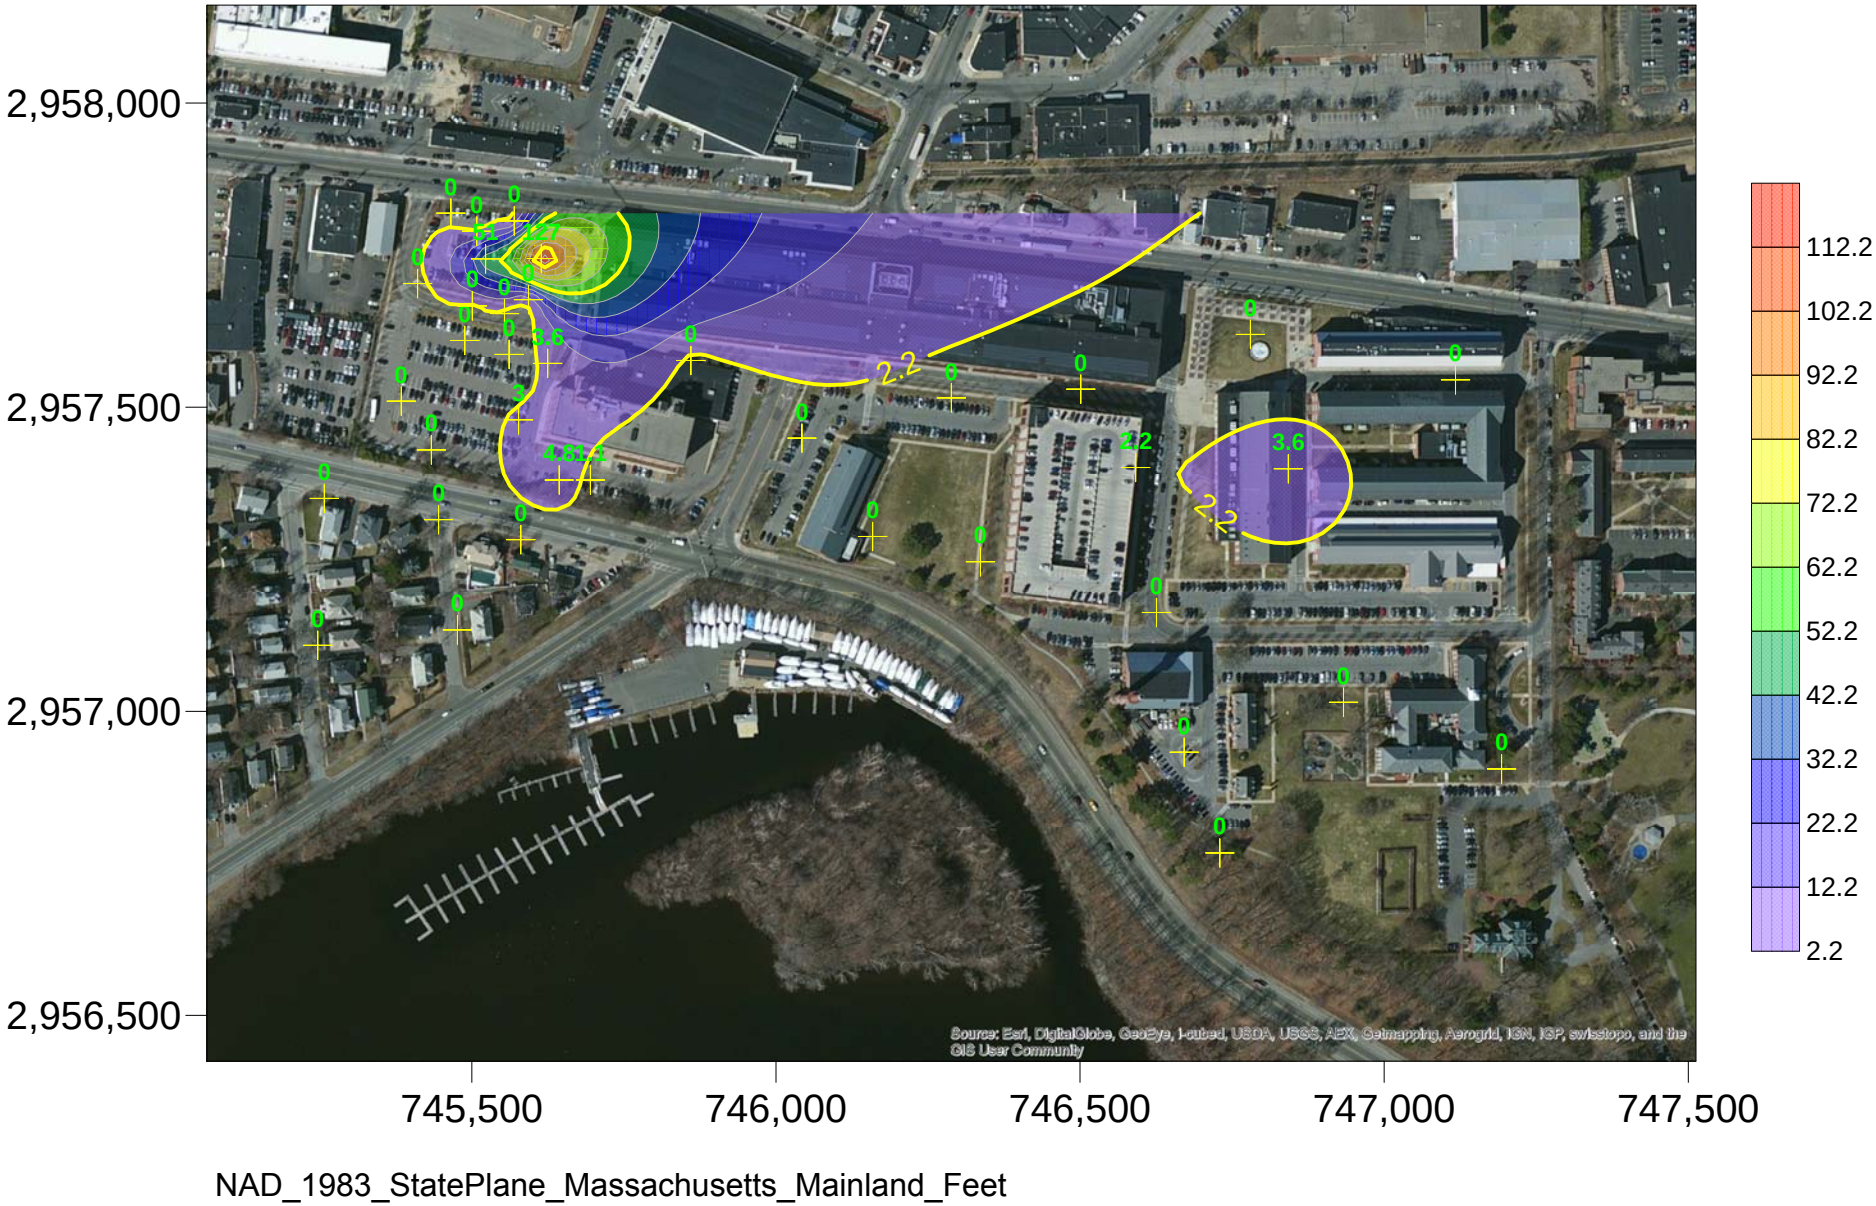

NAD_1983_StatePlane_Massachusetts_Mainland_Feet

Figure 6.
AMTL Watertown
TCE>VISL in Groundwater
(Ratio of TCE Concentration/VISL)

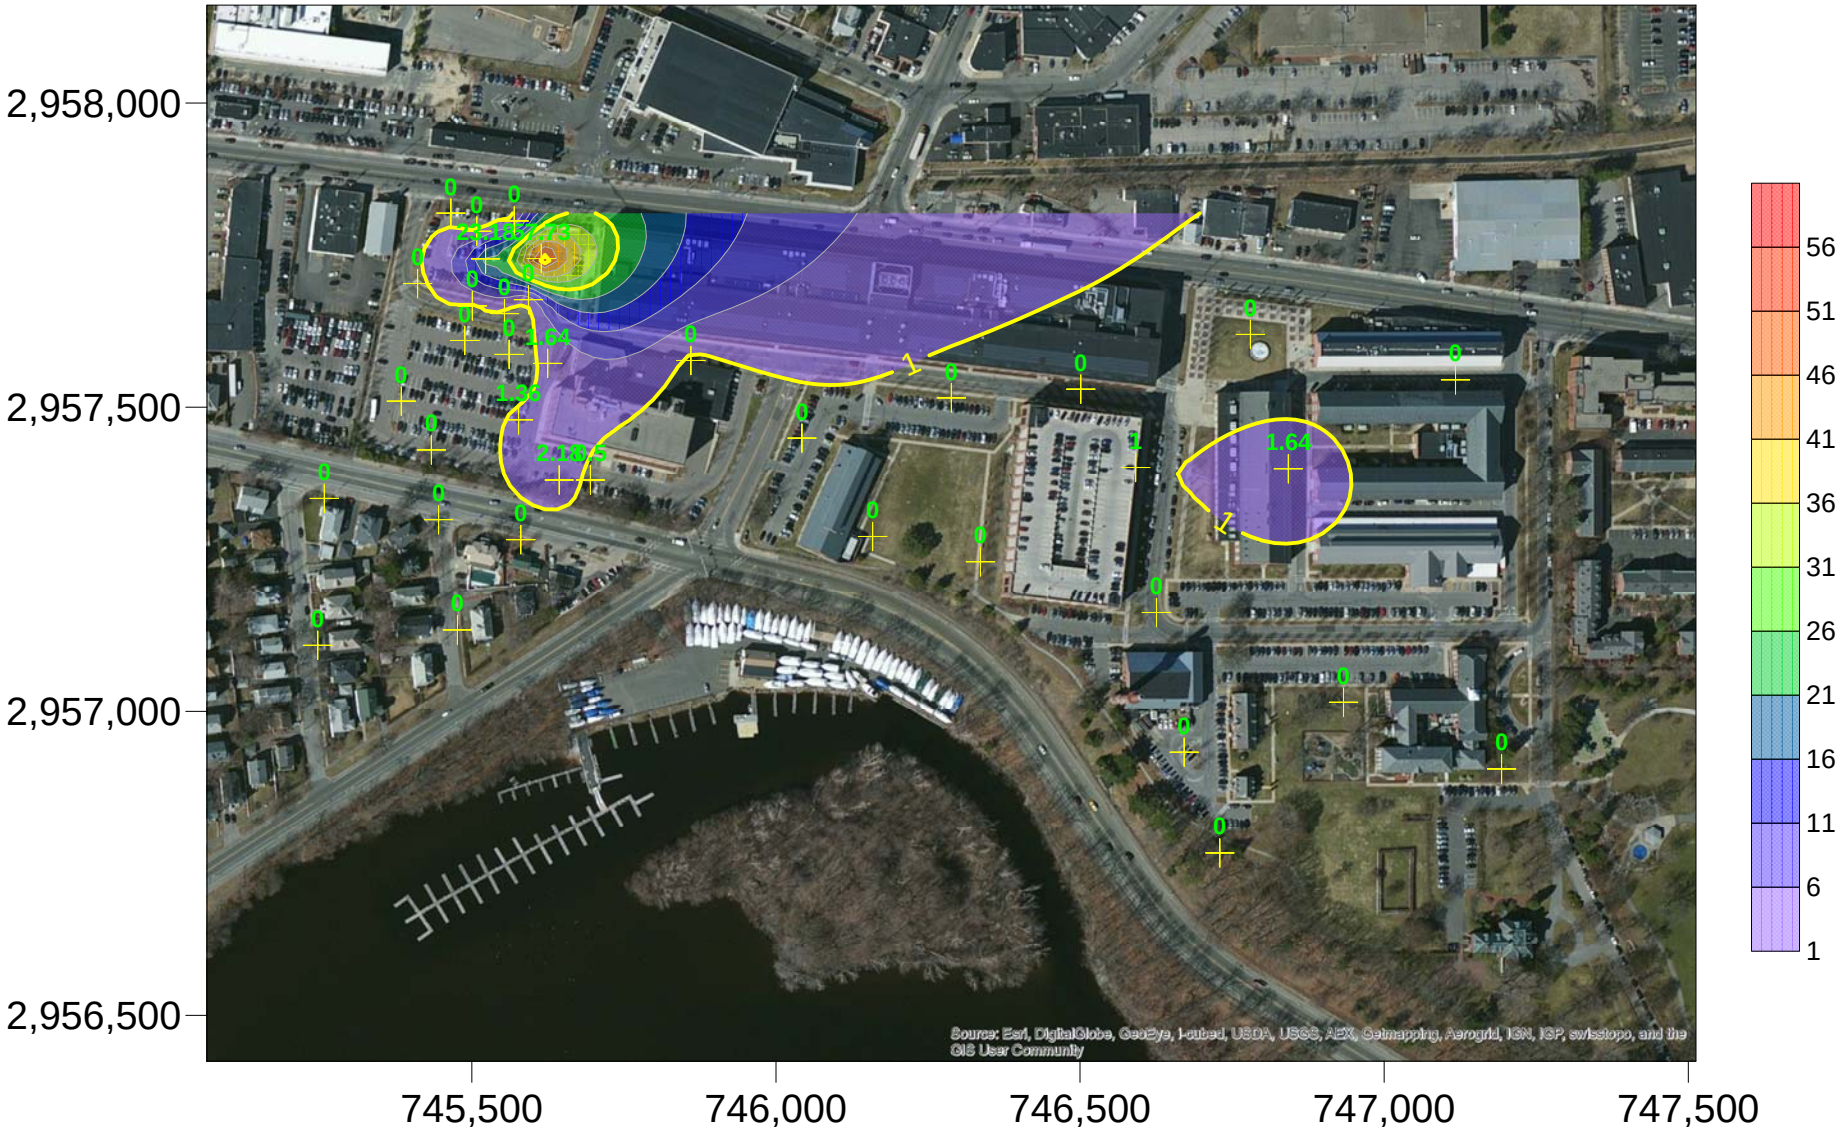

NAD_1983_StatePlane_Massachusetts_Mainland_Feet