B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jan 2020

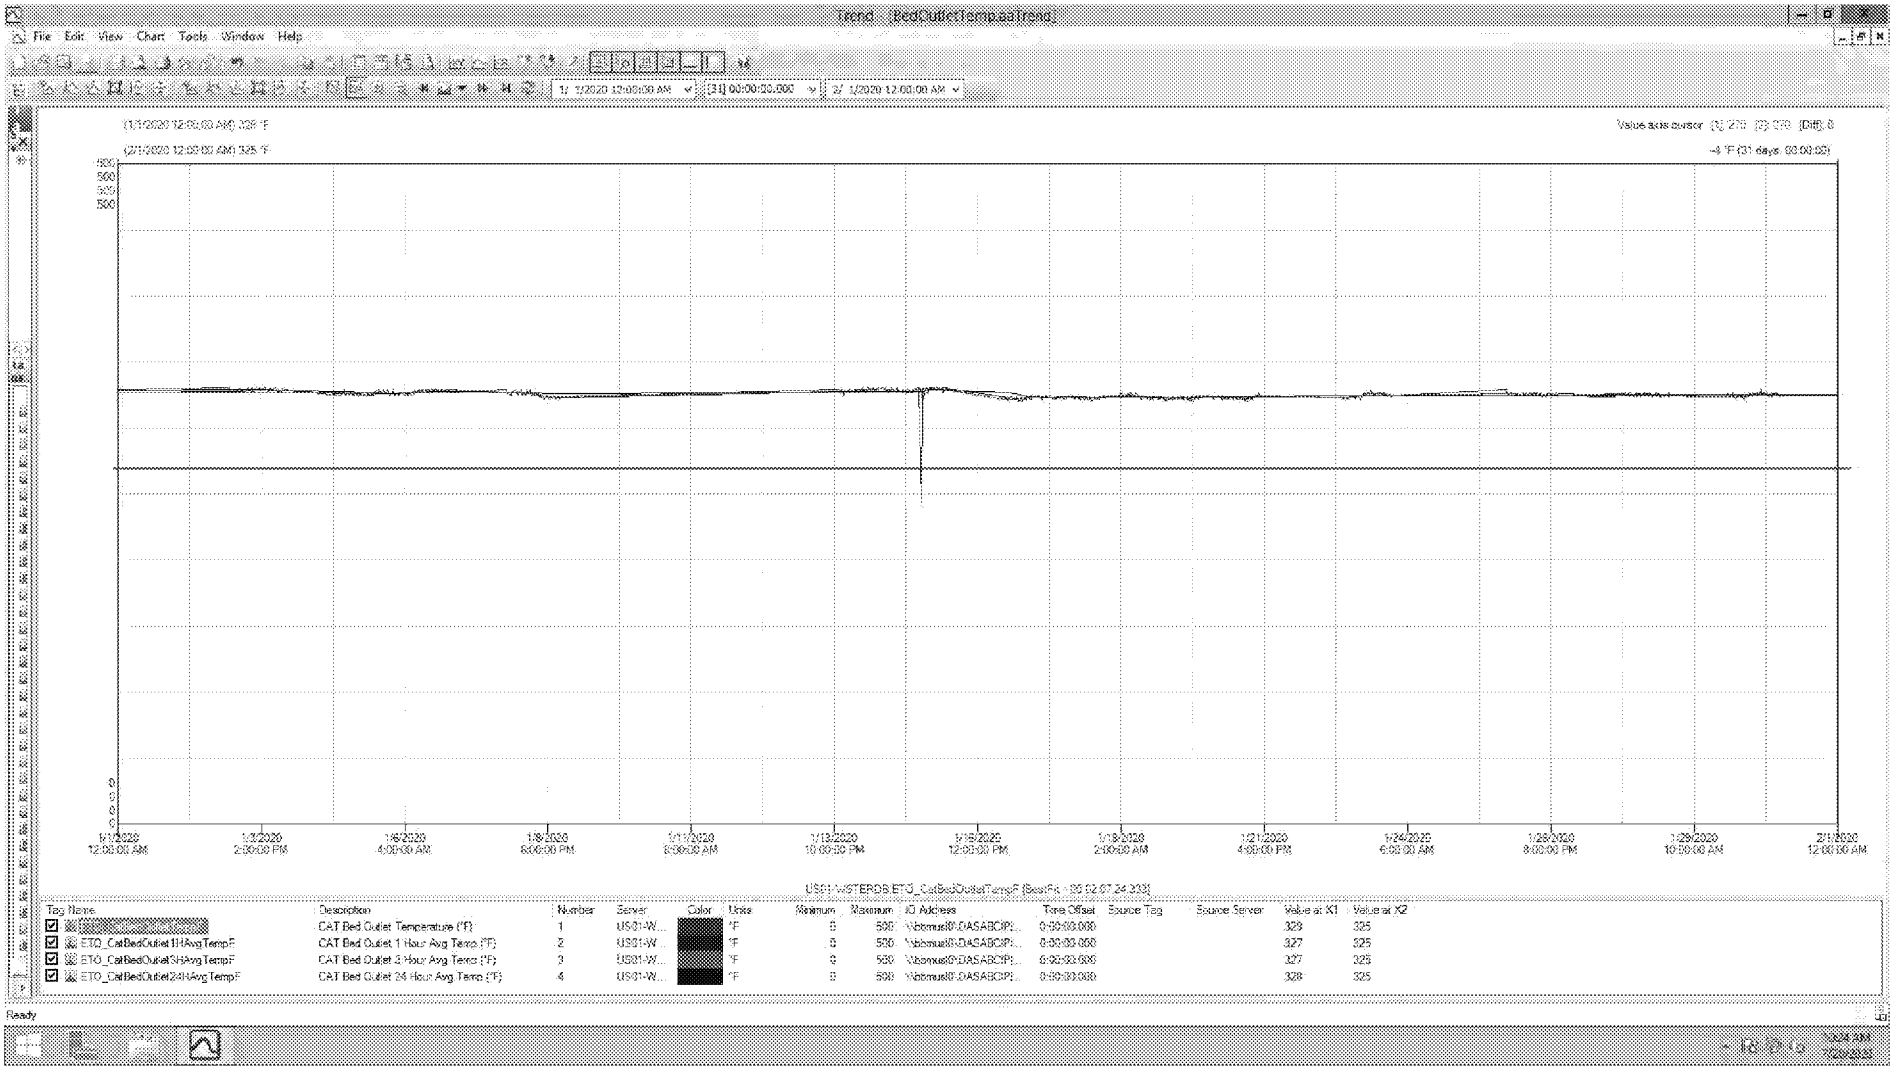

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jan 2020

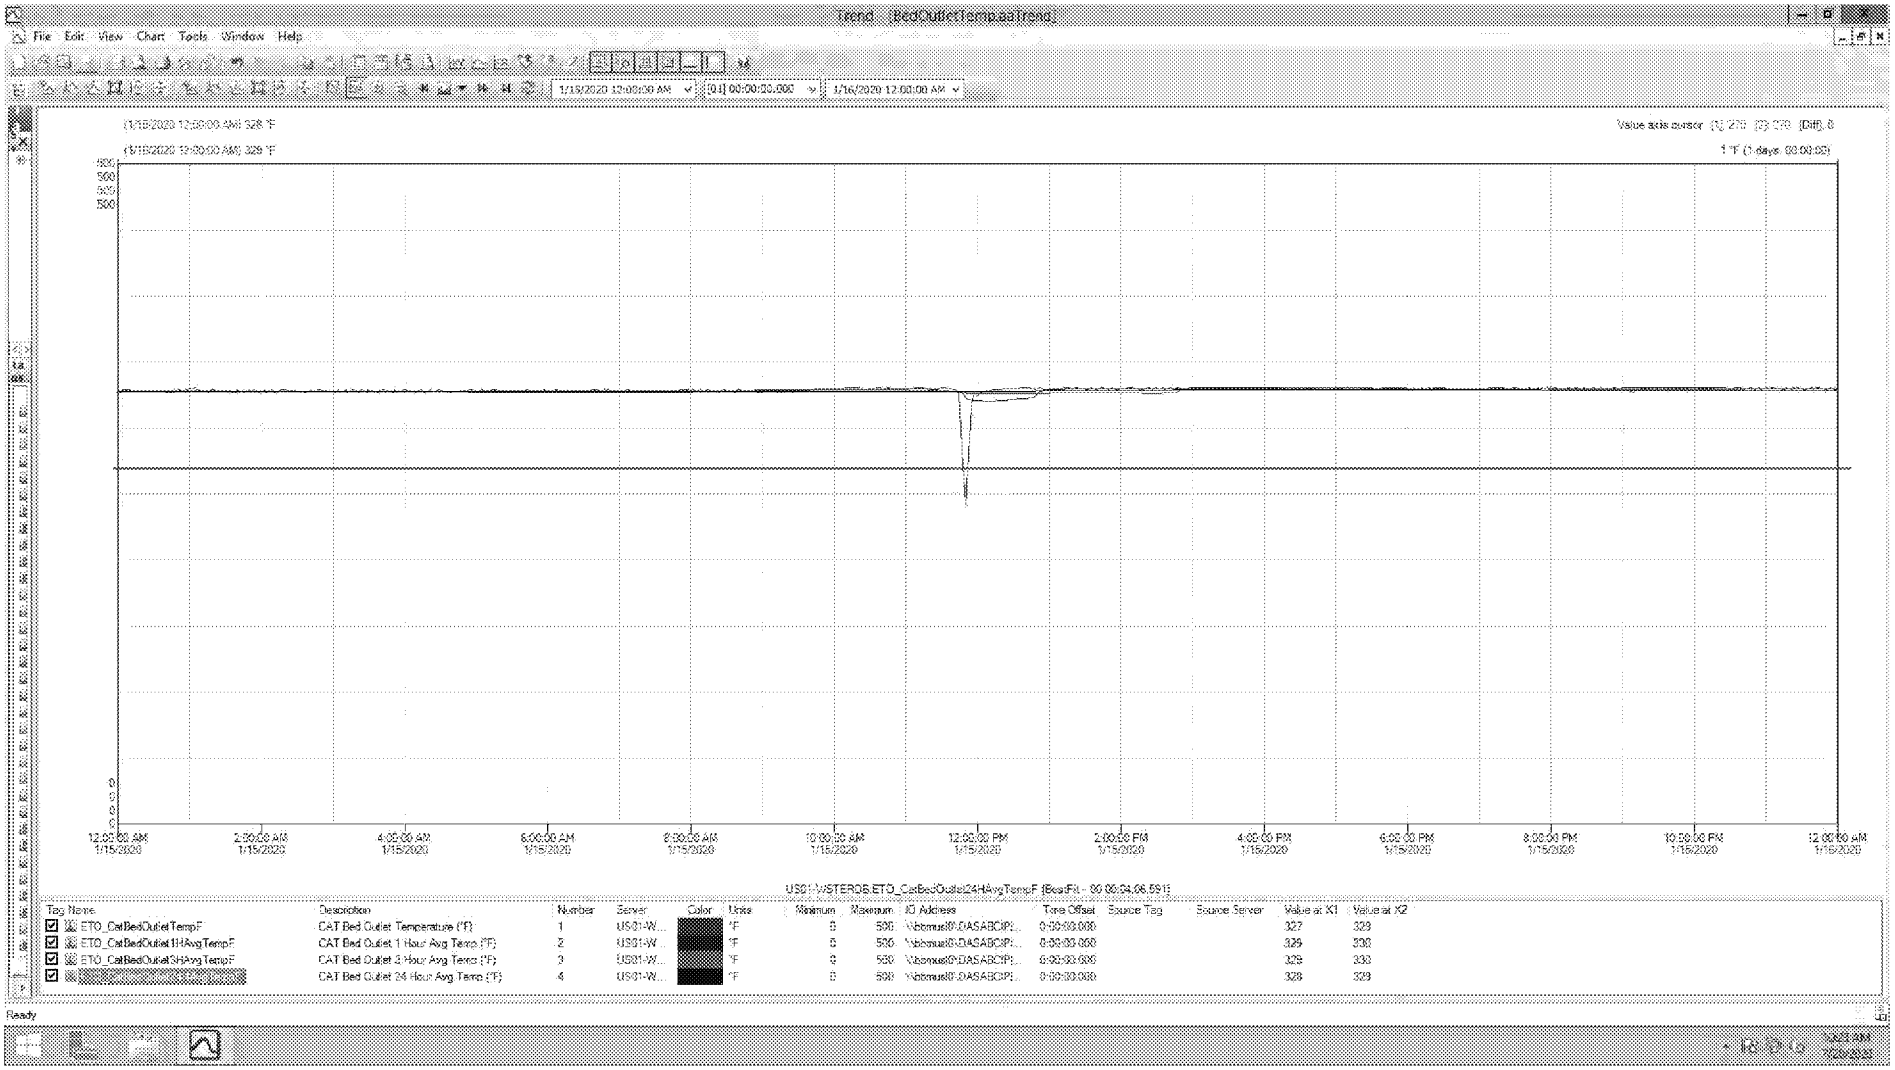

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Feb 2020

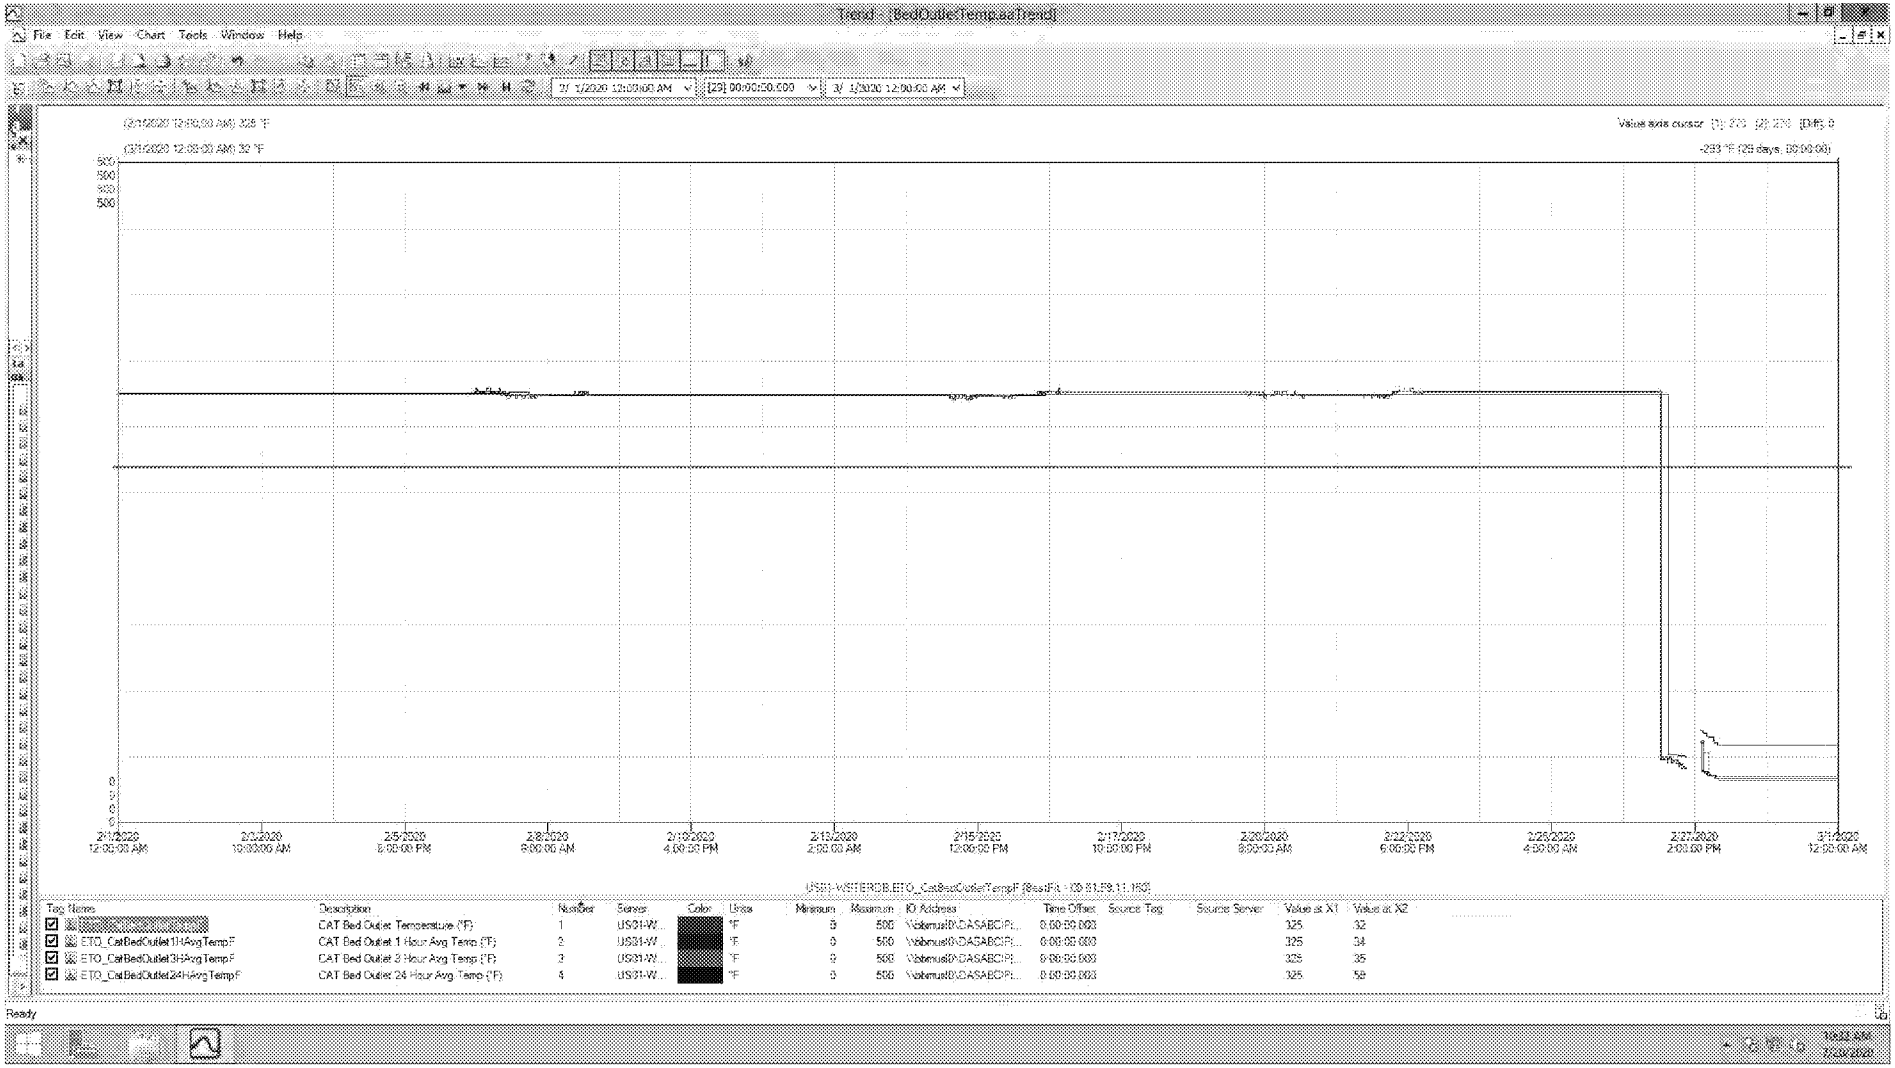

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Mar 2020

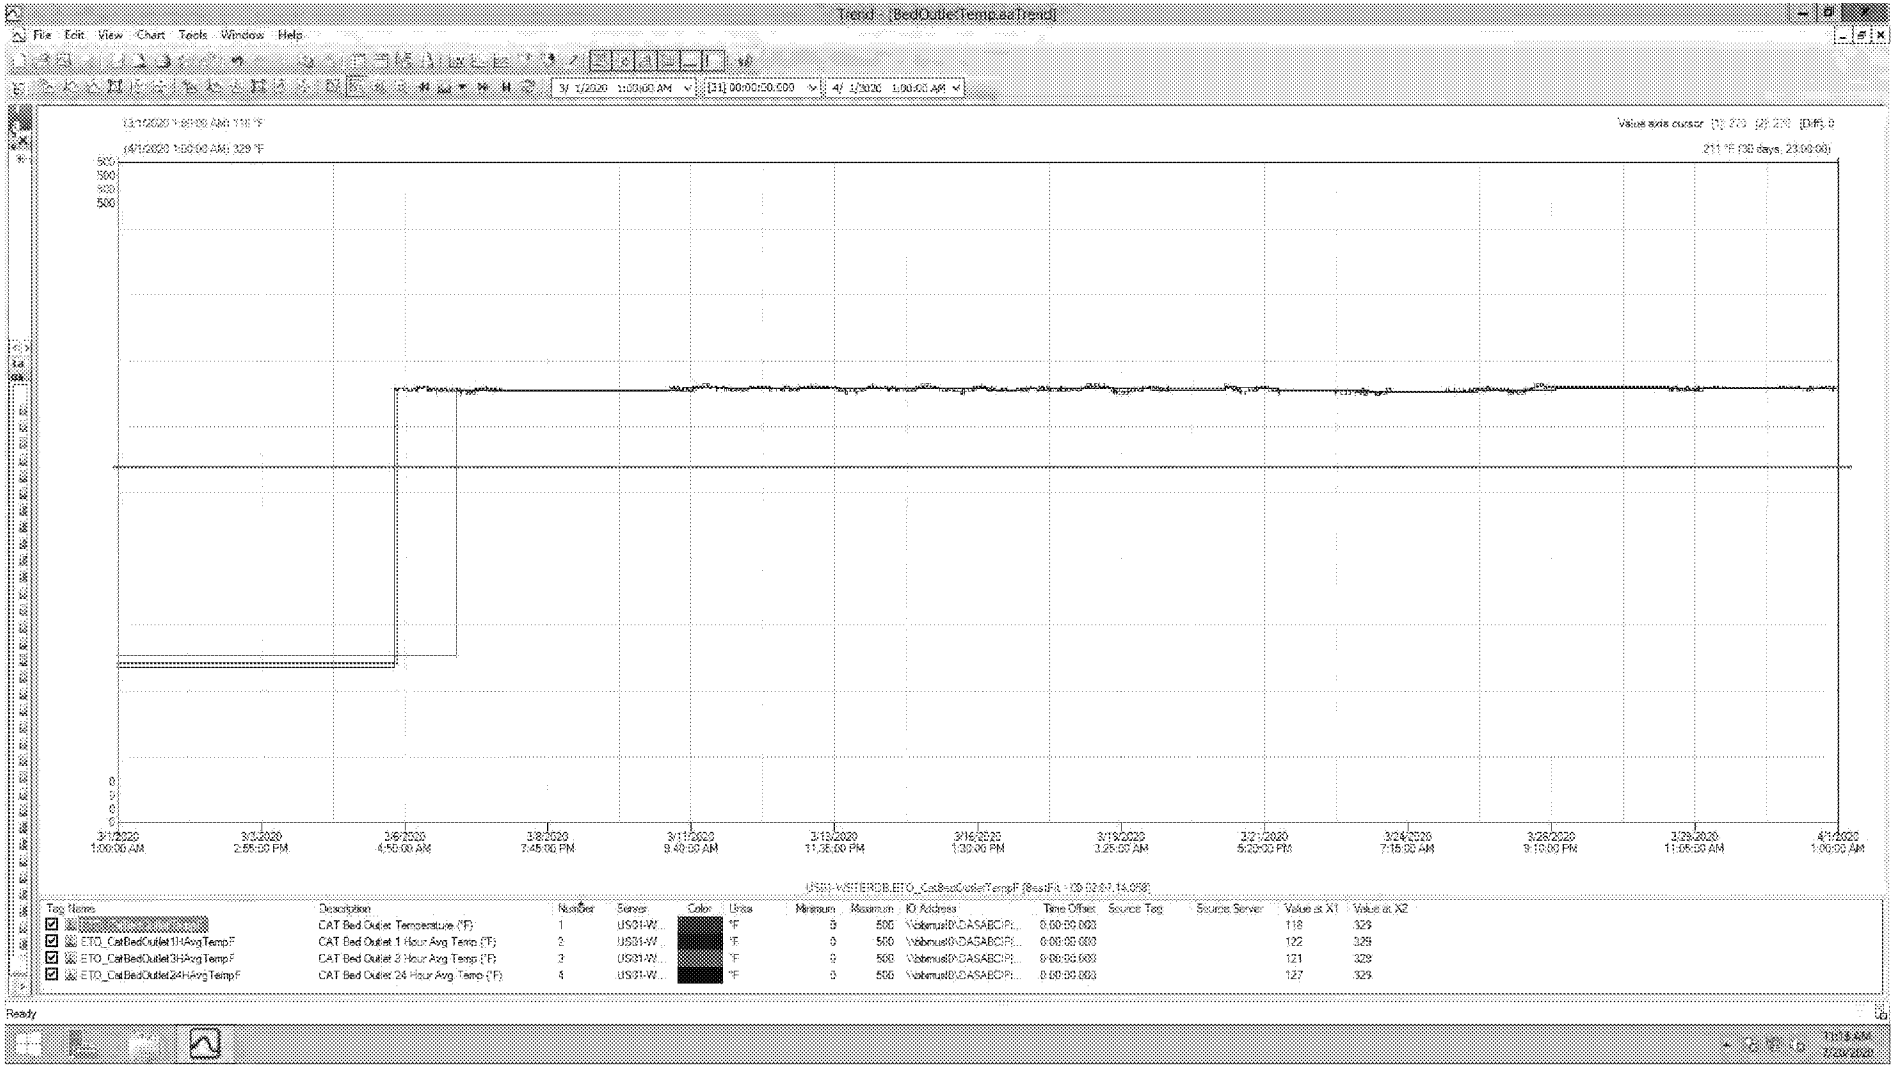

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Apr 2020

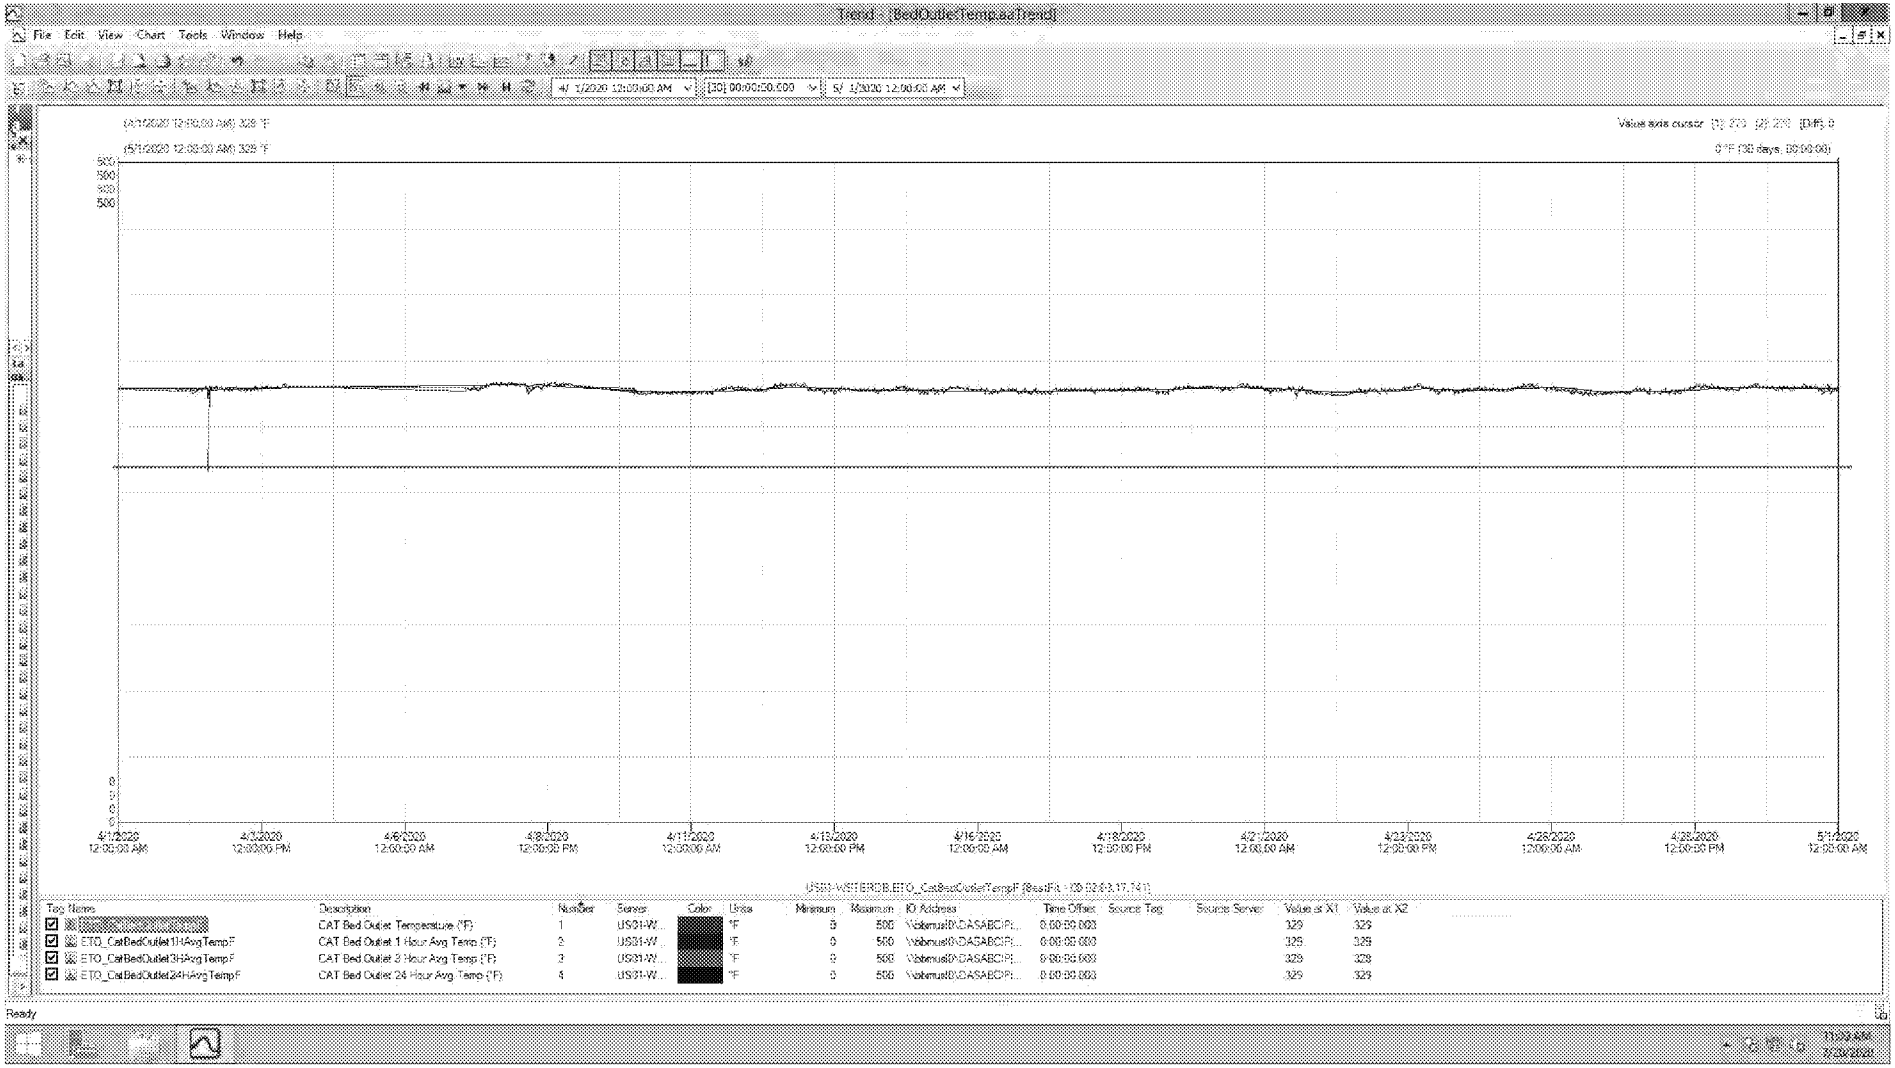

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Apr 2020

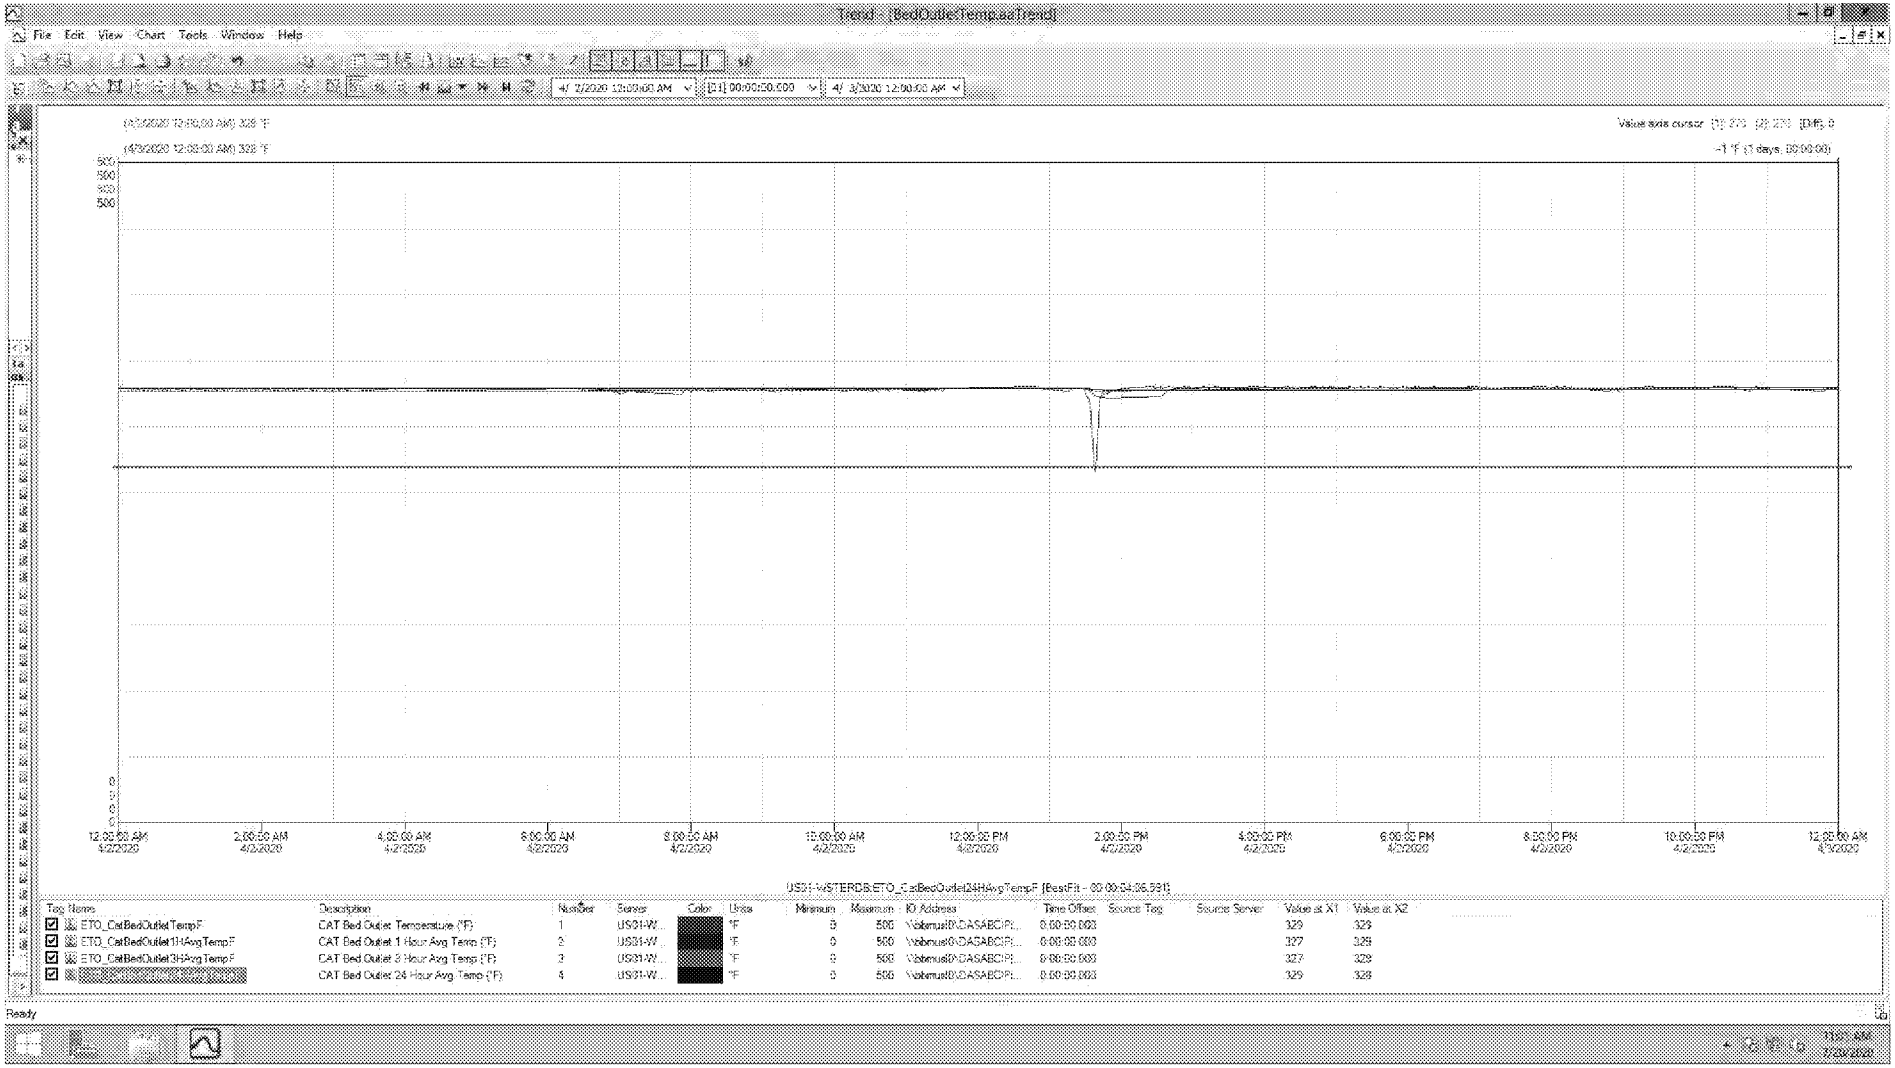

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – May 2020

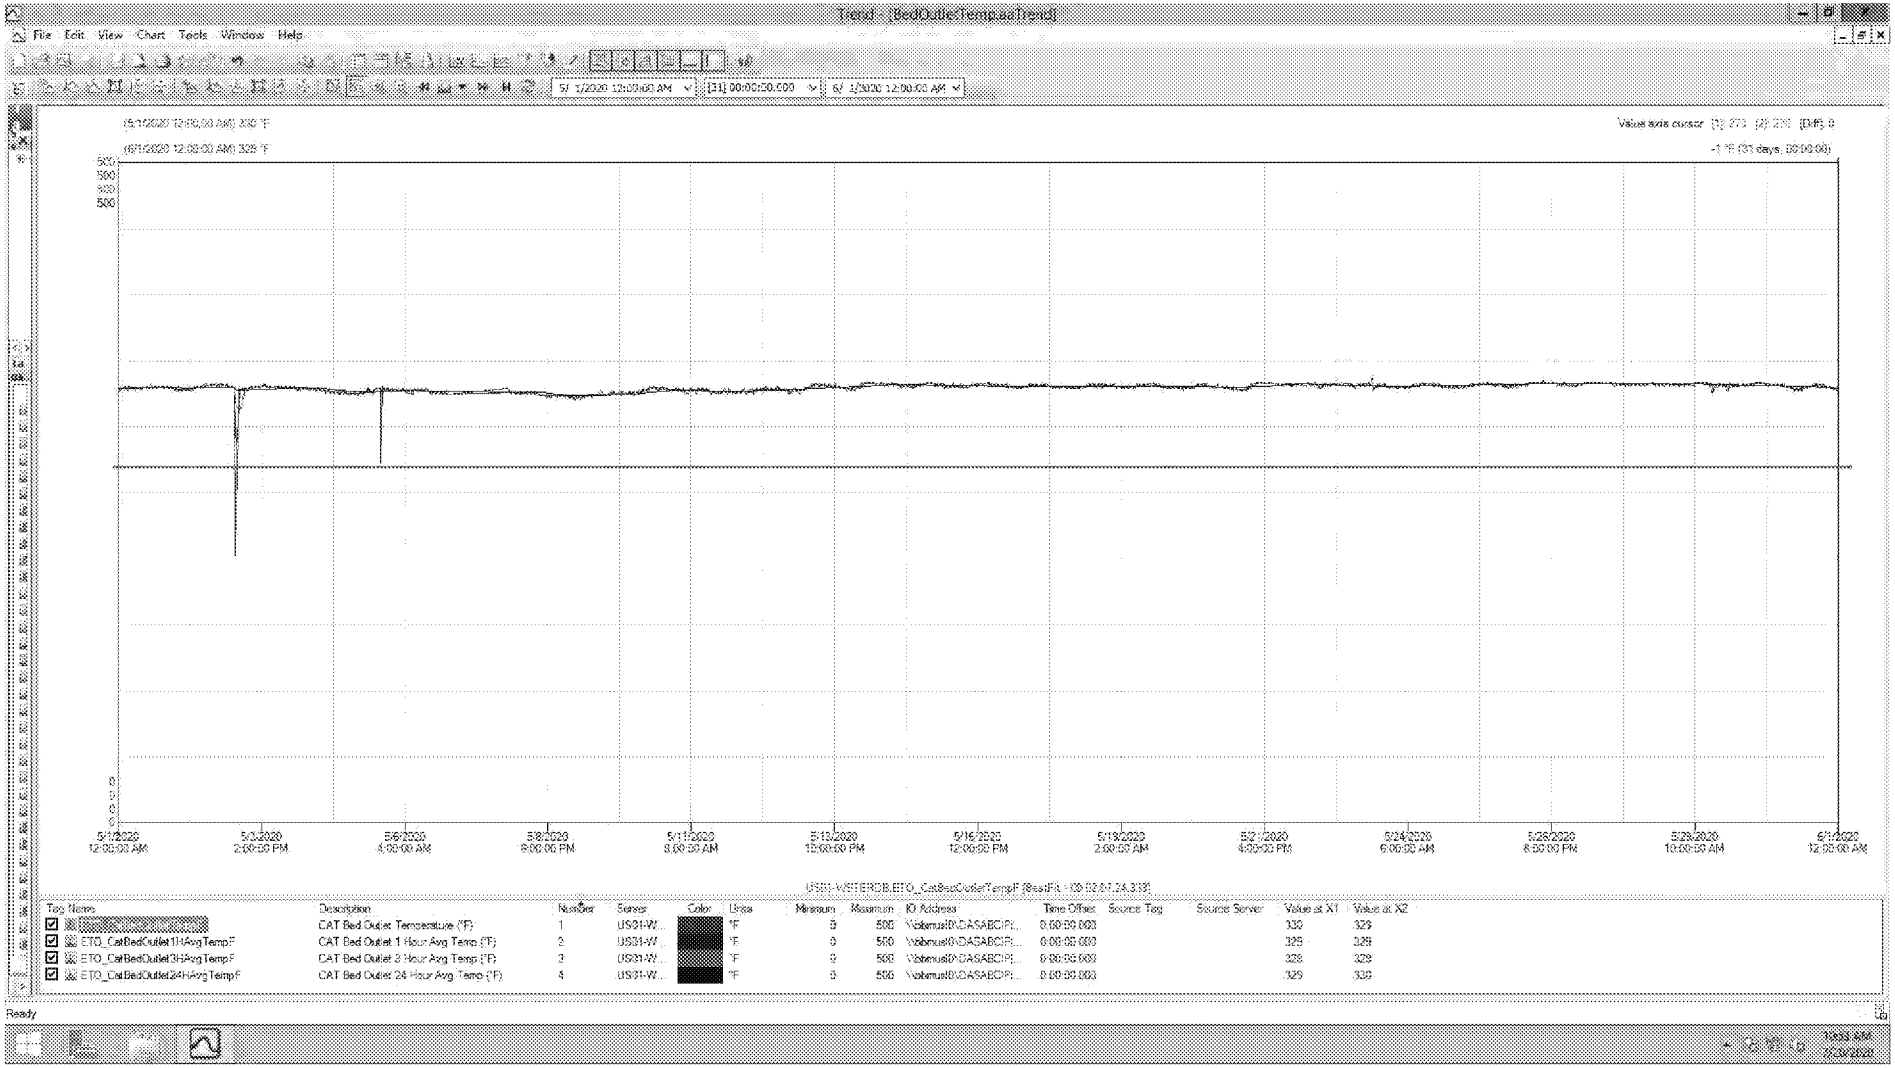

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – May 2020

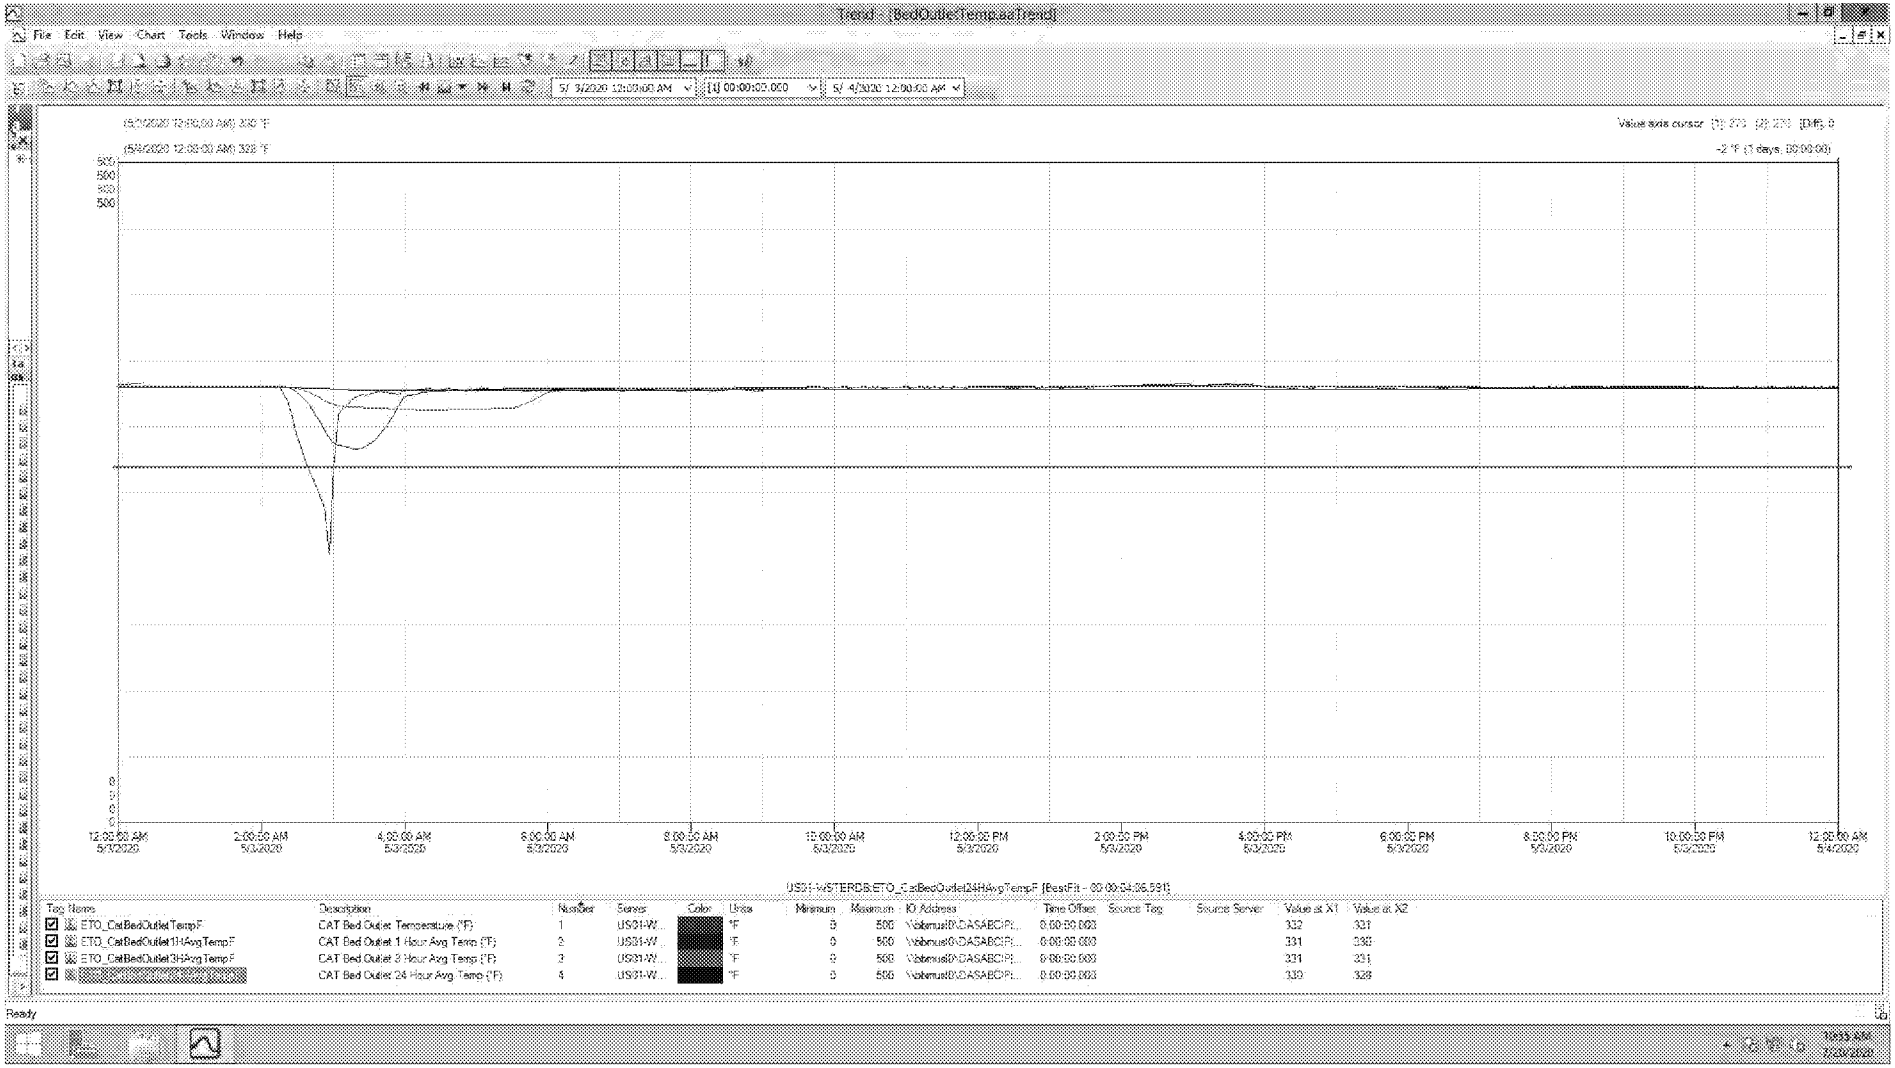

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jun 2020

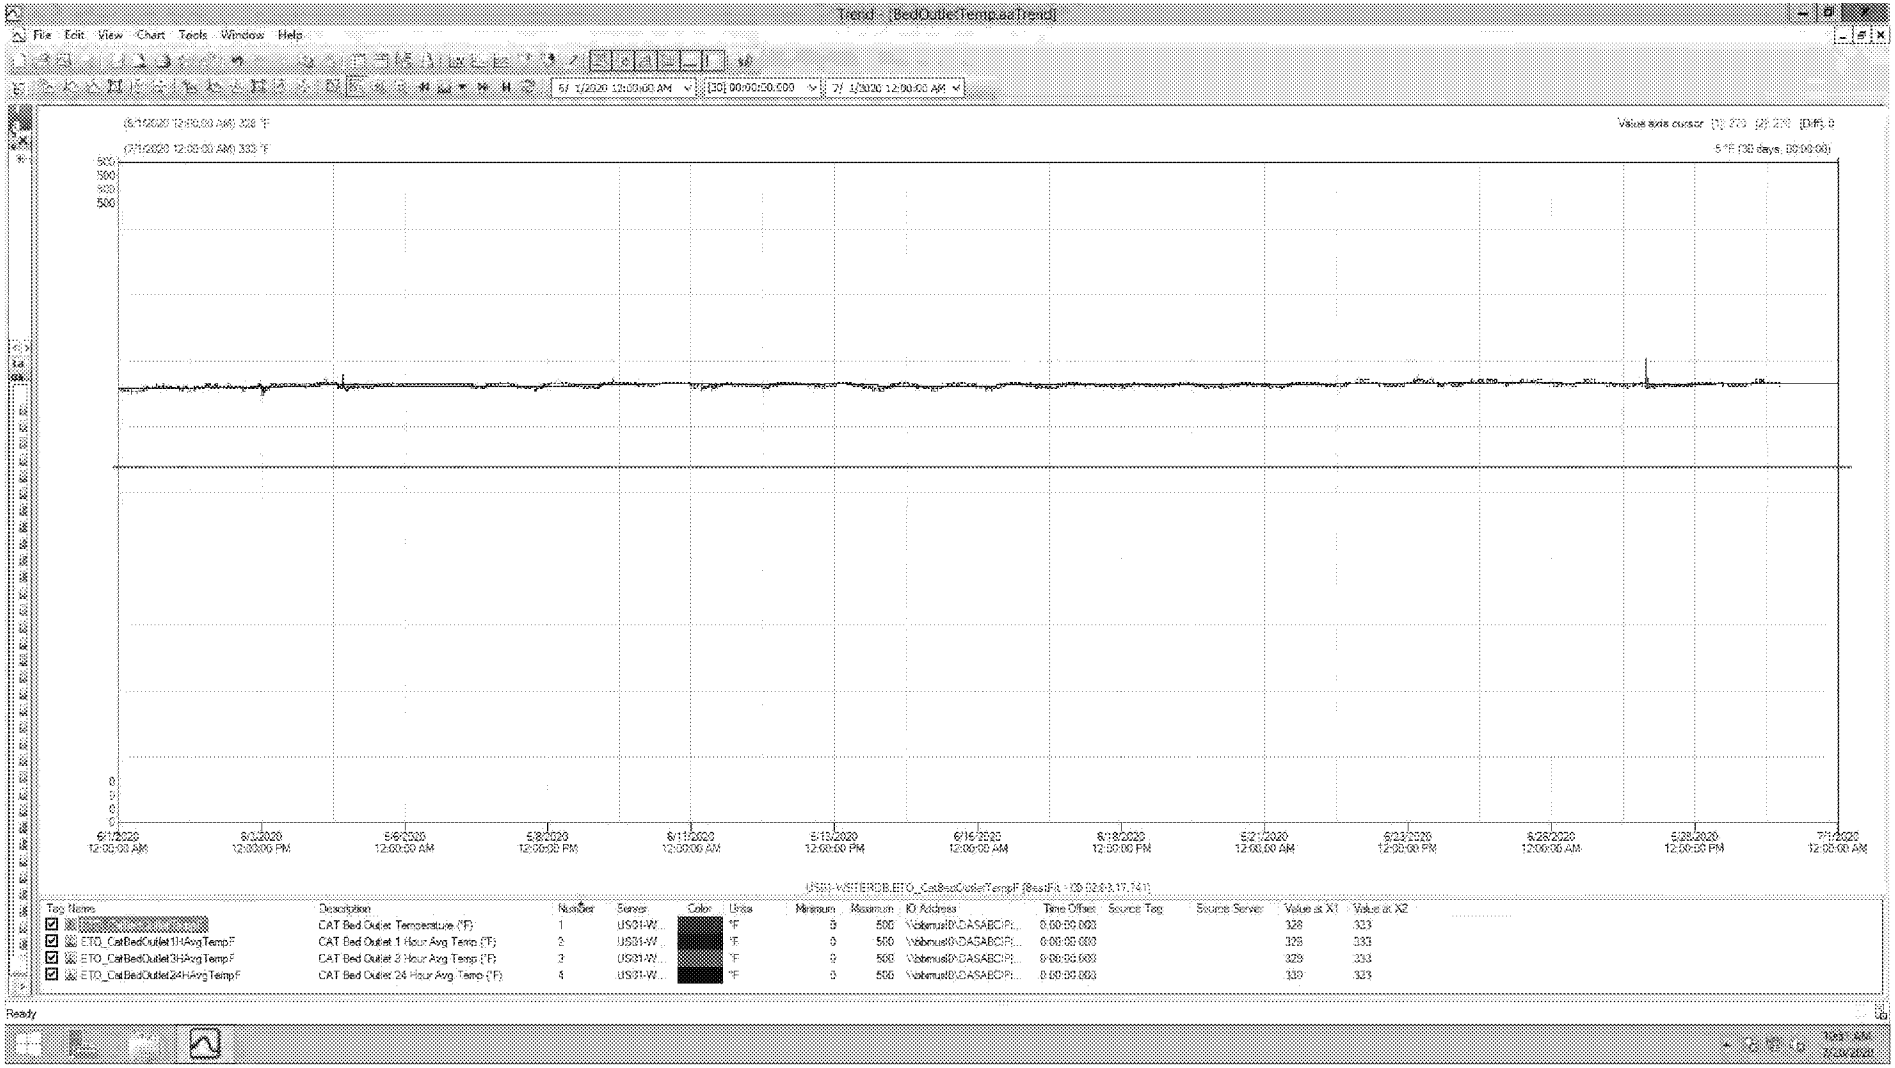

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

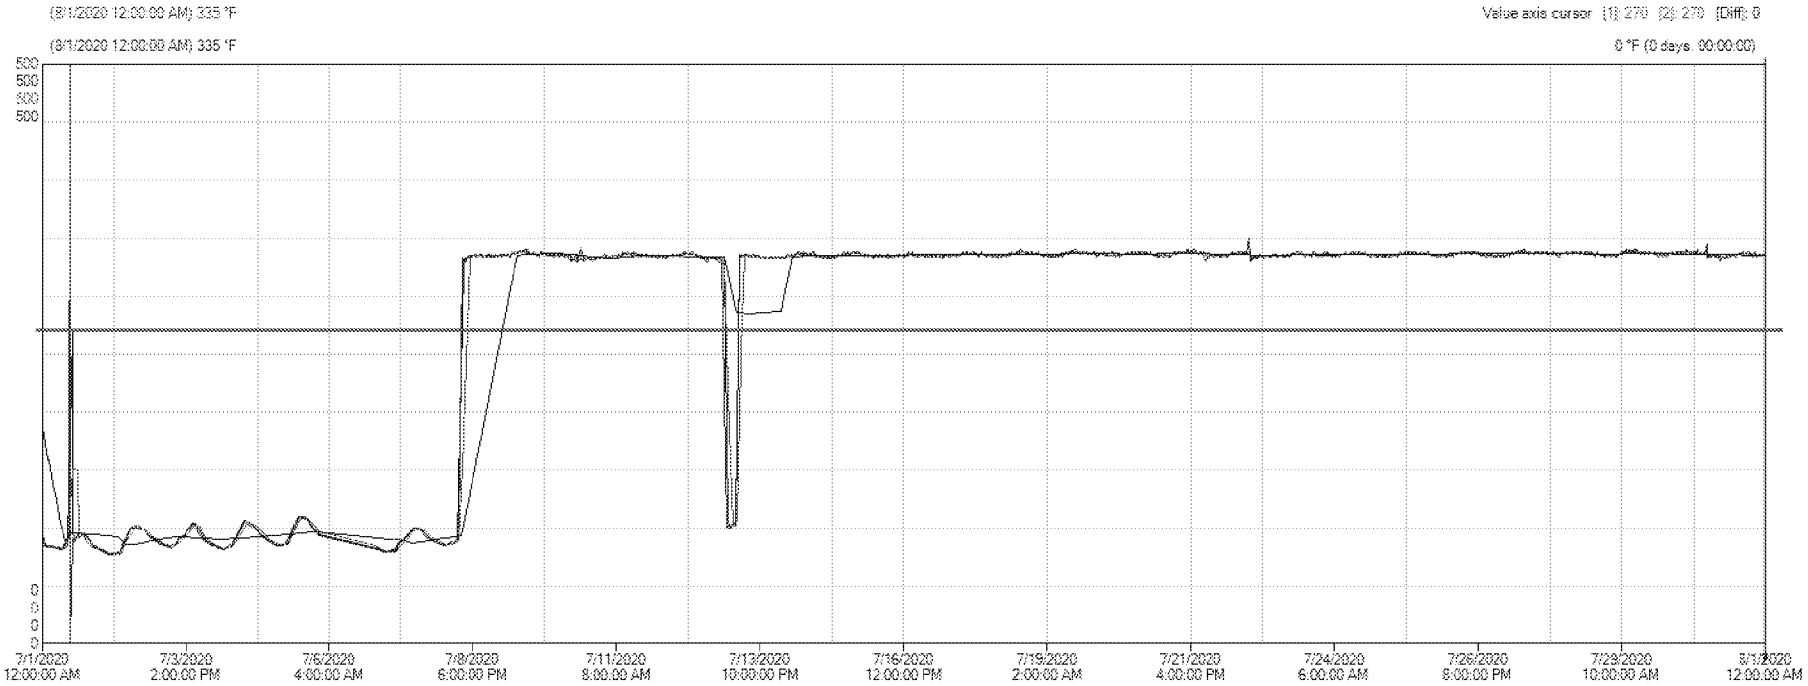

US01-WSTERDB:ETO_CatBedOutlet24HAvgTempF [BestFit - 00:02:43:09.646]

Tag Name	Description	Number	Server	Color	Units	Minimum	Maximum	IO Address	Time Offset	Source Tag	Source Server	Value at X1	Value at X2
☑ ETO_CatBedOutletTempF	CAT Bed Outlet Temperature (°F)	1	US01-W...		°F	0	500	\\bbmusl0\DASABCIP!ETO_1Sec!N27:420	0:00:00.000			336	336
☑ ETO_CatBedOutlet1HAvgTempF	CAT Bed Outlet 1 Hour Avg Temp (°F)	2	US01-W...		°F	0	500	\\bbmusl0\DASABCIP!ETO_1Sec!N27:650	0:00:00.000			336	336
☑ ETO_CatBedOutlet3HAvgTempF	CAT Bed Outlet 3 Hour Avg Temp (°F)	3	US01-W...		°F	0	500	\\bbmusl0\DASABCIP!ETO_1Sec!N27:670	0:00:00.000			336	336
☑ [illegible]	CAT Bed Outlet 24 Hour Avg Temp (°F)	4	US01-W...		°F	0	500	\\bbmusl0\DASABCIP!ETO_1Sec!N27:710	0:00:00.000			335	335

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

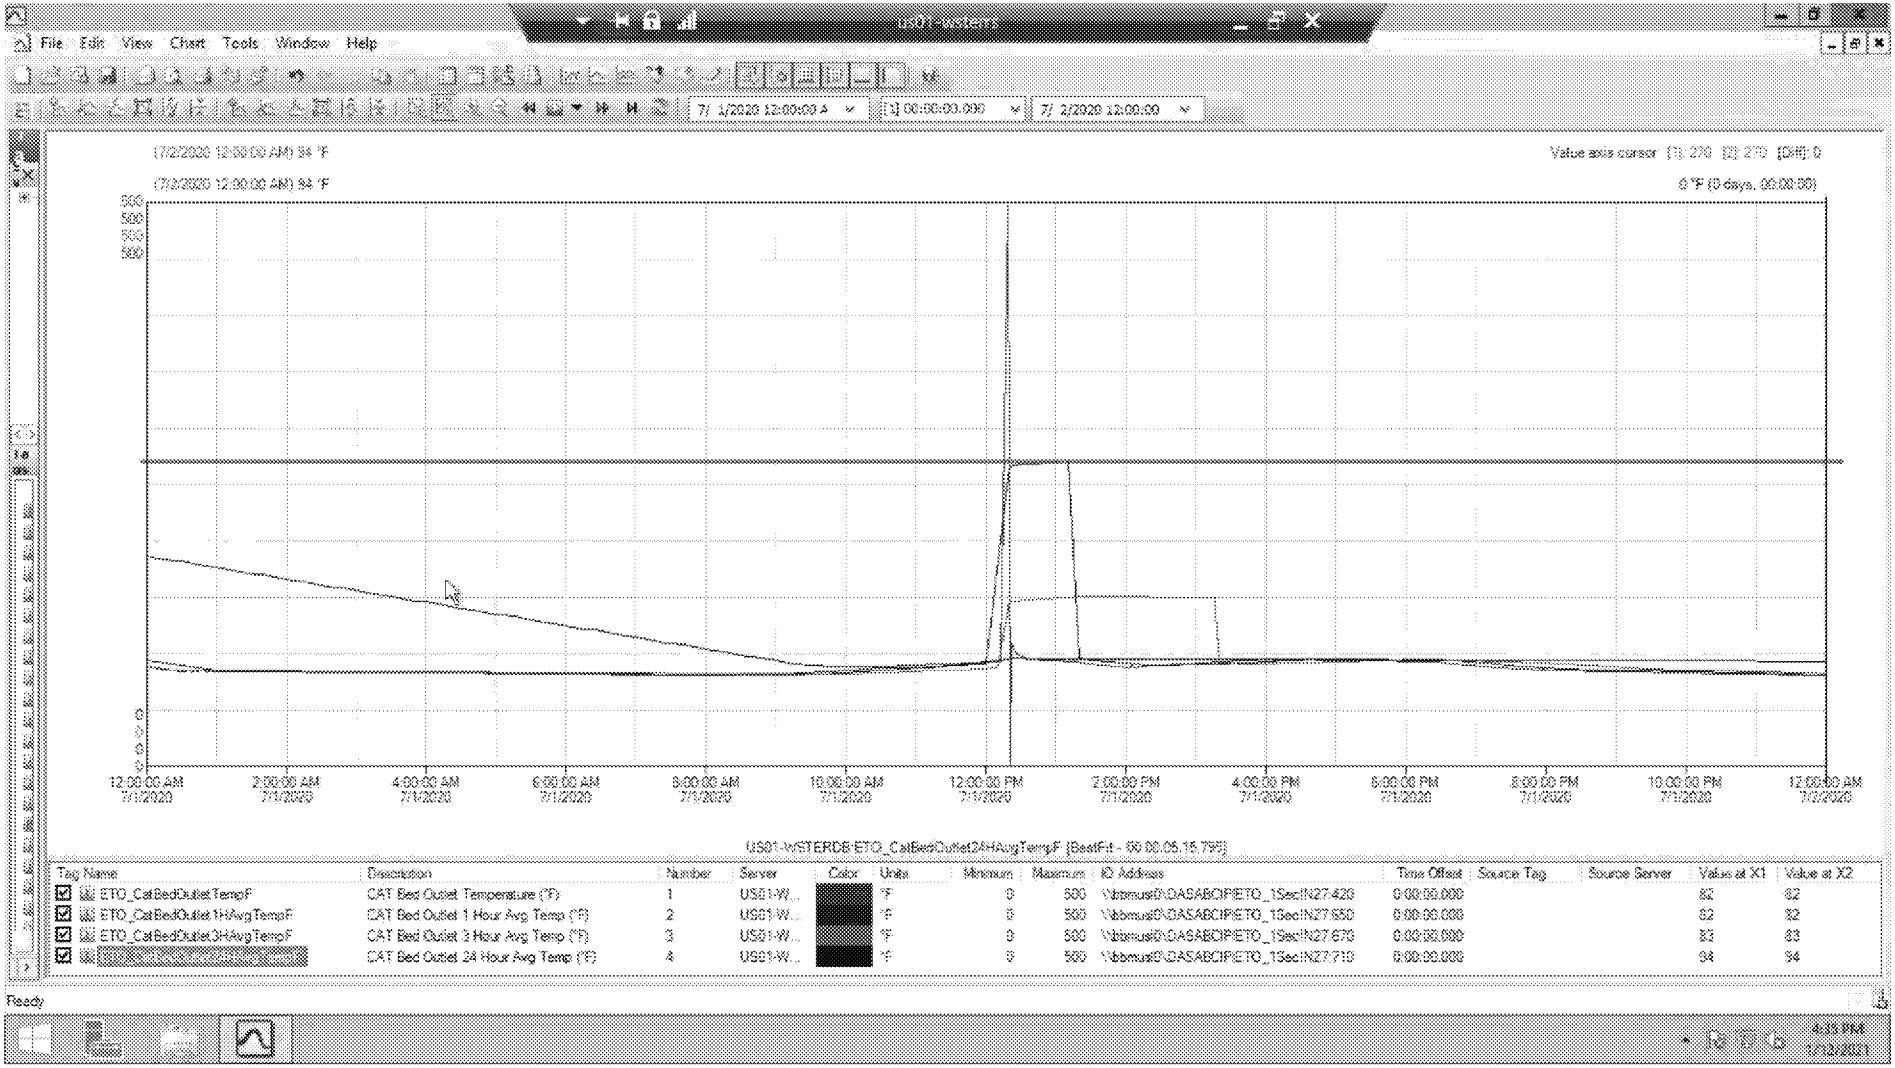

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

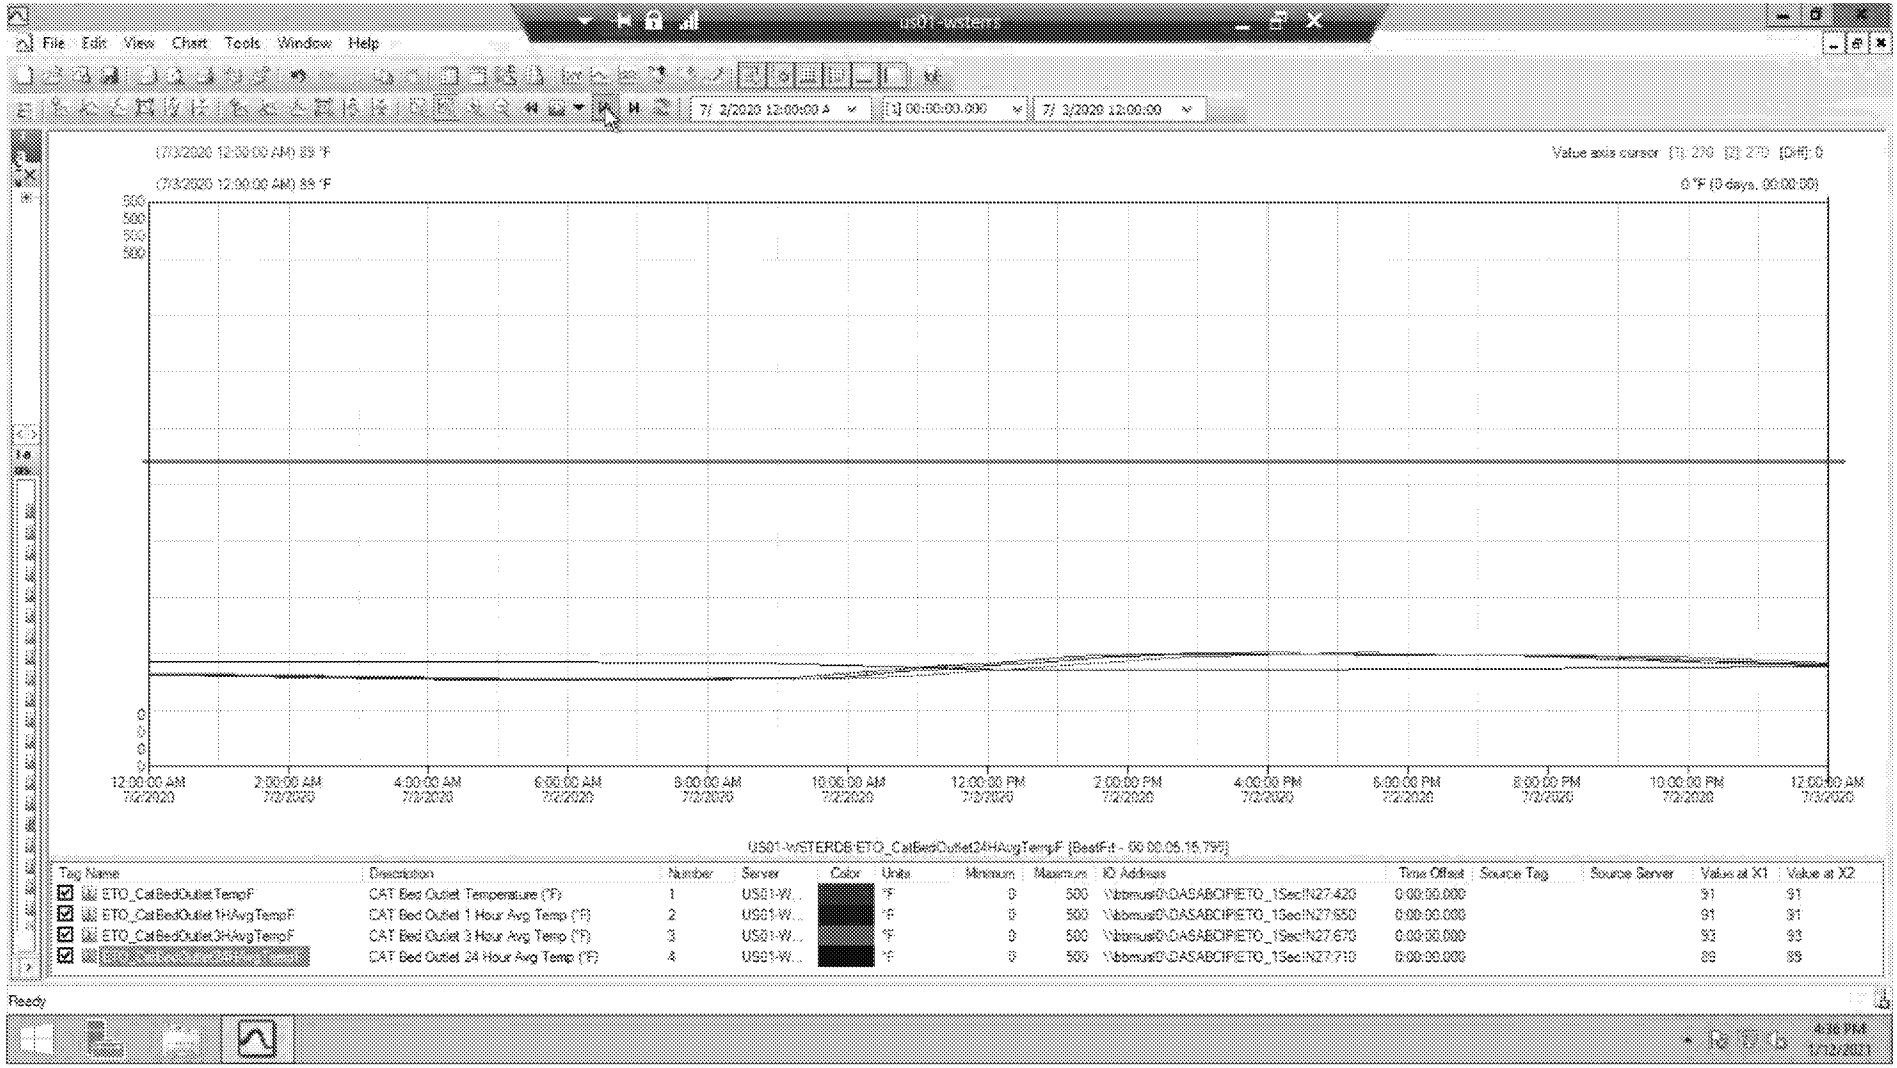

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

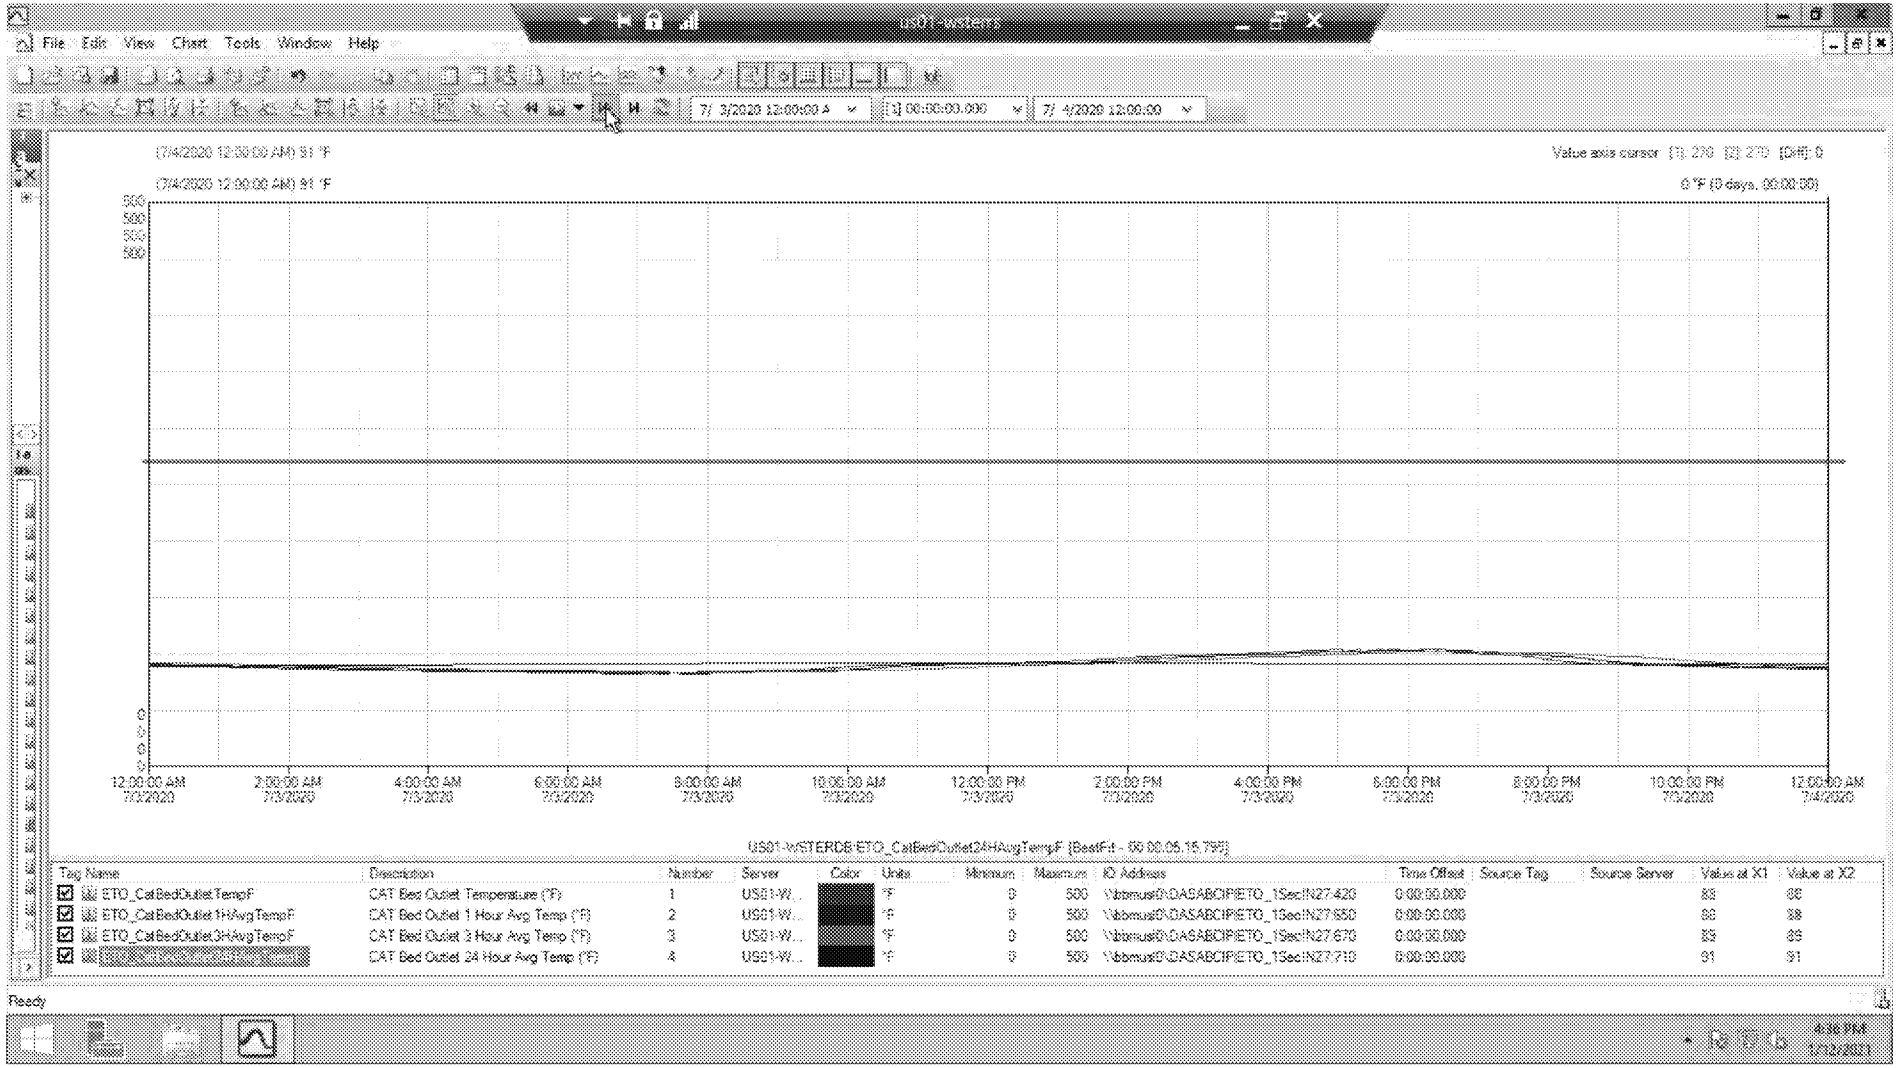

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

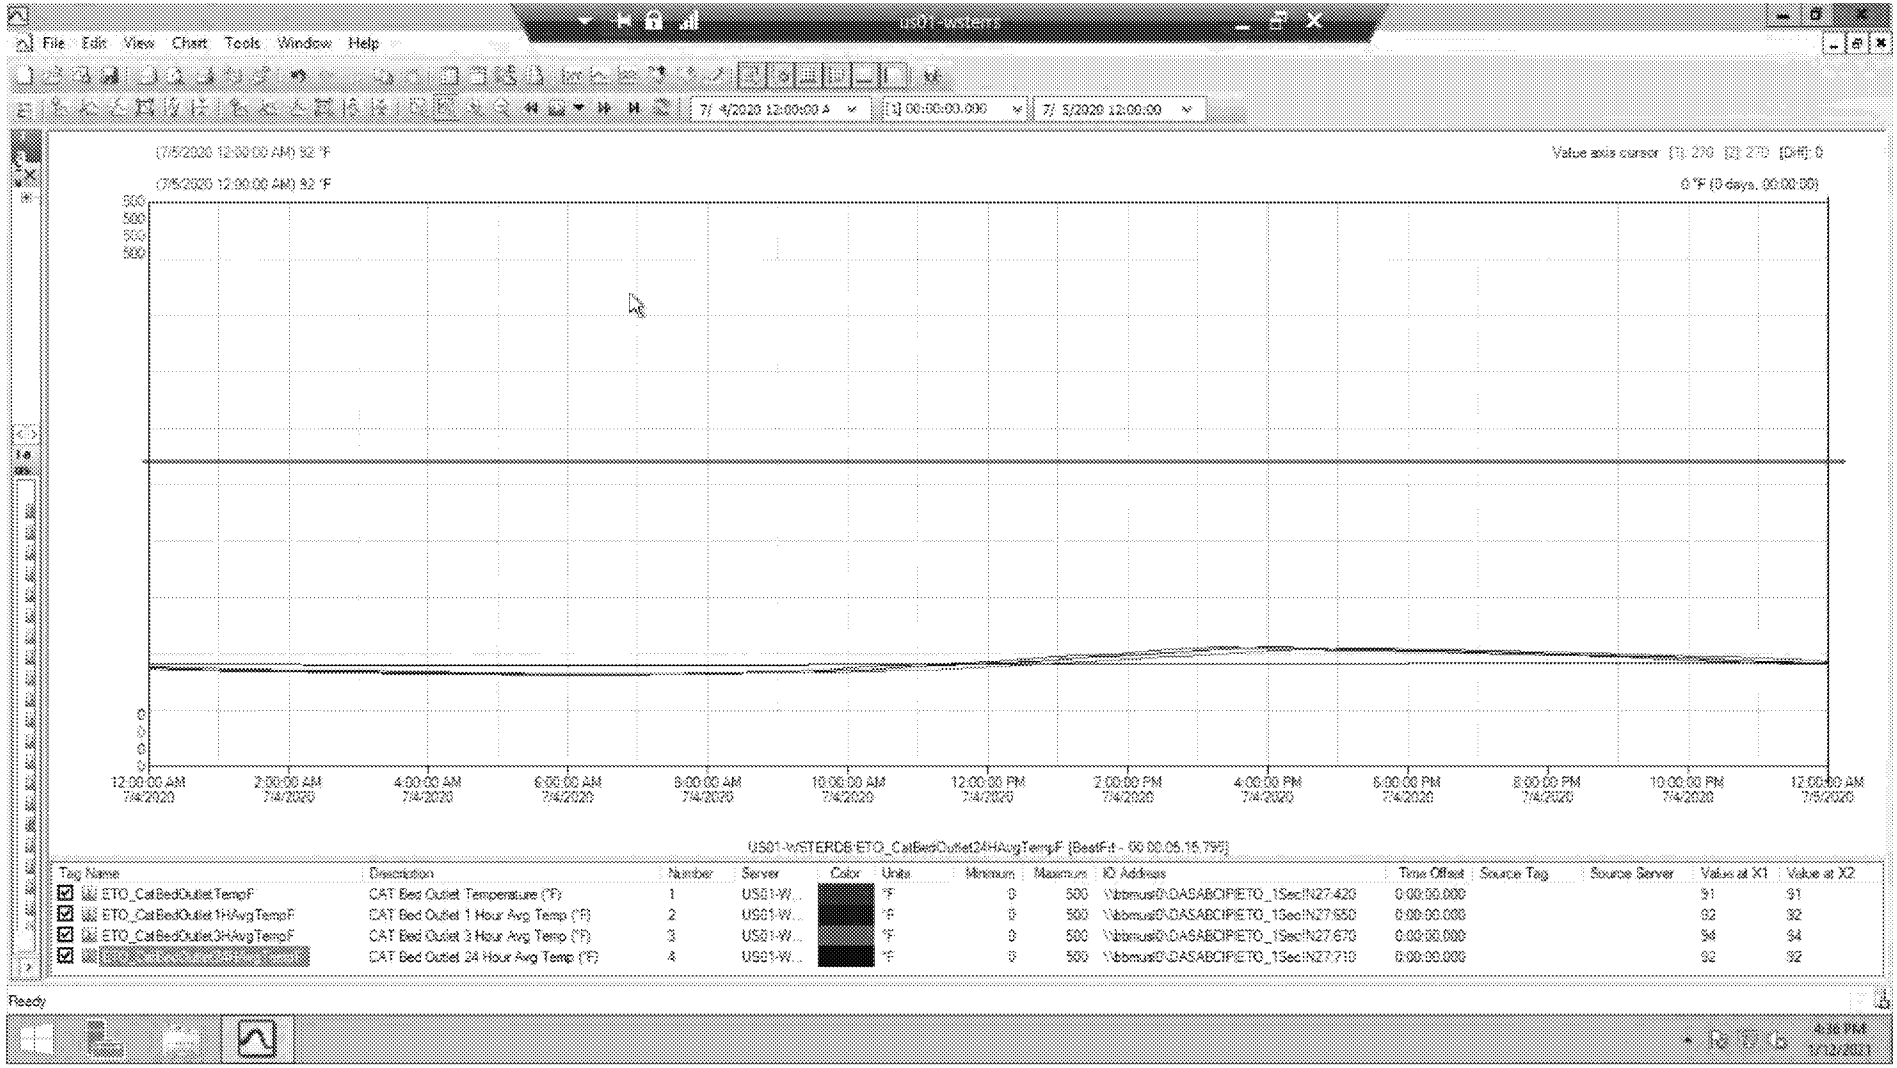

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

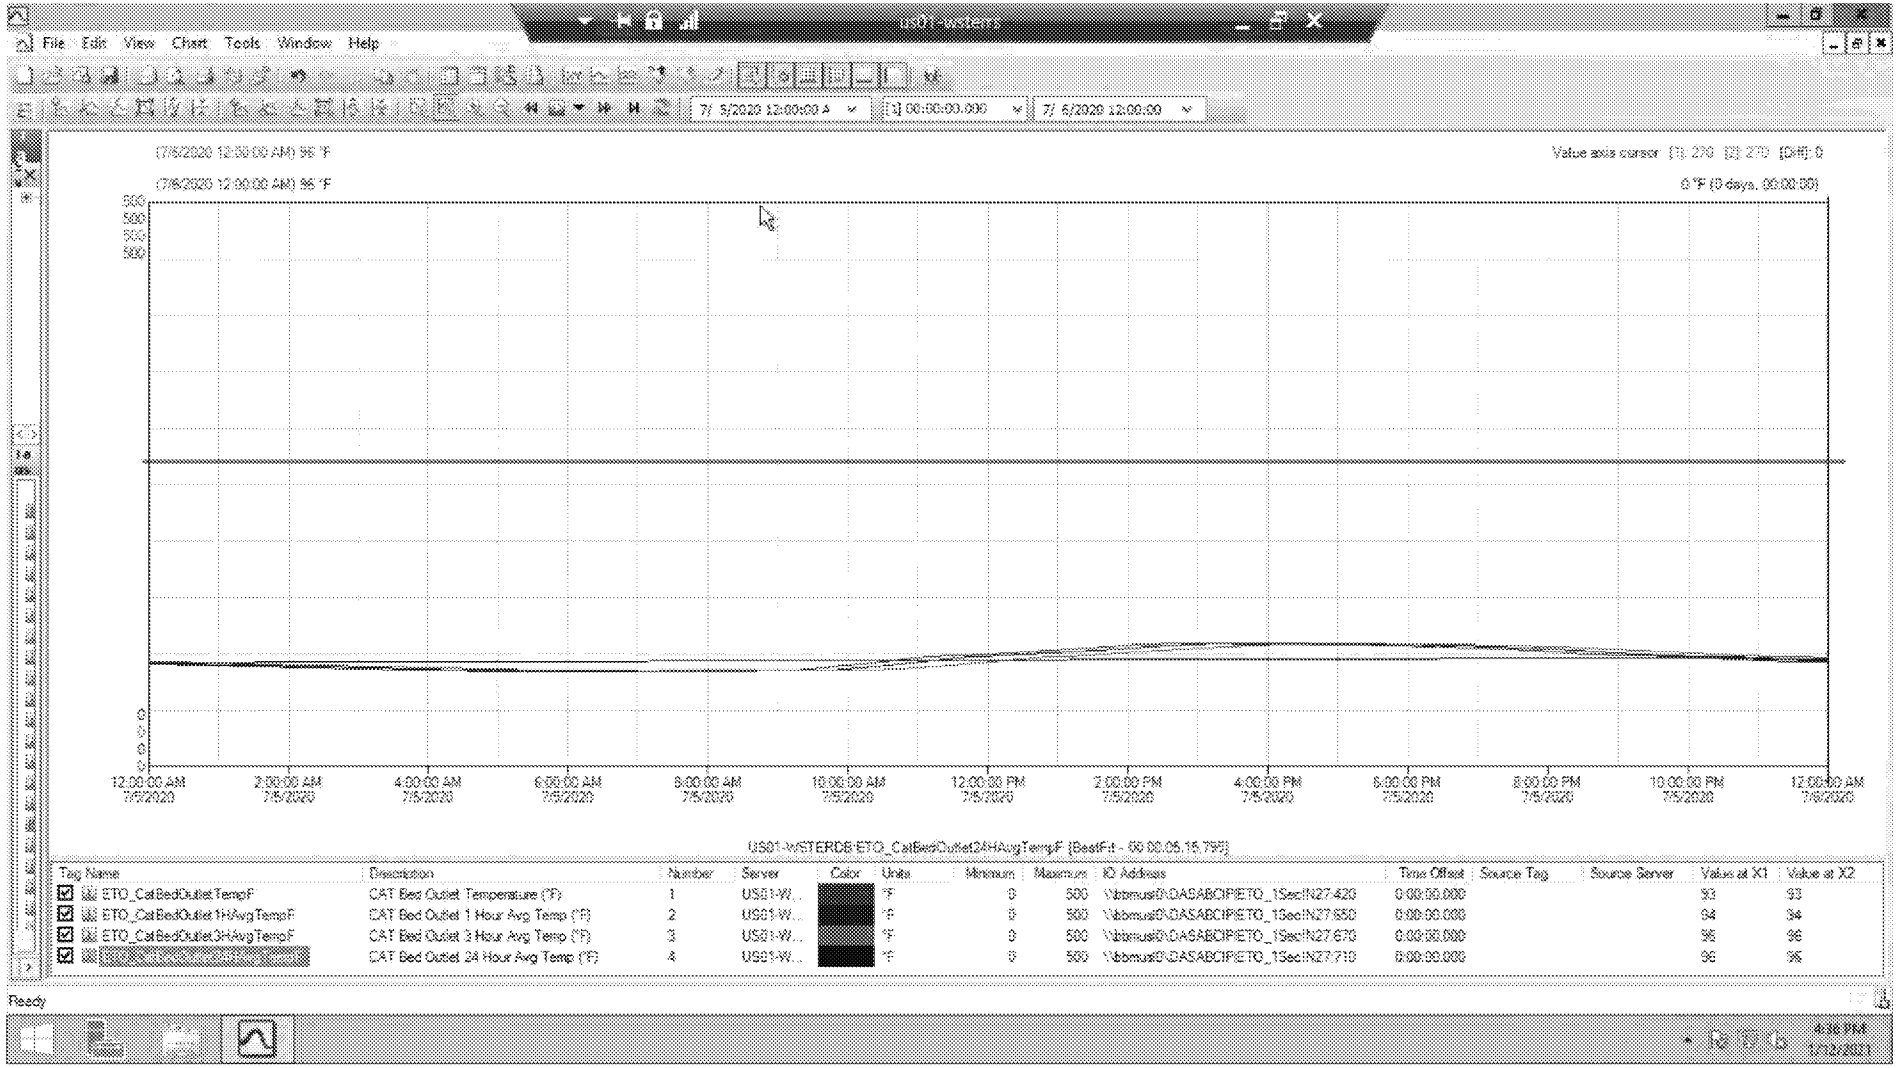

Tag Name	Description	Number	Server	Color	Units	Minimum	Maximum	IO Address	Time Offset	Source Tag	Source Server	Value at X1	Value at X2
ETO_CatBedOutletTempF	CAT Bed Outlet Temperature (°F)	1	US01-W...		°F	0	500	\\bbmus0\DASABCIP\ETO_1Sec!N27.420	0:00:00.000			93	93
ETO_CatBedOutlet1HAvgTempF	CAT Bed Outlet 1 Hour Avg Temp (°F)	2	US01-W...		°F	0	500	\\bbmus0\DASABCIP\ETO_1Sec!N27.650	0:00:00.000			94	94
ETO_CatBedOutlet3HAvgTempF	CAT Bed Outlet 3 Hour Avg Temp (°F)	3	US01-W...		°F	0	500	\\bbmus0\DASABCIP\ETO_1Sec!N27.670	0:00:00.000			96	96
	CAT Bed Outlet 24 Hour Avg Temp (°F)	4	US01-W...		°F	0	500	\\bbmus0\DASABCIP\ETO_1Sec!N27.710	0:00:00.000			96	96

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

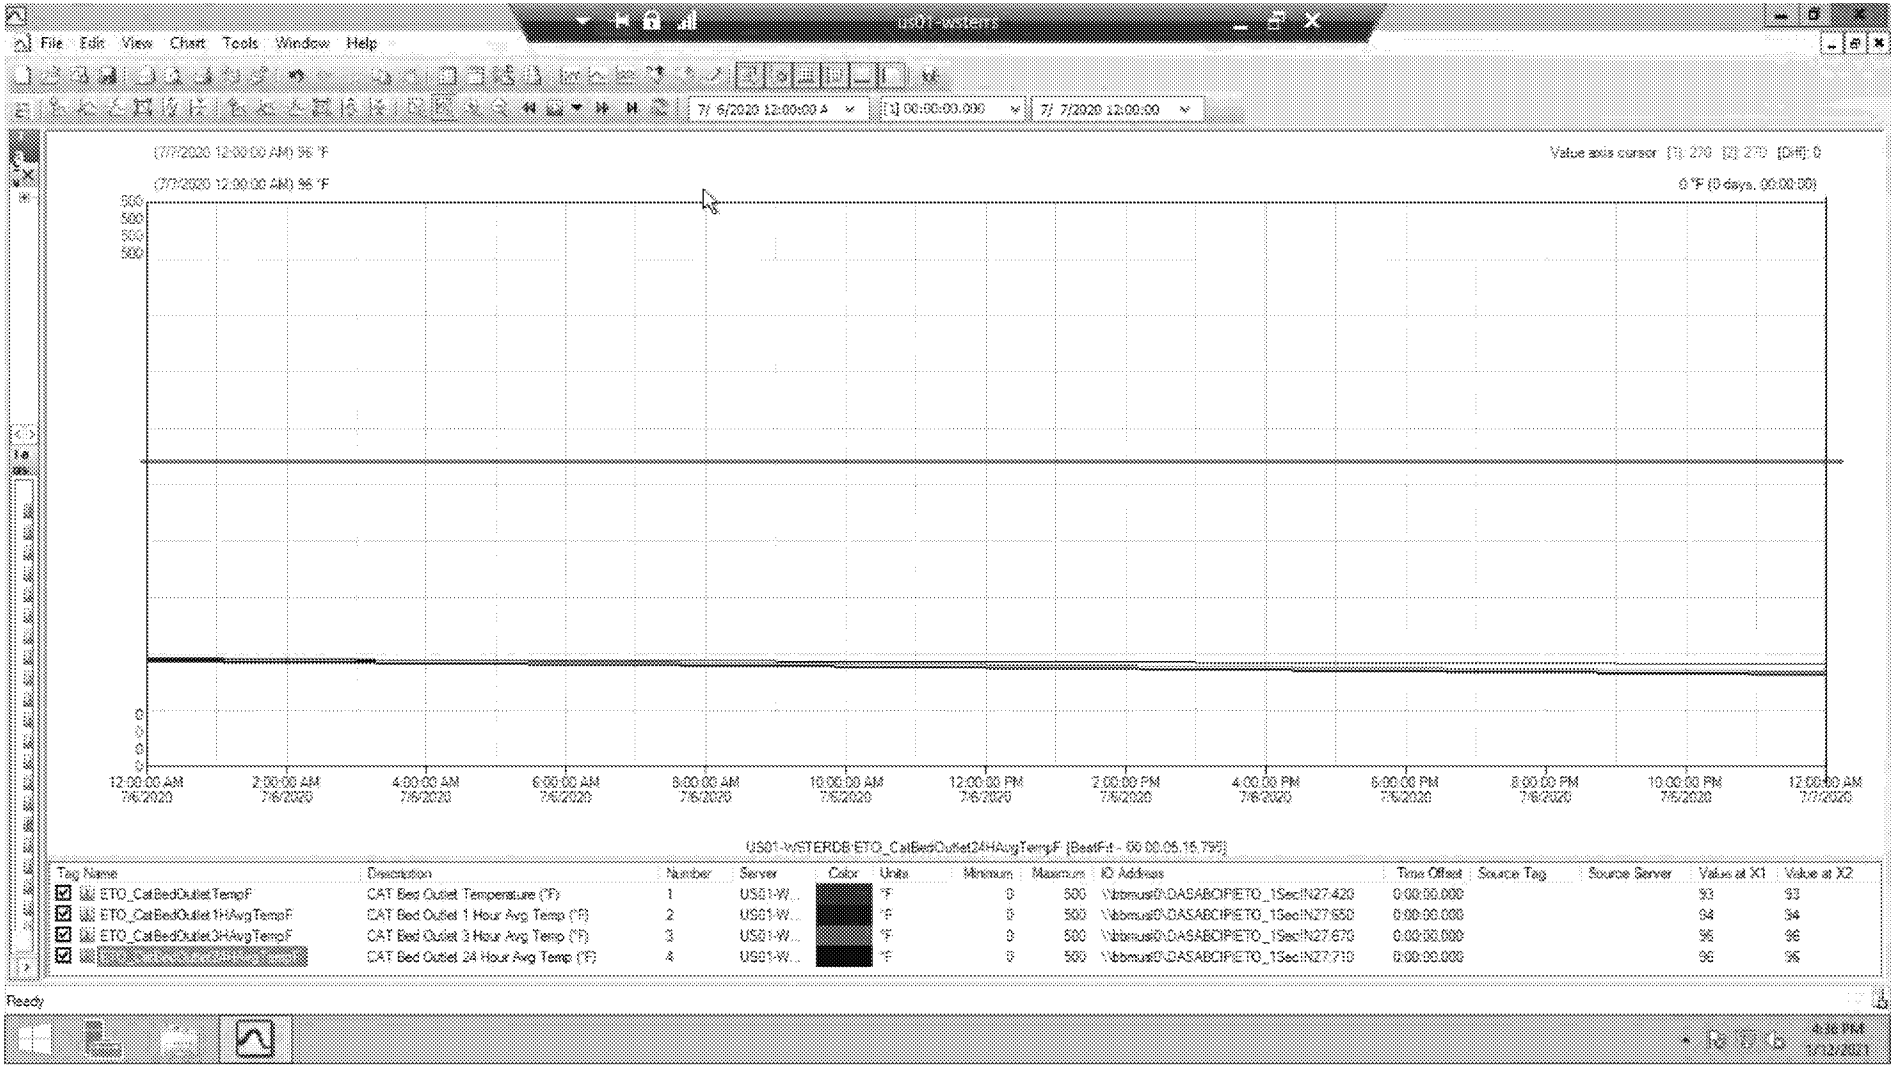

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

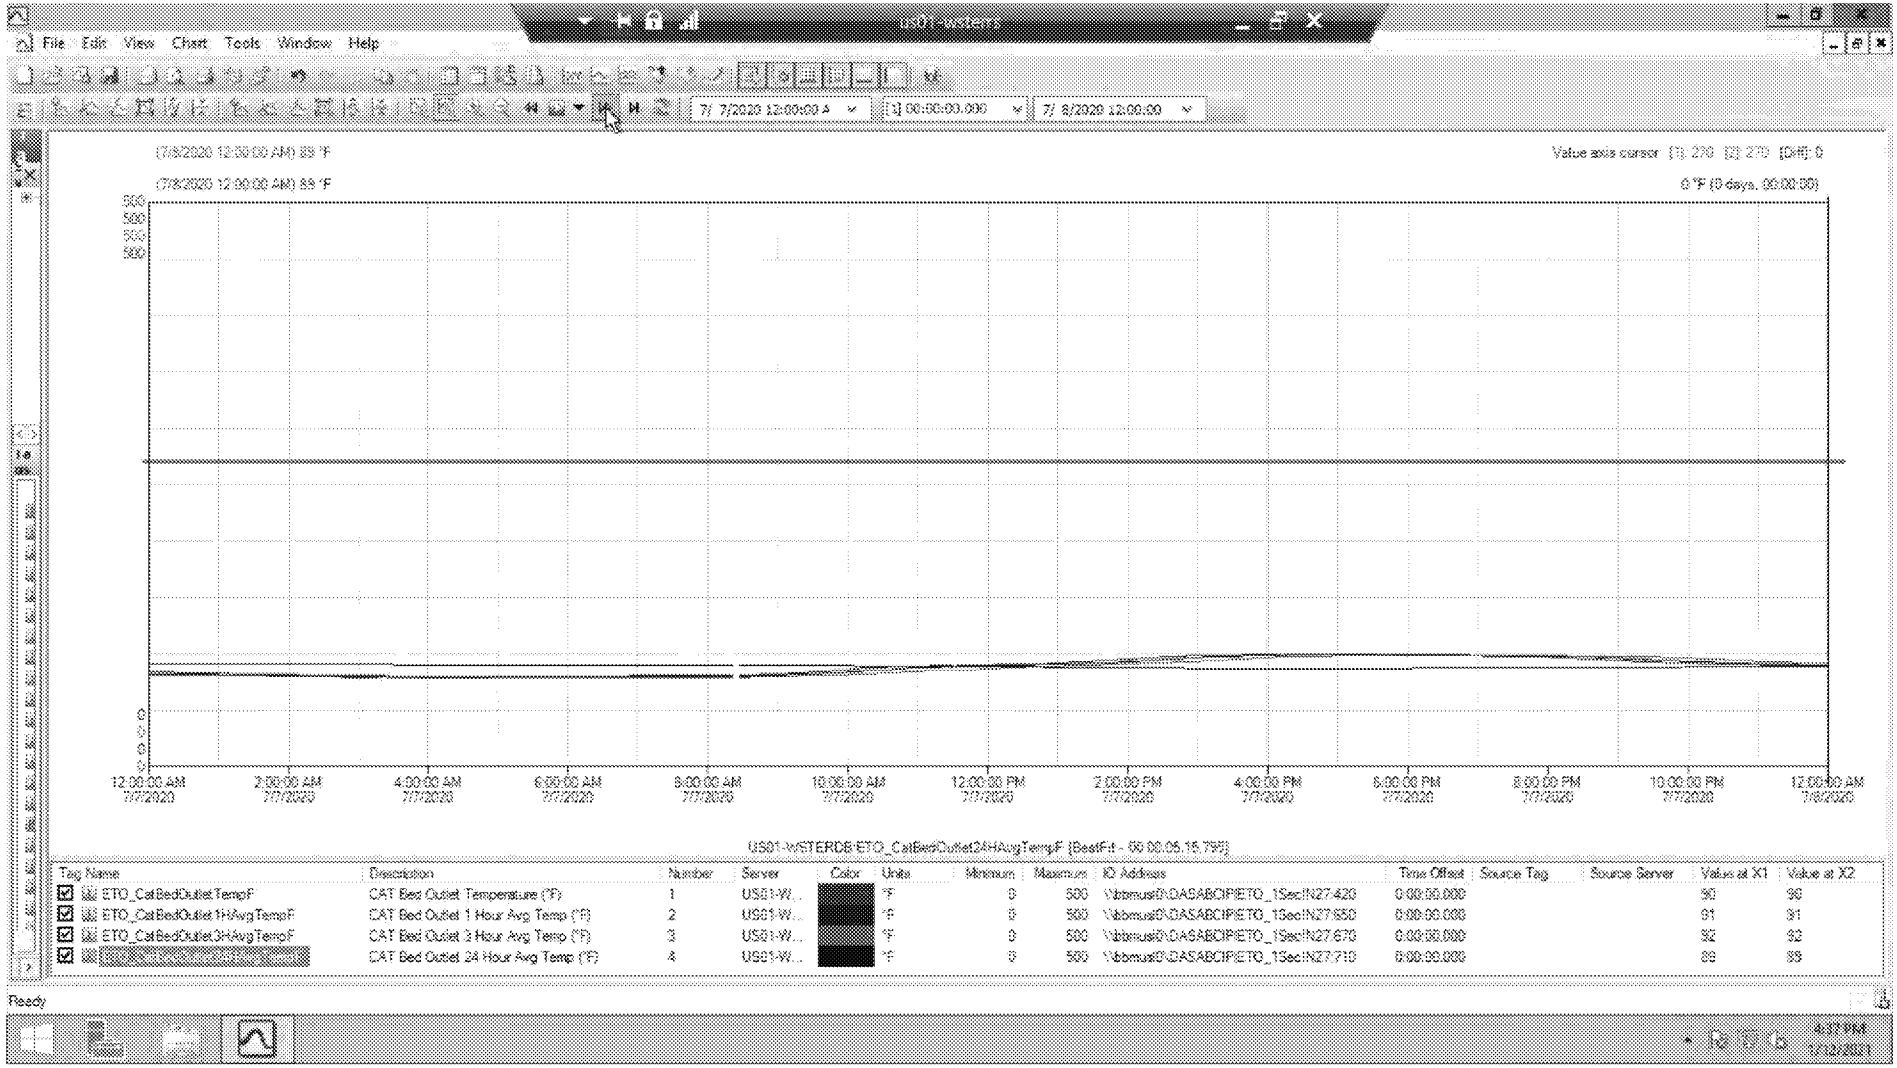

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

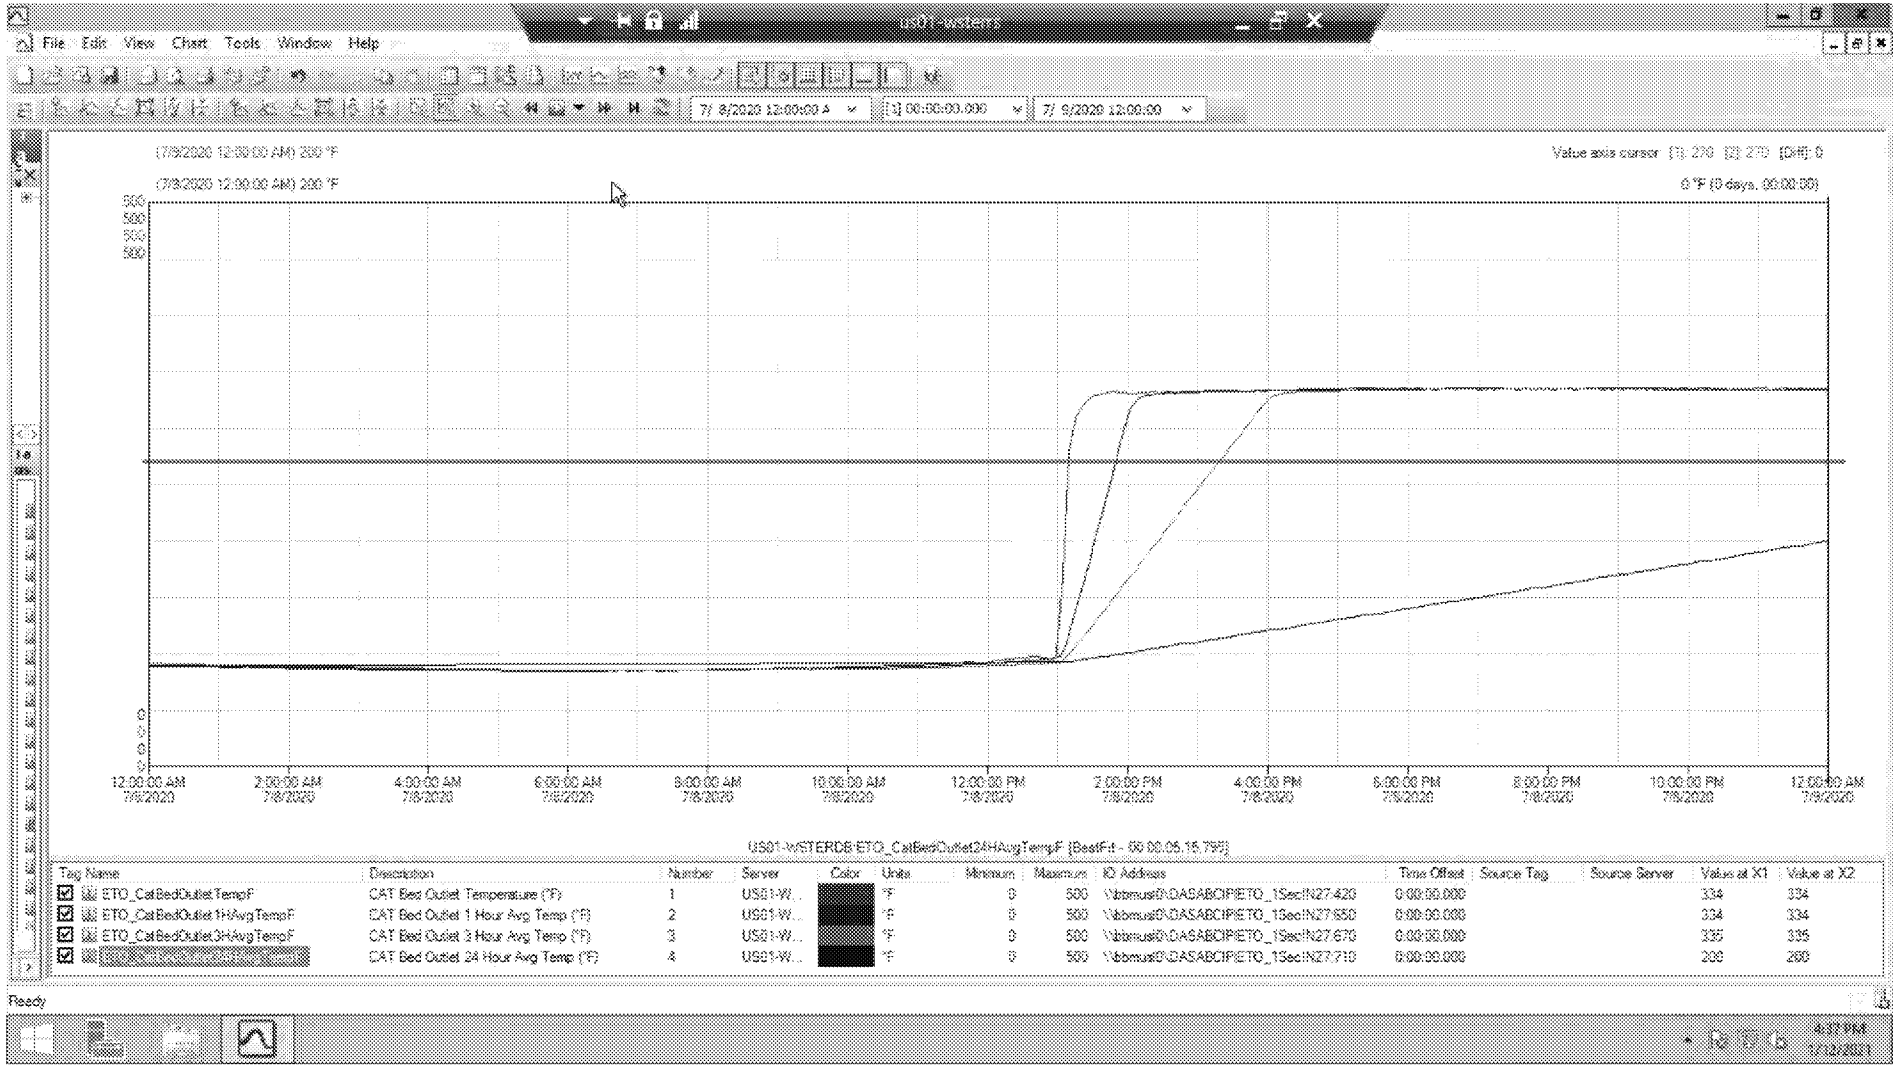

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Jul 2020

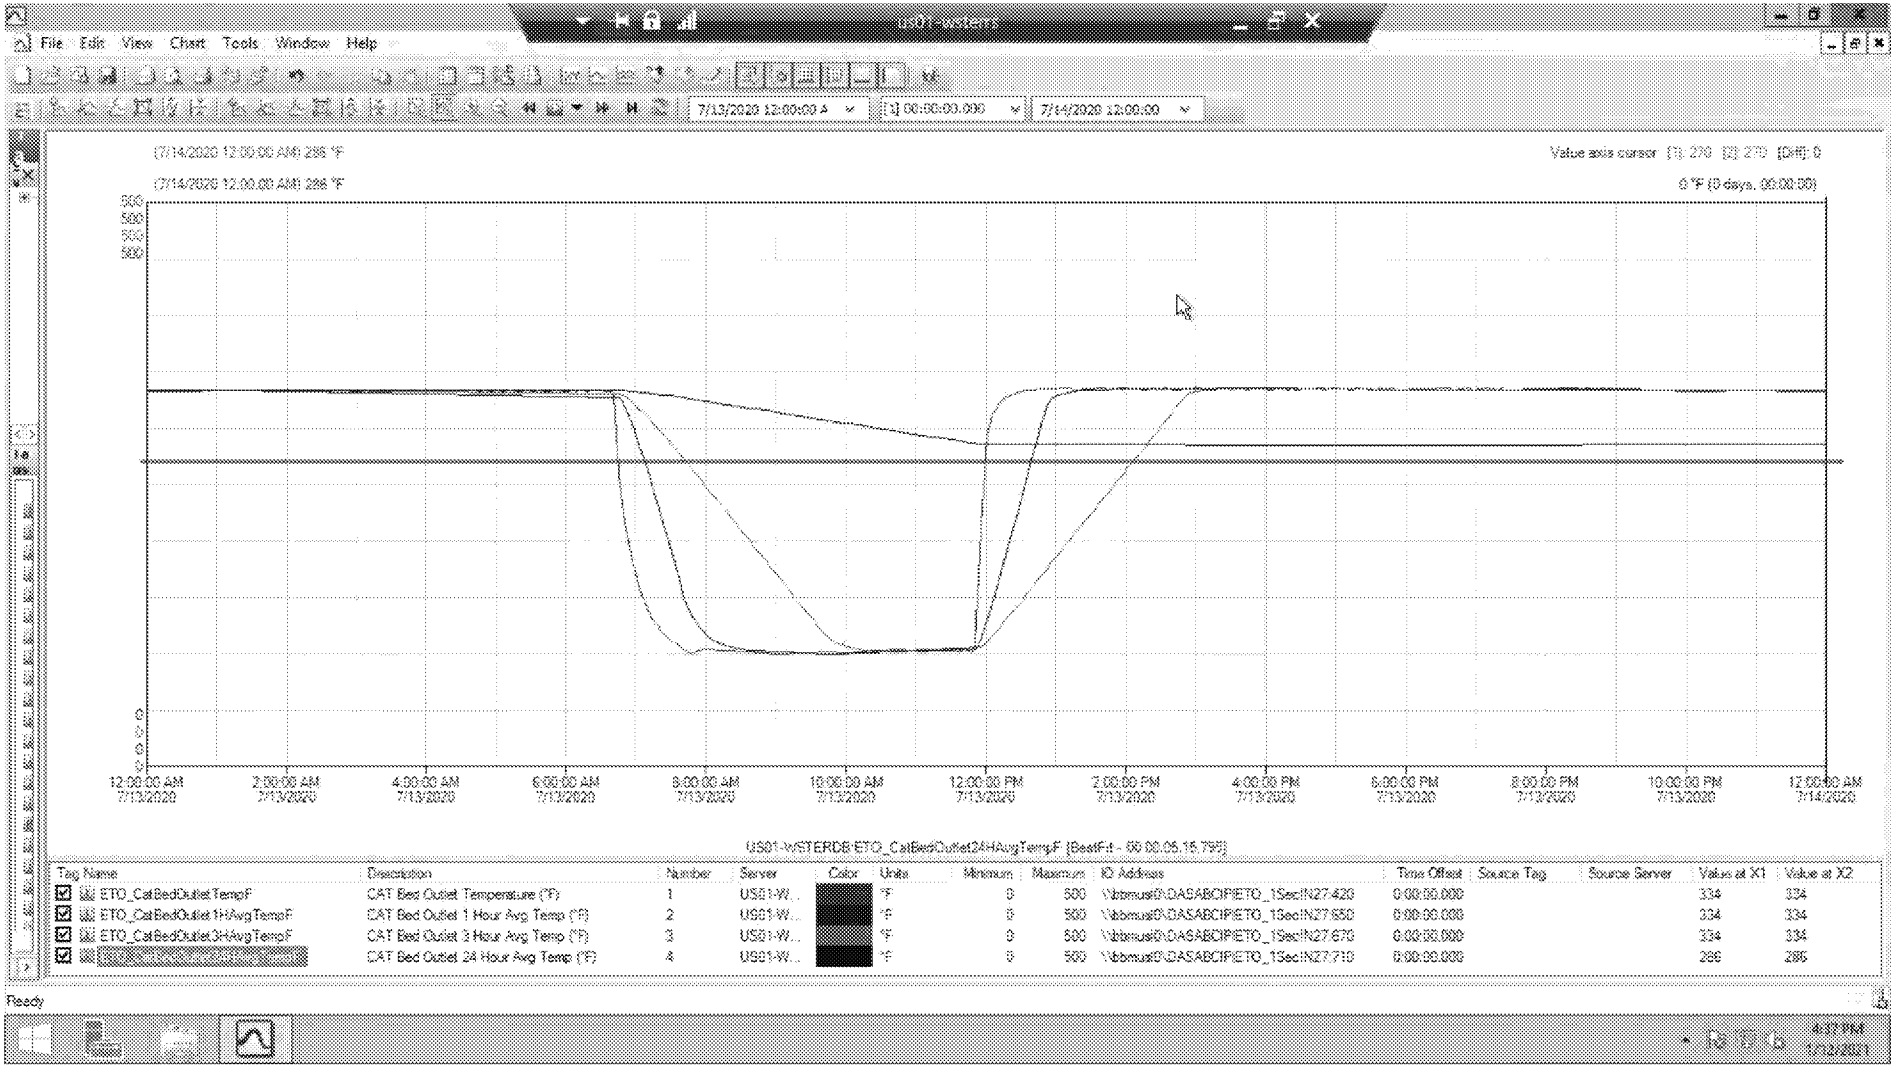

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

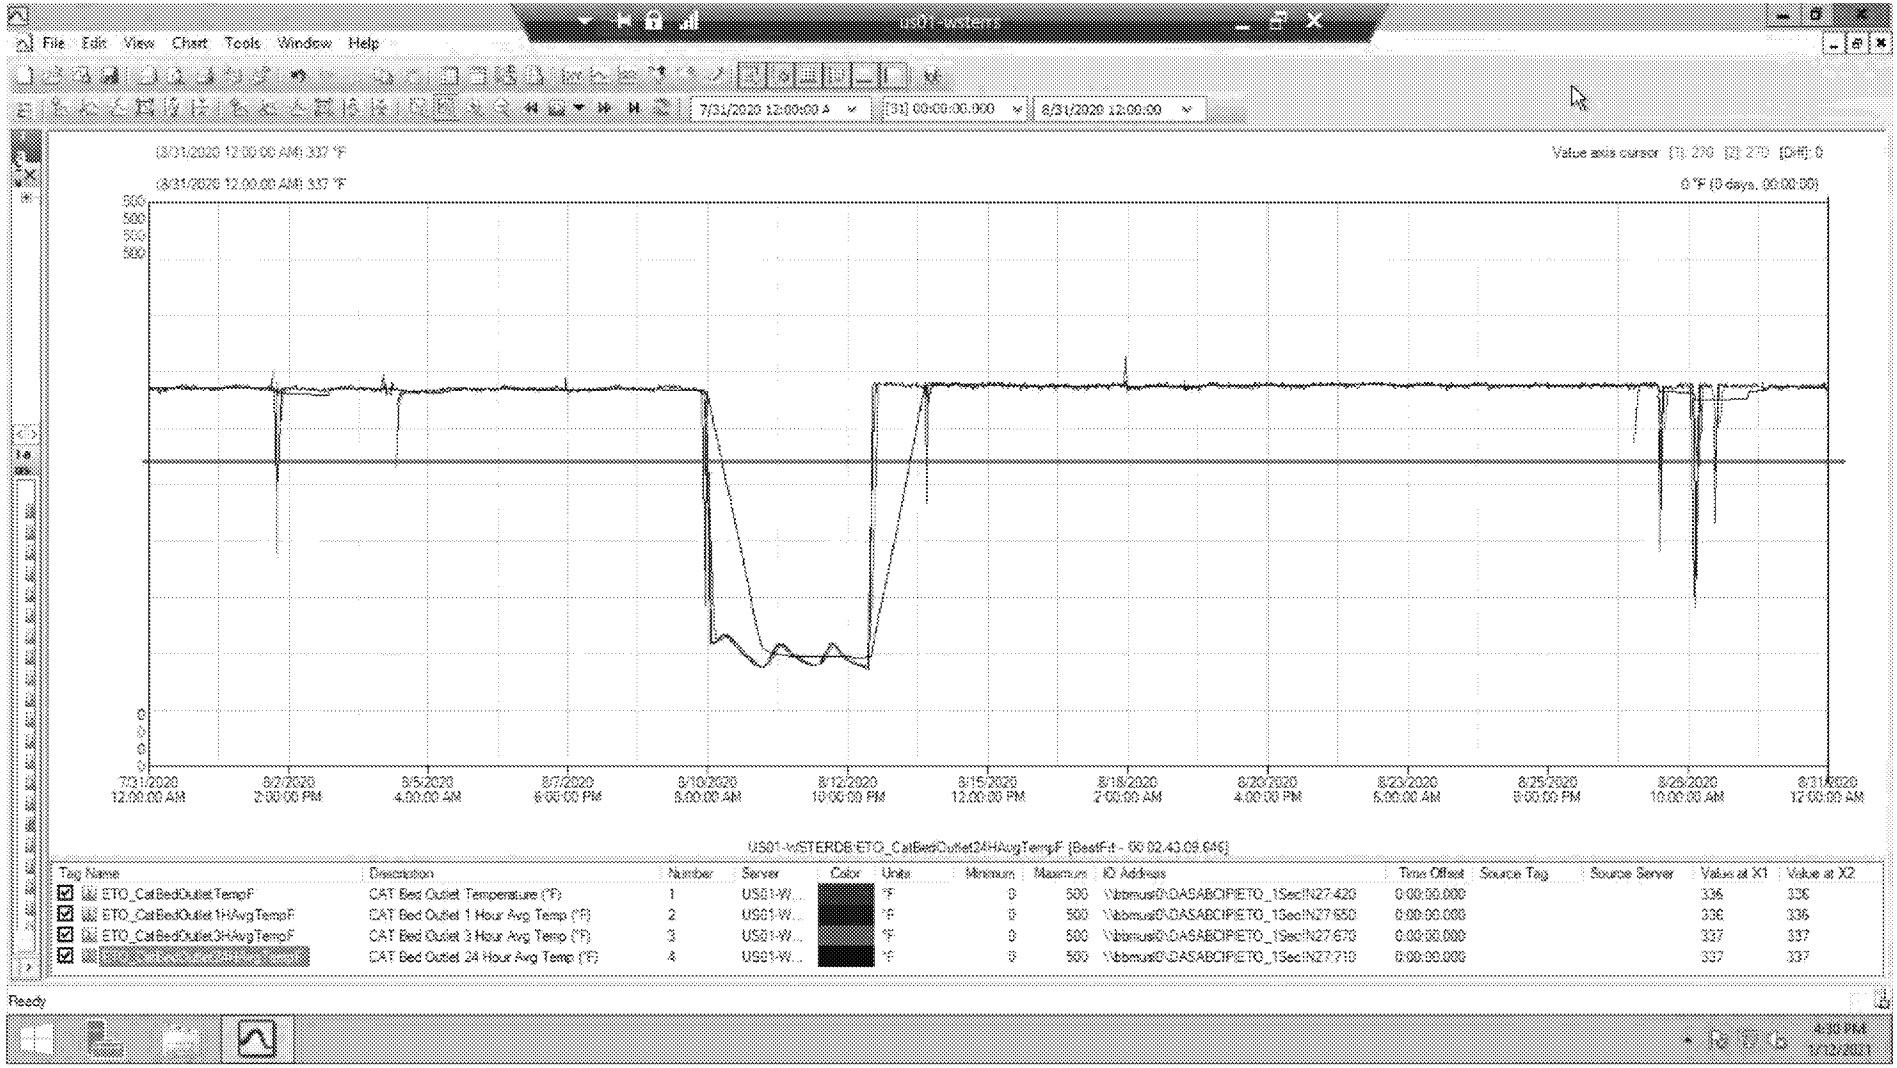

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

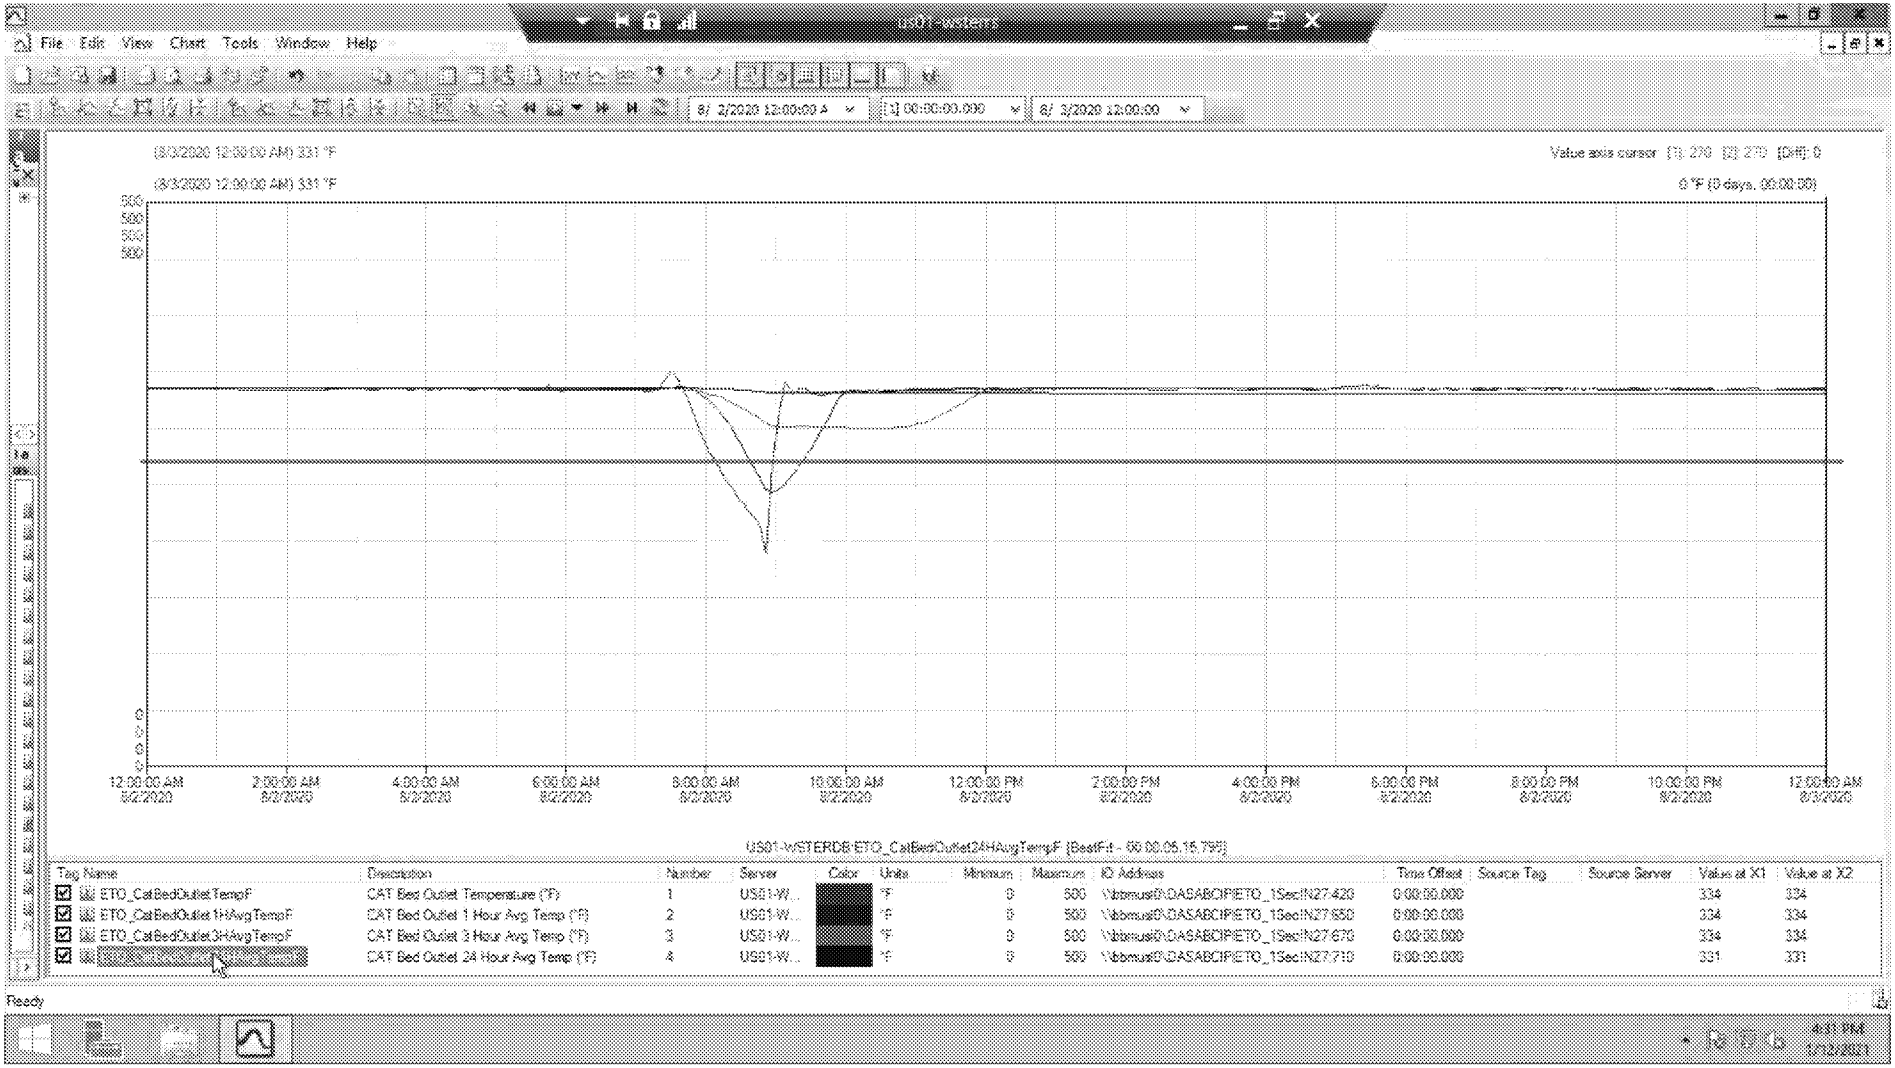

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

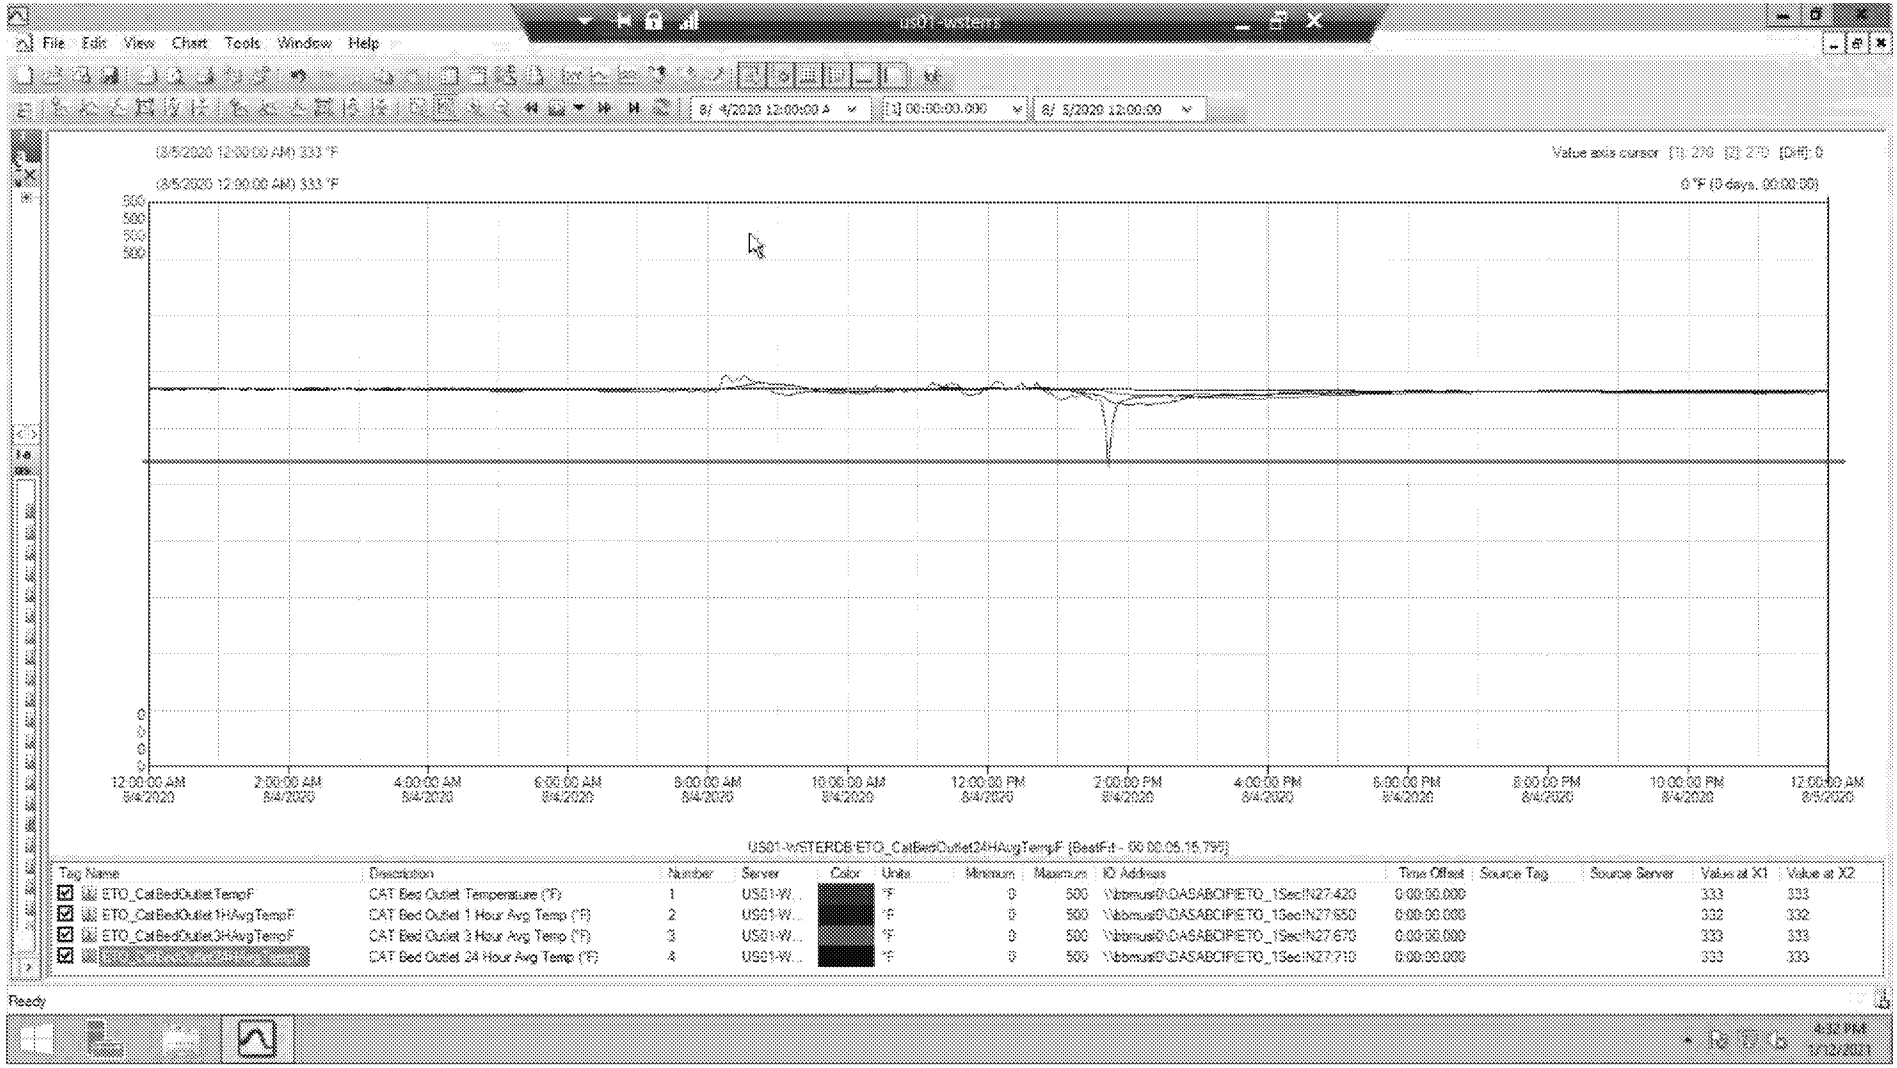

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

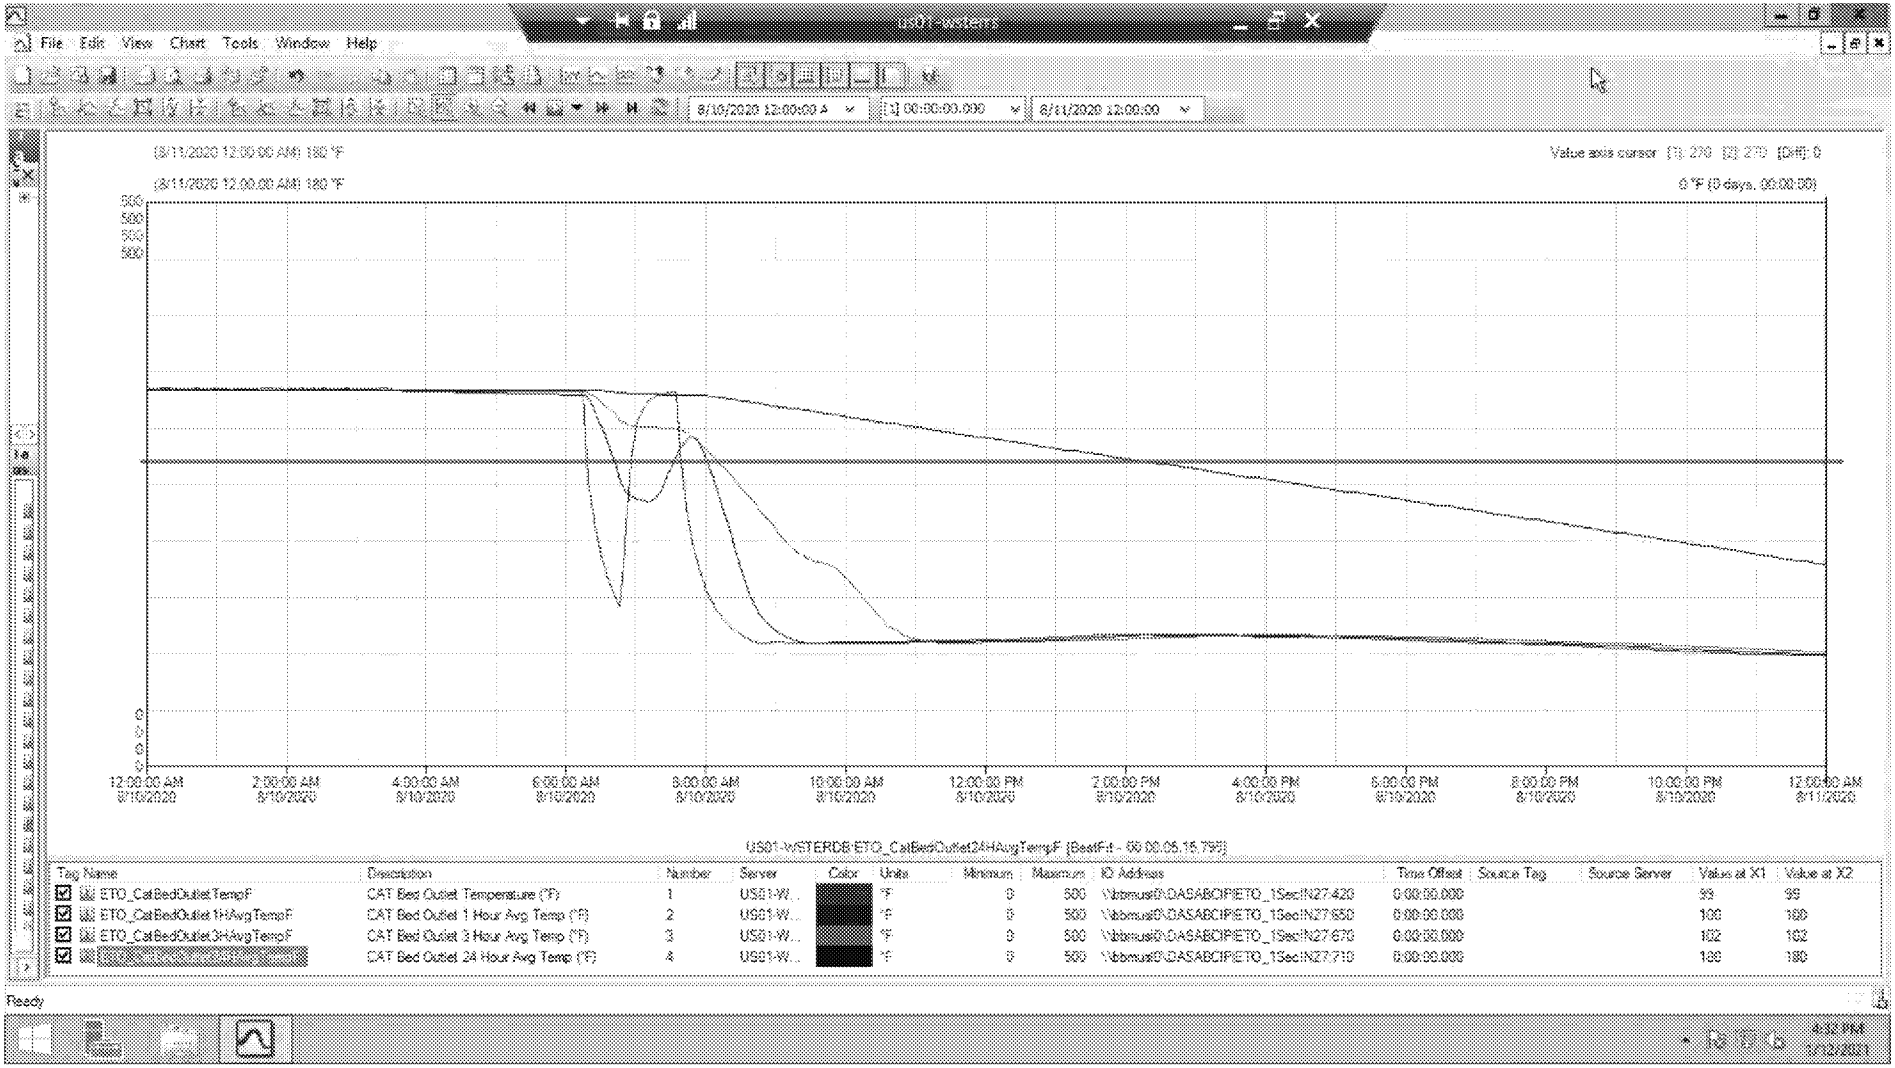

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

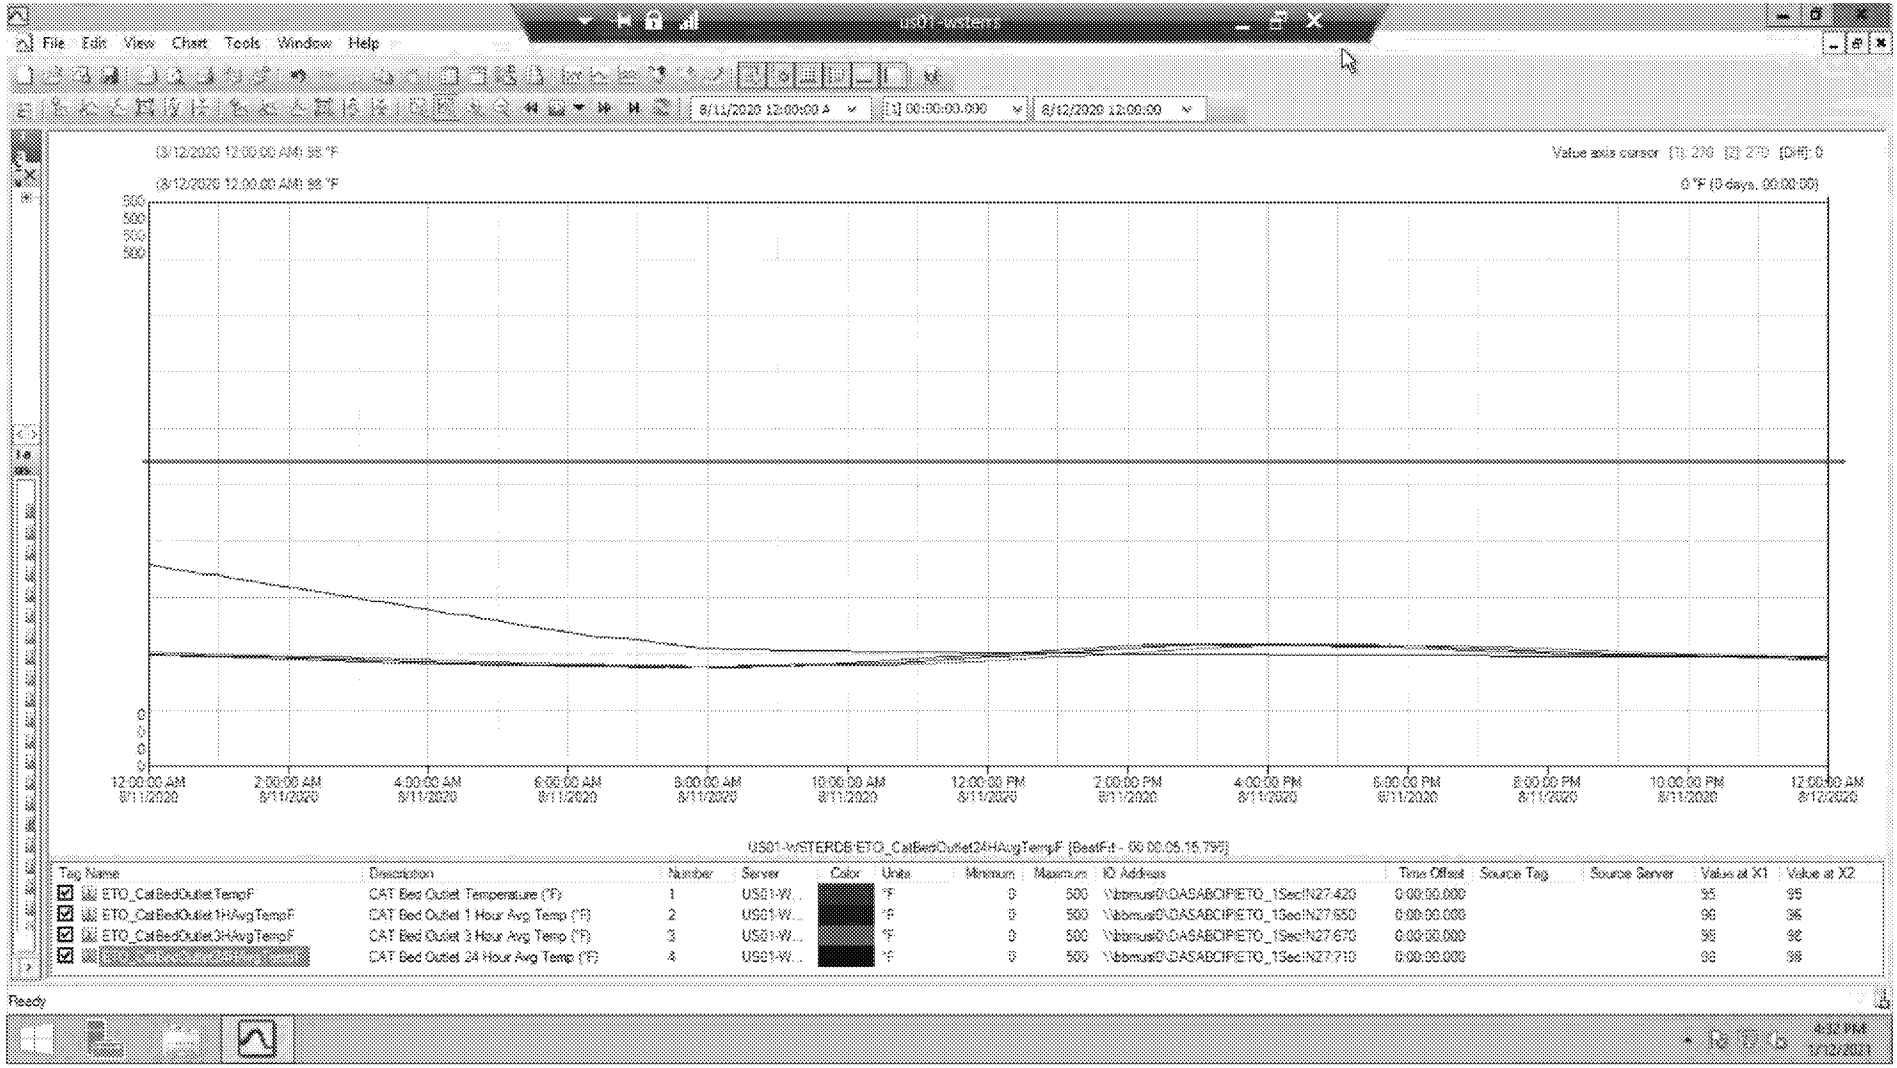

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

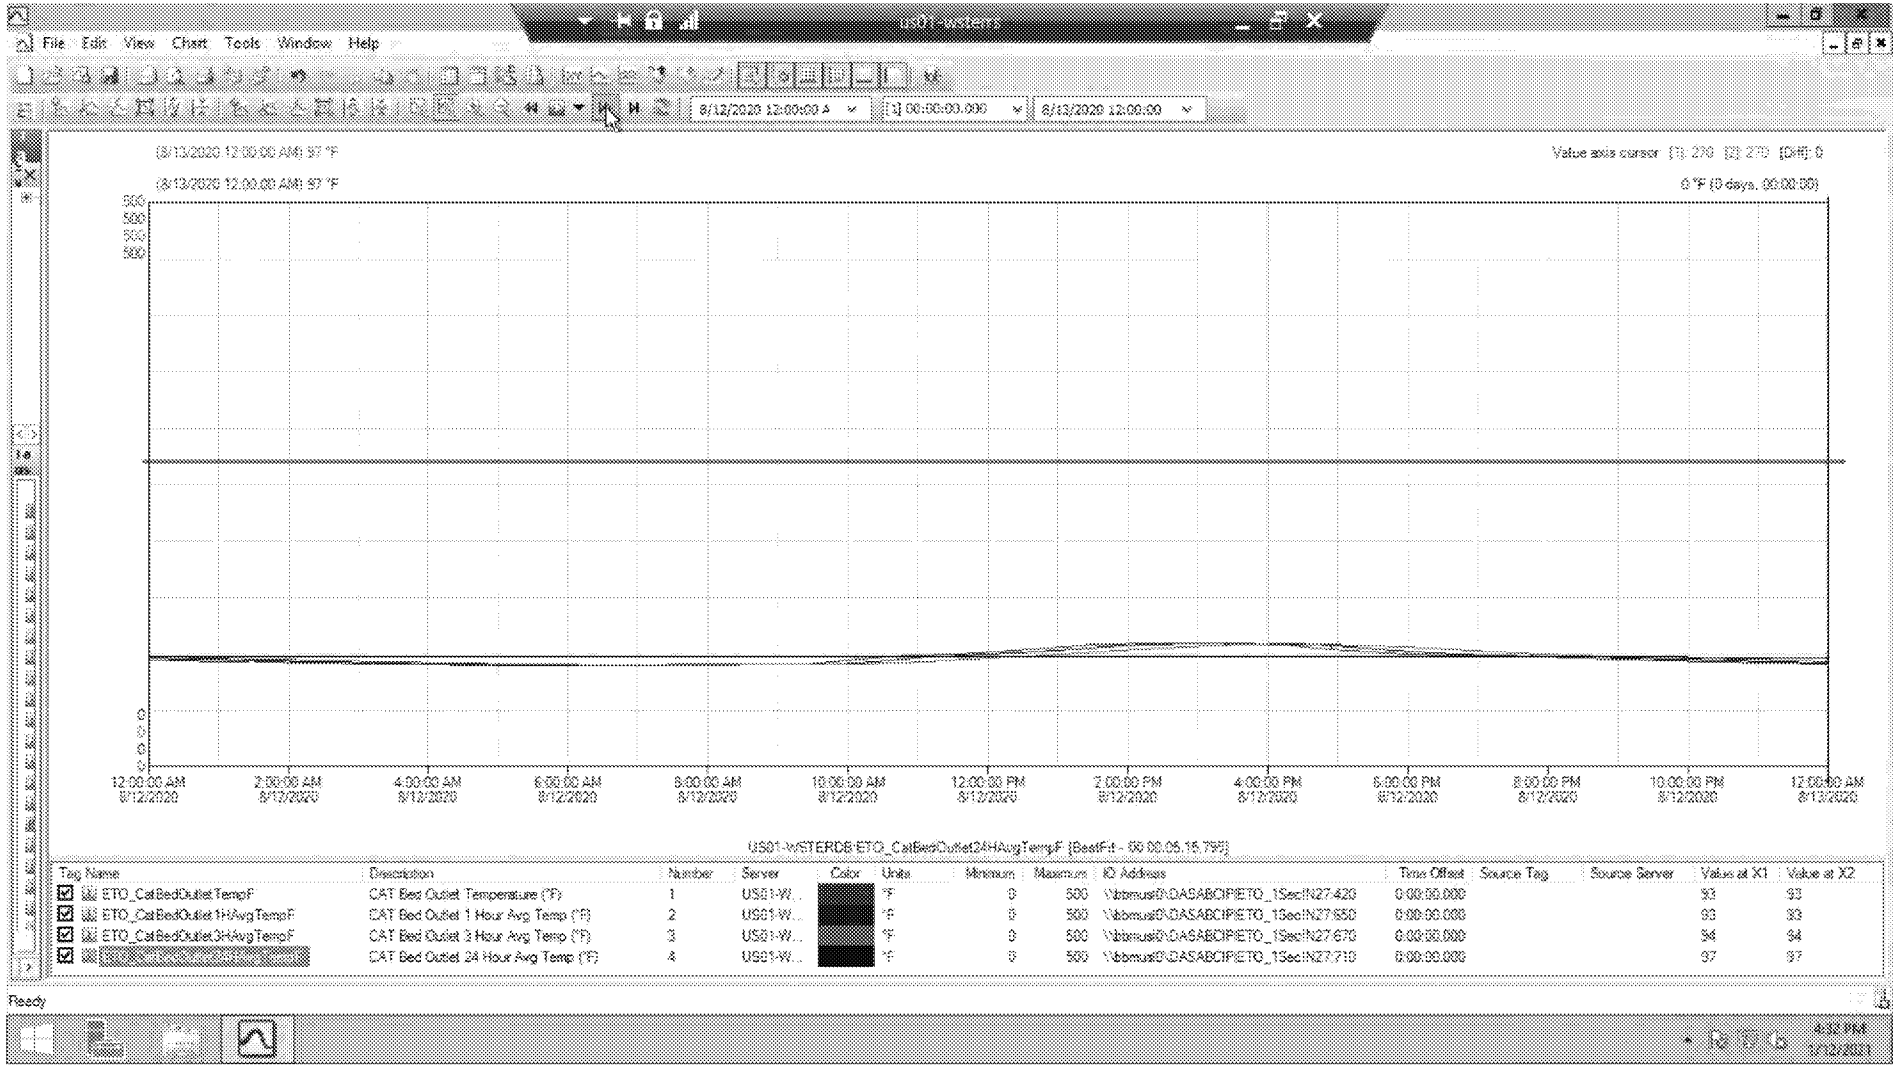

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

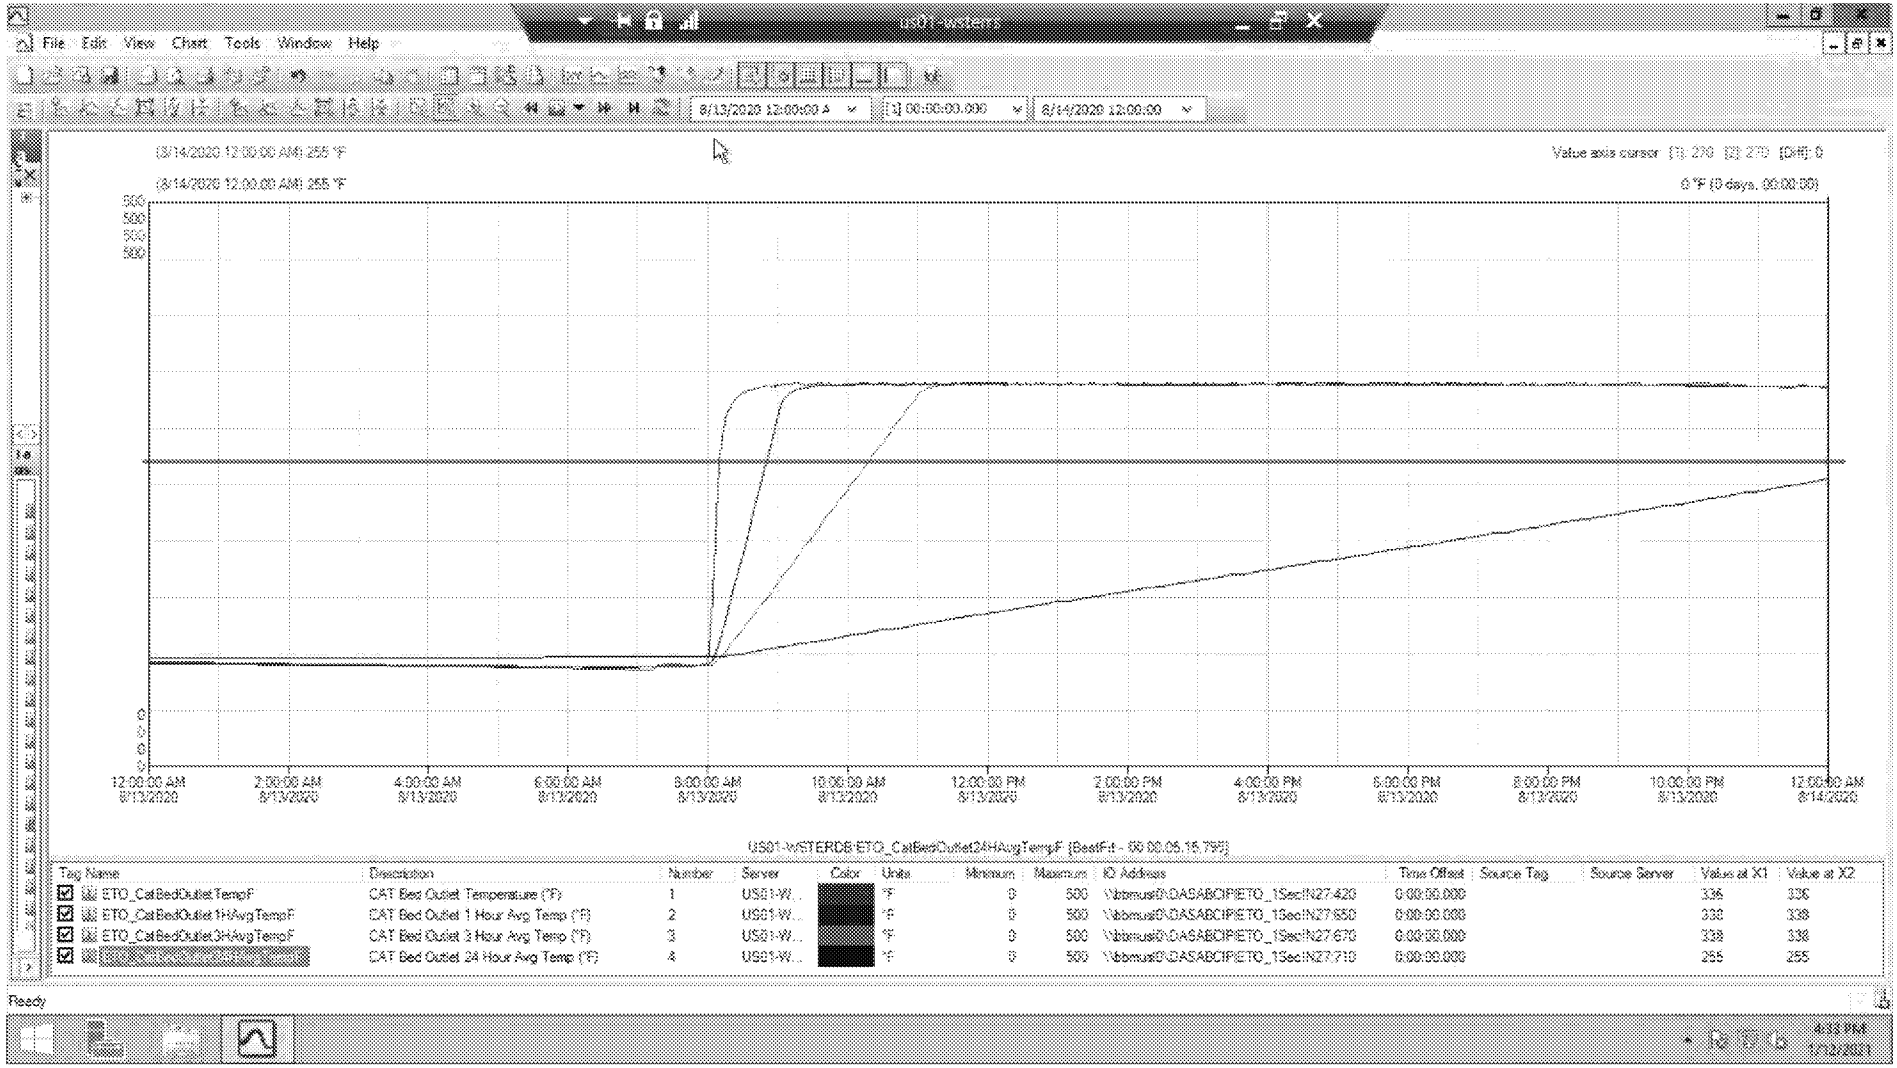

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

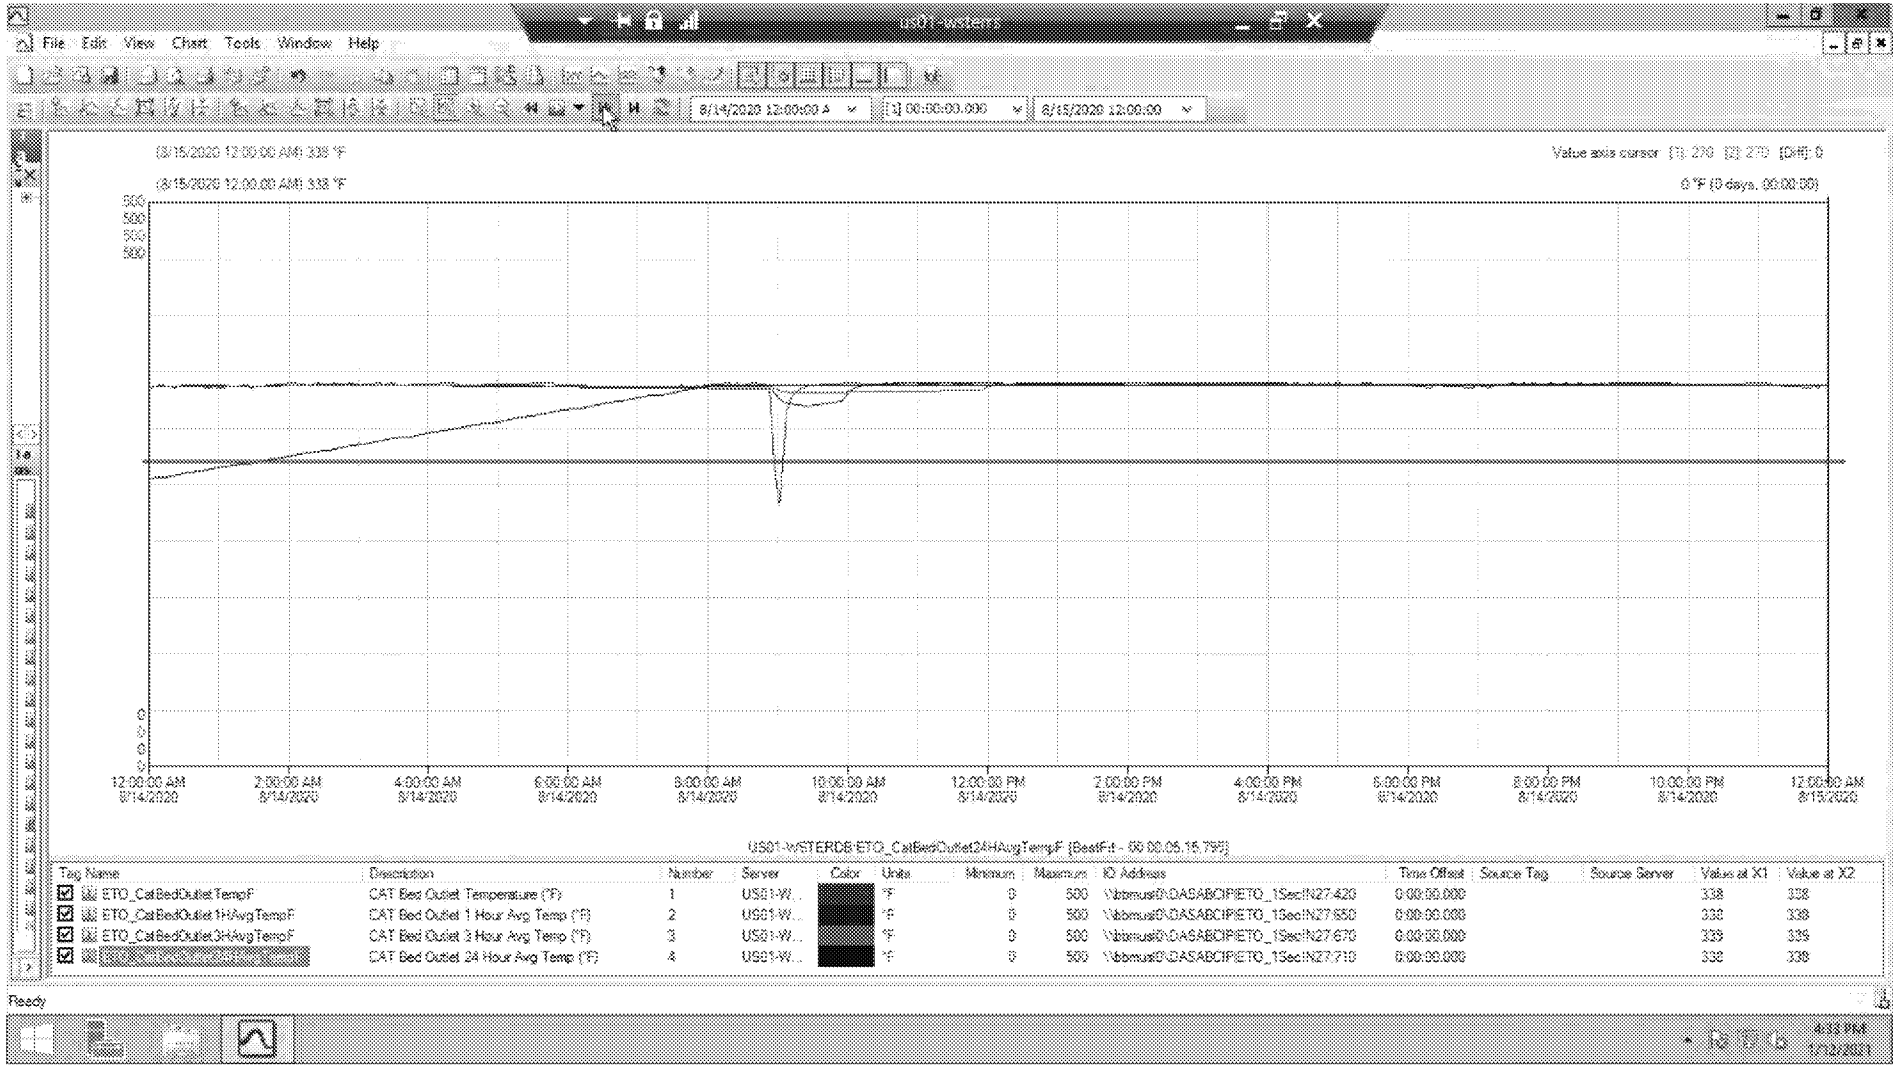

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

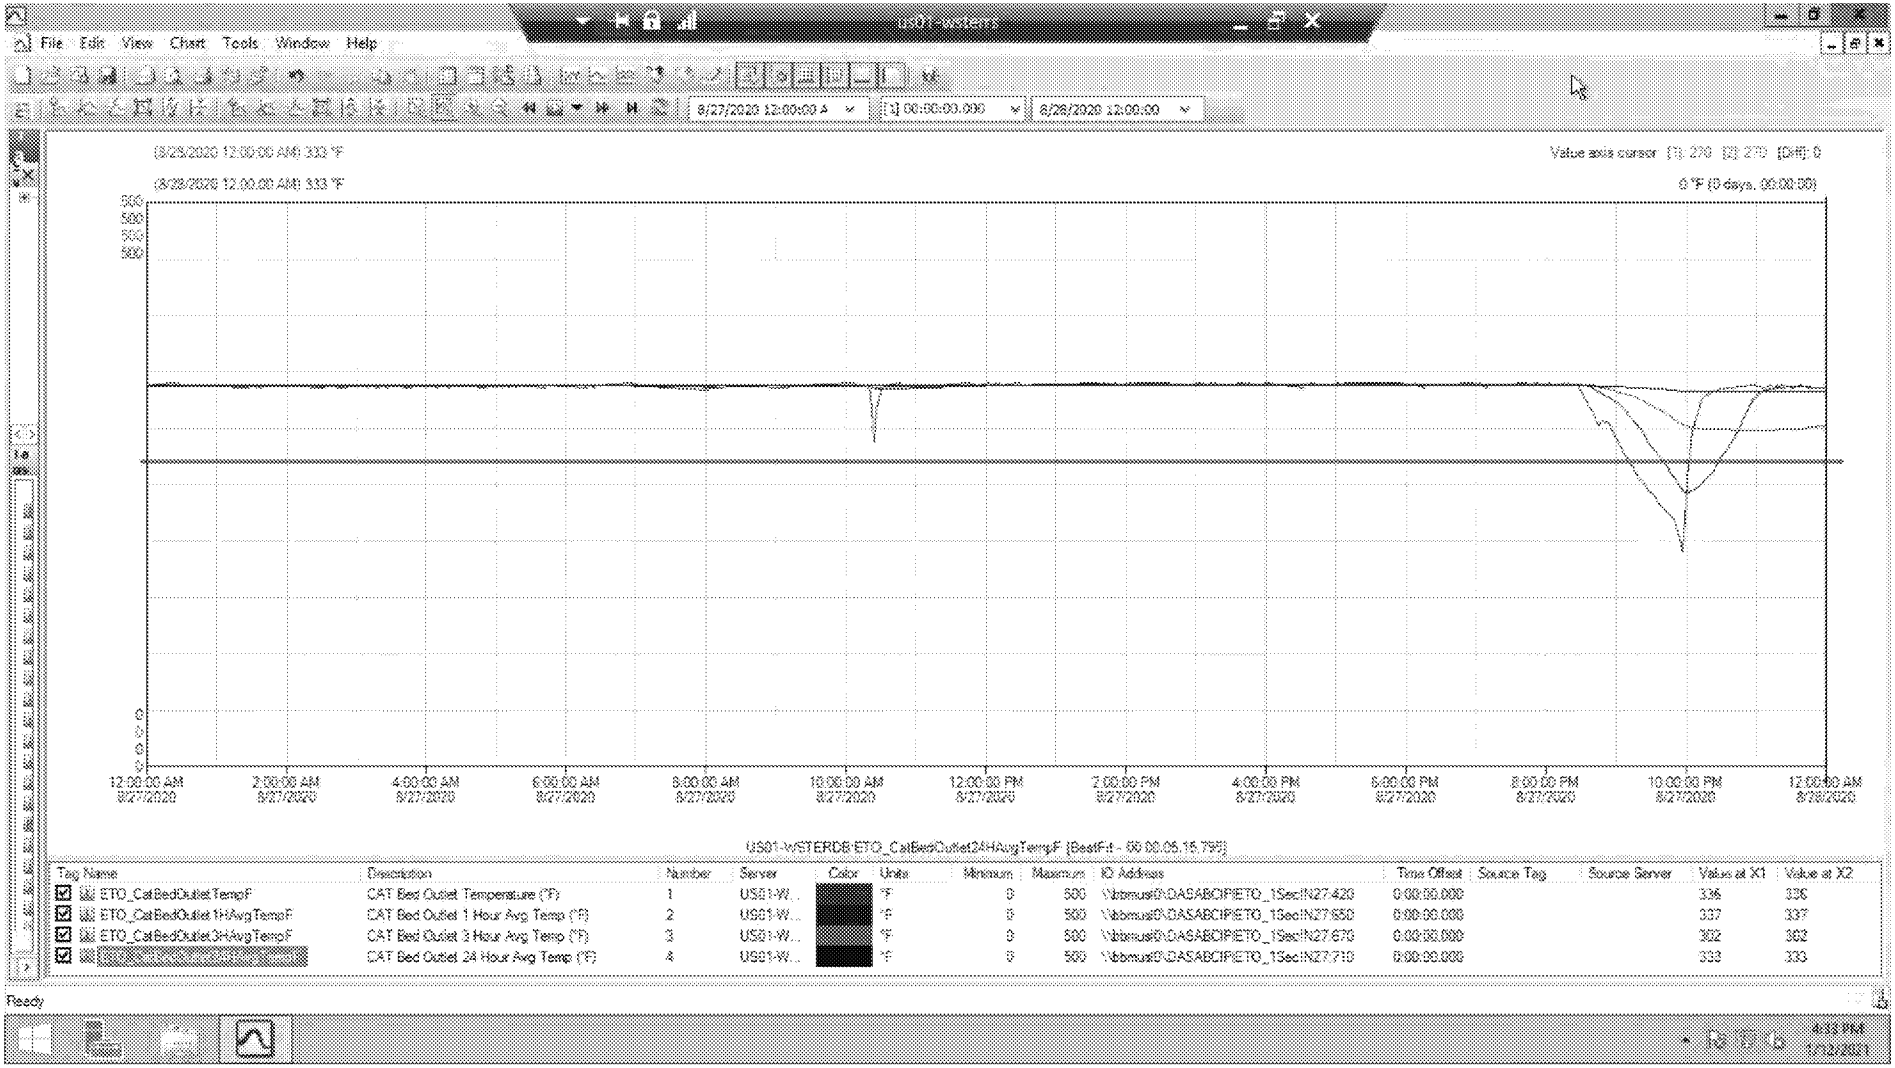

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Aug 2020

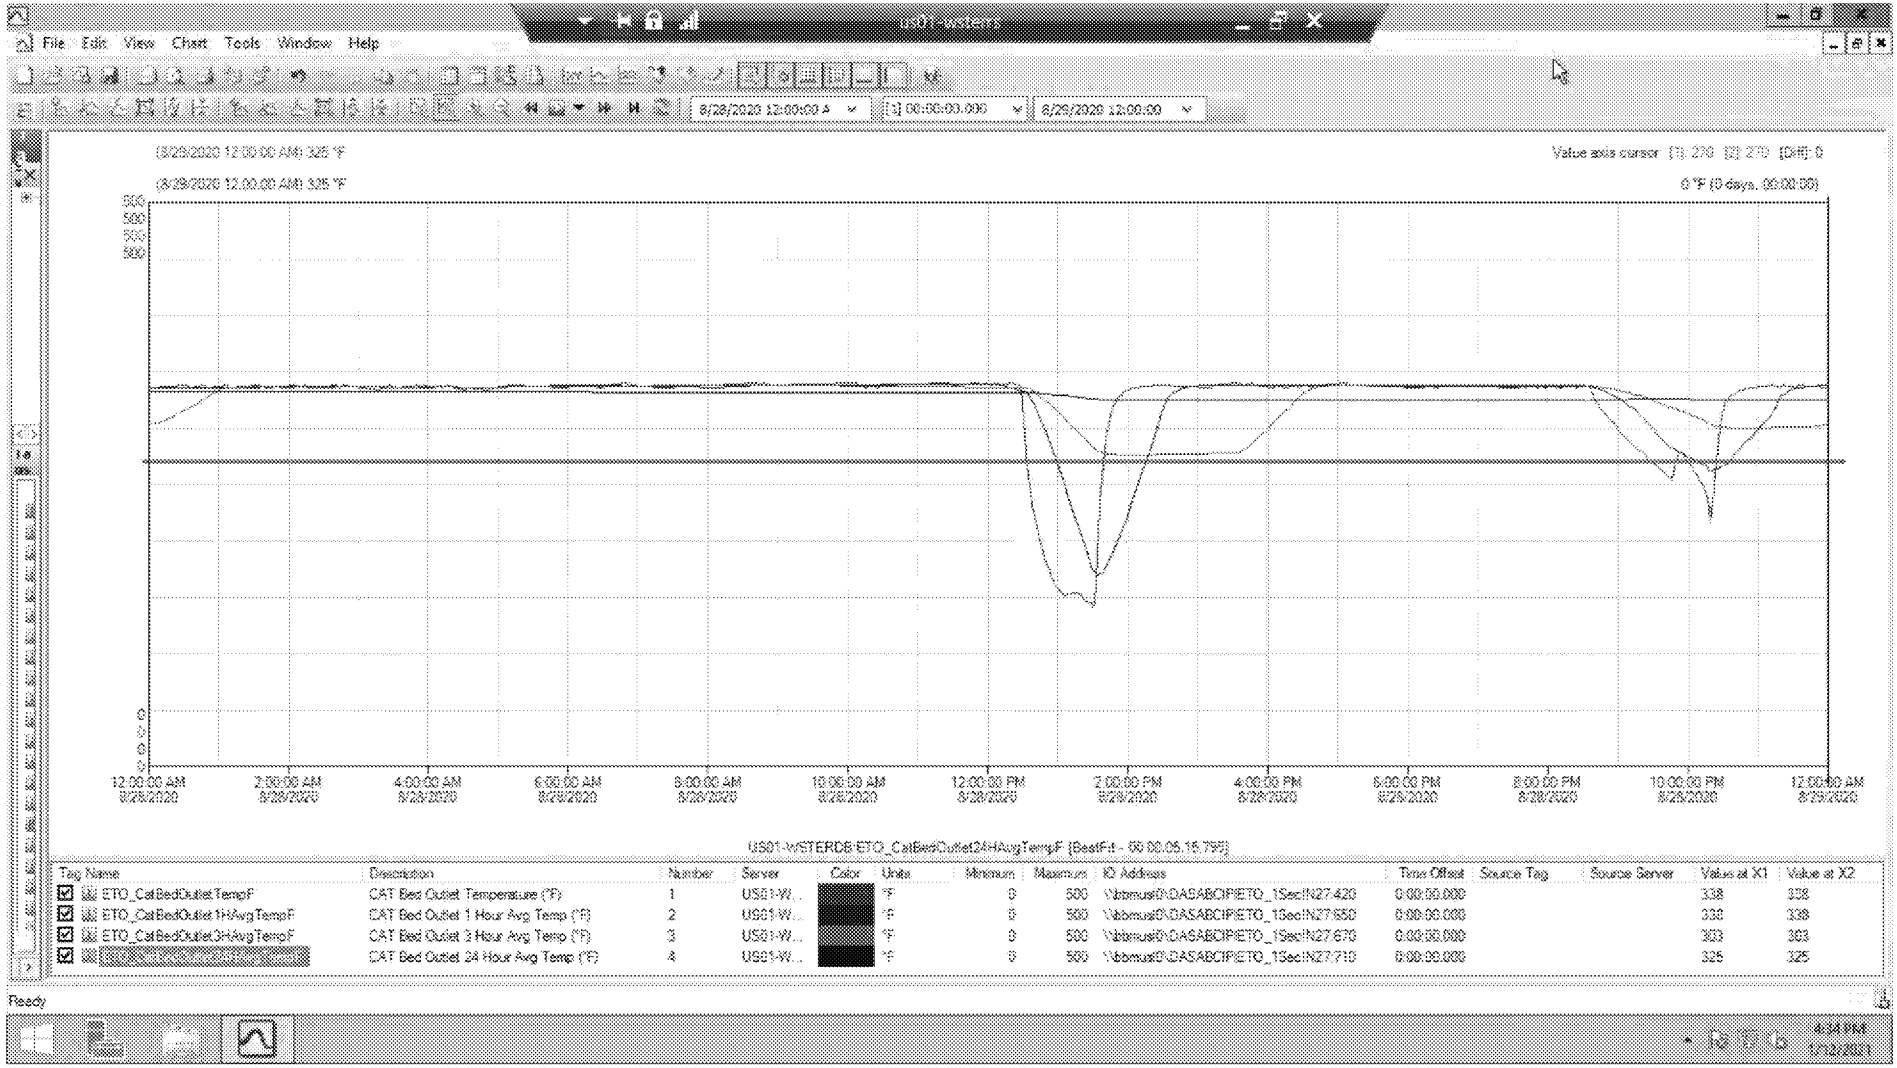

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Sep 2020

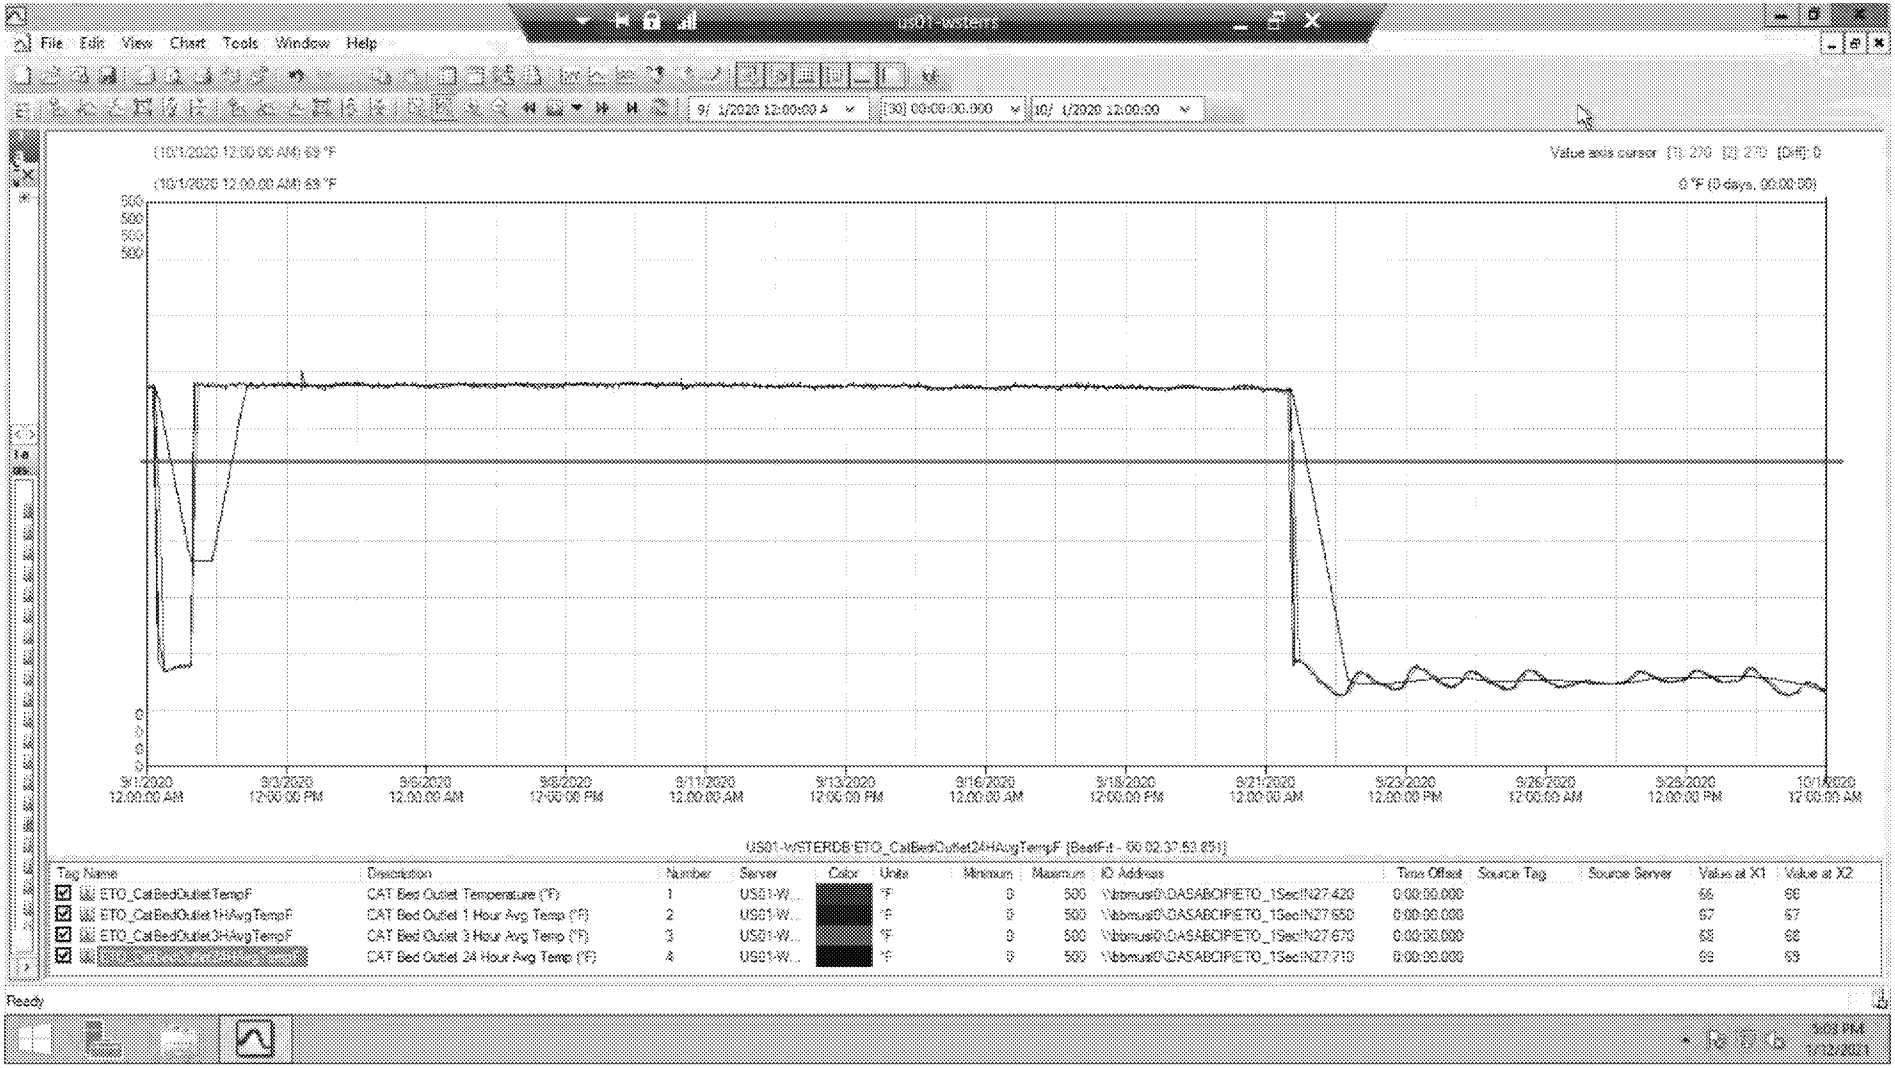

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Sep 2020

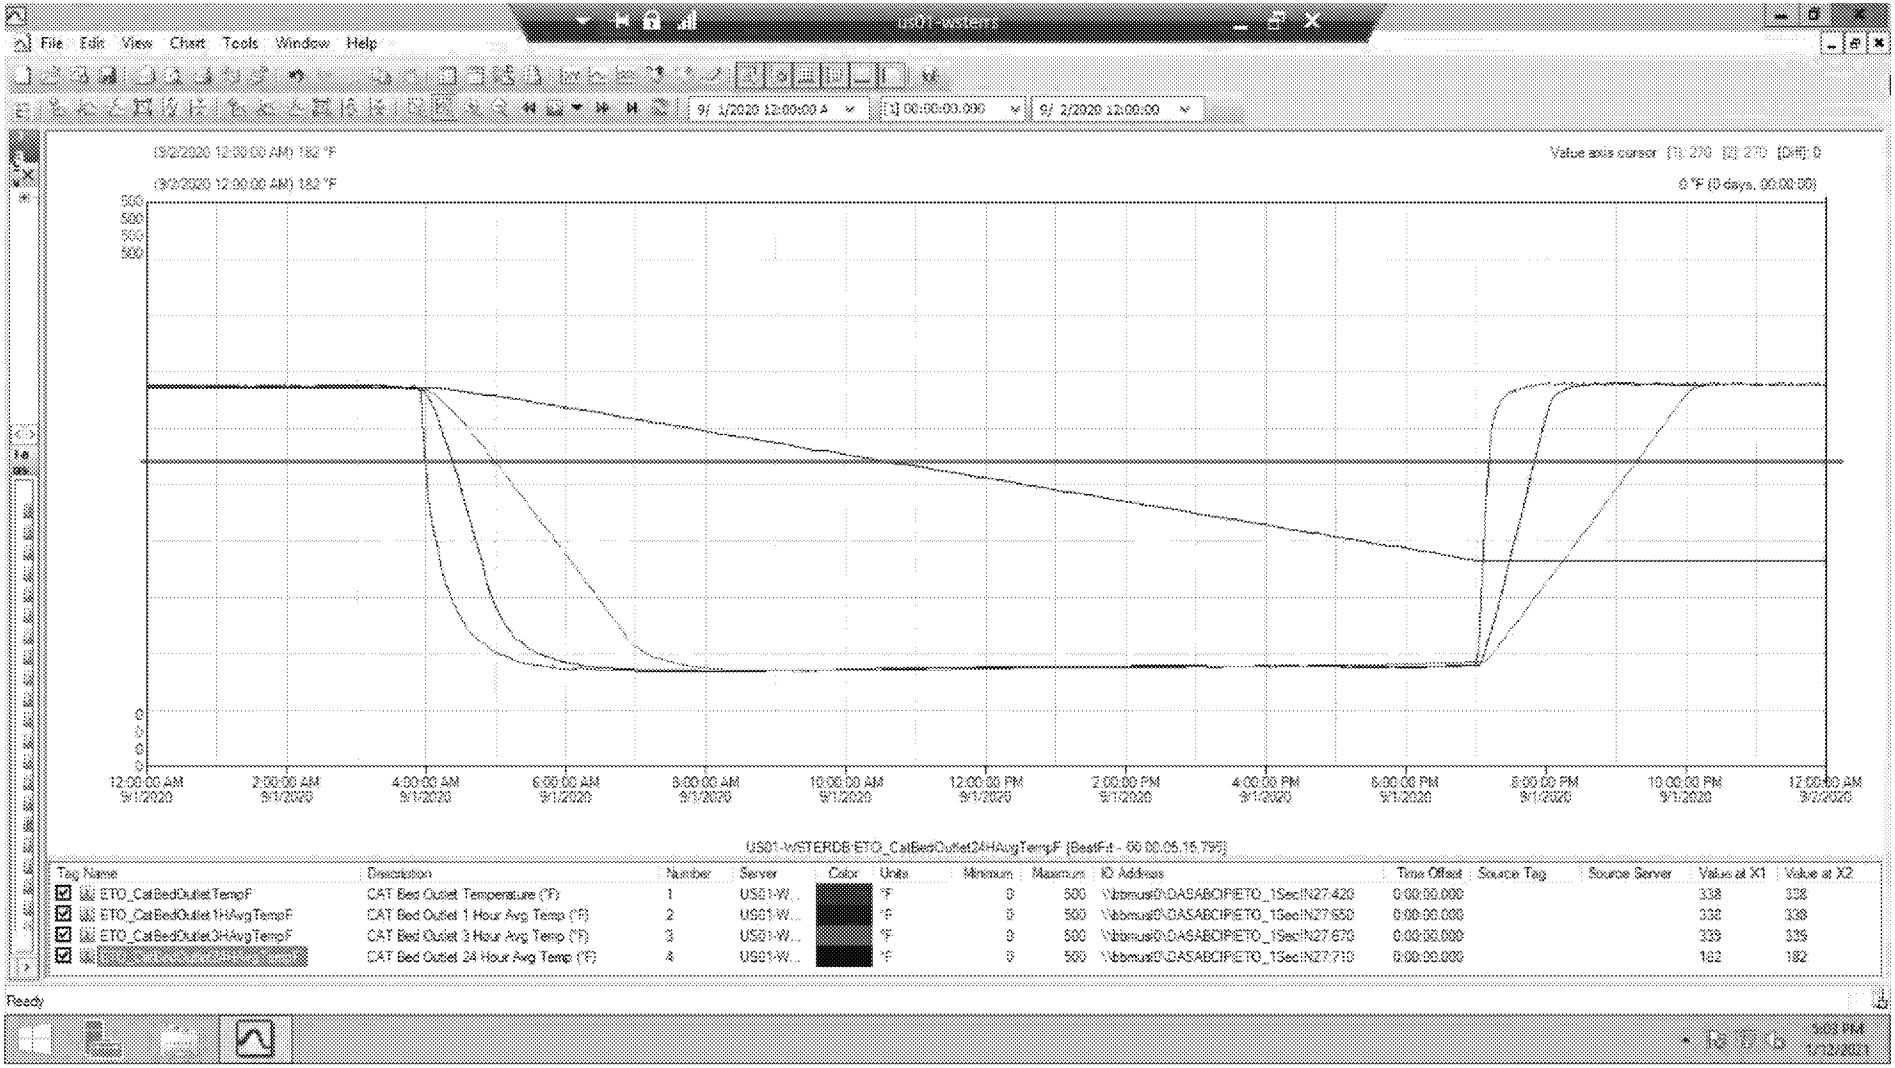

B Braun Medical Allentown Facility (EO Bed Outlet Temperature (degrees F)) – Sep 2020

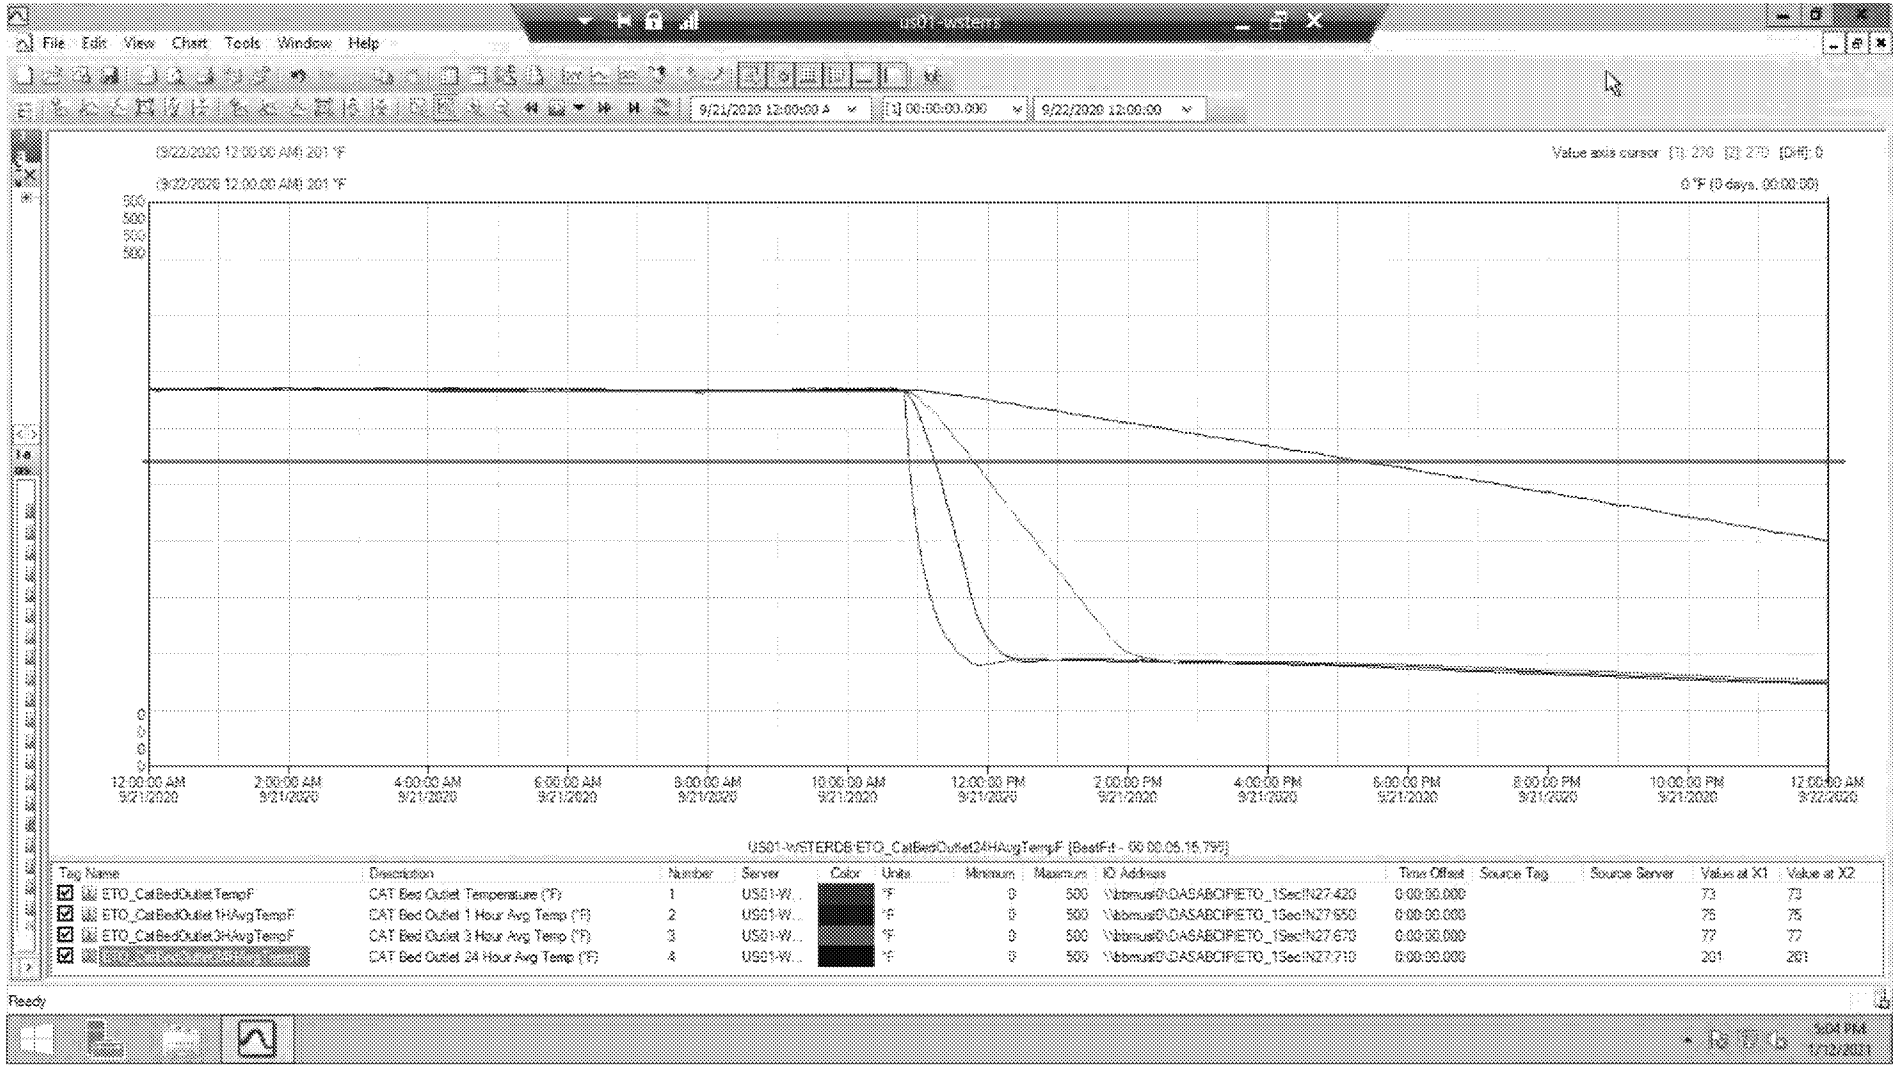

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Oct 2020

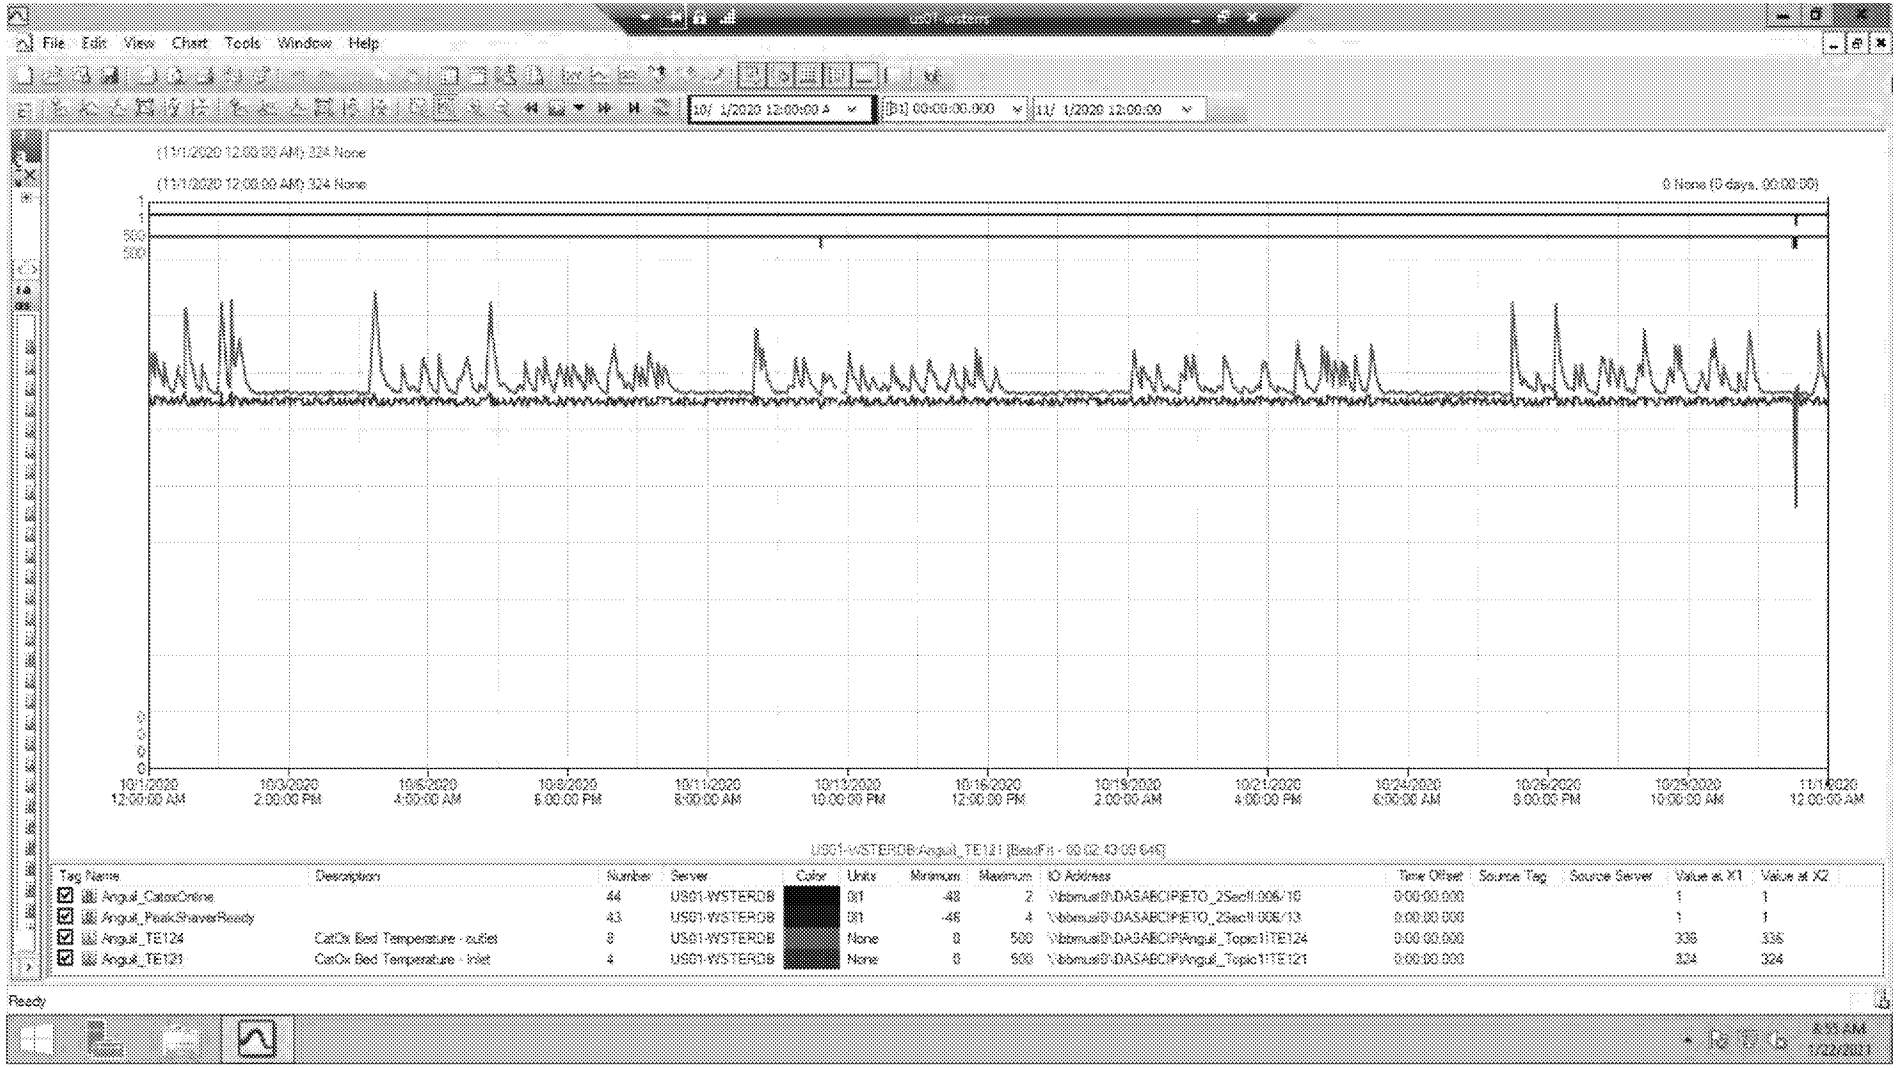

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Oct 2020

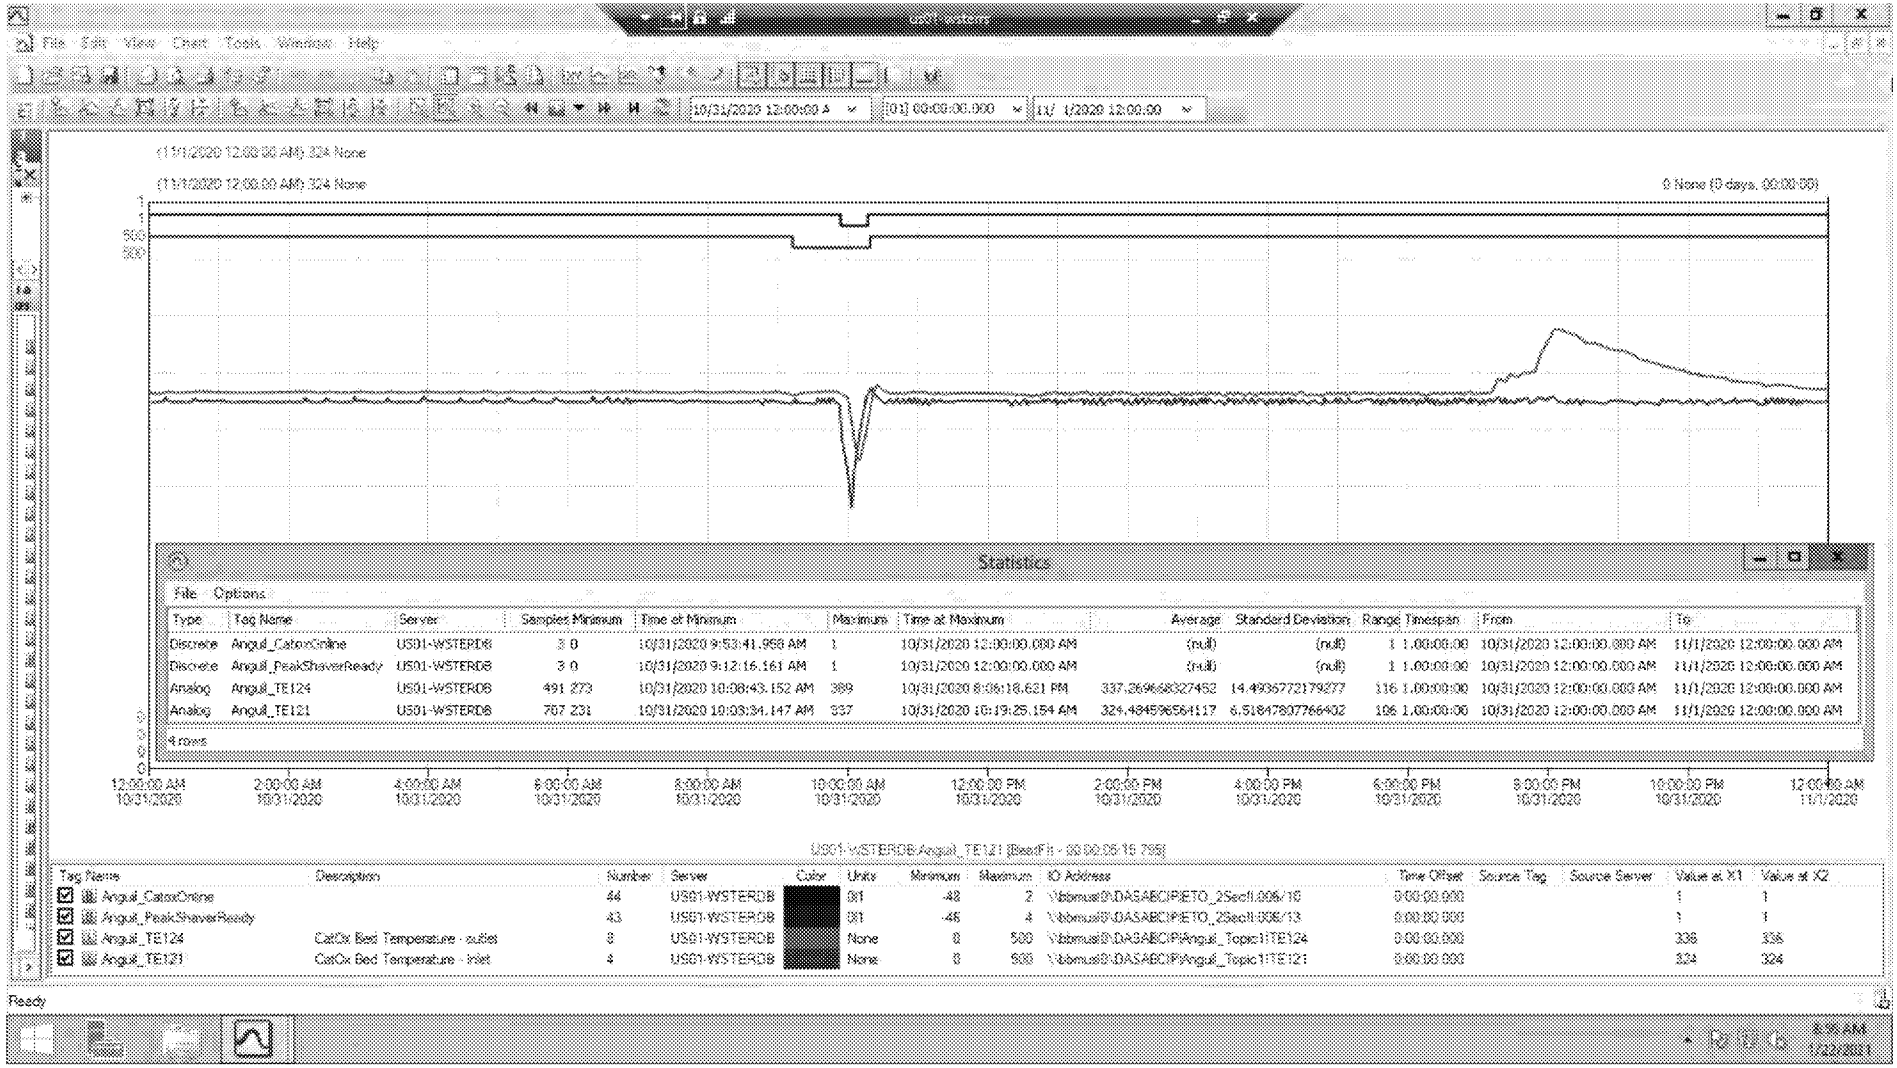

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Nov 2020

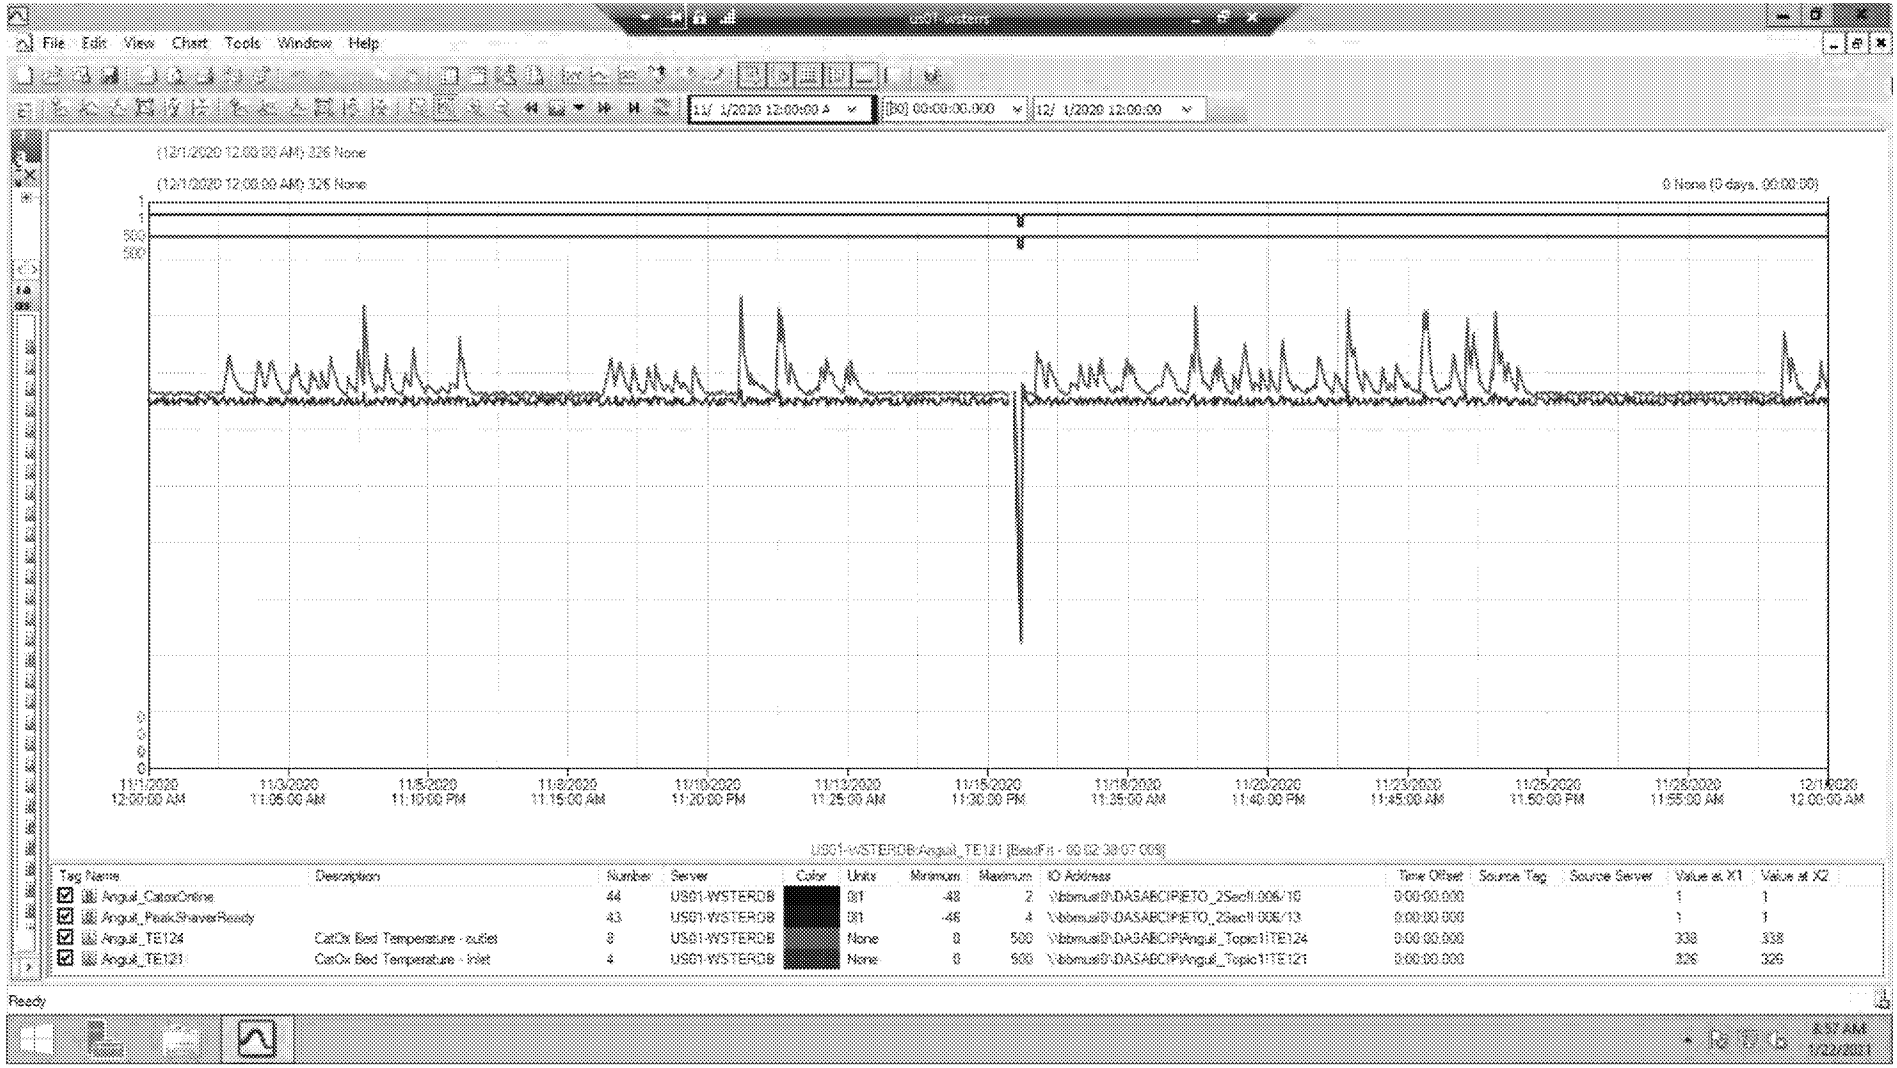

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Nov 2020

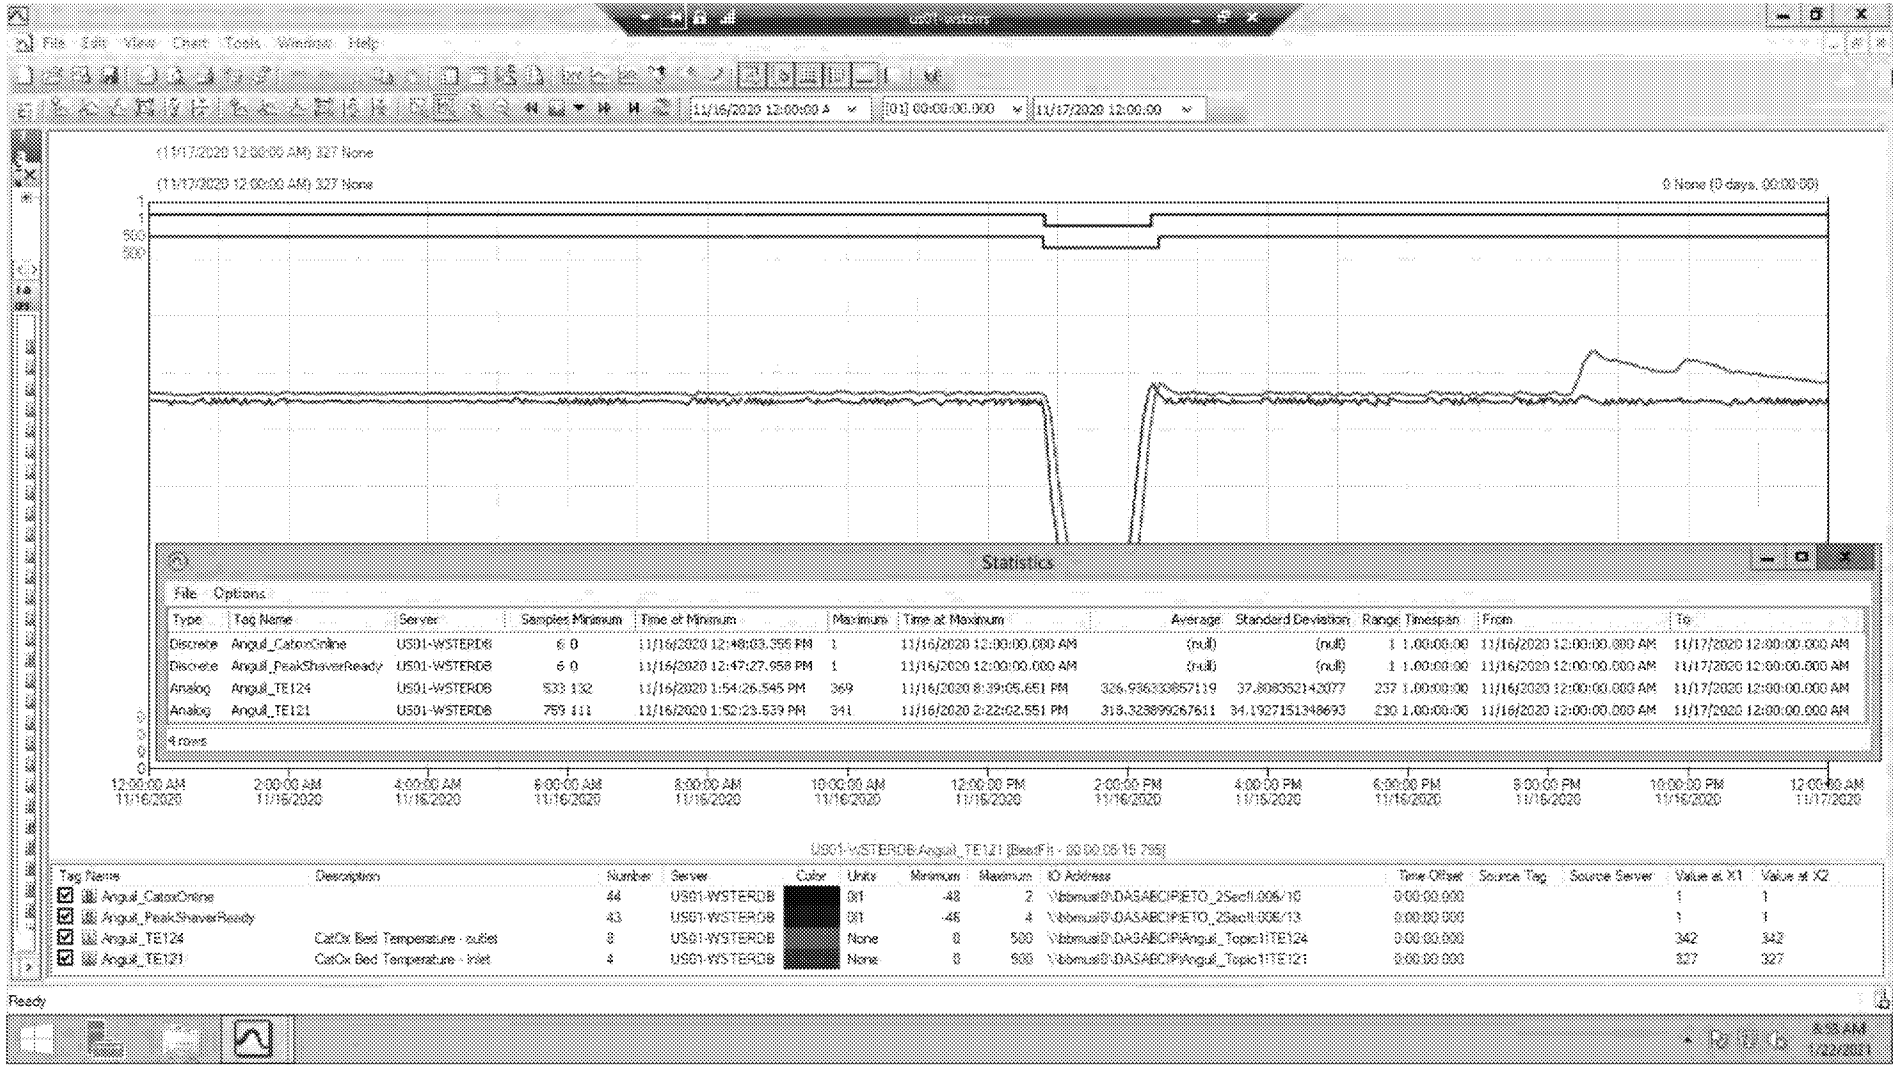

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Dec 2020

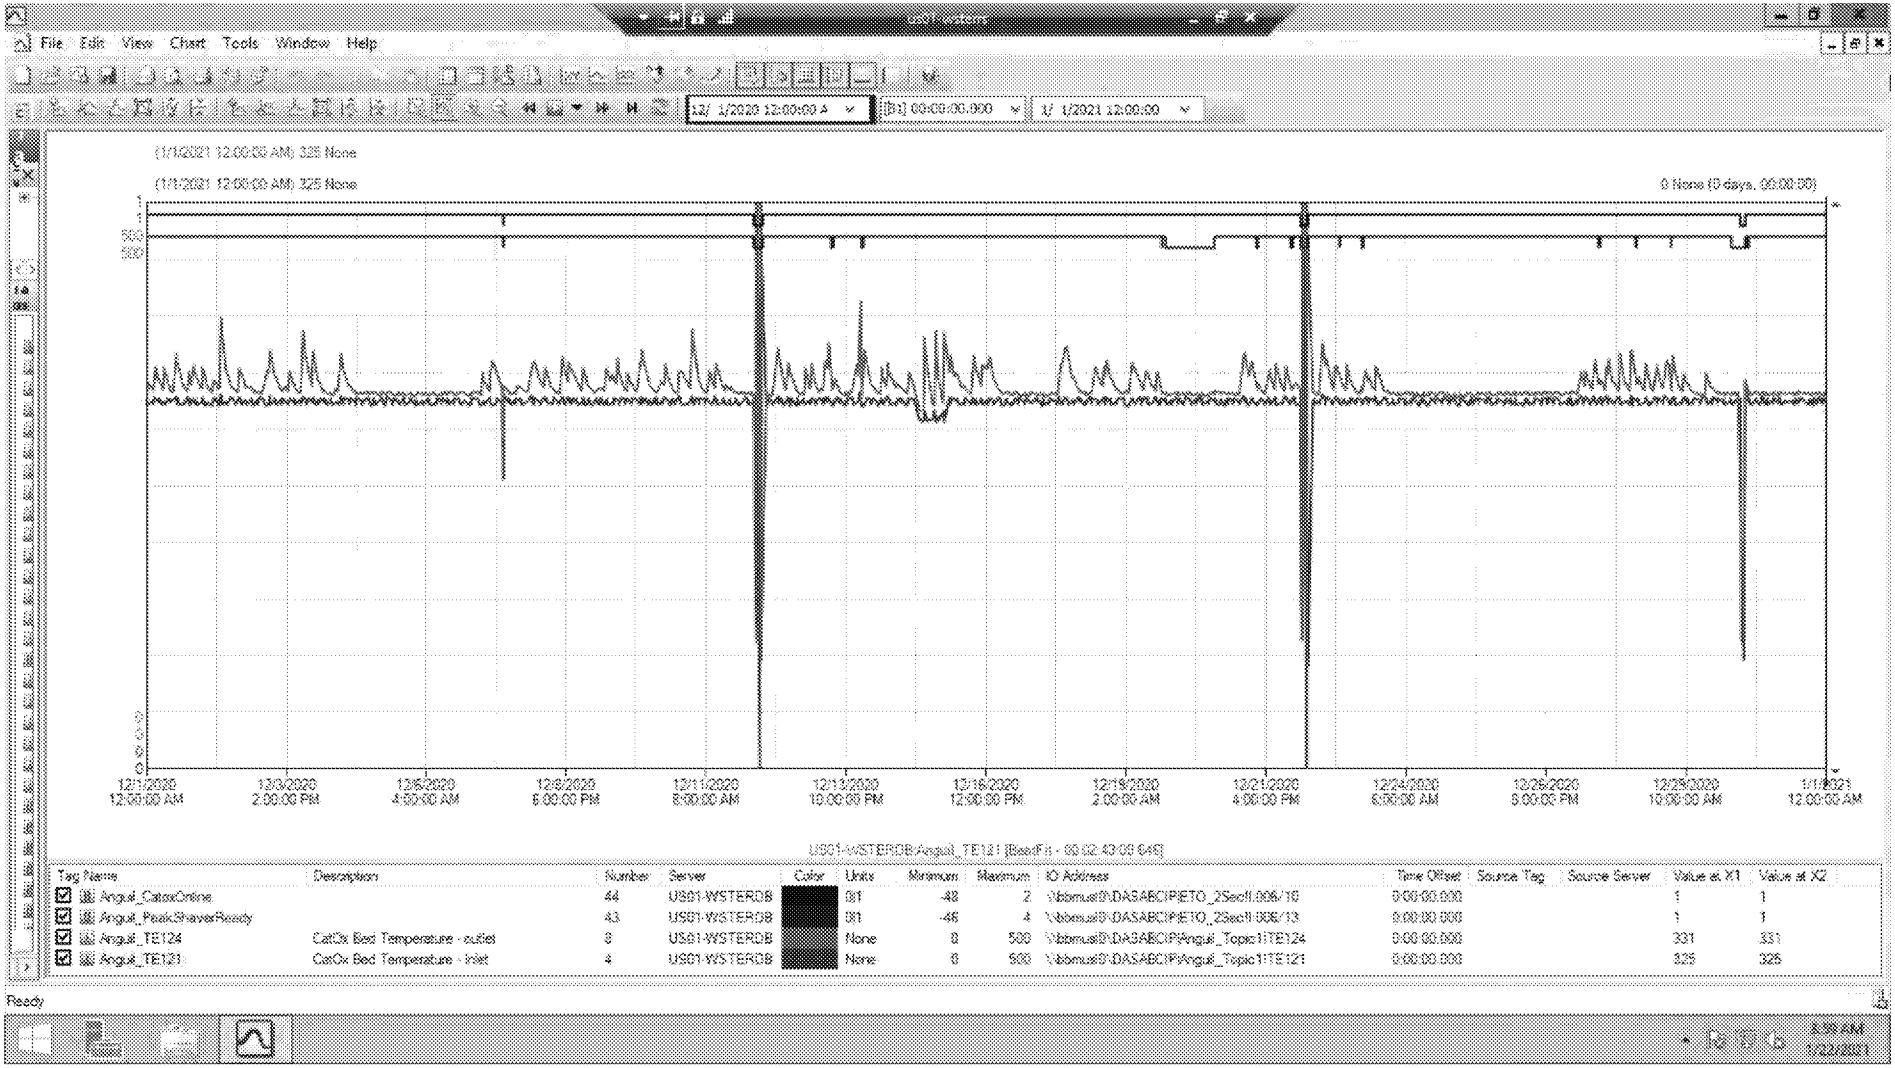

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Dec 2020

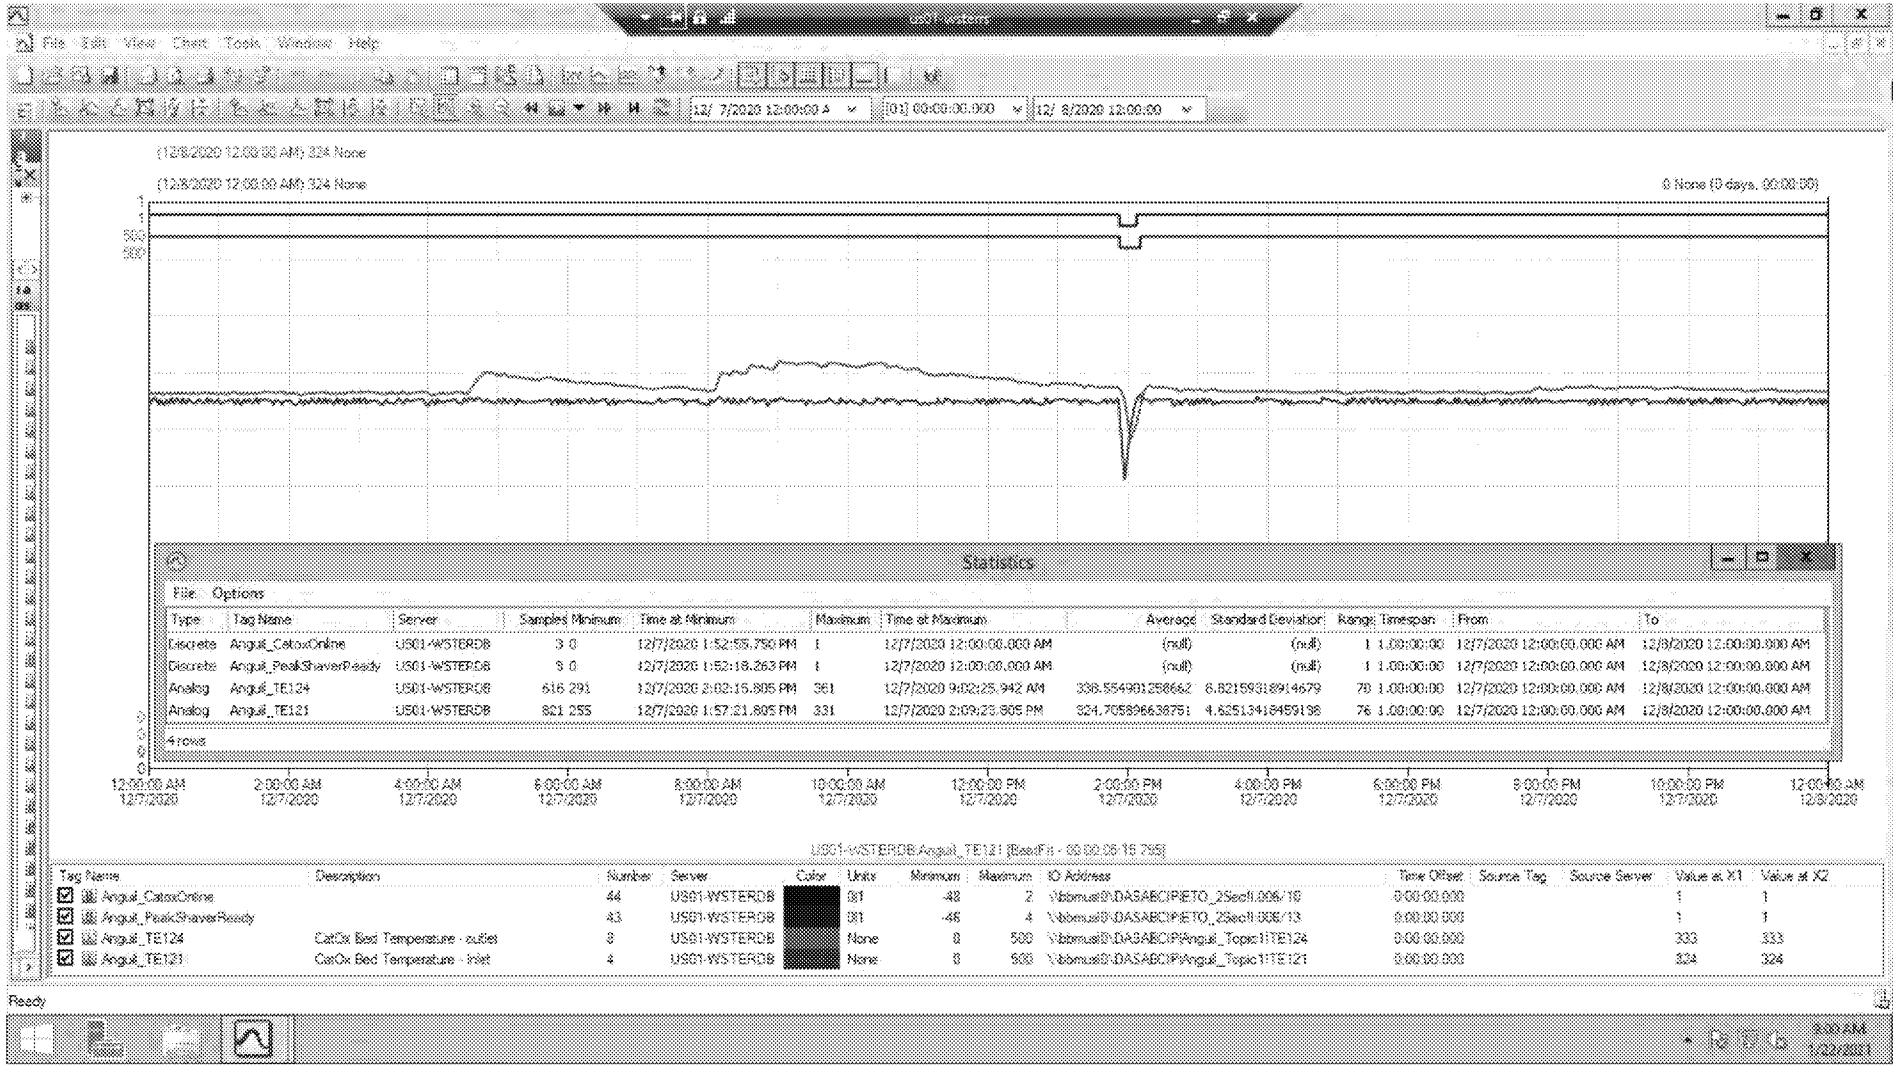

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Dec 2020

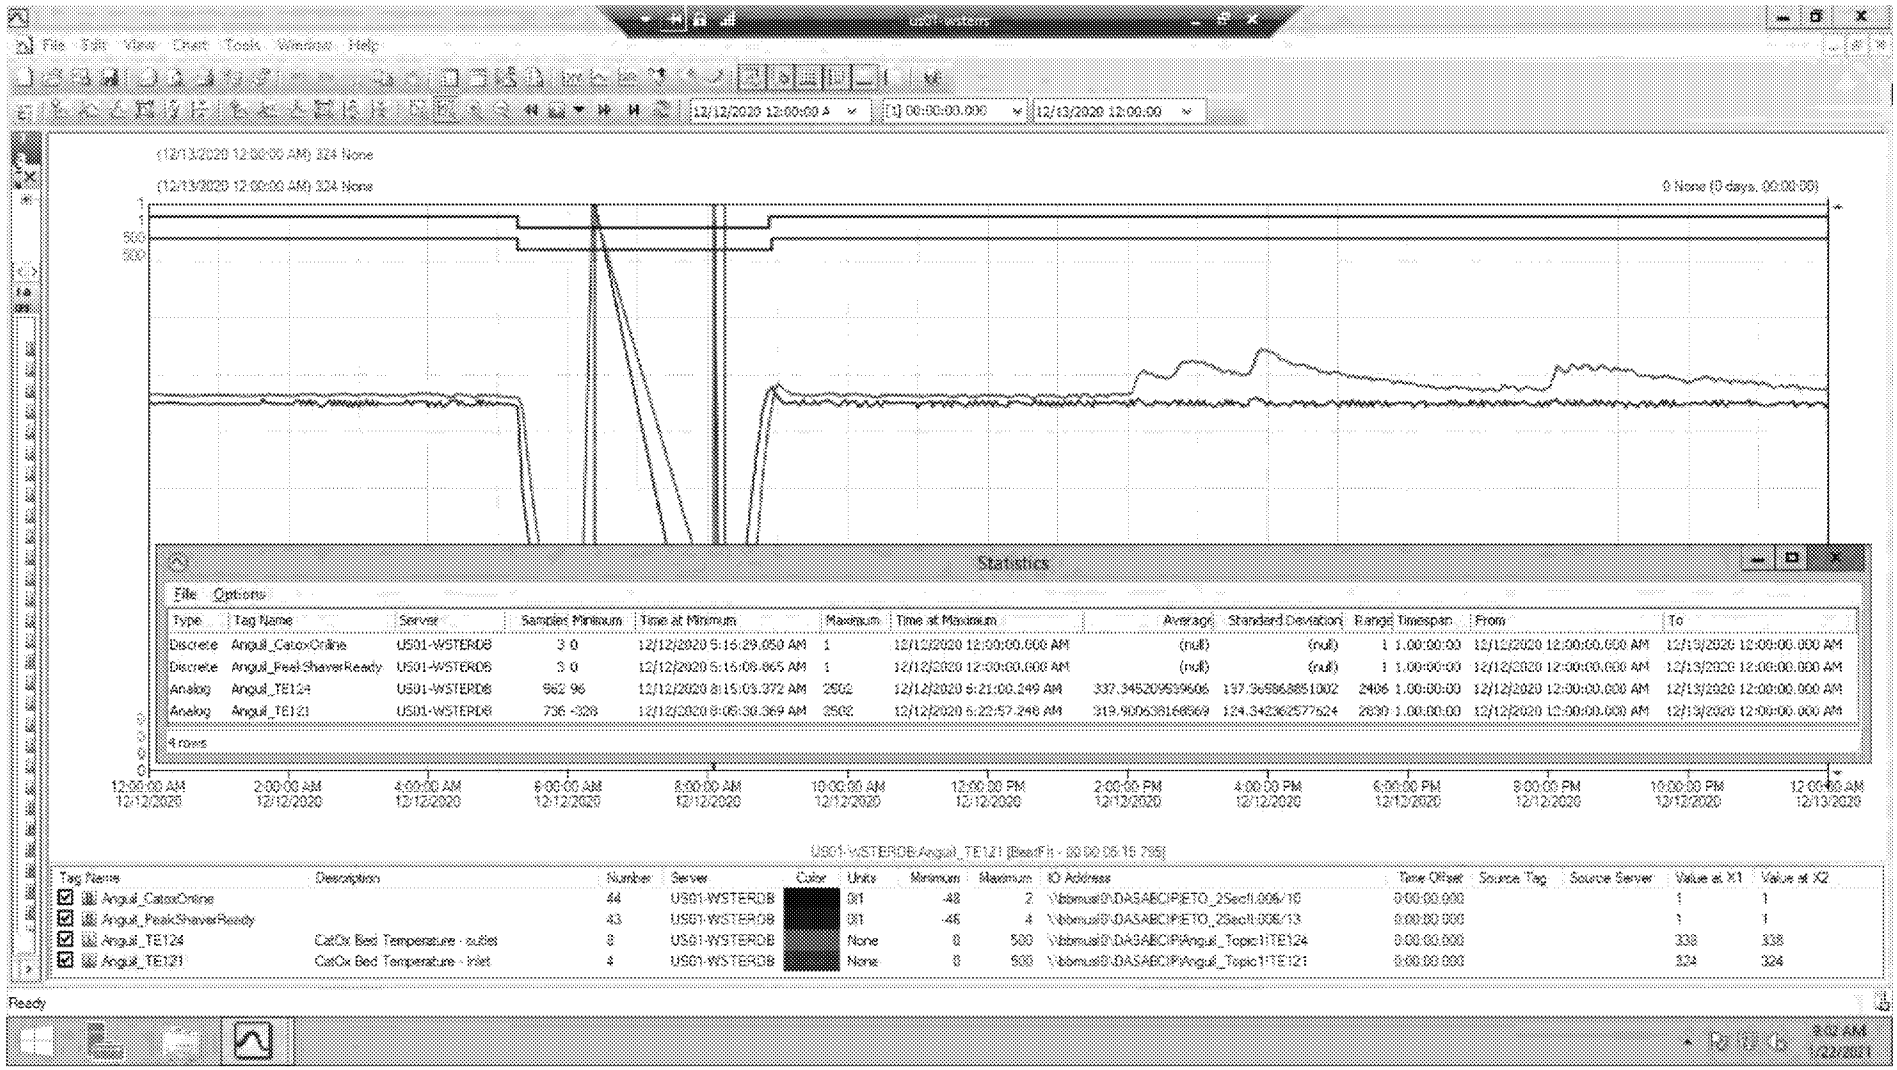

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Dec 2020

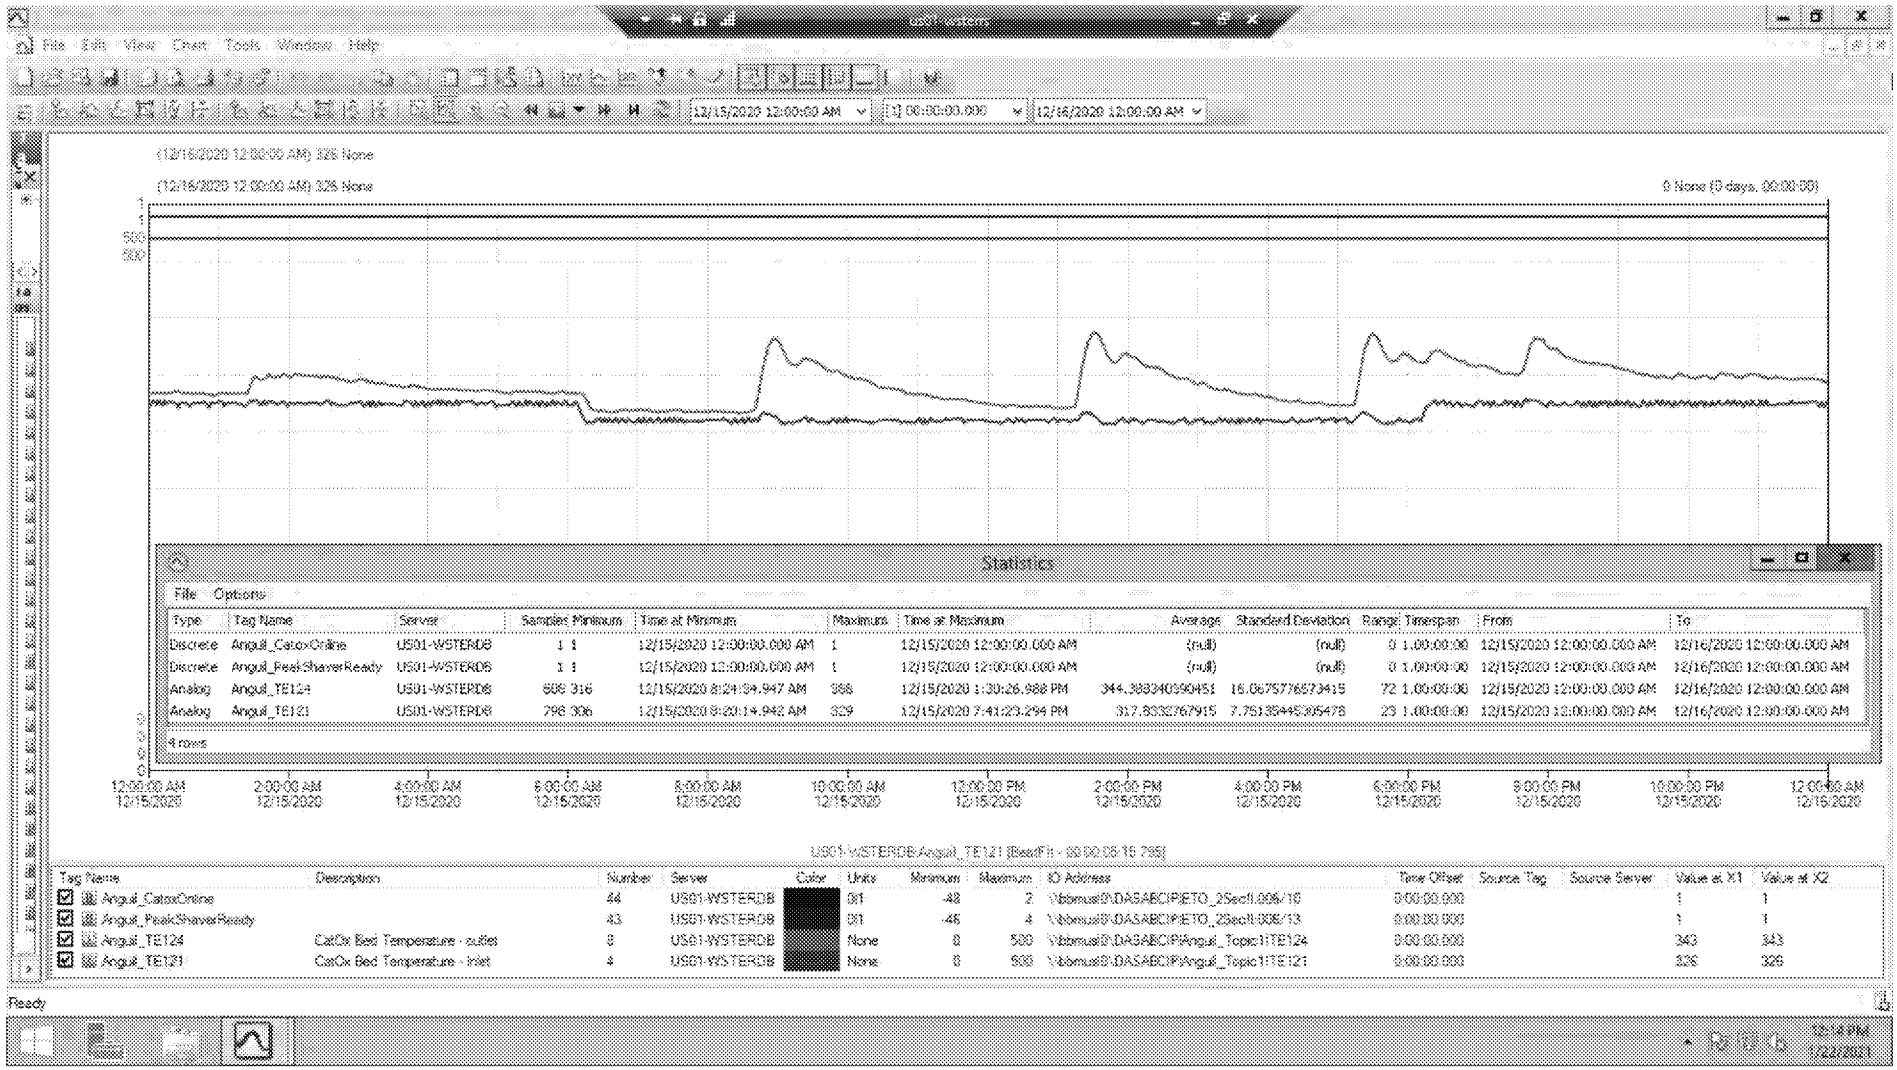

B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Dec 2020

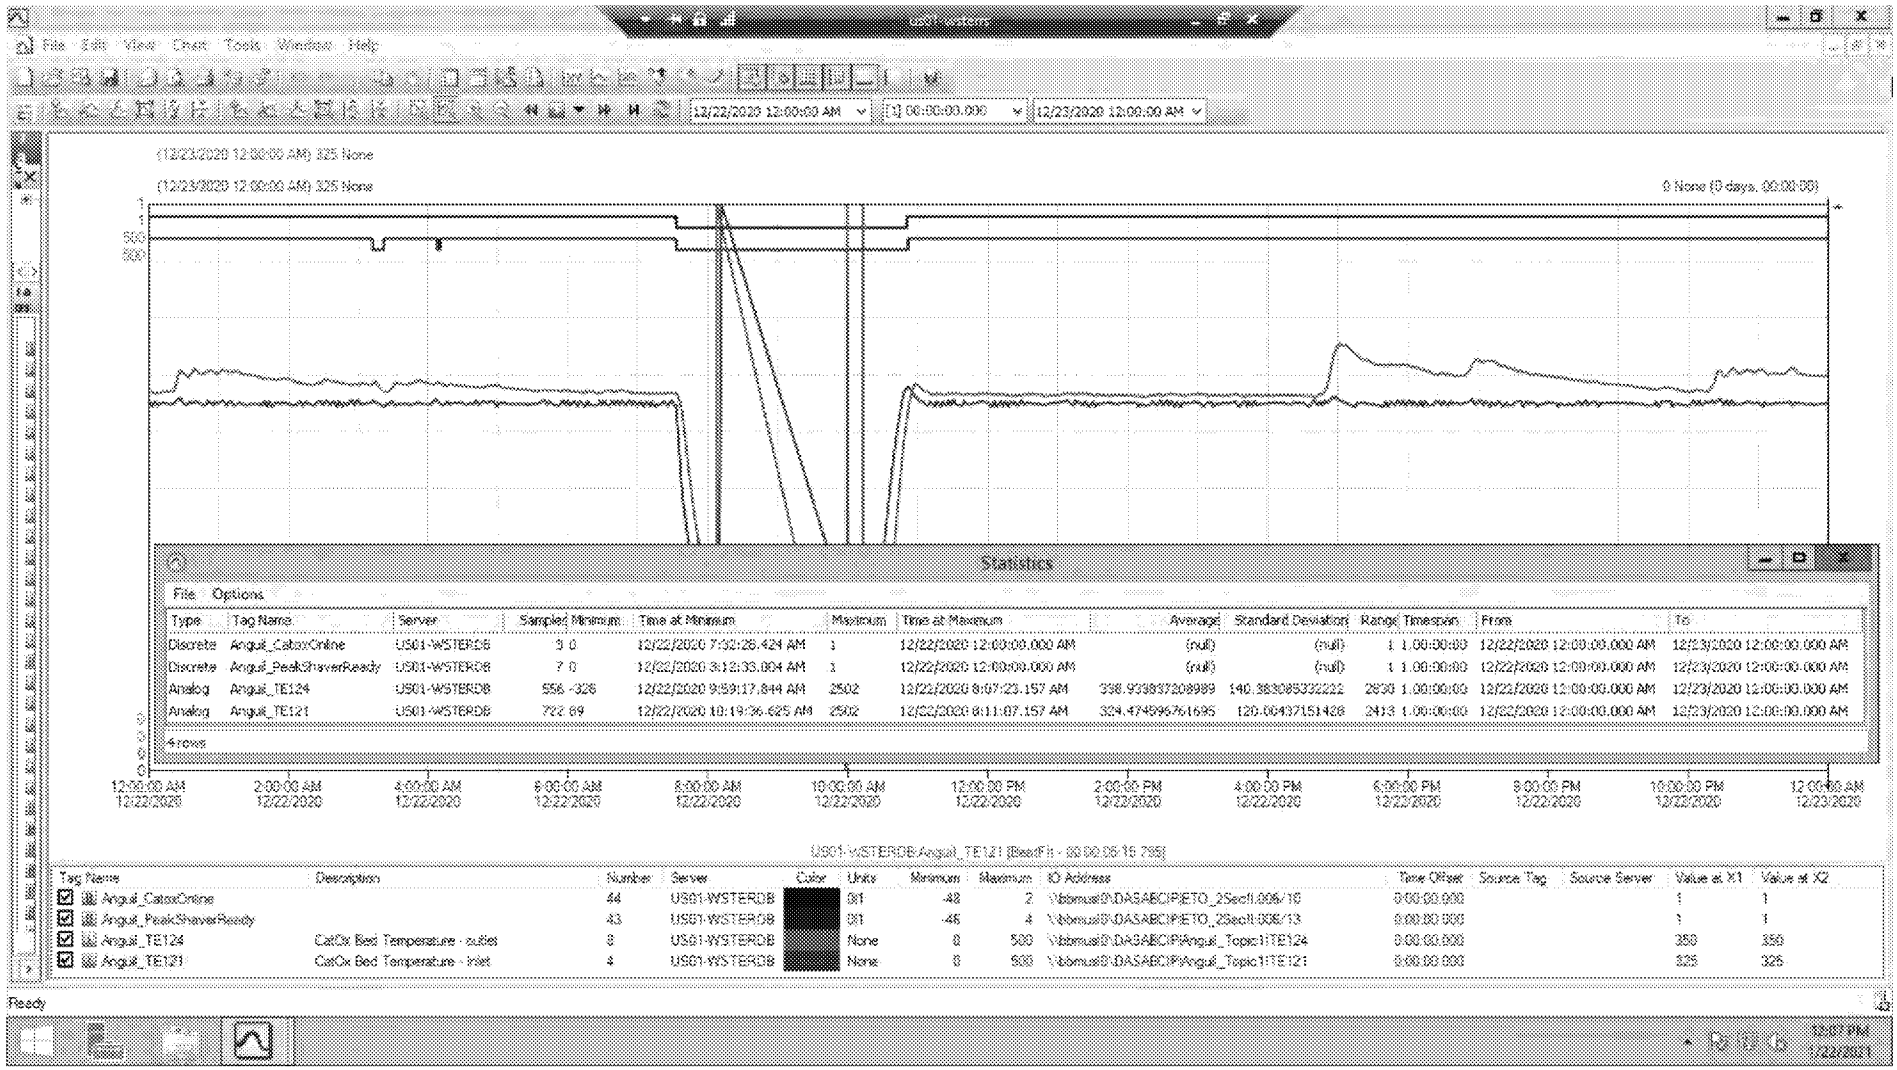
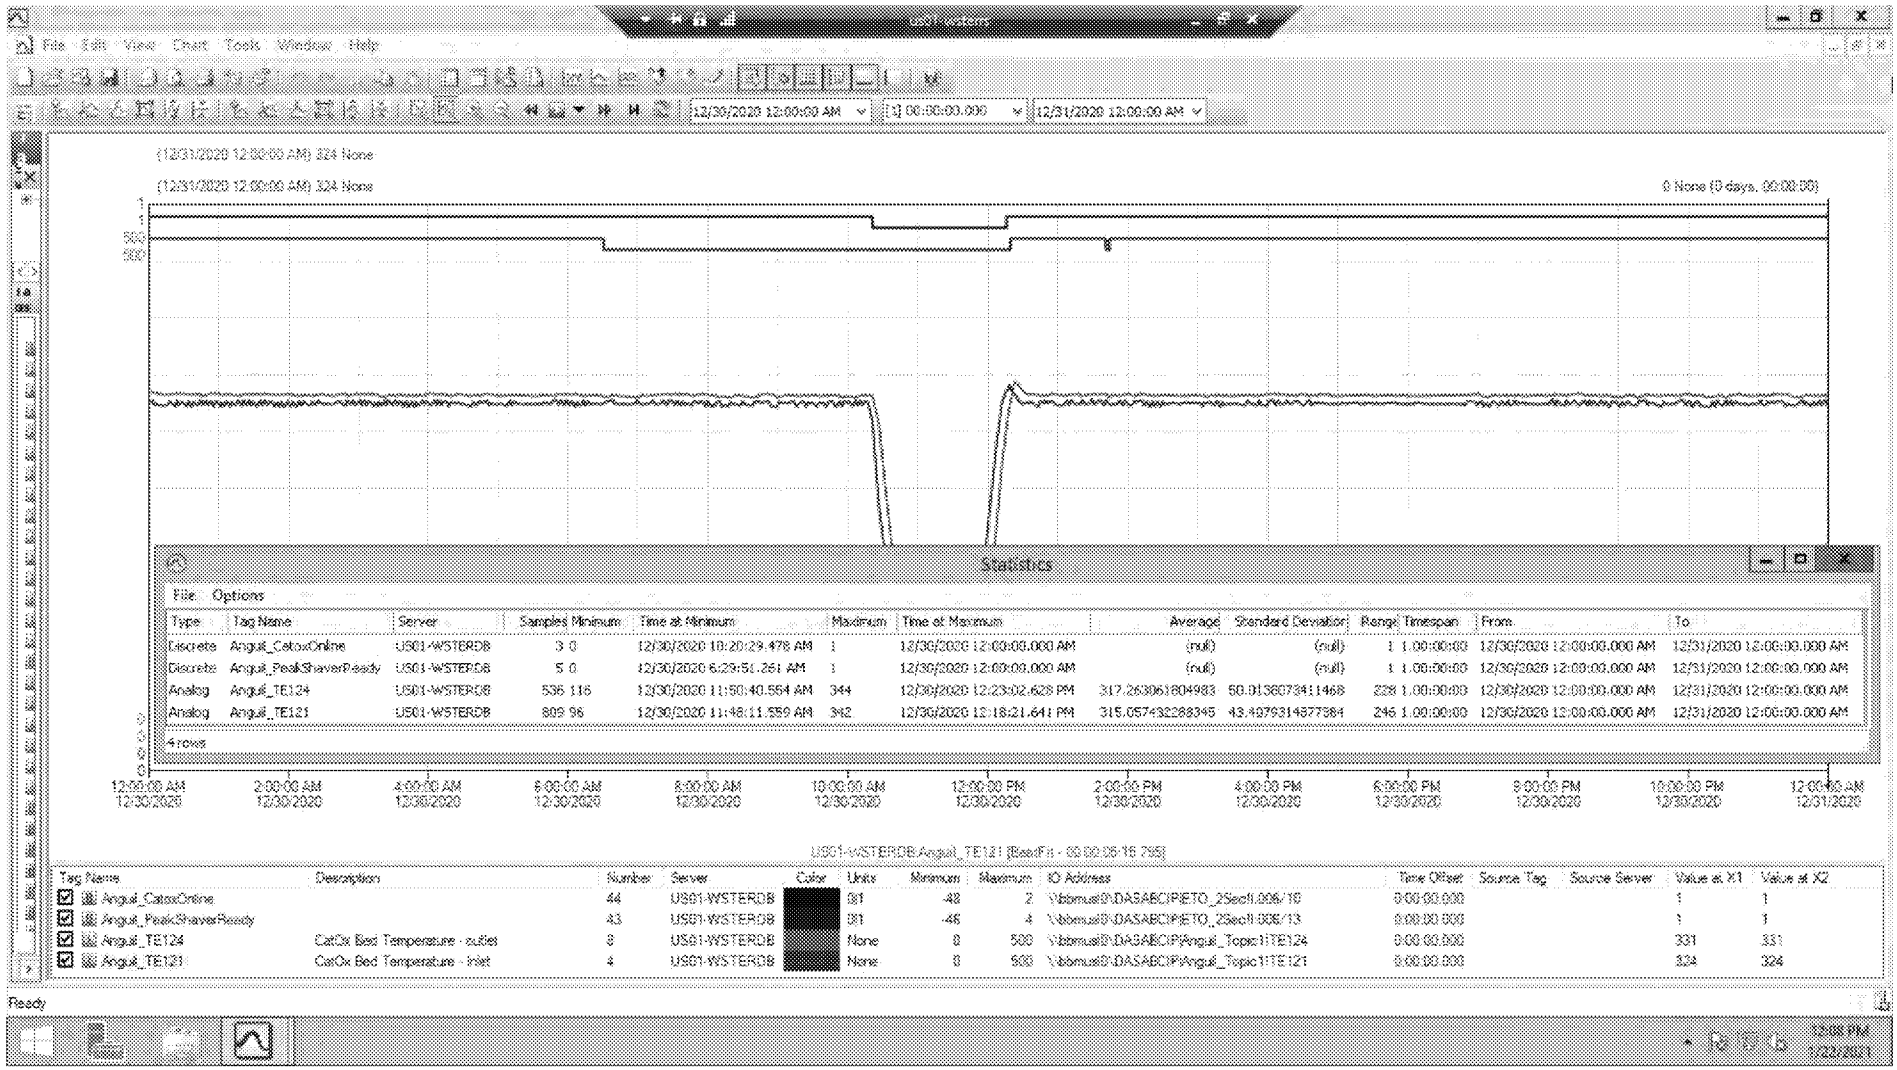
B Braun Medical Allentown Facility (Anguil CatOx Temperatures (degrees F)) – Dec 2020