Independent School District 473
730 Fifth Avenue South, P.O. Box 25 Isle, Minnesota 56342

Michael L. Conner, Superintendent

Dean J. Kapsner, K-12 Principal

Stanly B. Miller, Dean of Students/SAM

Fax

To: MARK **From:**

Title: EPA **Title:**

Fax: 312 582-5872 **Date:**

Re: Tank test **Pages:** Including Cover

☒ **Urgent** ☐ **For Review** ☐ **Please Comment** ☒ **Please Reply** ☐ **Please Recycle**

Mark 320-247-3052

☐ 320-676-3966 District Office Fax ☐ 320-676-1034 High School Fax ☐ 320-616-2358 ITV Fax

If you do not receive the total number of pages indicated, please call the District Office at 320-676-3146, the Elementary Office at 320-676-3494, or the High School at 320-676-3101.

Message:

I did 2 manual tests on tank 1 12-20 and 12-21, both results were inaccurate. I called griggs contracting and set up a repair/inspection for Dec 27.

Leak test on 12-26-12 passed
Please let me know if you recieved Nov and Dec tank 2

Mark C Brudle Trans Dir

Signature/Title

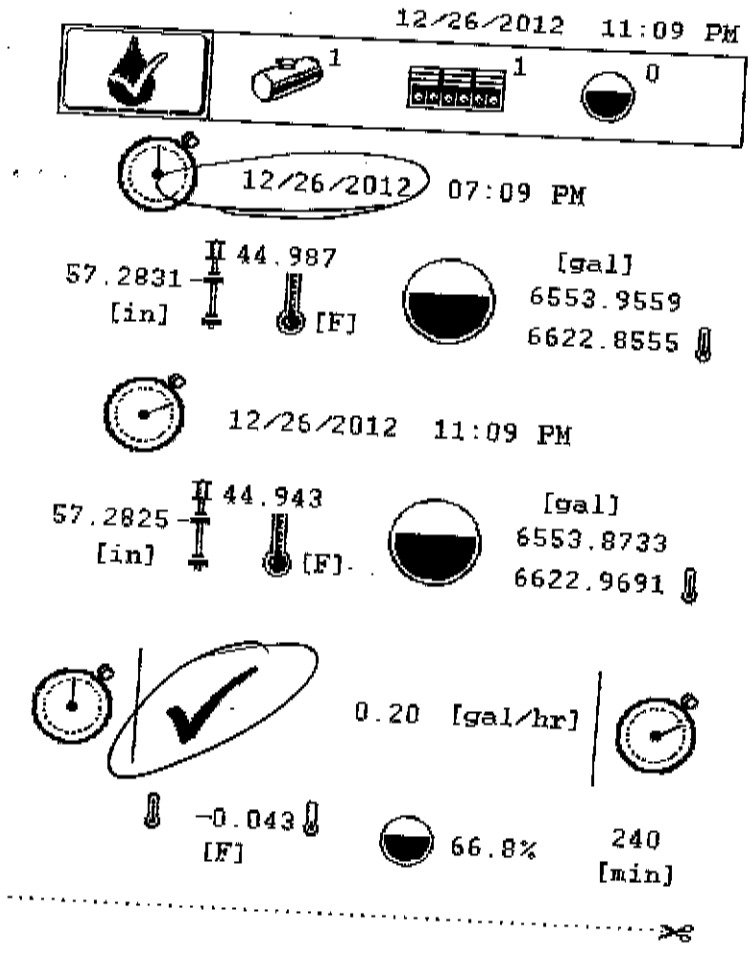

Griggs recalibrated computer today 12-27-12.
New settings will test weekly and will read tanks to 35%.
thanks,
Mark Bruske