Table 2
Central Wire Union, IL
Pump & Treat Extraction Well Influent VOC Concentrations by Quarter

Quarter	EW-1					EW-2				Estimated Blended Concentrations				
	TCE	PCE	TCA	DCE	cis-1,2-DCE	TCE	PCE	TCA	DCE	TCE	PCE	TCA	DCE	cis-1,2-DCE
1-2014	**8.6**	0.99	5	6.1	56	**16**	**13**	30	5.4					
2-2014	**15.0**	**13.0**	18	6.7	53	**23**	**38**	46	2.7					
3-2014	**9.1**	0.81	3.6	**7.5**	**72**	**18**	**32**	38	2.6					
4-2014	**7.5**	0.69	3.0	5.9	56	**20**	**33**	54	3.1					
1-2015	**7.9**	2.8	5.2	5.0	51	**6.8**	0	2.9	4.9					
2-2015	**8.5**	0.17	3.6	**7.9**	**78**	**18**	**36**	32	3.3					
3-2015	**8.5**	0.17	0.2	**9.4**	**89**	**15**	**30**	23	1.9					
4-2015	**7.5**	0.69	3.8	**8.4**	**84**	**14**	**31**	28	2.1					
1-2016	**7.7**	0.37	0.4	**9.3**	**88**	**12**	**27**	19	0.39					
2-2016	**7.2**	0.37	3.7	**8.2**	**82**	**10**	**22**	16	1.6					
3-2016	**7.5**	0.15	3.5	**7.8**	**79**	**12**	**29**	19	1.8					
4-2016	**6.7**	0.66	3.4	6.0	**70**	**15**	**32**	32	1.9					
1-2017	**6.7**	1.5	4.4	6.4	**71**	**14**	**32**	31	1.9					
2-2017	**7.3**	0.75	4.1	**8.0**	**94**	**13**	**29**	26	1.5					
3-2017	**7.8**	0.55	3.7	**9.3**	**110**	**8.1**	1.7	4.3	**9.1**					
4-2017	**7.4**	0.7	3.6	**7.2**	**85**	**10**	**29**	16	0.56					
1-2018	**6.5**	0.68	3.4	**7.0**	**79**	**8.5**	**26**	15	1.4					
2-2018	0.8	0.87	0.38	0.4	11	**8.4**	**28**	17	0.72					
3-2018	**5.7**	0.95	2.2	6.8	**84**	**8.4**	**28**	17	0.72					
4-2018	**5.8**	0.75	3.3	**7.1**	**87**	**7.5**	**24**	13	0.35					
Jan-2019	**6.6**	0.75	1.2	5.9	**80**	**7.3**	**25**	13	0.25	**7.0**	**15.3**	8.3	2.5	33
1-2019	**5.0**	0.42	1.6	6.9	**100**	**7.6**	**23**	15	0.63	**6.8**	**11.7**	8.4	4.4	59.5
2-2019	**6.3**	0.68	3.2	**8.7**	**96**	**11.0**	**27**	25	1.50	**9.8**	**14.0**	14.7	6.7	66.3
EPA MCL	**5**	**5**	**200**	**7**	**70**	**5**	**5**	**200**	**7**					

J = Result is less than the Reporting Limit but greater than or equal to the Method Detection Limit and the concentration is an

Note 1: cis-1,2 - DCE not shown for EW-2 (all concentrations were under the MCL of 70 ug/L).
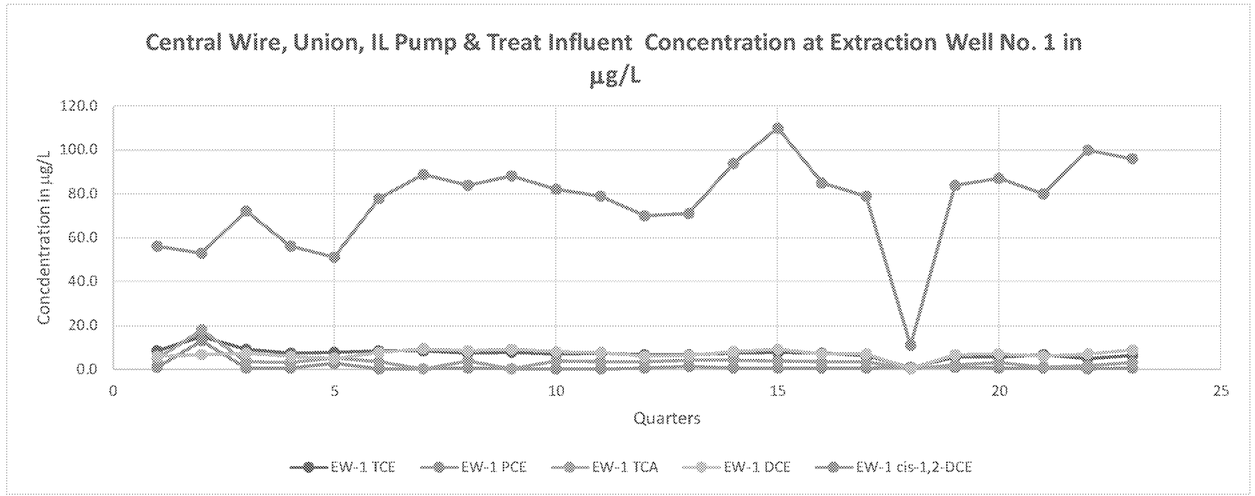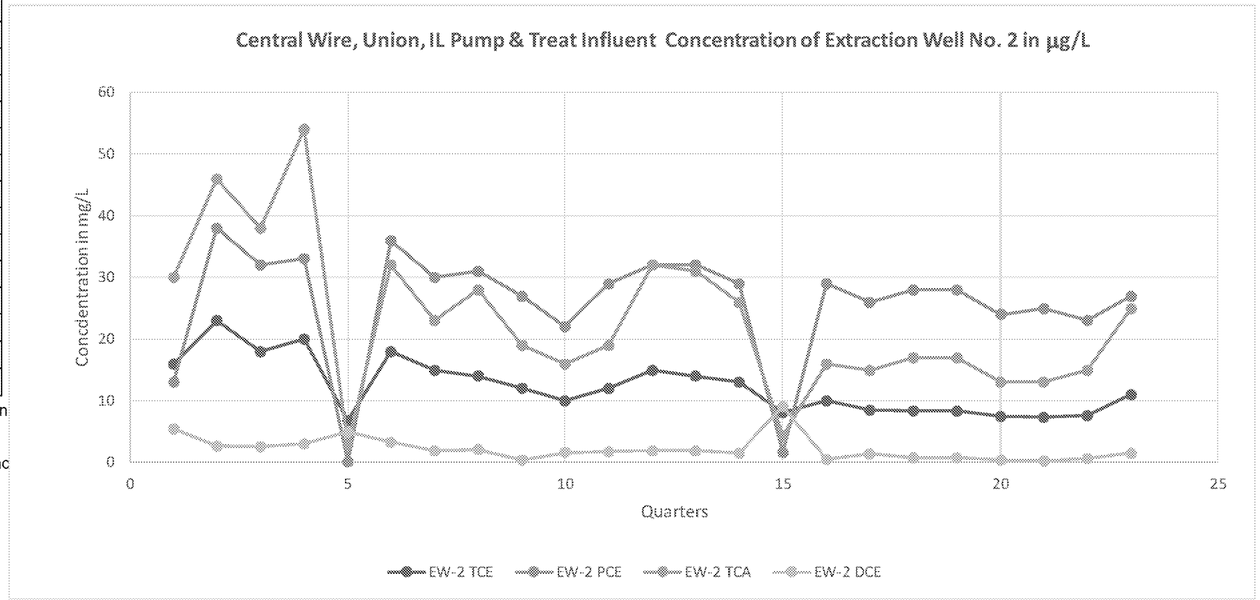
Note 2: The indicator for estimated values (J) has been left off because the estimated blended influent value is calculated anc