MW-7

Sampling Month & Year	TCE	PCE	1,1-DCE
June-95	**64**	**150**	**130**
April-02	**33**	**84**	**22**
June-03	**63**	**140**	**11**
December-03	**56**	**200**	5.5
June-04	**34**	**160**	2.3
January-05	**19**	**180**	1.9
June-05	**15**	**140**	0
December-05	**16**	**140**	1.45
June-06	**10**	**150**	0
December-06	**9**	**200**	0
March-07	**7.5**	**180**	0
June-07	**7.2**	**170**	1.1
September-07	**6.2**	**110**	0
December-07	**8.9**	**110**	1.2
March-08	**6**	**110**	0
October-08	4.8	**93**	4.3
March-09	**6.5**	**80**	8.8
June-09	**5.9**	**82**	2.4
December-09	**7.2**	**9.4**	**7.5**
June-10	4.8	**60**	4.8
December-10	**5.9**	**76**	11
June-11	2.8	0.57	4.6
December-11	**5.7**	**61**	3
June-12	**6.5**	**67**	7
December-12	**5.6**	**63**	1.4
June-13	3.5	**46**	0
December-13	0	1.8	0
June-14	3.3	**49**	0
October-14	3.8	**46**	0
June-15	3.1	**51**	0
December-15	2.4	**38**	0
June-16	2.6	**47**	0
December-16	2.8	**46**	0

MCL:	5	5	7

Concentrations reported in micrograms per liter.
Bold values exceed the MCL.
EPA Method 8260B was run. Only chemicals with detections above the MCLs were plotted.
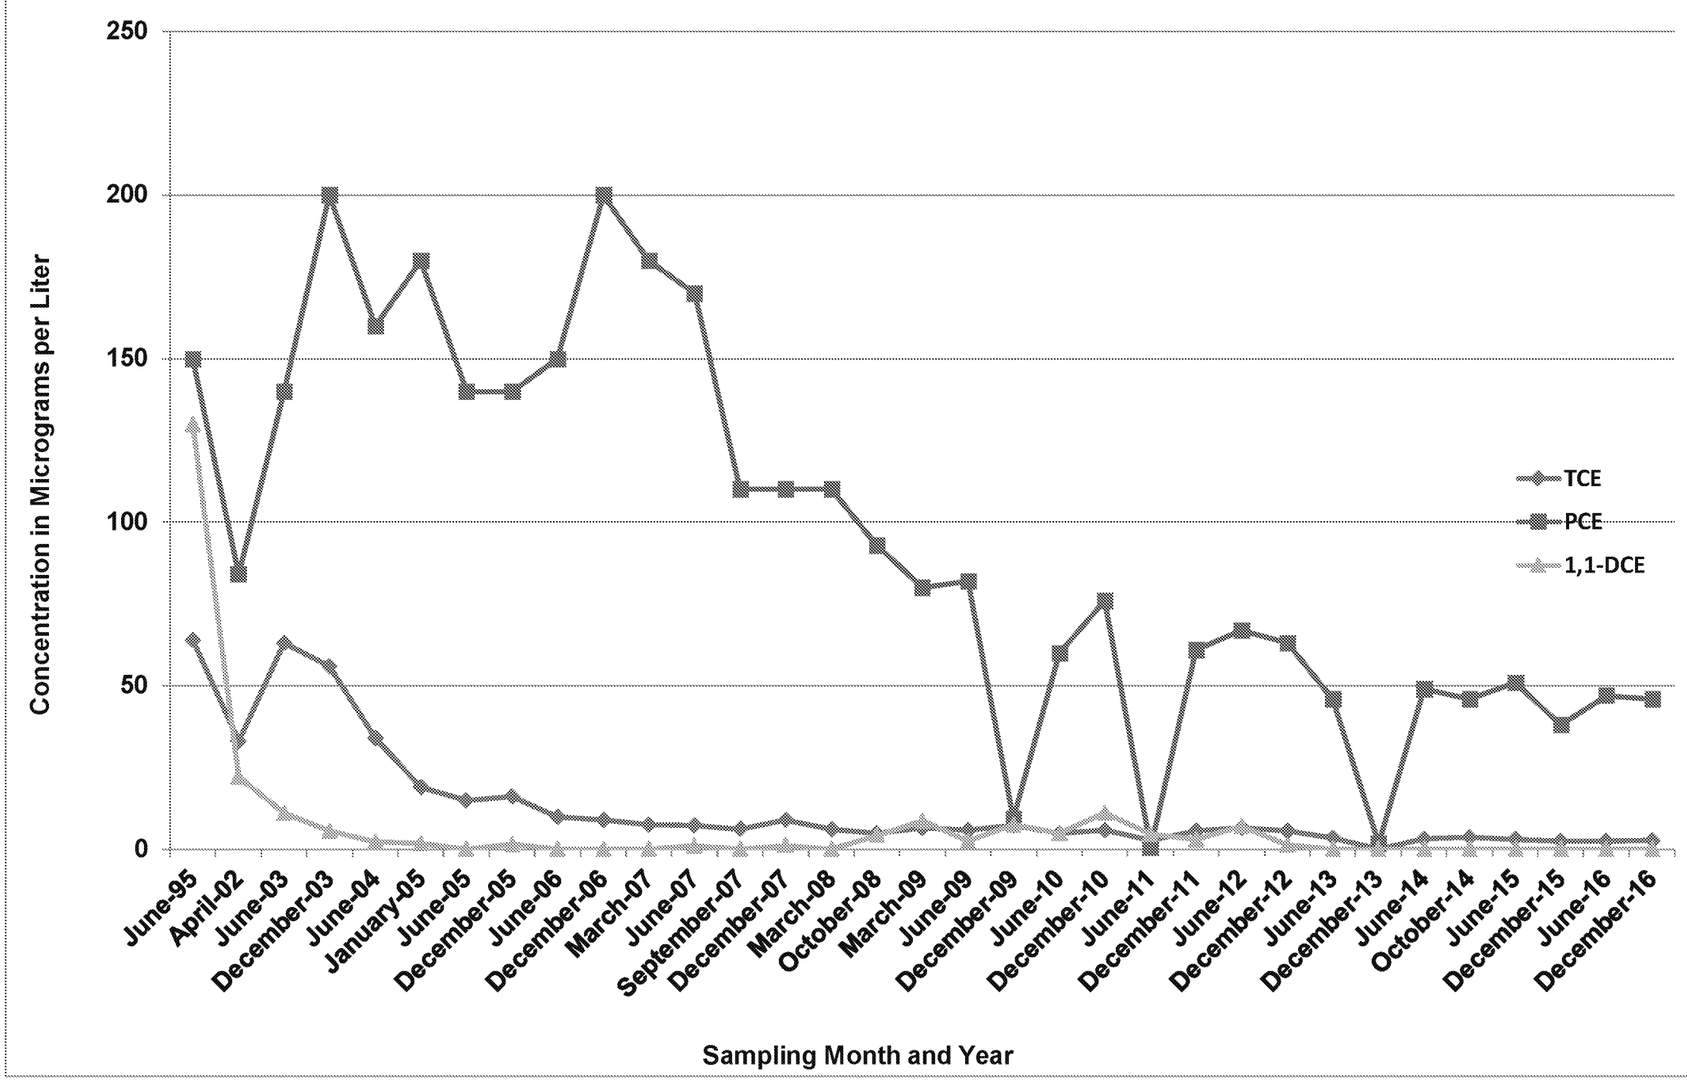
Figure 3-6
Trends in VOC Concentrations at the Central Wire Union, Illinois Plant for Parameters Exceeding the MCLs in Monitoring Well MW-7 from 1995 - 2016