MW-6

Time	PCE	1,1-DCE	1,2-DCE	1,1-DCA	1,1,1-TCA	1,2-DCA	TCE
J-95	**36**	-	-	10	-	-	-
A-02	**14**	-	-	-	1.1	-	-
J-03	**10**	-	-	-	-	-	-
D-03	**12**	-	-	-	-	-	-
J-04	**9.6**	-	-	-	-	-	-
J-05	**9.1**	-	-	-	-	-	-
Jn-05	**9.4**	-	-	-	-	-	-
D-05	**9.91**	-	-	-	-	-	-
Jn-06	**7**	-	-	-	-	-	-
D-06	**7.8**	-	-	-	-	-	-
Jn-07	**67**	-	-	-	-	-	-
D-07	**8.4**	-	-	-	-	-	1.3
M-08	**8.5**	-	-	-	-	-	-
O-08	**7.54**	-	-	-	-	-	-
M-09	**7.2**	0.011 B		-	-		-
Jn-09	**7.8**	-	-	-	-	-	-
D-09	**9.5**	-	-	-	-	-	-
Jn-10	**7**	-	-	-	0.69 J	-	-
D-10	**7.6**	-	-	-	-	-	-
Jn-11	**6.2**	-	-	-	-	-	-
D-11	**6.6**	-	-	-	-	-	0.26 J
Jn-12	**7.2**	-	-	-	-	-	0.25 J
D-12	**6.3**	-	-	-	-	-	-

MW-6	
Time	**PCE**
June-95	**36**
April-02	**14**
June-03	**10**
December-03	**12**
June-04	**9.6**
January-05	**9.1**
June-05	**9.4**
December-05	**9.91**
June-06	**7**
December-06	**7.8**
June-07	**67**
December-07	**8.4**
March-08	**8.5**
October-08	**7.54**
March-09	**7.2**
June-09	**7.8**
December-09	**9.5**
June-10	**7**
December-10	**7.6**
June-11	**6.2**
December-11	**6.6**
June-12	**7.2**
December-12	**6.3**
June-13	4.9
December-13	4.9
June-14	4.3
October-14	4.9
June-15	4.4
MCL	5

Concentrations reported in micrograms per liter.
Bold values exceed the MCL.
EPA Method 8260B was run.
Only chemicals with detections above the MCLs were plotted.
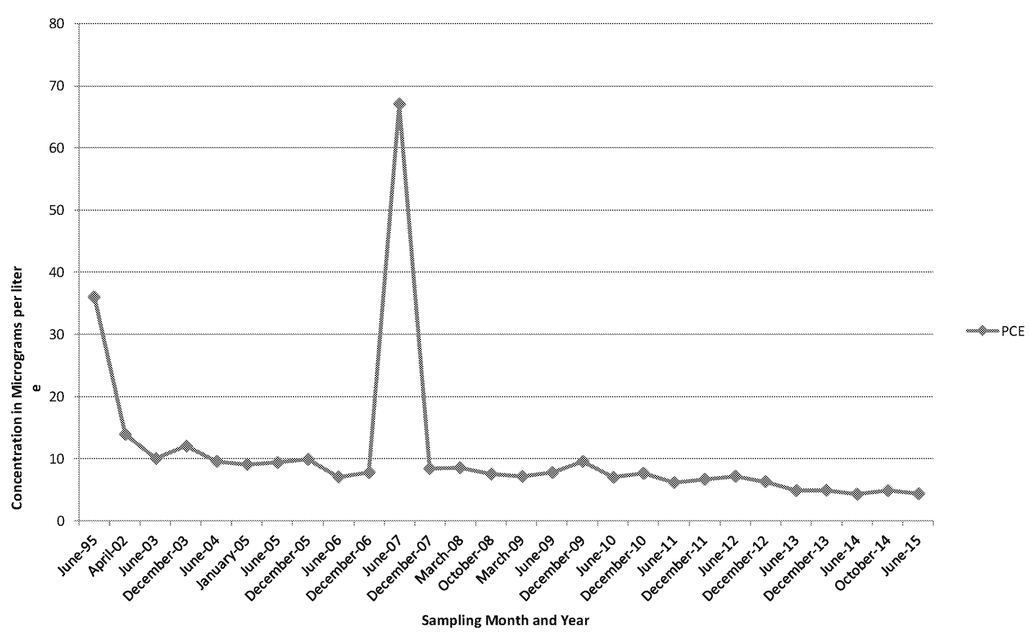
Figure 5
Trends in VOC Concentrations at Central Wire Union, Illinois Plant for Parameters Exceeding the MCLs in Monitoring Well MW-6 from 1995 - June 2015