MW-5

Sampling Month & Year	TCA	TCE	PCE	DCE
April-02	**300**	**5**	**94**	**12**
June-03	**360**	**10**	**190**	5
December-03	**330**	**7.5**	**210**	1.8
June--04	150	**4.7**	**170**	0
January-05	160	**5.1**	**190**	0
June-05	120	4.9	**190**	0
December-05	93.2	4.63	**133**	1.64
June-06	78	4.7	**120**	0
December-06	82	4	**160**	0
June-07	0	4.5	**150**	5.7
December-07	0	4.6	**130**	1.1
March-08	58	3.8	**160**	0
October--08	45	3.1	**110**	0
June-09	51	3.5	**140**	1.8
December-09	31	2.7	**140**	0
June-10	46	3.6	**100**	0.98
December-10	37	3.2	**130**	1.5
June-11	42	2.6	**110**	0.77
December-11	36	2.5	**98**	0
June-12	49	4.2	**120**	0.77
December-12	29	2.6	**110**	0.94
June-13	29	2.4	**86**	0
Dec.-13	19	1.8	**72**	0
Jun-14	26	2.1	**92**	0
Oct-14	24	2.1	**81**	0
Jun-15	20	2	**92**	0
Dec-15	10	1	**62**	0
Jun-16	21	2.2	**9.3**	0
MCL	200	5	5	7

Concentrations reported in micrograms per liter.
Bold values exceed the MCL.
EPA Method 8260B was run. Only chemicals with detections above the MCLs were plotted.
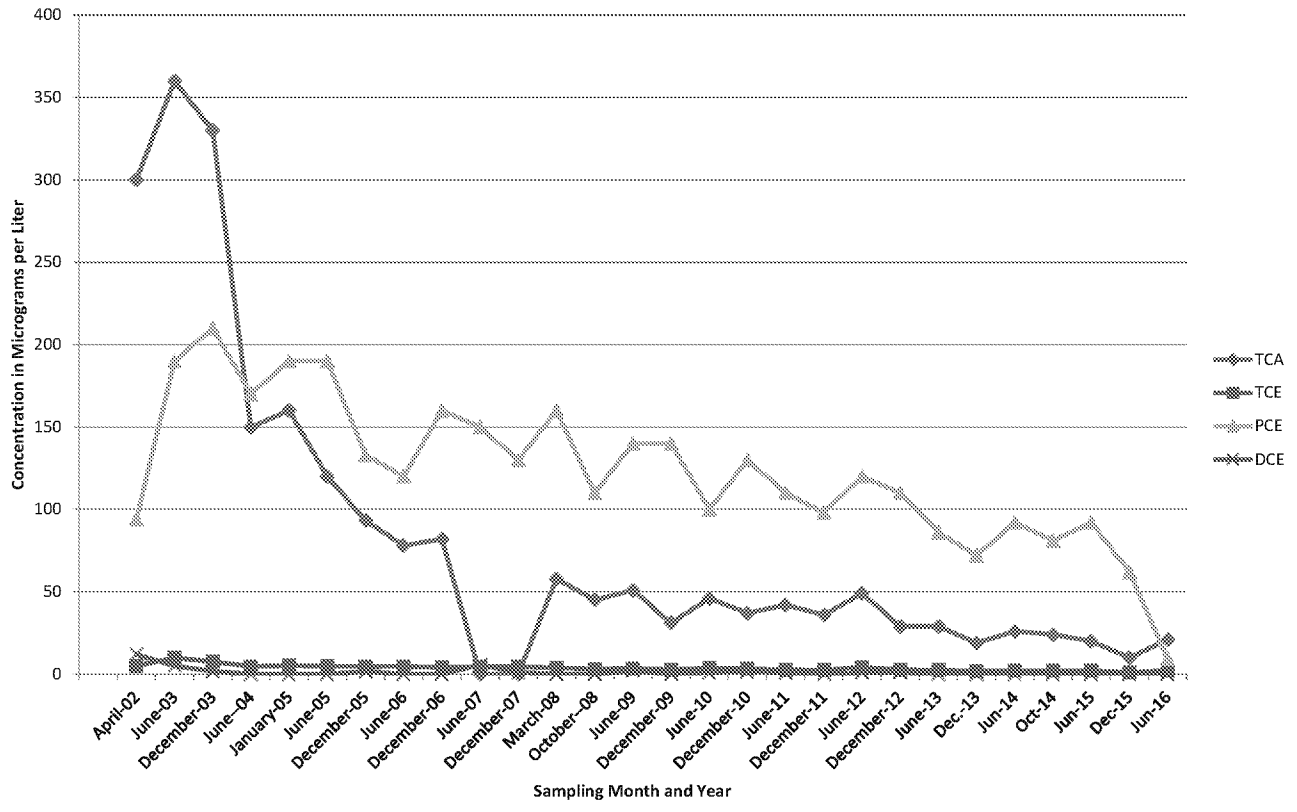
Figure 4
Trends in VOC Concentrations at the Central Wire Union, Illinois Plant for Parameters Exceeding the MCLs in Monitoring Well MW-5 from 2002 - June 2016