Exhibit I

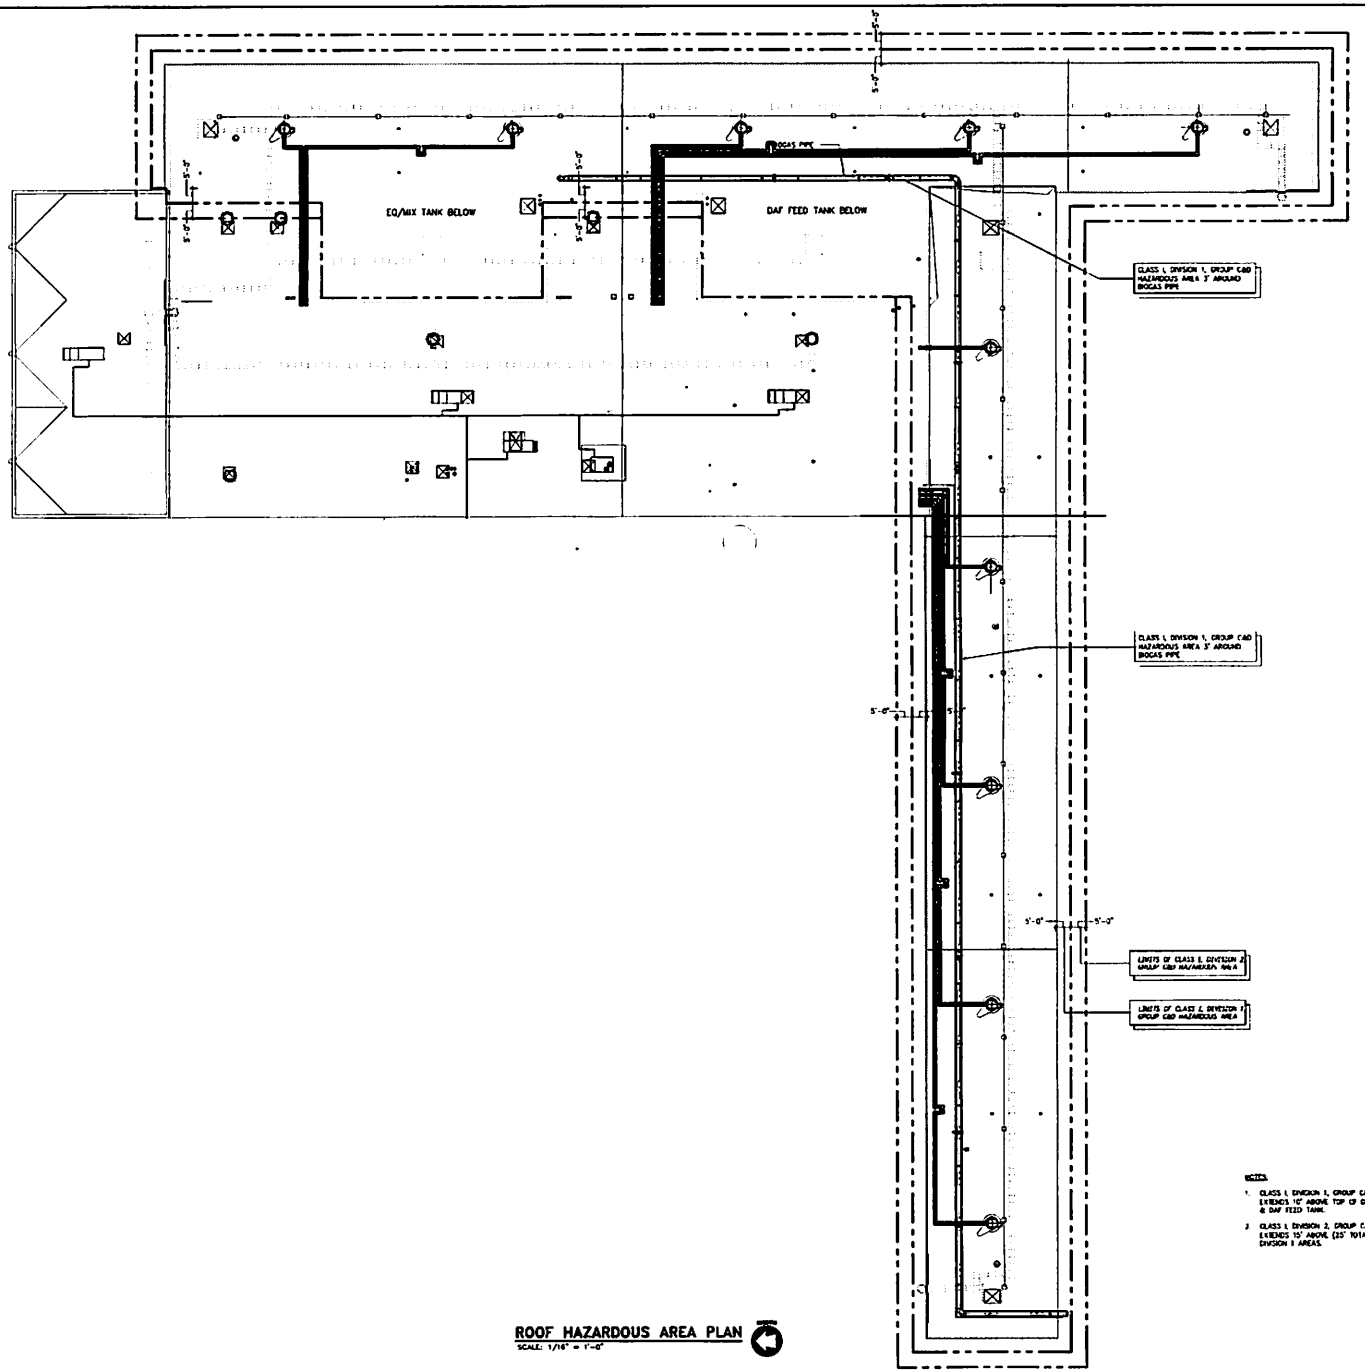

ROOF HAZARDOUS AREA PLAN
SCALE: 1/16" = 1'-0"

NOTES

1. CLASS I, DIVISION 1, GROUP C&D HAZARDOUS AREA EXTENDS 15' ABOVE TOP OF DIGESTER, EQ/MIX TANK & DAF FEED TANK.
2. CLASS I, DIVISION 2, GROUP C&D HAZARDOUS AREA EXTENDS 15' ABOVE (25' TOTAL) TOP OF CLASS I, DIVISION 1 AREAS.

Copyright 2015 Big Ox Energy

RENEWABLE NATURAL GAS FACILITY
BIG OX ENERGY - DAKOTA CITY NEBRASKA 68731
ROOF HAZARDOUS AREA PLAN

NO	DATE	REVISIONS
1	06-2-15	RO REVIEWS
2	06-23-15	ADDENDUM #1
3	06-23-15	CONST. DOC. CONTRACTOR

McMAHON
EMPLOYEE OWNED ARCHITECTS ENGINEERS
1545 WASHINGTON DRIVE, MEDINA, NE 68833
Mailing Address: P.O. BOX 1273, Norfolk, NE 68702-1273
Tel. (402) 371-4128 Fax (402) 371-0425
www.mcmahon-ae.com

Miron Building Excellence

BIGOX ENERGY

CONFIDENTIAL BUSINESS INFORMATION

TRADE SECRET

DESIGNED CTO
DRAWN JRP
PROJECT NO. 01079-950158
DATE 6-12-15
SHEET NO. M28