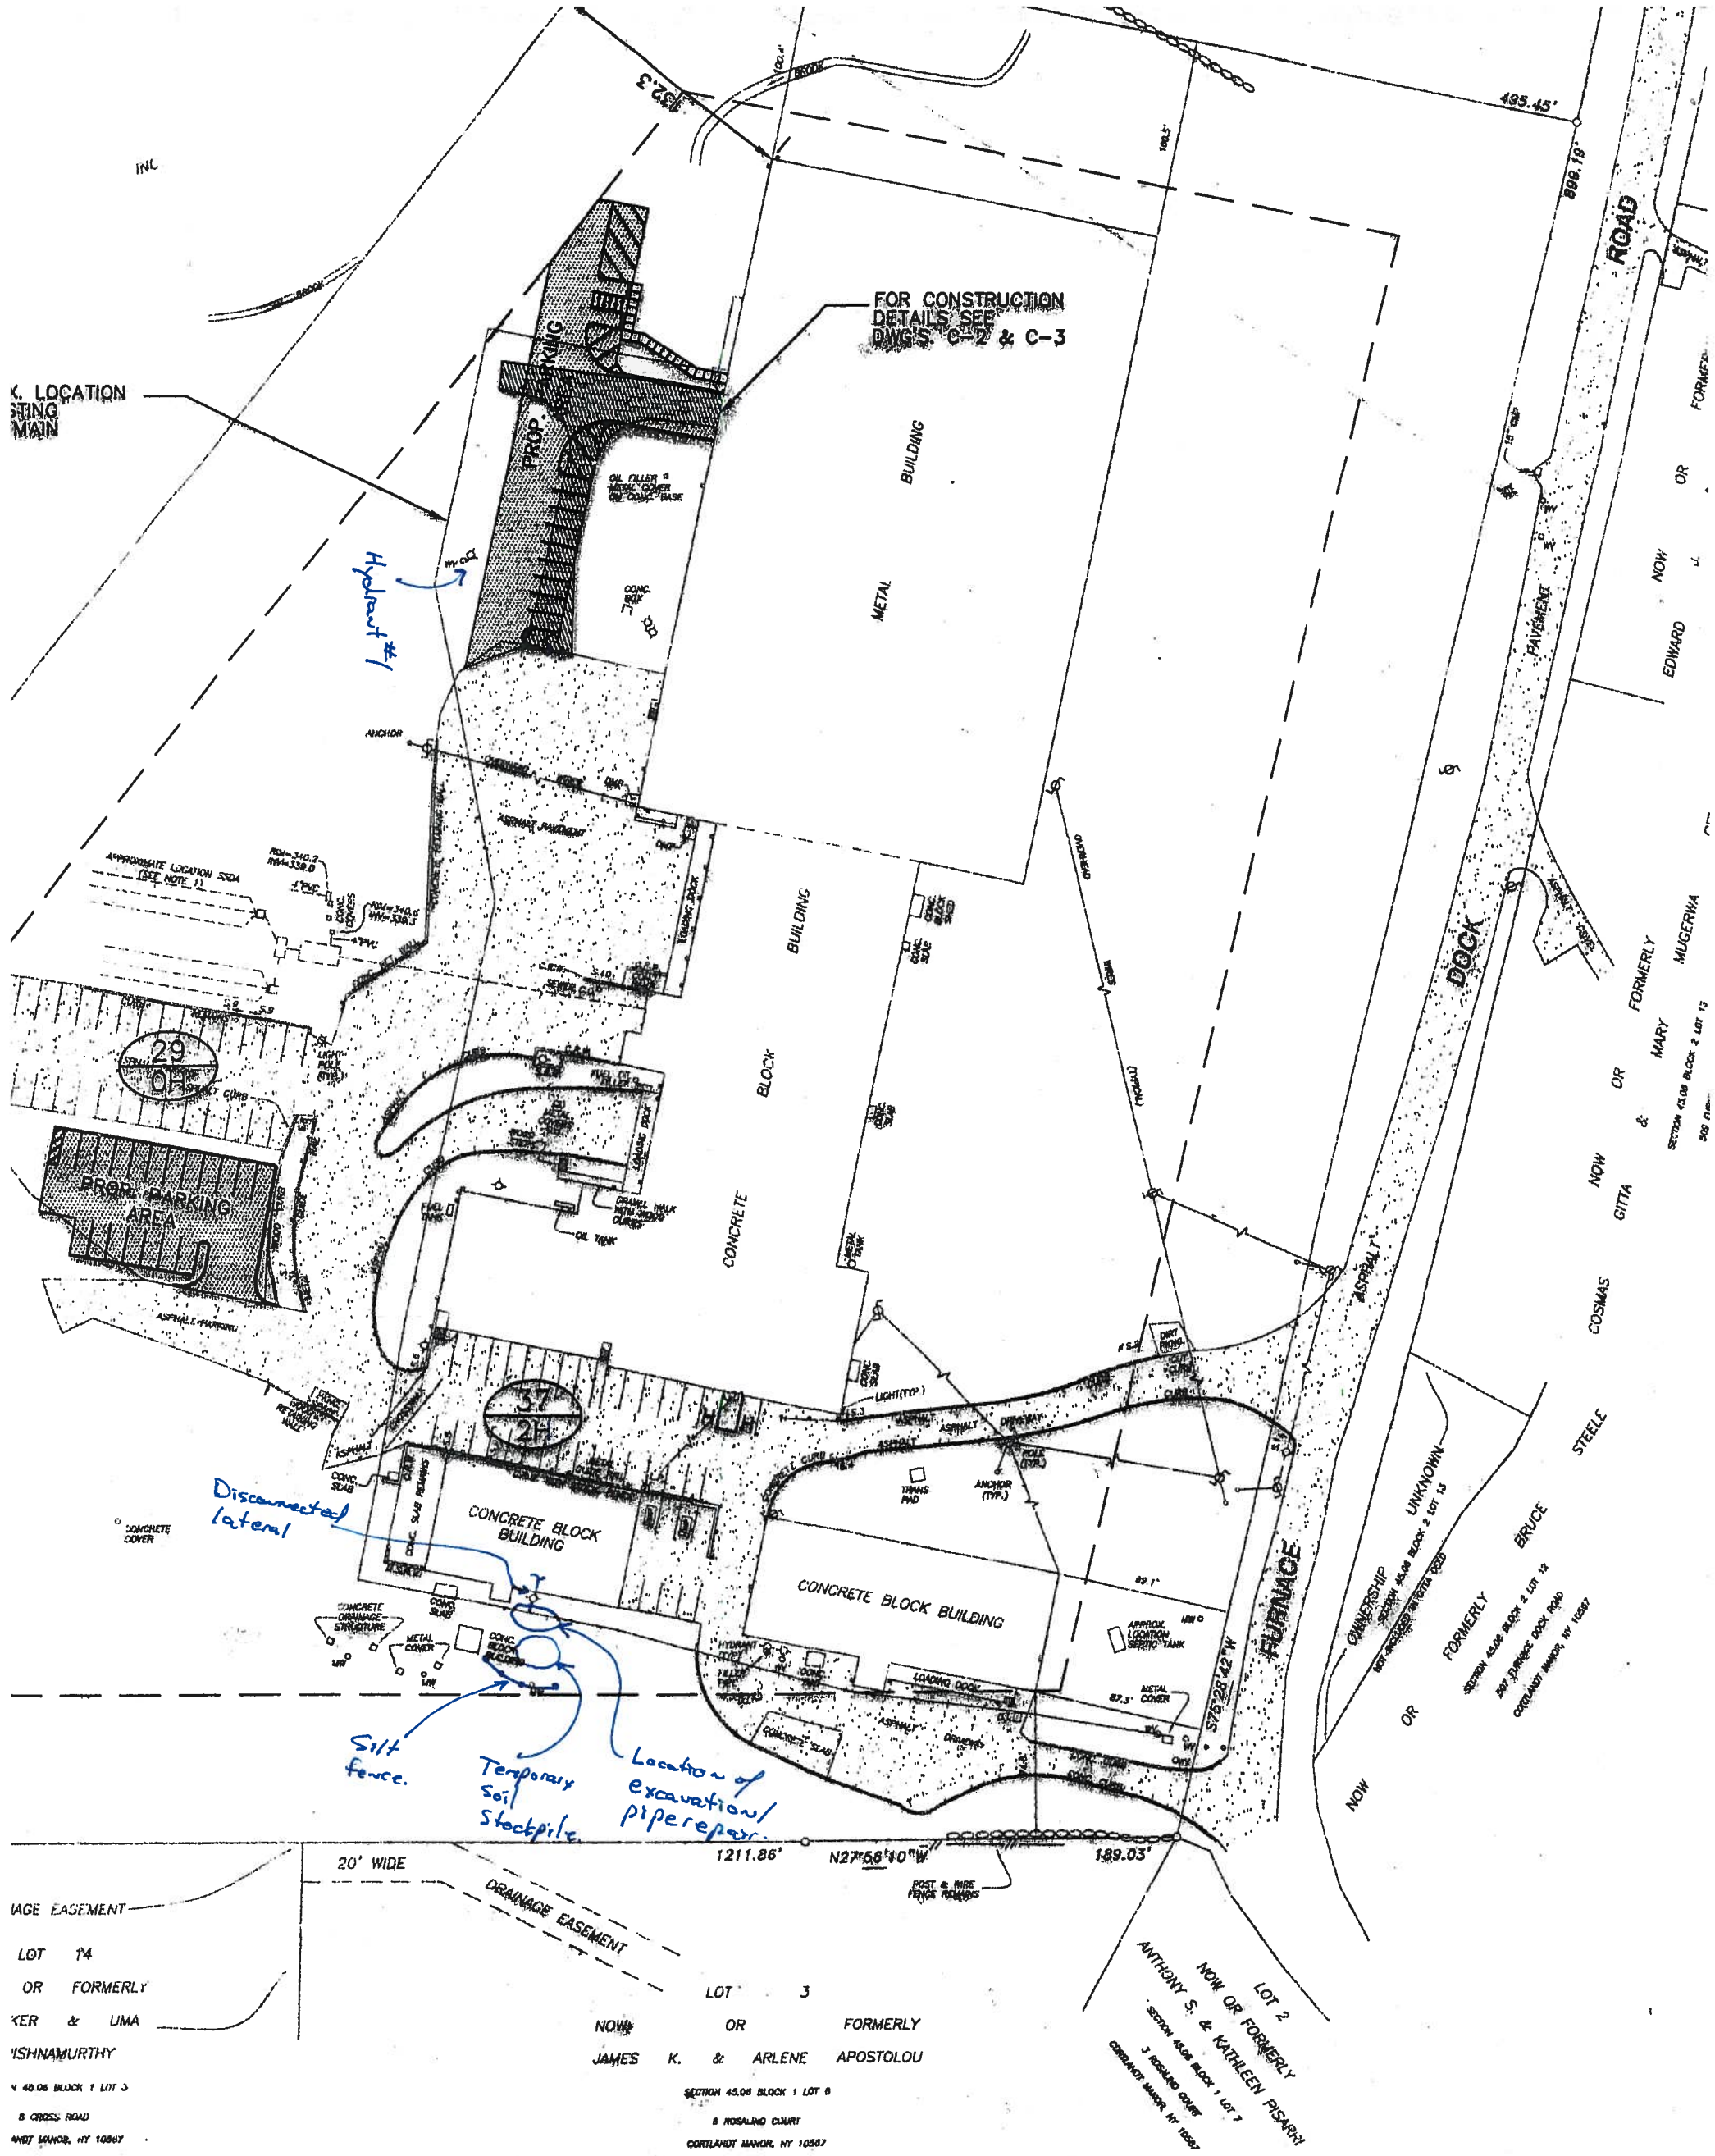

Cortlandt Water Line Repair - April 19, 2008

5/2/08 by DED 1"=80'

The Department Head signatures indicate the this drawing or set of dra
the Planning Board resolution of approval and with the general requiren
Town of Cortlandt for which the Department Head is responsible. The
all public health and safety considerations are the sole responsibility of
who has signed and sealed the drawings.

Reviewed by The Department of Environmental Service

Director Date Co-Director Da

Reviewed by The Department of Technical Services

Director 6/24/08 Date

UBJECT PREMISES MUST BE COMMENCED WITHIN ONE YEAR FROM THE PLANNING BOARD
OVAL SHALL EXPIRE UNLESS A TIME EXTENSION IS REQUESTED BY THE APPLICANT AND

RATORS SHALL BE CERTIFIED TO THE DIRECTOR OF TECHNICAL SERVICES ON AN ANNUAL

BCLP00438