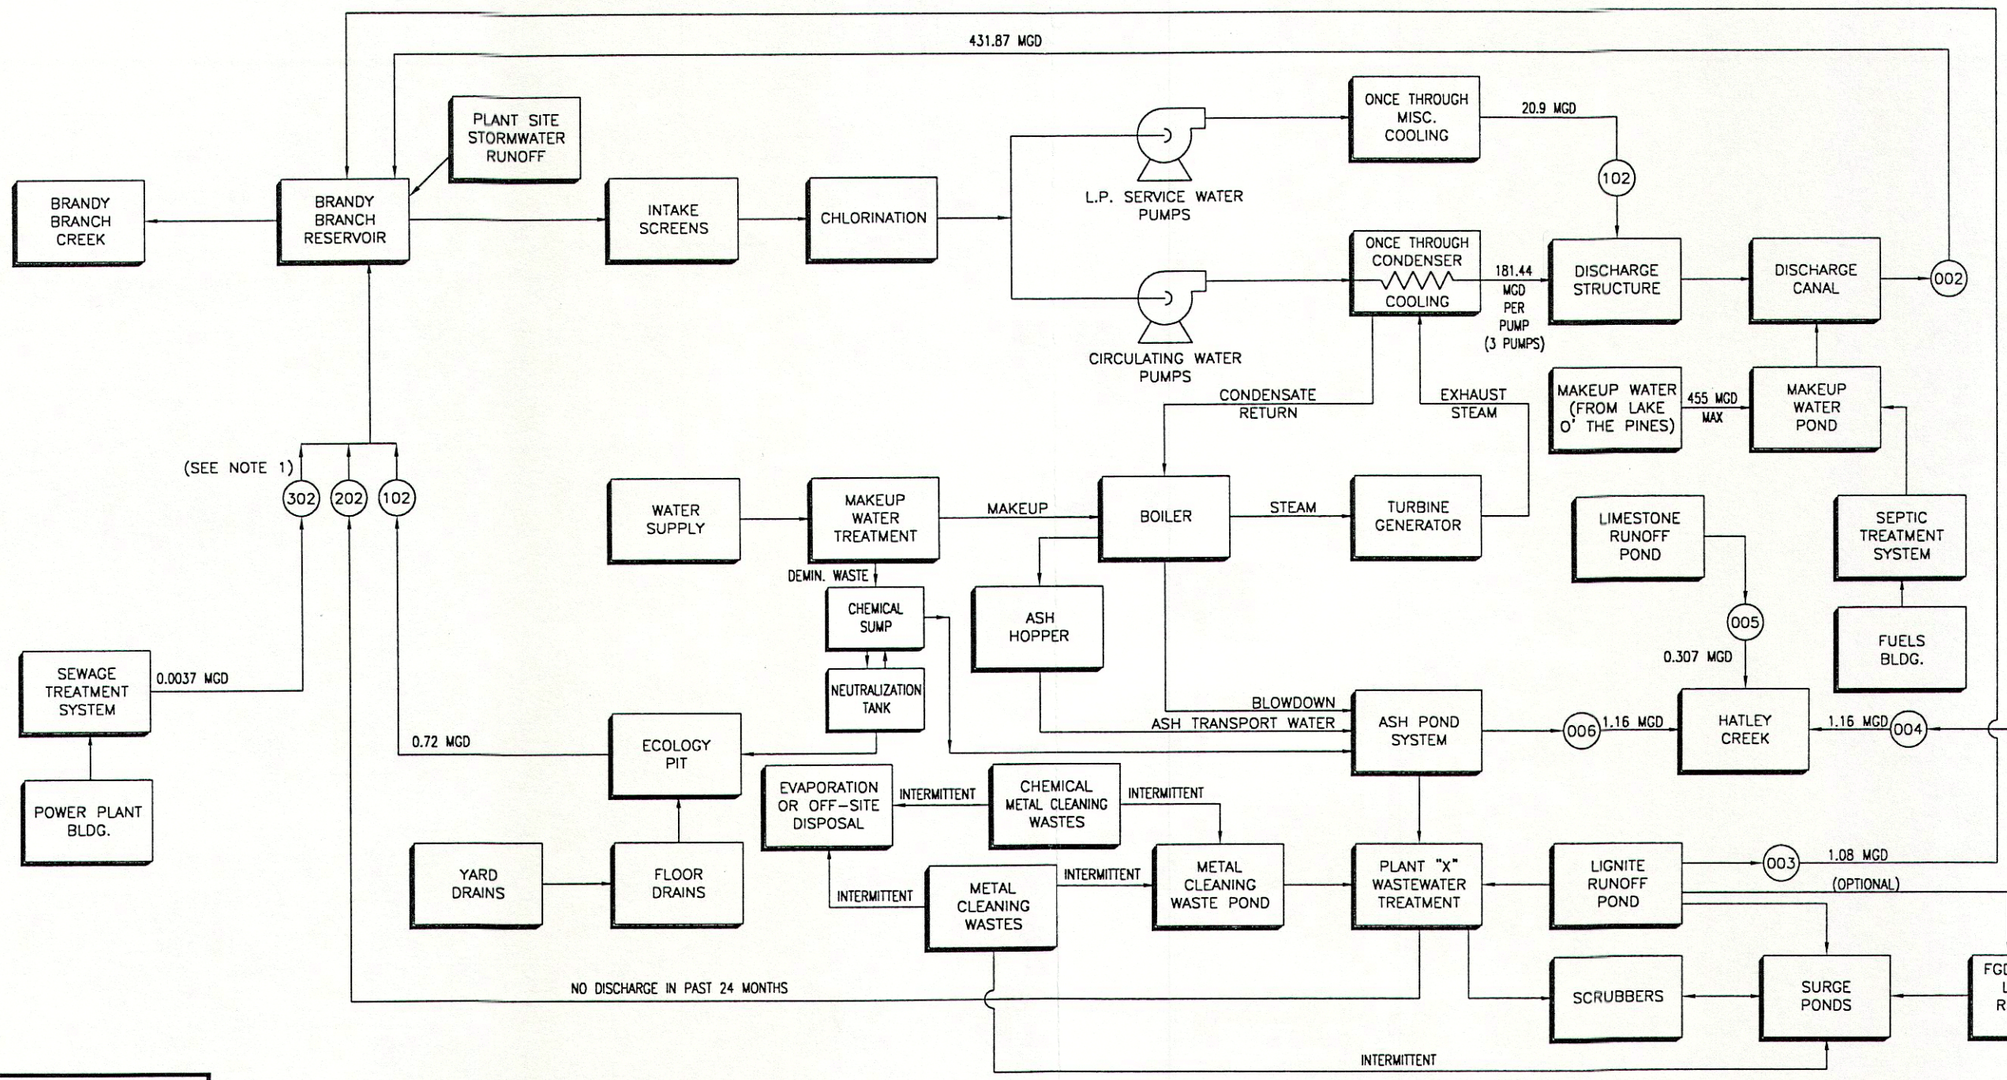

NOTE: 1. GRAB SAMPLES OF TREATED SEWAGE FROM THE POWER PLANT AND FUELS BUILDINGS HAVE HISTORICALLY BEEN PHYSICALLY COMPOSITED INTO A SINGLE FLOW WEIGHTED SAMPLE FOR ANALYSIS AND REPORTING.

REV	DESCRIPTION	DATE	APP'D

APPROVED BY:

ENGINEERED BY:

DRAWN BY:

DATE: 7-26-02

SCALE: NONE

CONT./PROJ. No.

THIS DRAWING CONTAINS INFORMATION PROPRIETARY TO AEP Pro Serv, Inc.; IT IS SUBMITTED IN CONFIDENCE AND IS TO BE USED SOLELY FOR THE PURPOSES FOR WHICH IT IS FURNISHED. THIS DRAWING AND SUCH INFORMATION IS NOT TO BE REPRODUCED, TRANSMITTED, DISCLOSED OR USED OTHERWISE IN WHOLE OR IN PART WITHOUT THE WRITTEN AUTHORIZATION OF AEP Pro Serv, Inc.

SWEPCO

HENRY W. PIRKEY POWER PLANT

SCHEMATIC OF WATER FLOW

AEP PRO SERV
1616 Woodall Rodgers Fwy
Dallas, TX 75202

DWG. NO. SWP-07

REV 0

REVIEW SEEN BY: PROCESS | PIPING | STRUCT | MECH | ELECT | INSTR