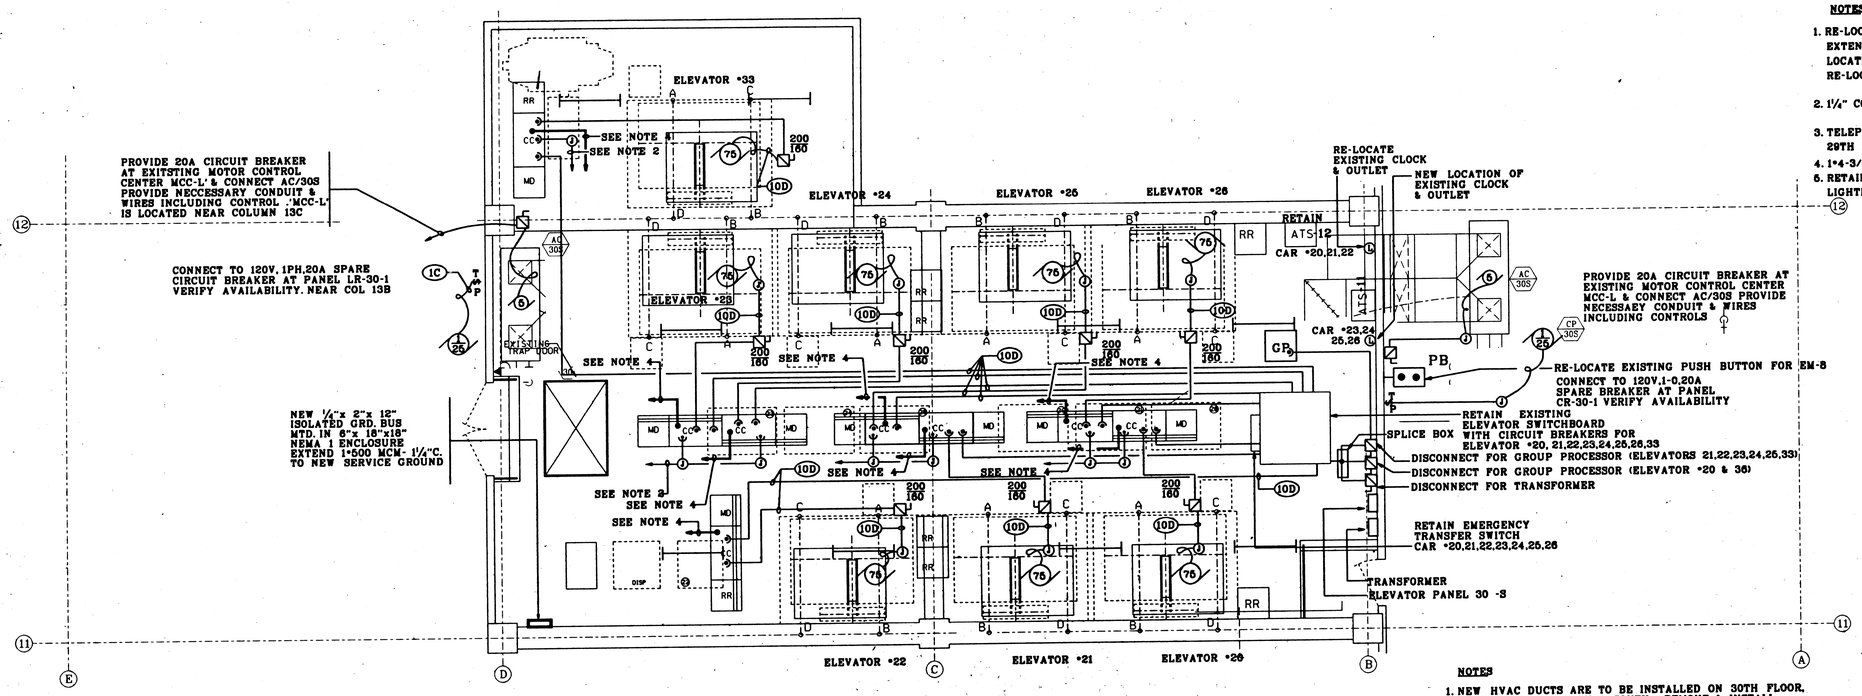

NOTES

1. RE-LOCATE EXISTING DEVICES ON COLUMN B EXTEND CONDUIT & WIRES. CO-ORDINATE LOCATION & ELEVATION OF DUCTS PRIOR TO RE-LOCATION
2. 1 1/4" CONDUIT TO EXISTING TELEPHONE CABINET
3. TELEPHONE TERMINAL CABINET IS LOCATED ON 29TH FLOOR
4. 1*4-3/4"C. TWW GRD. TO GROUND BUS
5. RETAIN EXISTING ELECTRICAL SYSTEM FOR LIGHTING,POWER,AND LOW CURRENT SYSTEM.

NOTES

1. NEW HVAC DUCTS ARE TO BE INSTALLED ON 30TH FLOOR. MACHINE ROOM NORTH & SOUTH . REMOVE & INSTALL EXISTING LIGHT FIXTURES ON LOCATIONS AS SHOWN ON DRG *9M7 EXTEND CONDUIT AND WIRES AS REQUIRED.

(1) ELECTRICAL SYSTEM LAYOUT MACHINE ROOM (SOUTH) @ 30TH FLOOR ELEVATOR NOS. 20 THRU 26 & 33

SCALE:1/4" = 1"-0"

NORTH

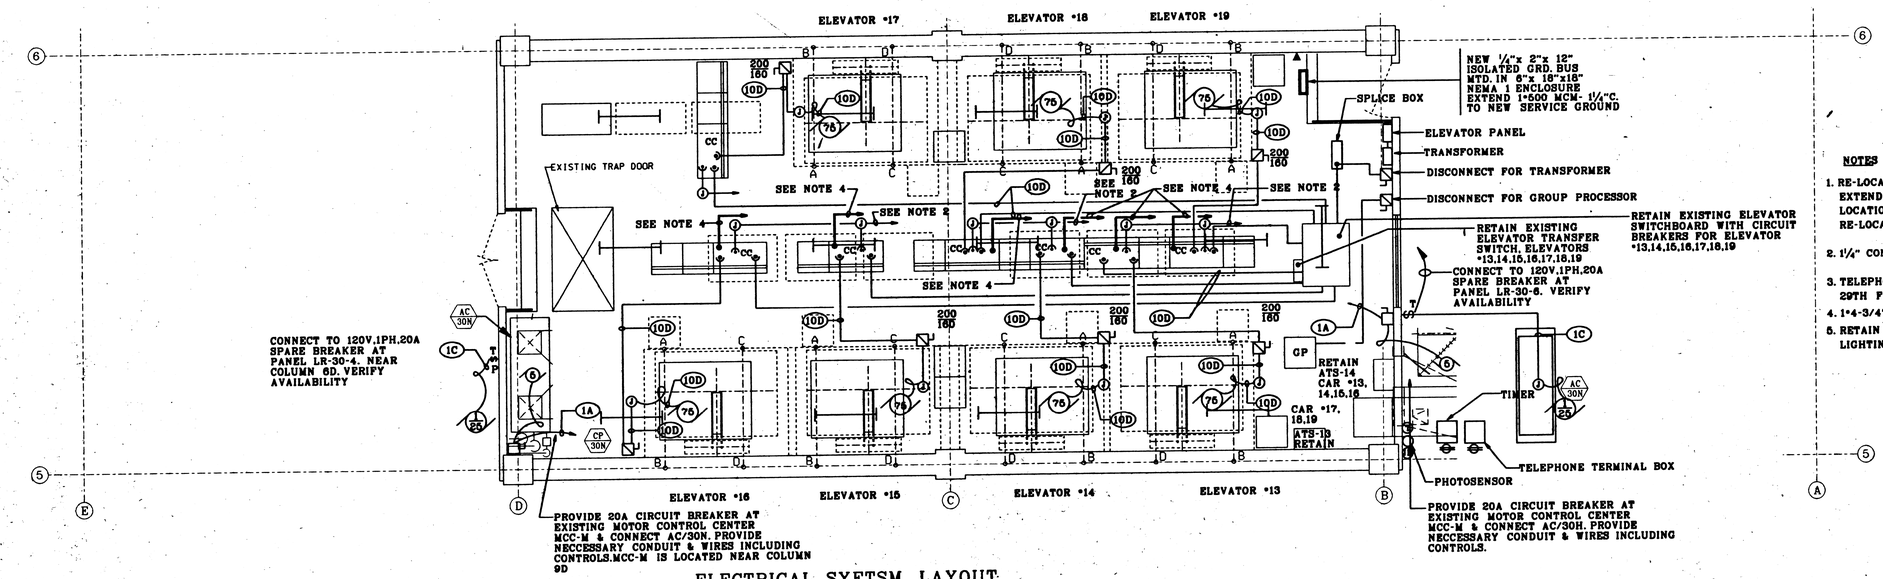

NOTES

1. RE-LOCATE EXISTING DEVICES ON COLUMN B EXTEND CONDUIT & WIRES. CO-ORDINATE LOCATION & ELEVATION OF DUCTS PRIOR TO RE-LOCATION
2. 1 1/4" CONDUIT TO EXISTING TELEPHONE CABINET
3. TELEPHONE TERMINAL CABINET IS LOCATED ON 29TH FLOOR
4. 1*4-3/4"C. TWW GRD. TO GROUND BUS
5. RETAIN EXISTING ELECTRICAL SYSTEM FOR LIGHTING,POWER,AND LOW CURRENT SYSTEM.

(2) ELECTRICAL SYETSM LAYOUT MACHINE ROOM (NORTH) 30TH FLOOR ELEVATOR NOS. 13 THRU 19

SCALE:1/4" = 1"-0"

NORTH

NO.	REVISION	DATE
	FINAL	2/23/98

ENVIRONMENTAL SYSTEMS DESIGN
CONSULTING ENGINEERS
MECHANICAL - ELECTRICAL
55 EAST MONROE ST.-SUITE 1660
CHICAGO,ILLINOIS 60603
(312) 372-1200

J.MARTIN ASSOCIATES
Elevator Consultants
Williamsburg Commons
4 Amor Court
East Brunswick, N.J. 08816-6426
908-613-9400 FAX 908-613-9436

GENERAL SERVICES ADMINISTRATION
PUBLIC BUILDING SERVICE
CHICAGO IL

BUILDING	NAME	E. M. DIRKSEN (EMD) BUILDING
	ADDRESS	219 S DEARBORN ST
	CITY / STATE	CHICAGO IL
	NUMBER	
PROJECT	DESCRIPTION	ELEVATOR IMPROVEMENT FOR EMD BLDG.
	NUMBER	IIL94004
DRAWINGS	DRAWN BY	RC
	CKD BY	JS
	DATE	2/23/98
	TITLE	30TH FLOOR POWER
	TYPE	ELECTRICAL
	NUMBER	9 E 6

Copyright © 1994 by Environmental Systems Design