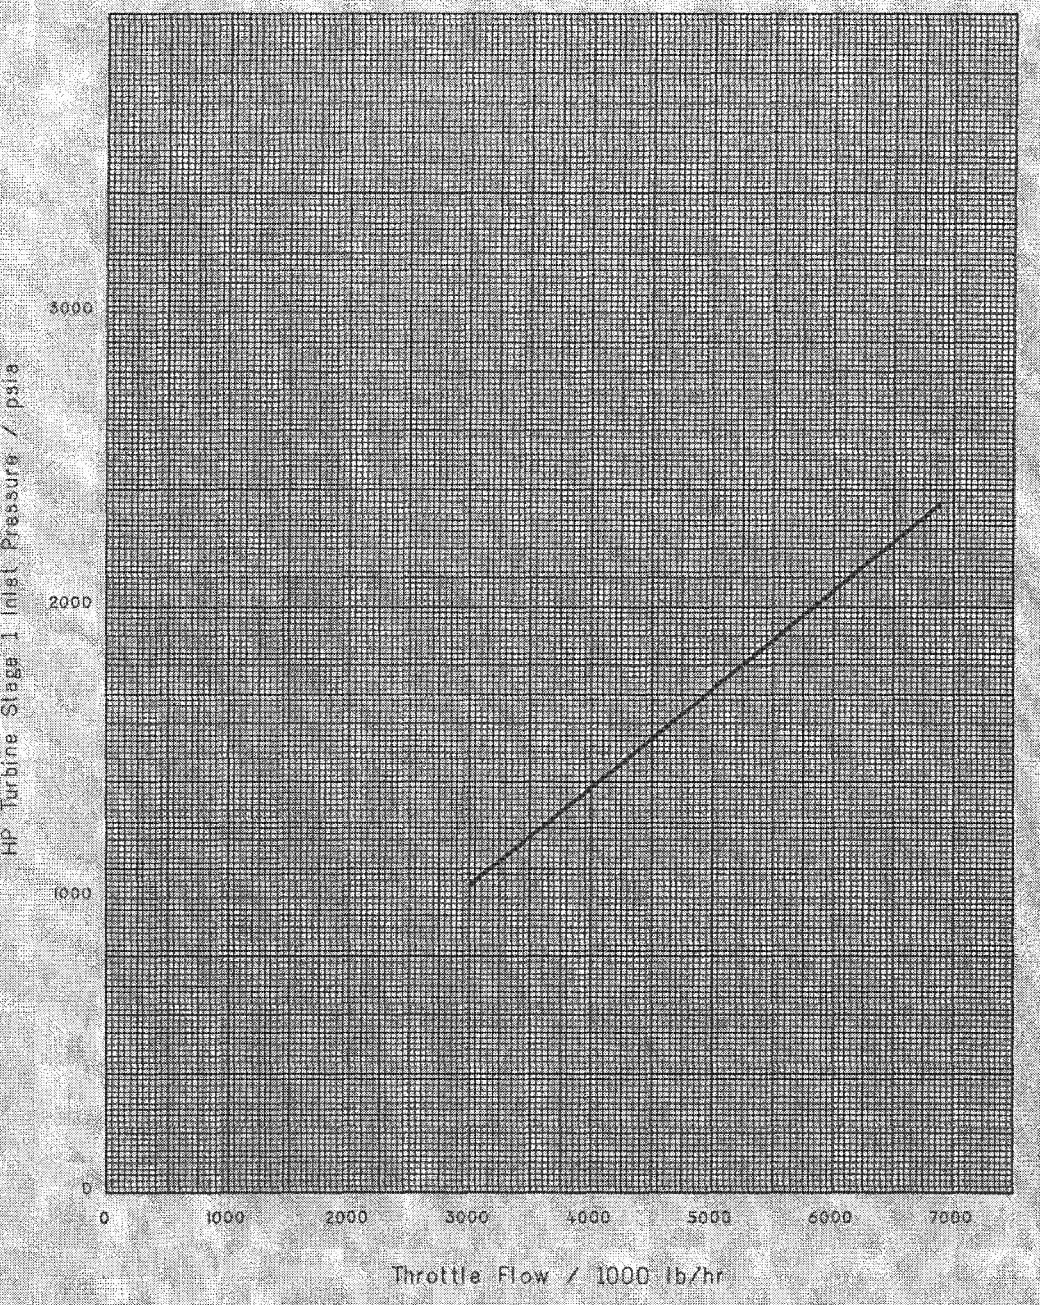


FOR INFORMATION ONLY

ALSTOM Power

INTERMOUNTAIN POWER SERVICES CORPORATION
INTERMOUNTAIN 1 AND 2
HP TURBINE UPGRADE
HP TURBINE STAGE 1 INLET PRESSURE vs. THROTTLE FLOW

| Quotation No: | Issue: | Drawing Number: |
|---|---|---|
| T112415/6 | A | TS29367 |

This drawing and any information or descriptive matter set out hereon are the confidential and copyright property of ALSTOM Energy Ltd. and must not be reproduced, loaned, copied or used for manufacturing, tendering or for any other purpose without their written permission. © 2001 Drawn: P.J.K. Checked: Approved:

IP7006709