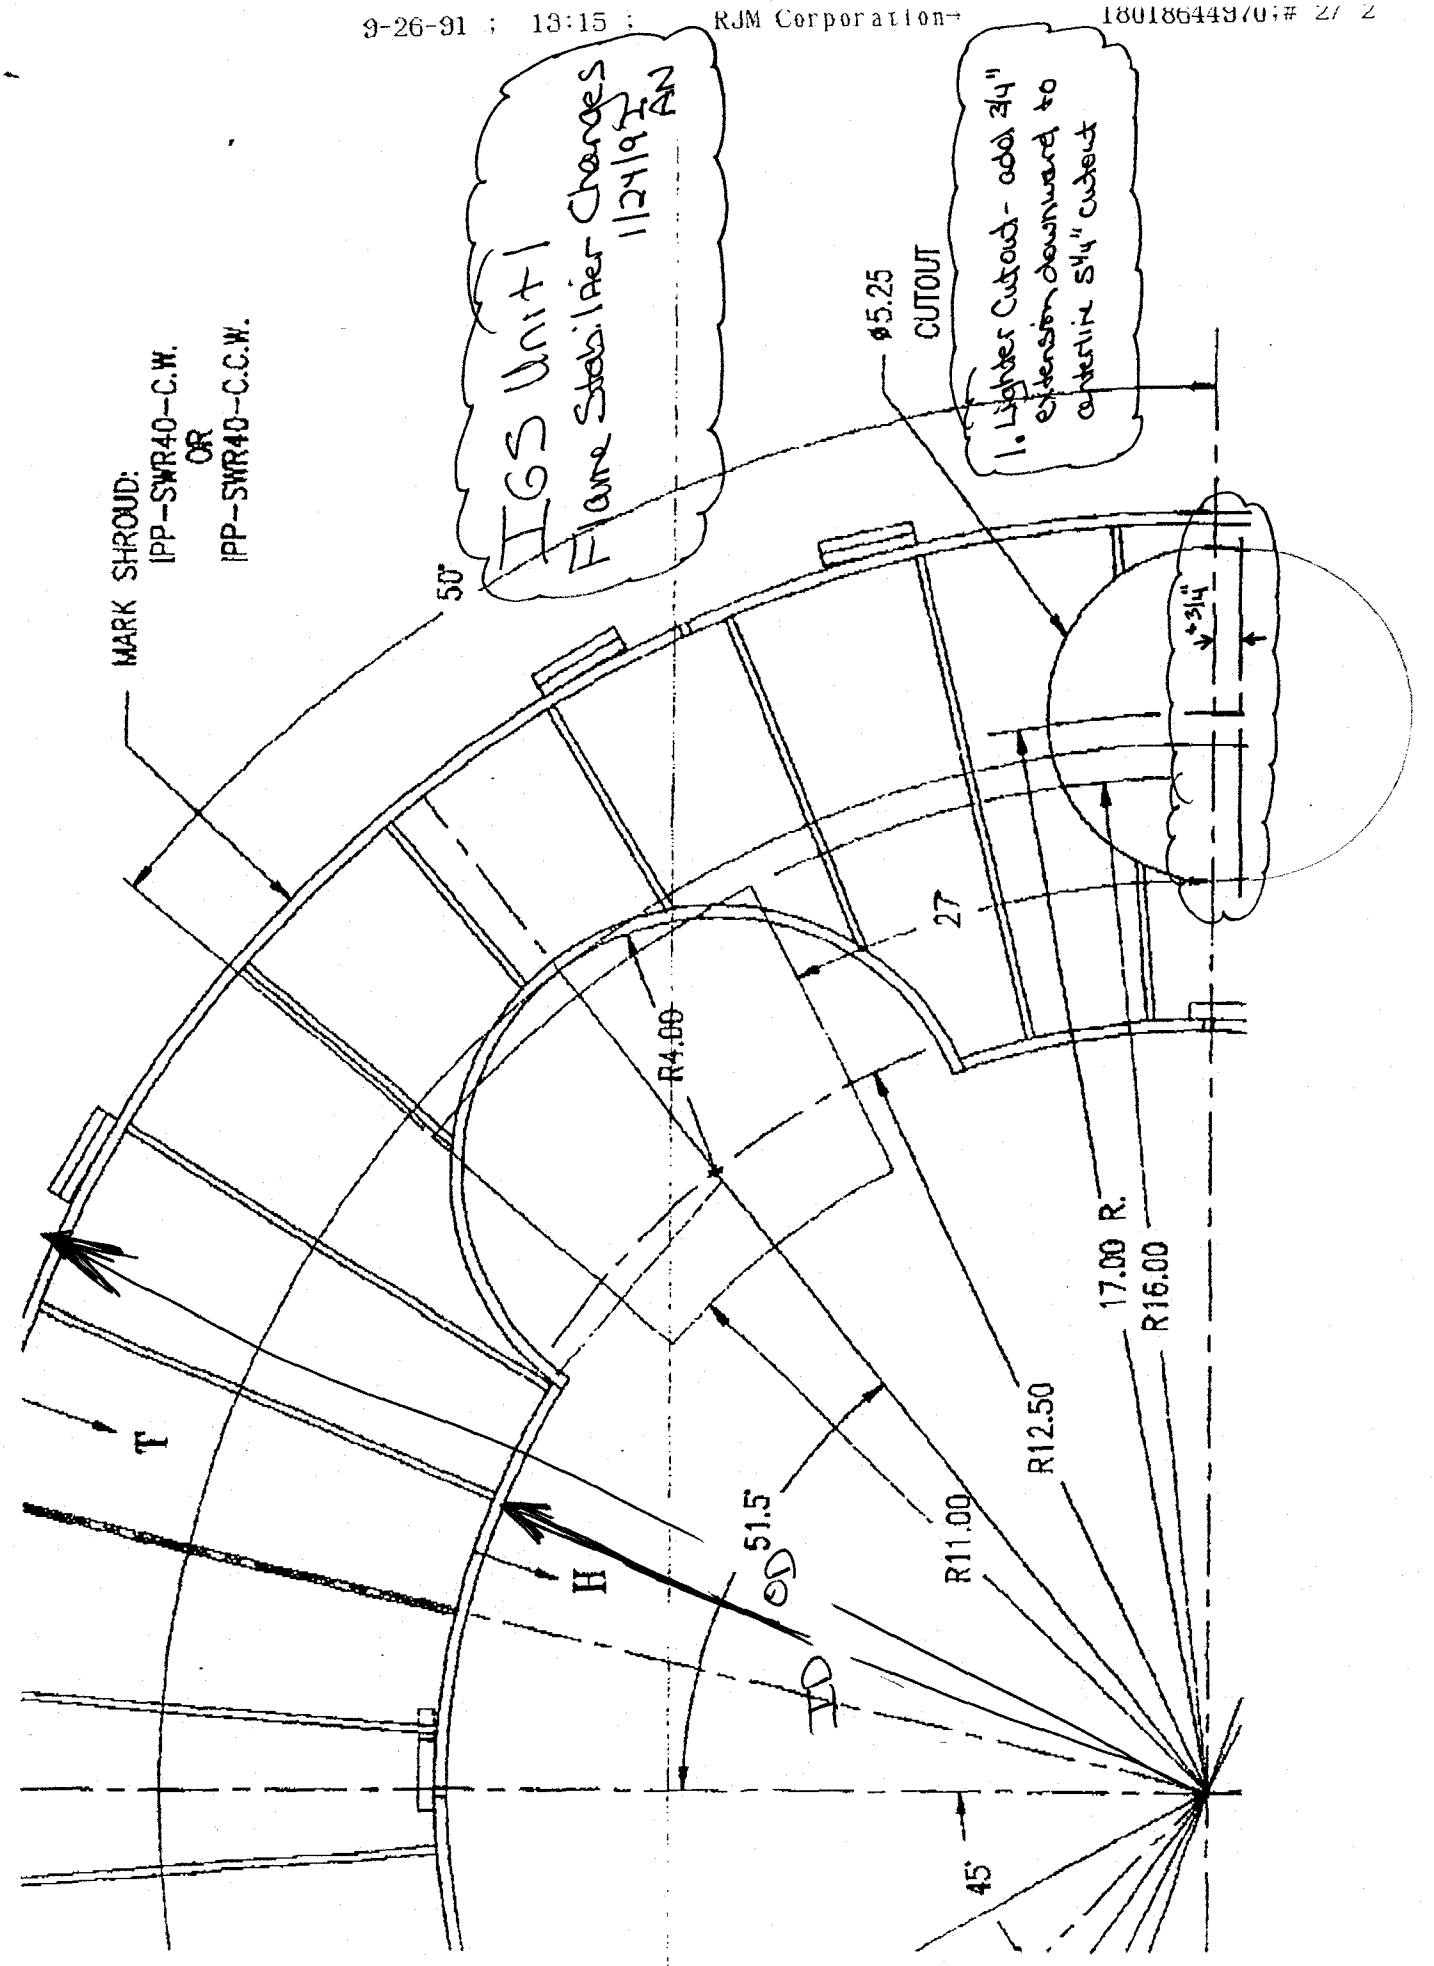
HGS Unit
Flame Stabilizer Changes
1/24/92
1. Lighter Cutout - add 3/4" extension downward to centerline 5 1/4" cutout
MARK SHROUD:
IPP-SWR40-C.W.
OR
IPP-SWR40-C.W.
50°
Ø5.25
CUTOUT
3/4"
27
R4.00
17.00 R.
R16.00
R12.50
R11.00
51.5°
T
H
45°