INTERMOUNTAIN GENERATING STATION

EXCESS AIR VS COAL FLOW

PLACING PULVERIZERS IN-SERVICE

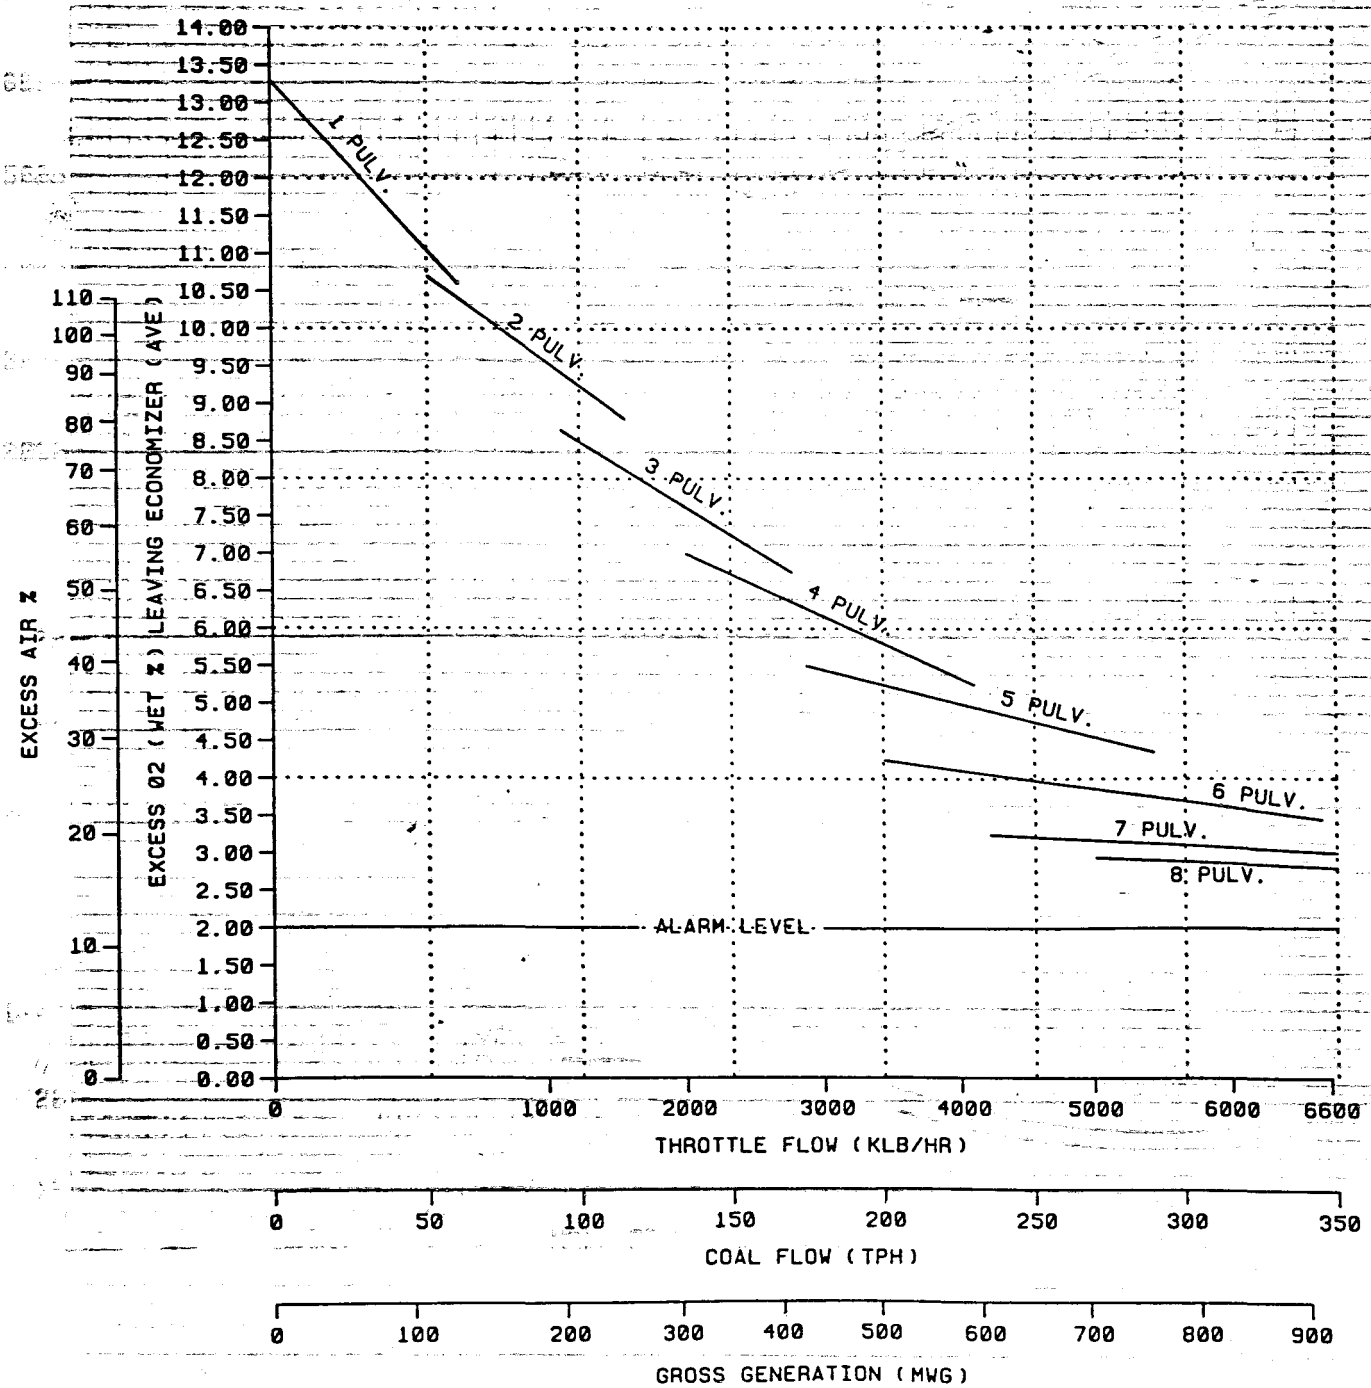

BW 6/8/90

IP7_003382