CORRELATION: NO Overfire Air (5%) ~~##~~ 1/3, 2/3, & inlet dampers closed
O2% control room vs CO Stack test & NOx Stack CEM

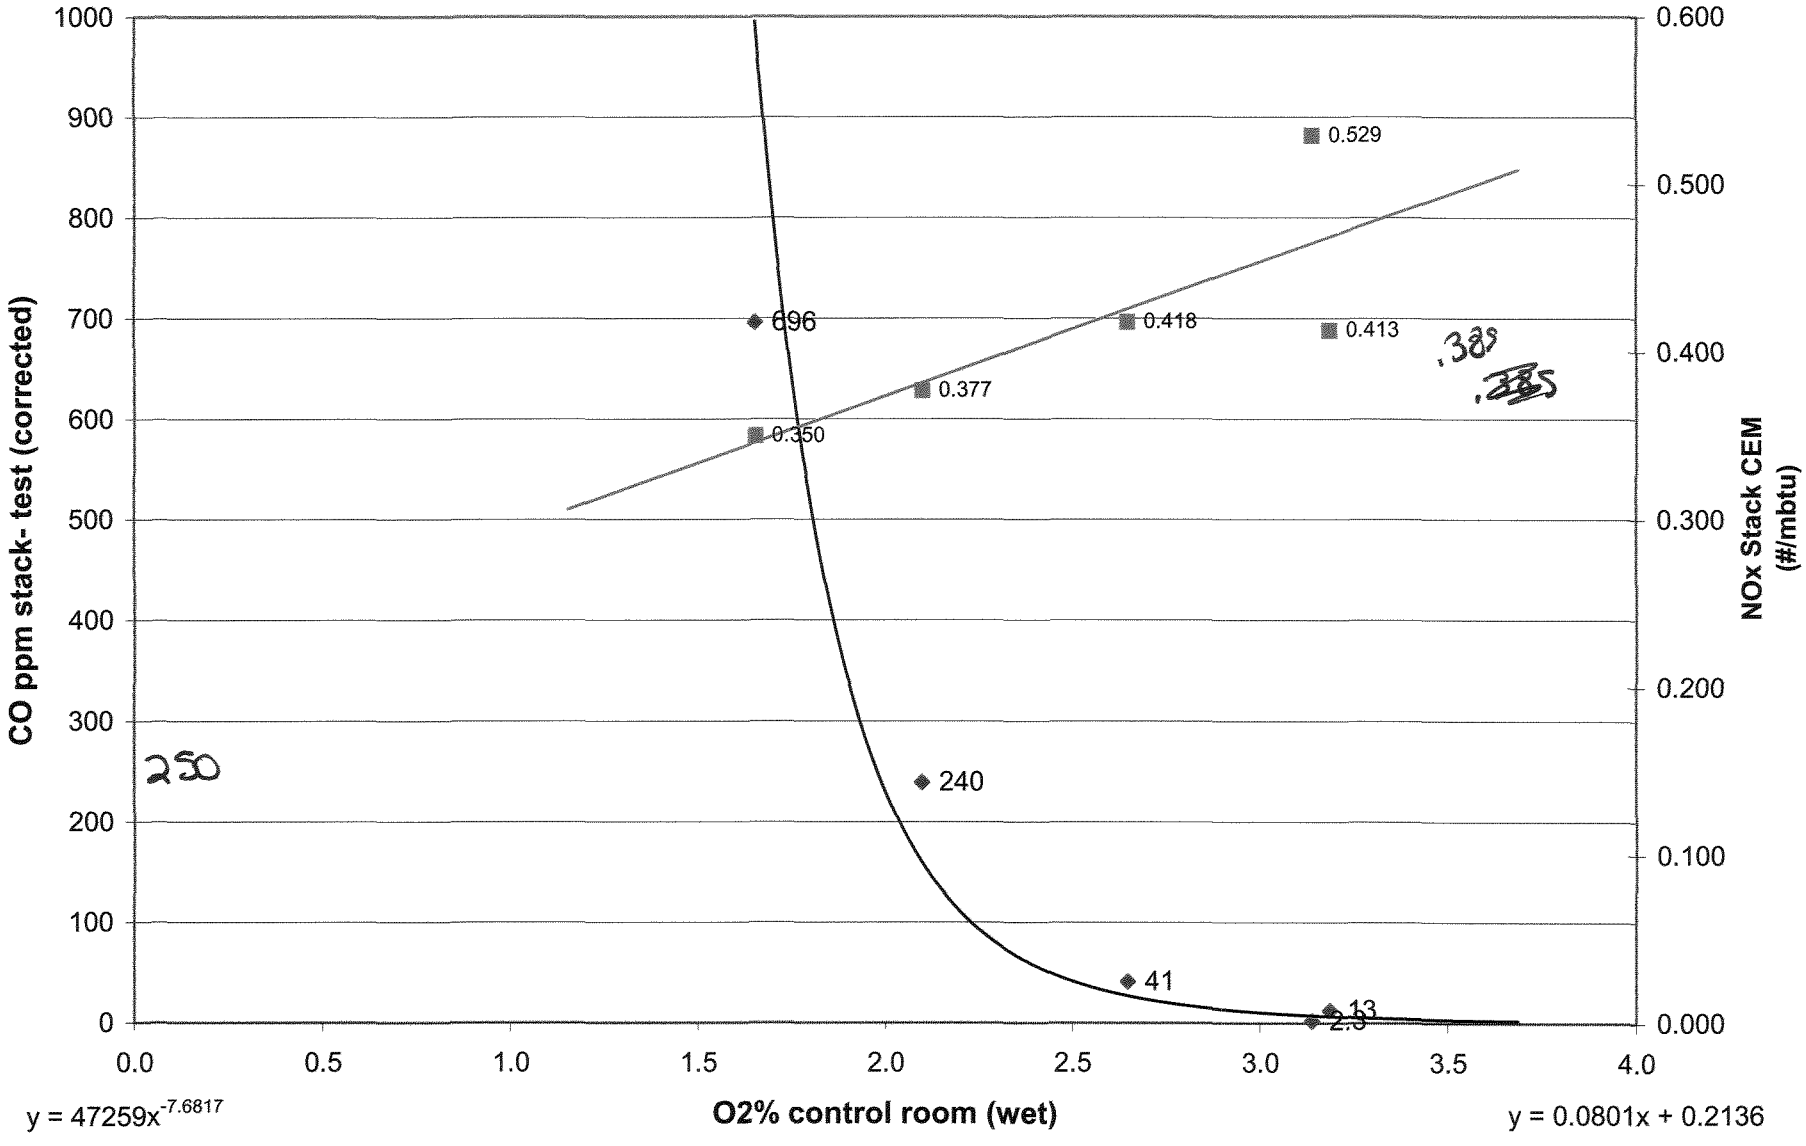

IP7_035447

1/3 dampers open

CORRELATION: Overfire Air (10%)
O2% control room vs CO Stack test & NOx Stack CEM

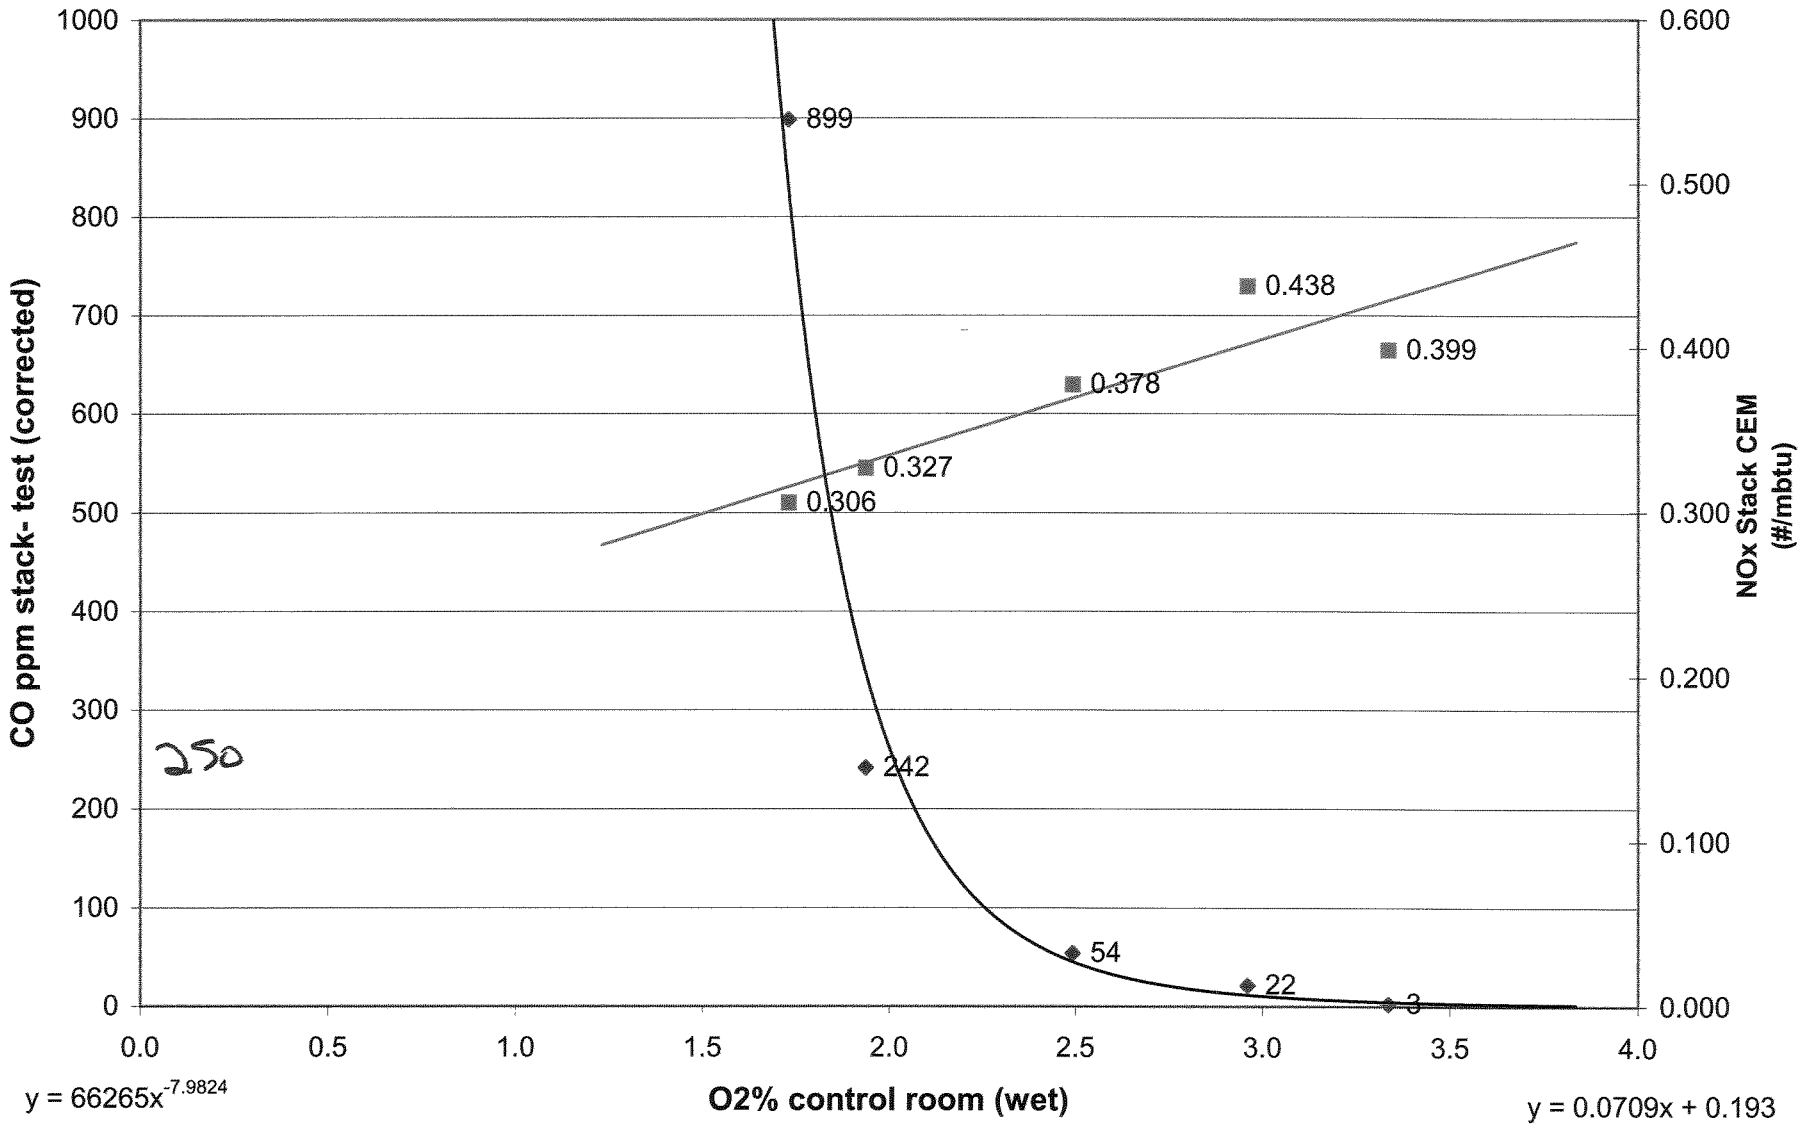

IP7_035448

2/3 dampers throttled

CORRELATION: Overfire Air (12%)
O2% control room vs CO Stack test & NOx Stack CEM

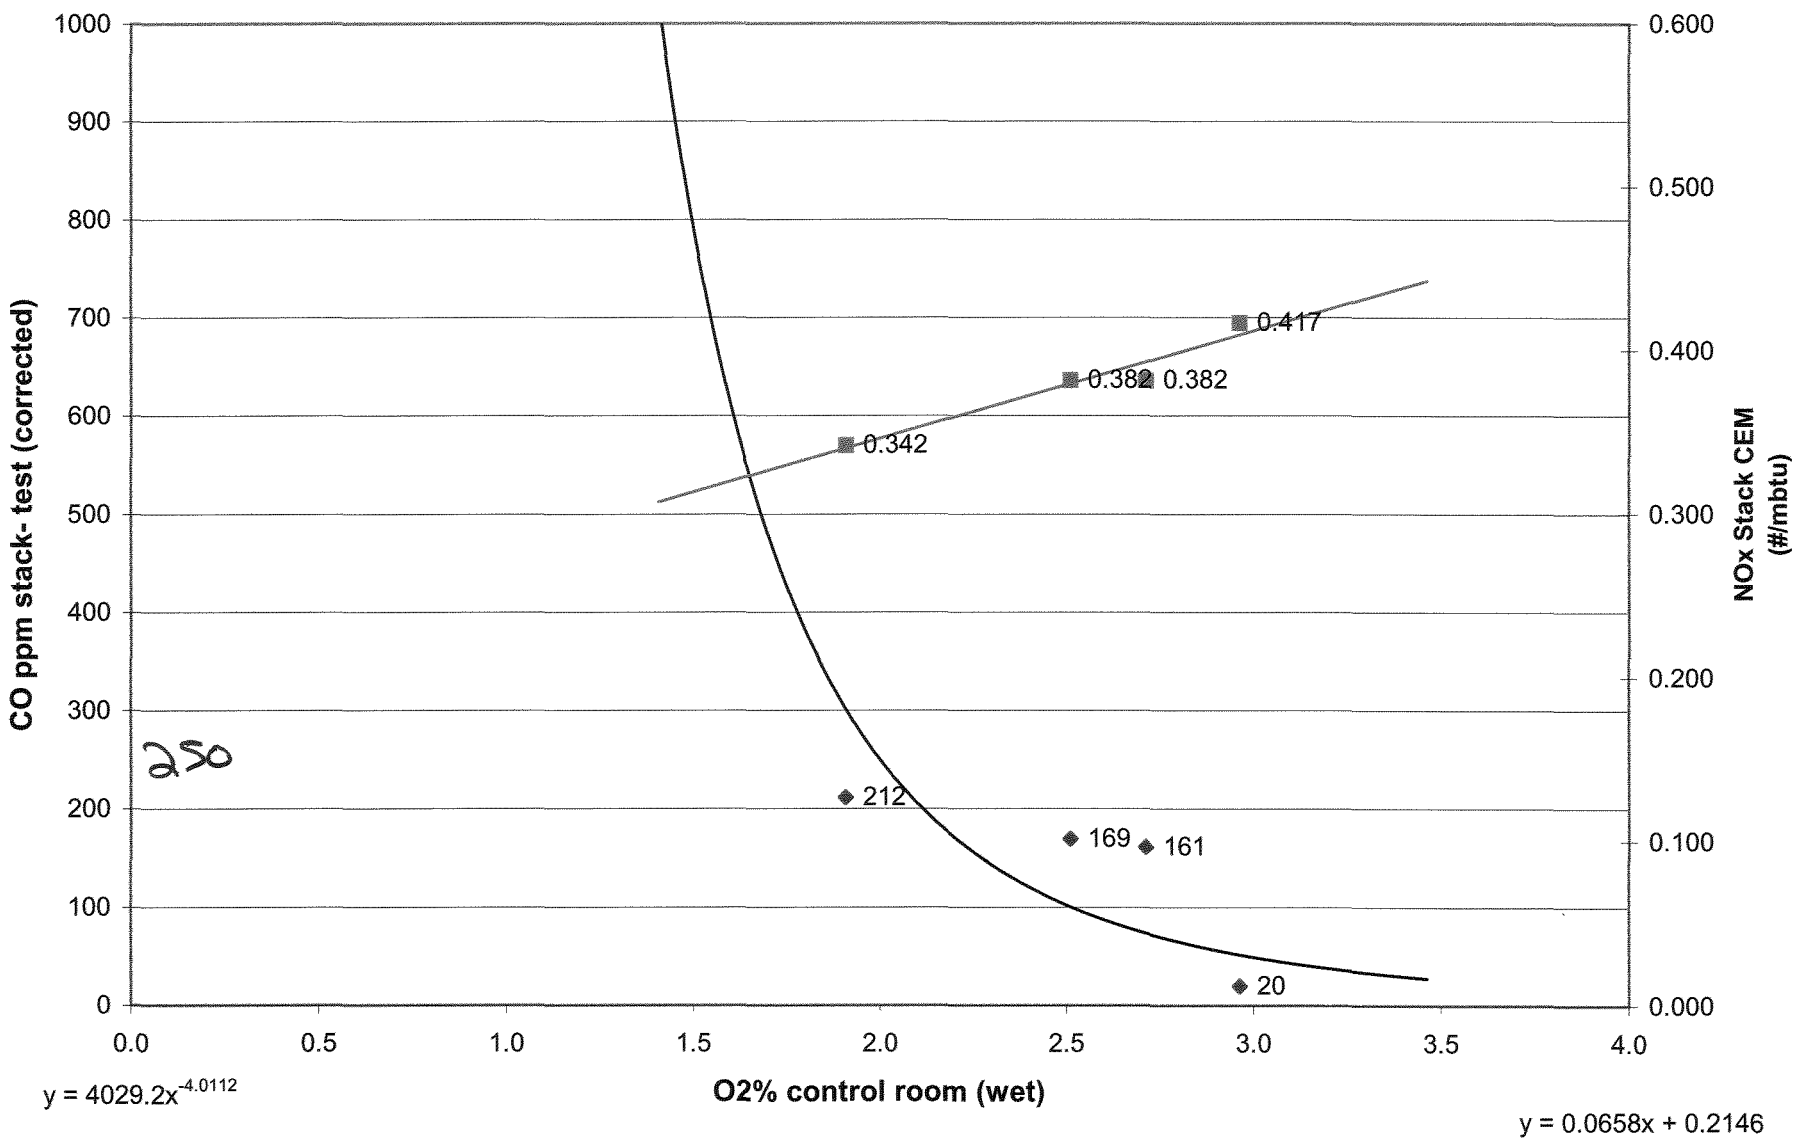

IP7_035449

2/3 dampers open

CORRELATION: Overfire Air (14%)
O2% control room vs CO Stack test & NOx Stack CEM

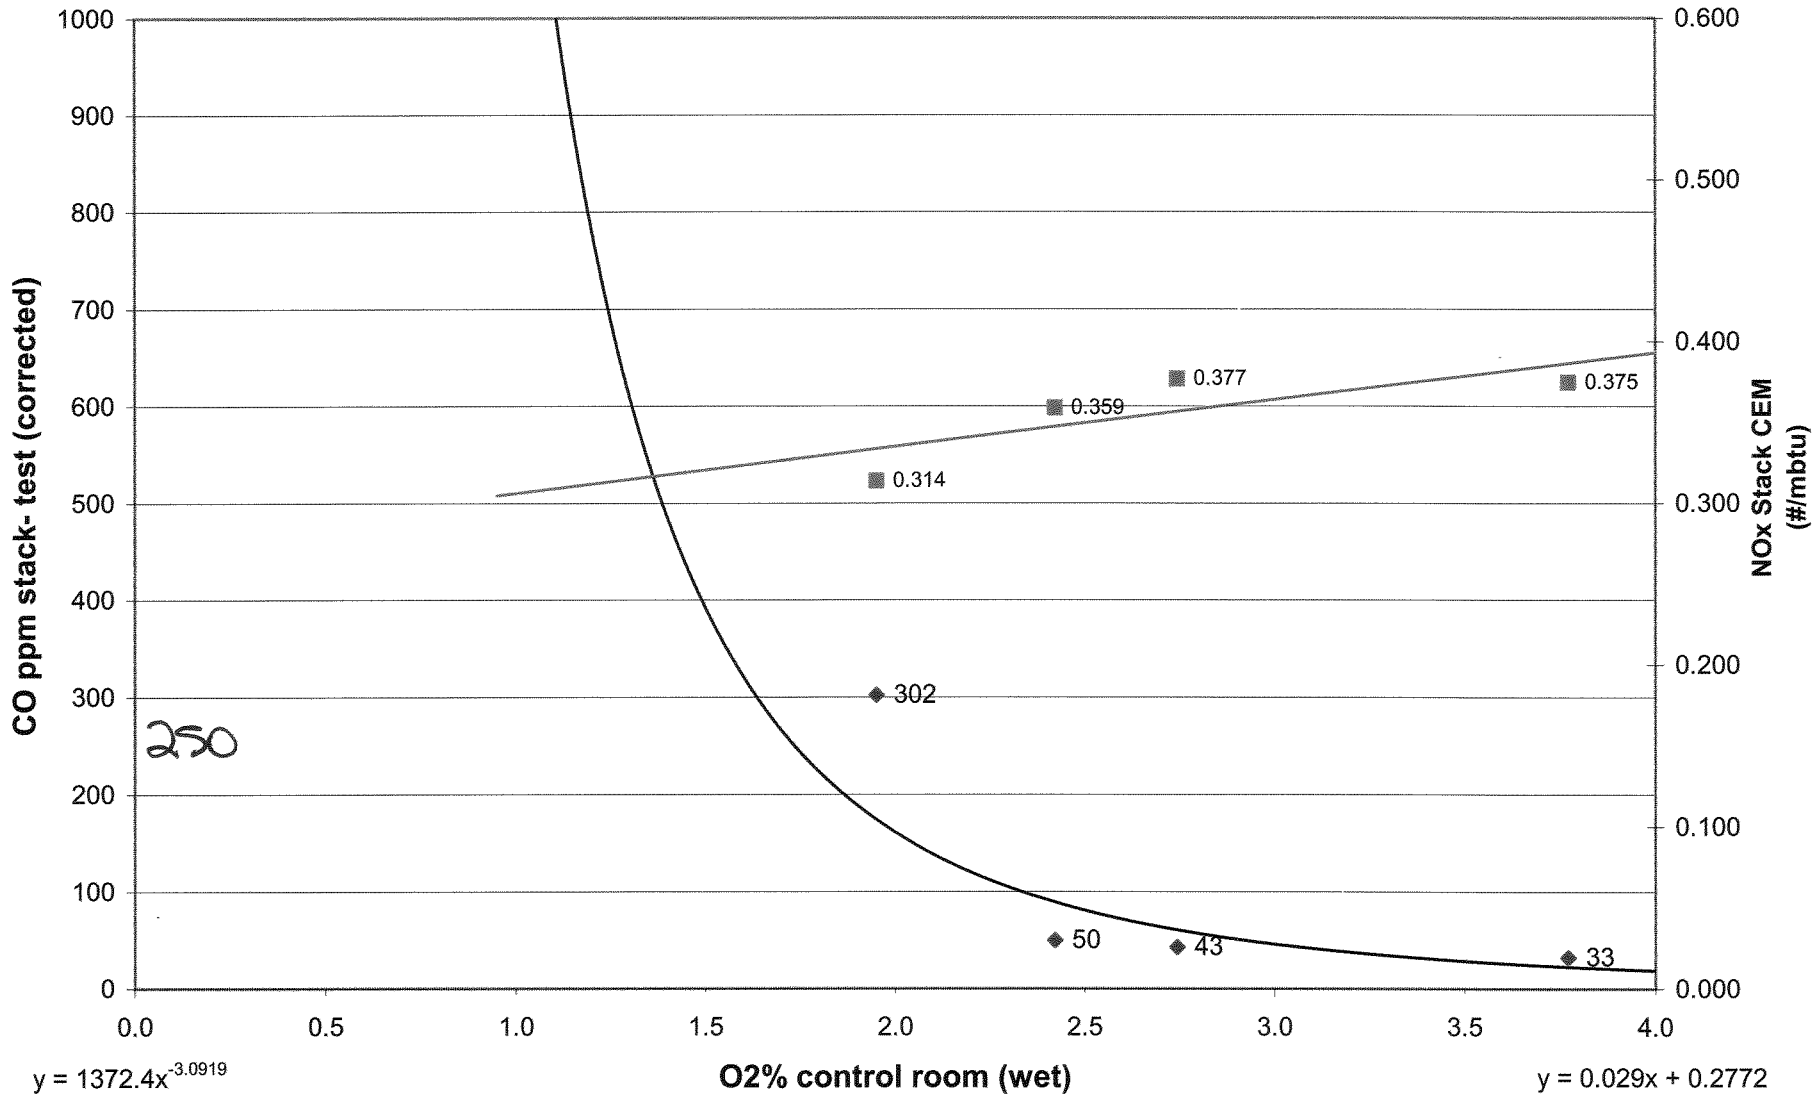

IP7_035450