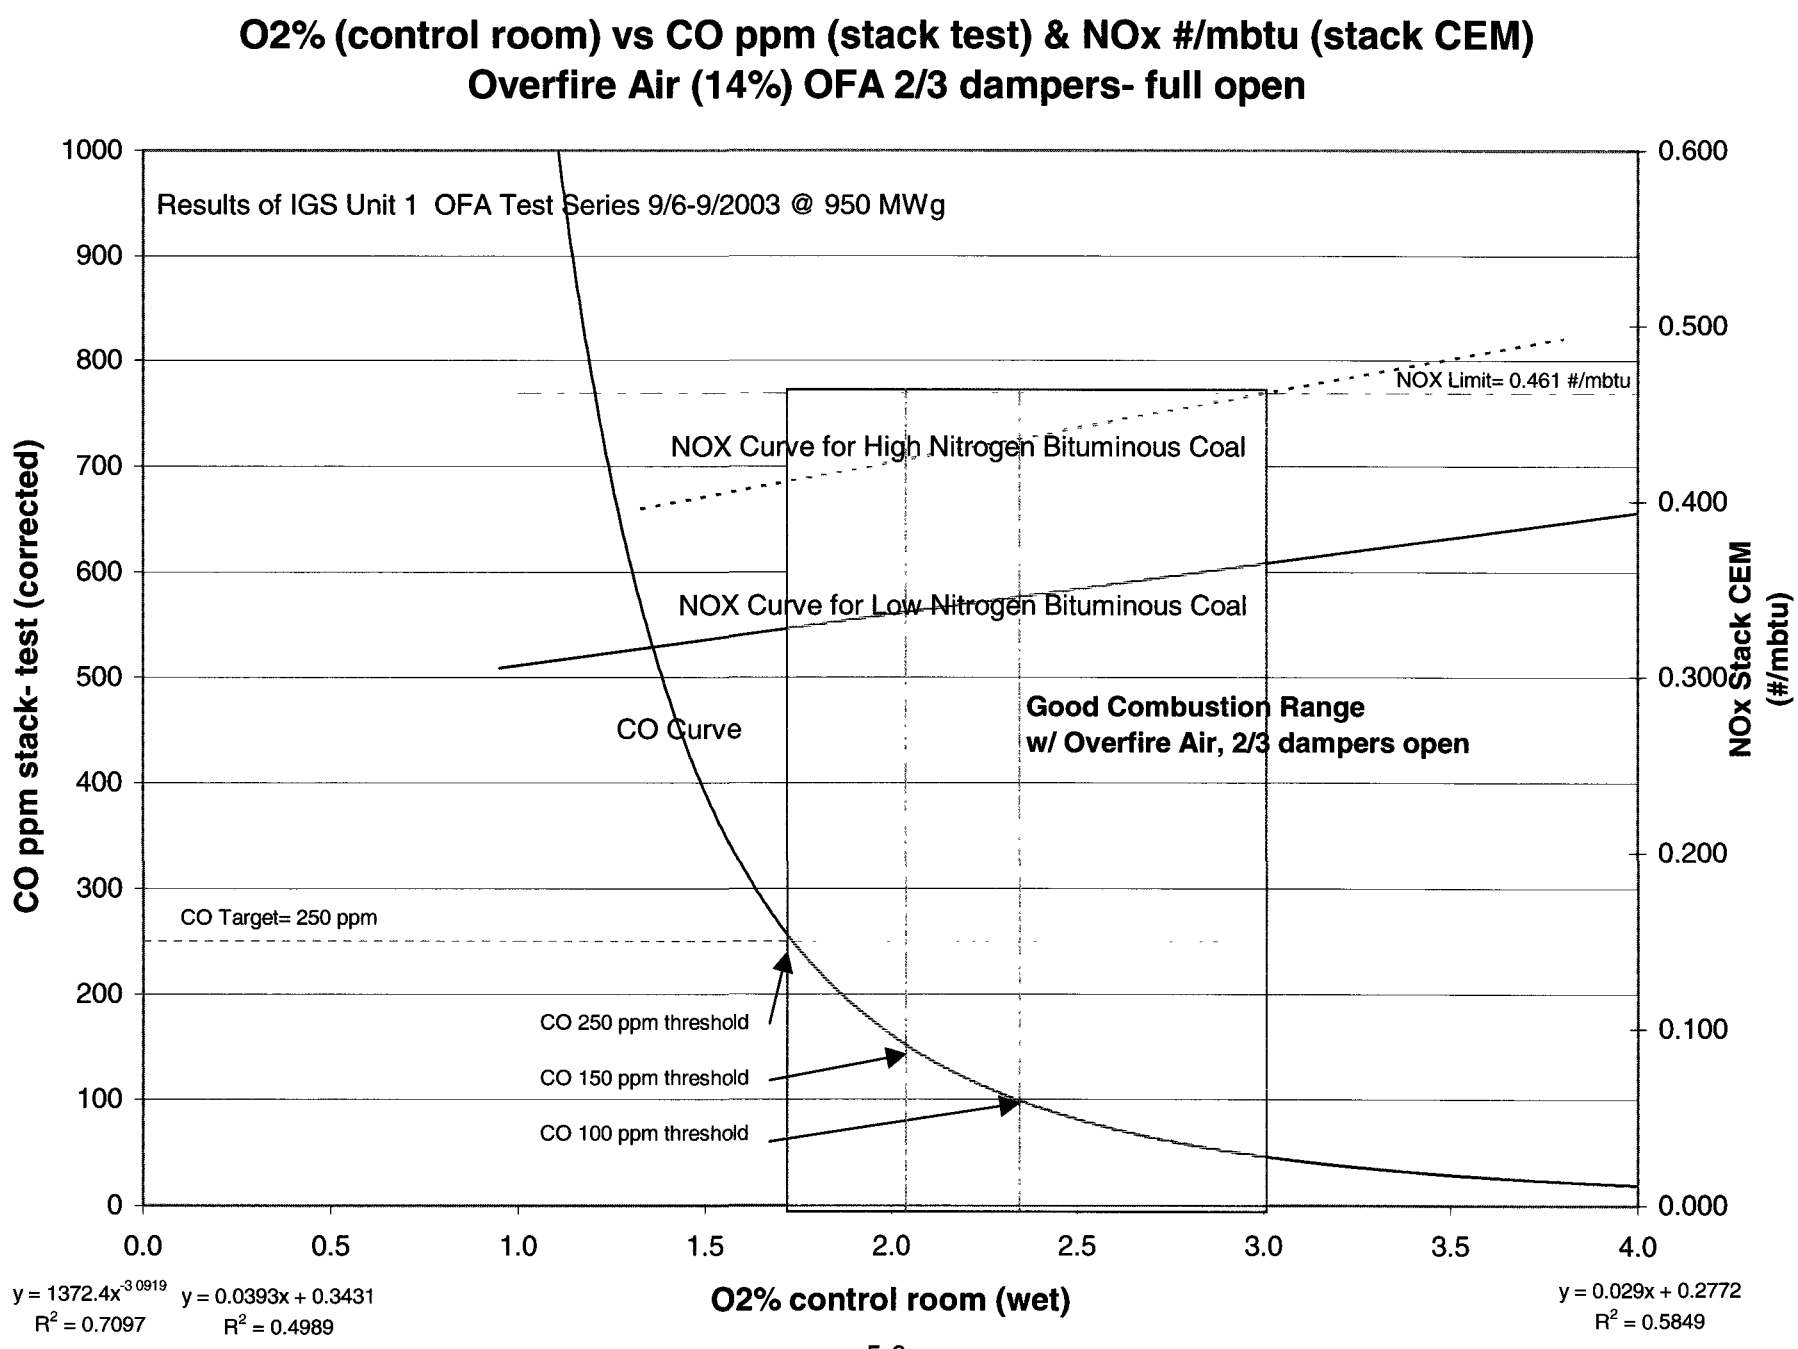

Figure 5-4

IP7_035531

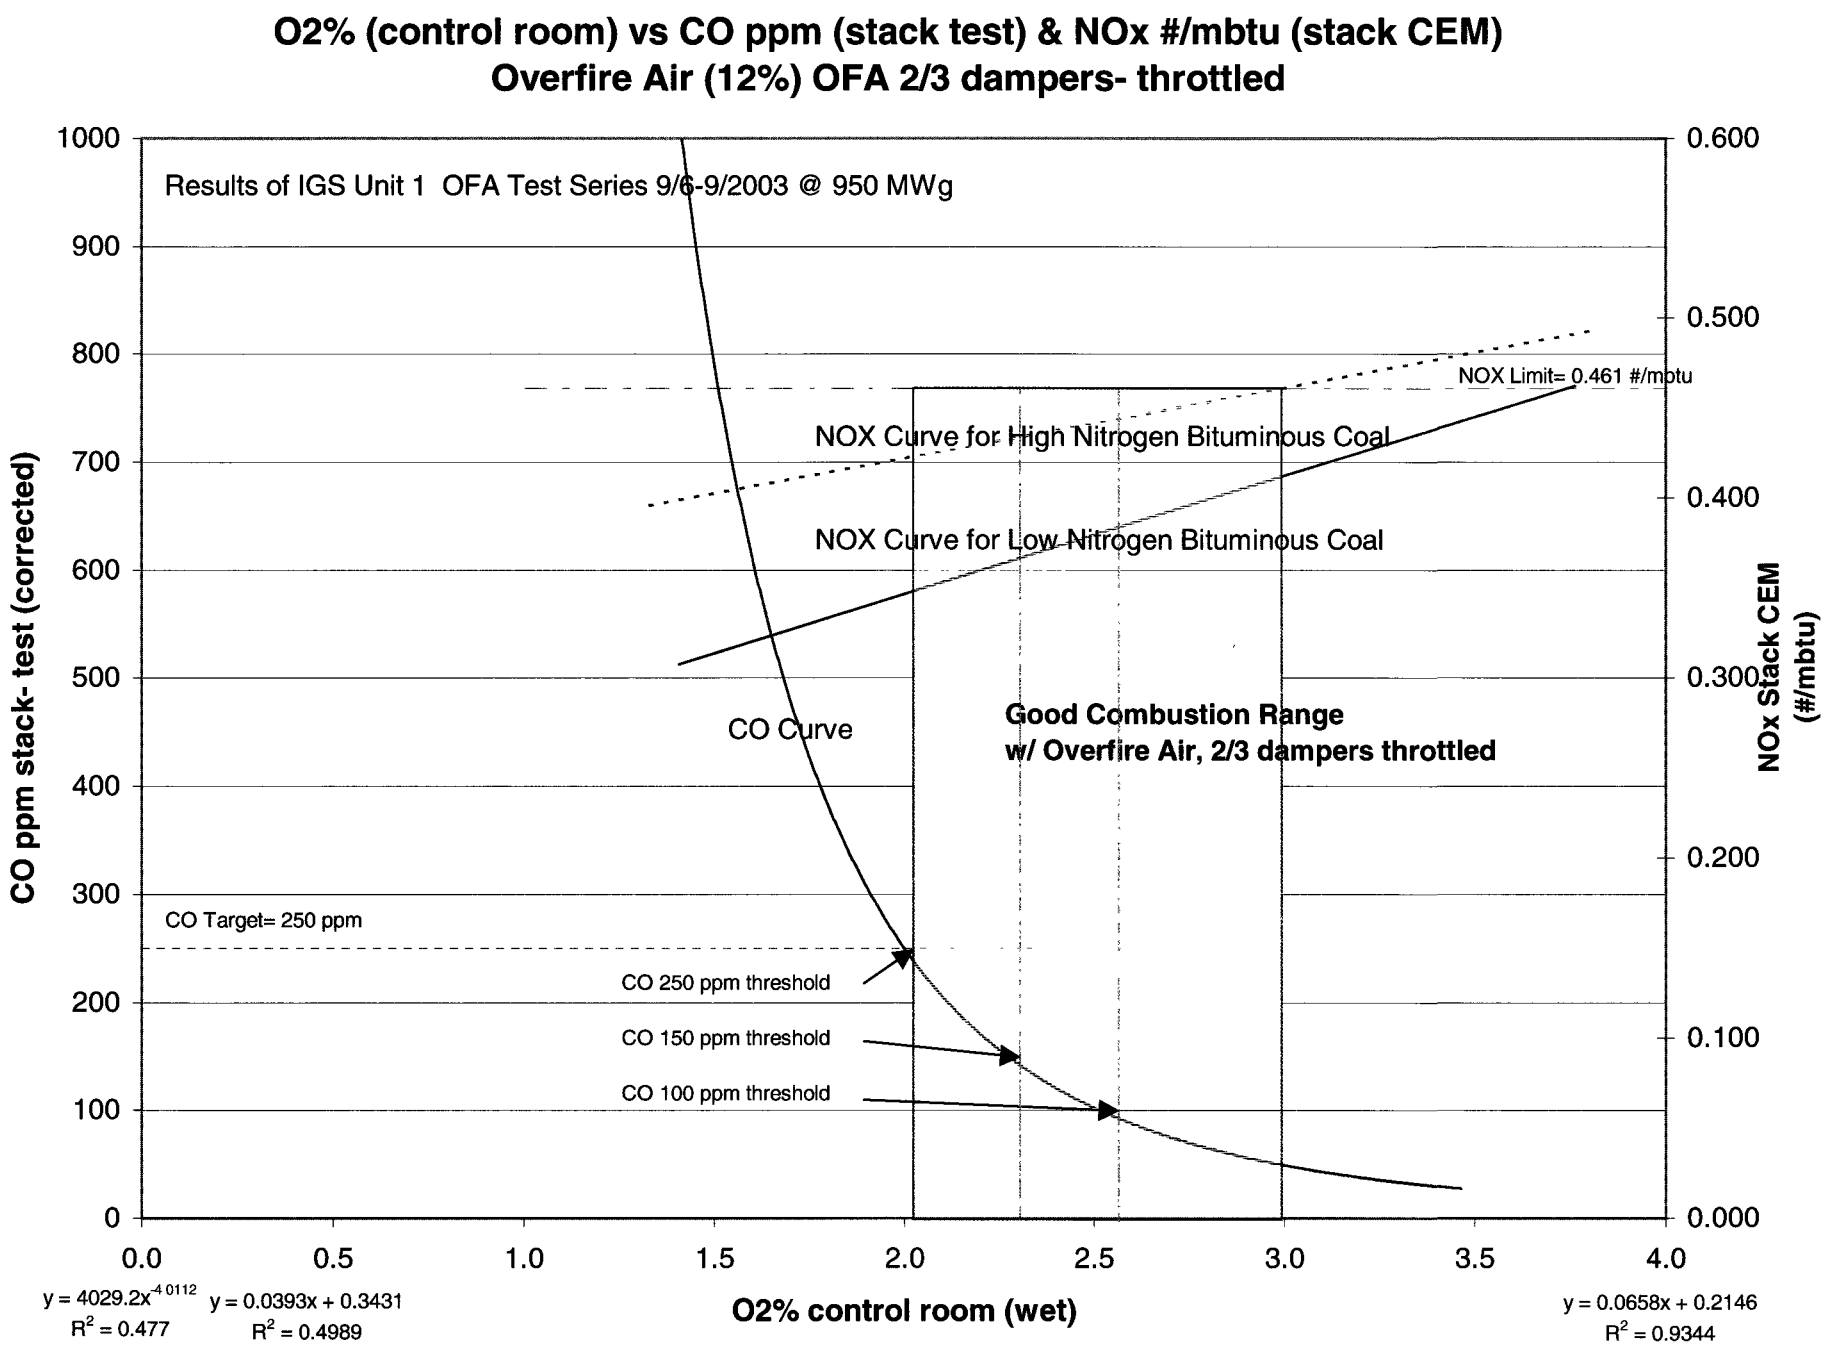

Figure 5-3

IP7_035532

O2% (control room) vs CO ppm (stack test) & NOx #/mbtu (stack CEM)
Overfire Air (10%) OFA 1/3 dampers- full open

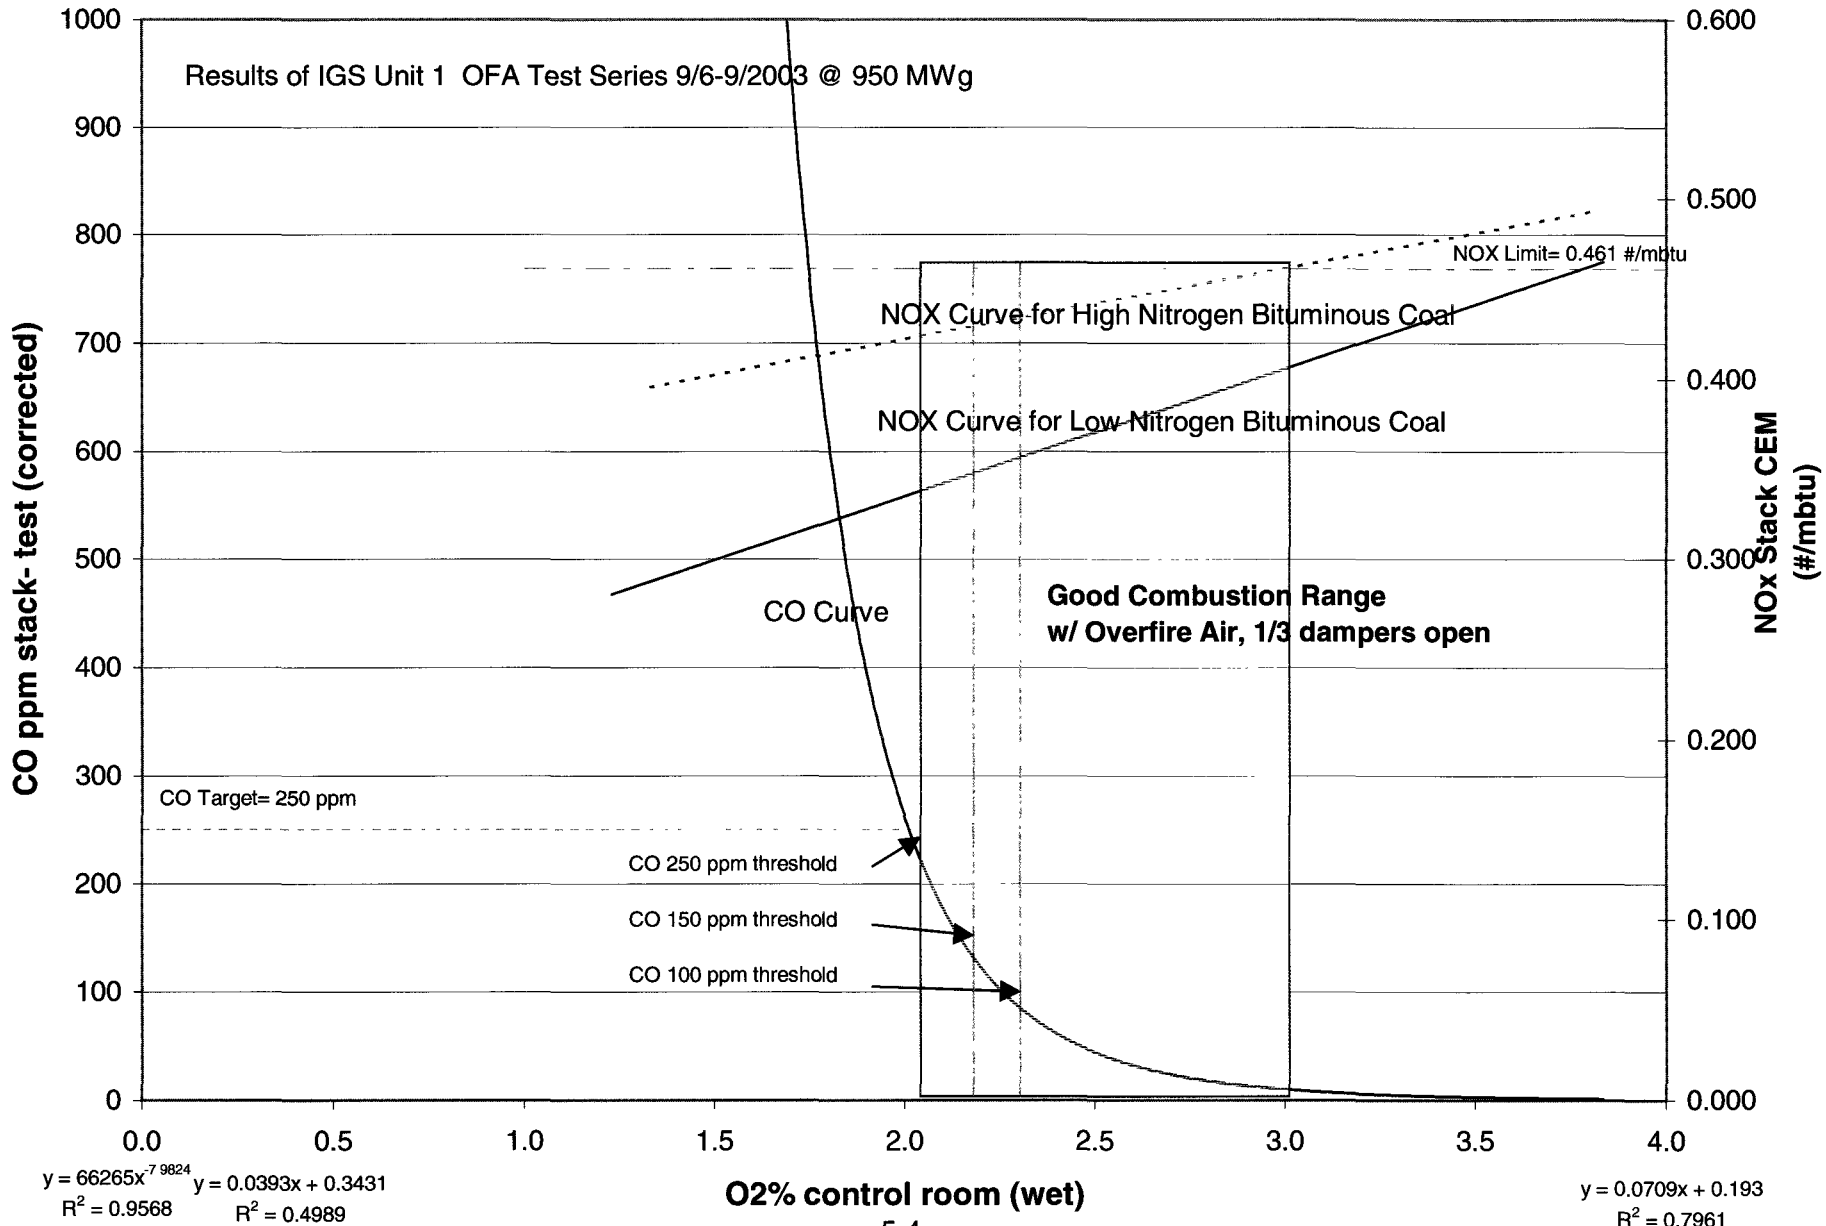

Figure 5-2

IP7_035533

O2% (control room) vs CO ppm (stack test) & NOx #/mbtu (stack CEM)
NO Overfire Air (5% cooling) OFA 1/3, 2/3, & inlet dampers closed

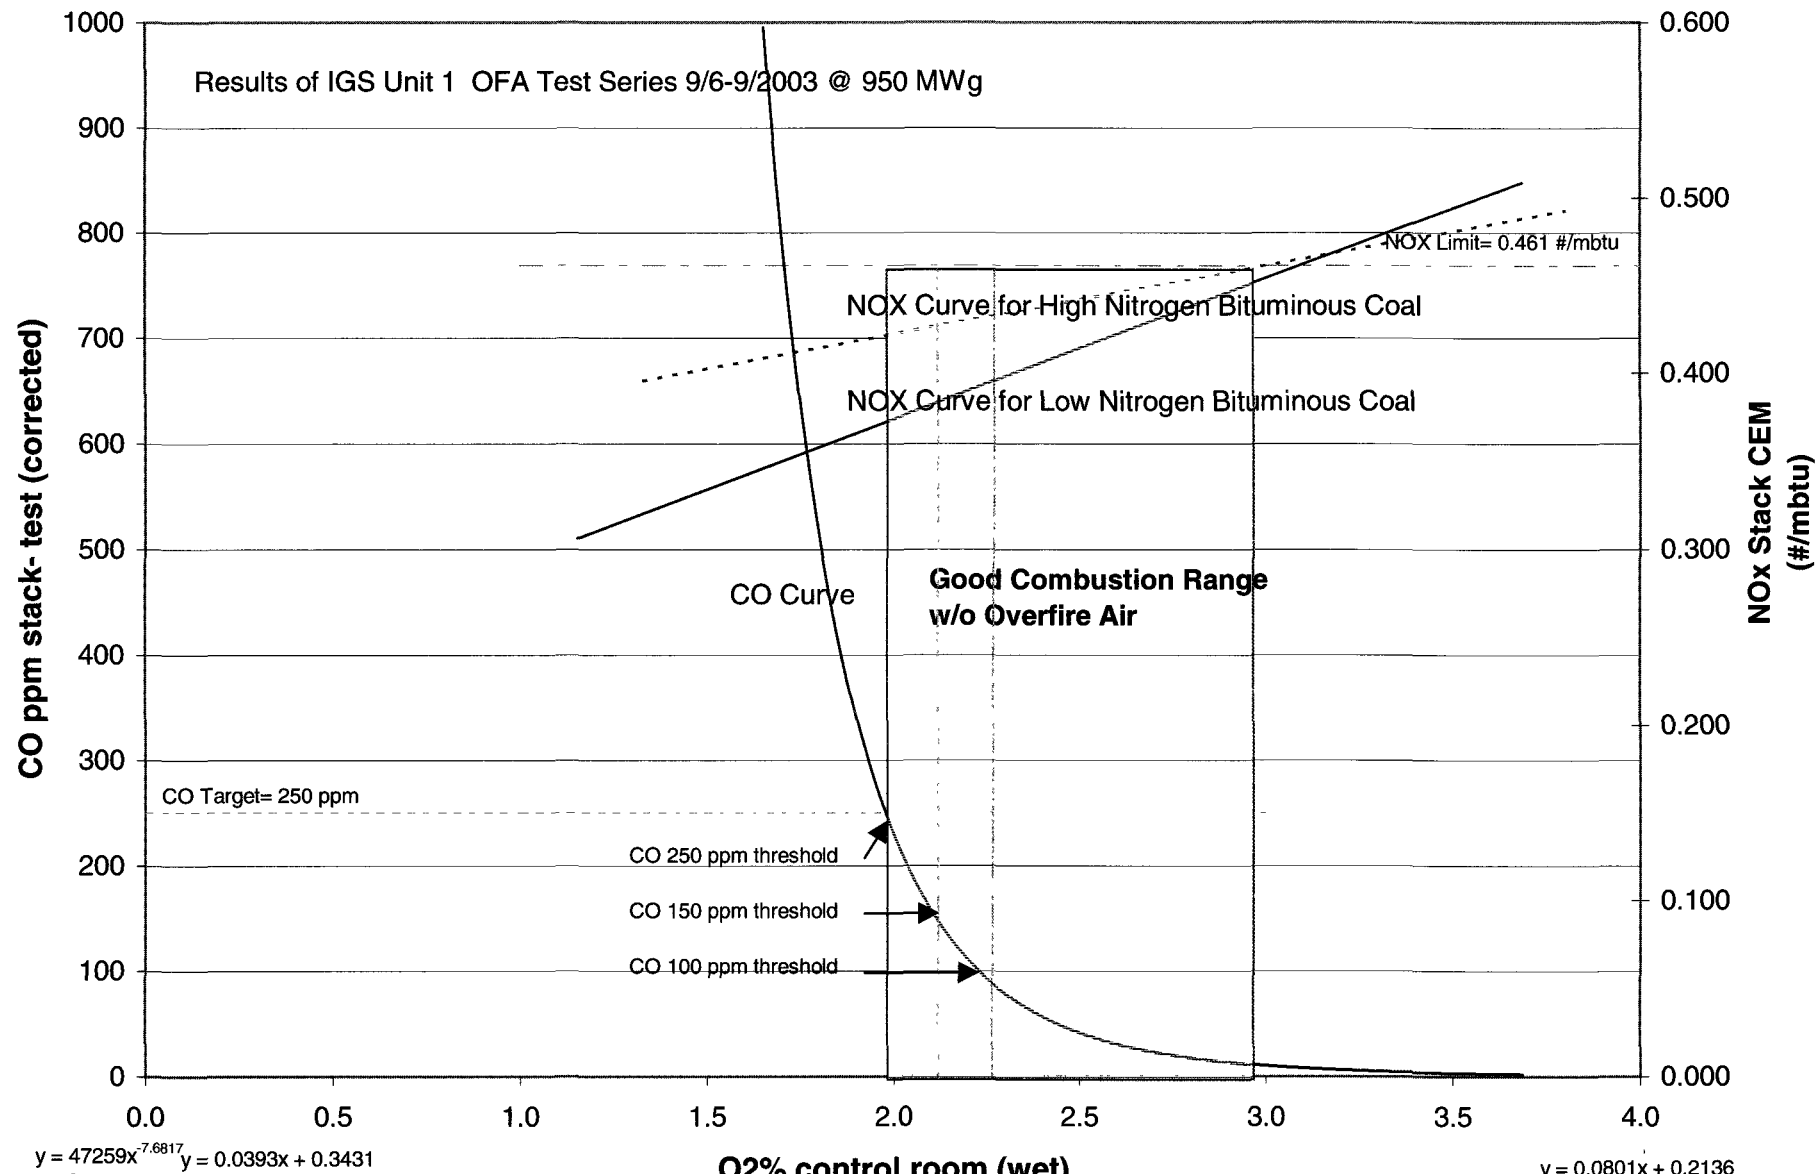

Figure 5-1

IP7_035534