BUILDING LEGEND

1	MAIN GUARD HOUSE	21	WATER TREATMENT	42	PELLET LOADING (Inoperative)
2	CALENDER WAREHOUSE	22	PUMP HOUSE, FIRE PROTECTION	43	ISOBUTANE STORAGE TANK
3	TRANSFER HOUSE - WEST	23	ELECTRICAL SUB-STATION	44	RUBBER SHREDDER BUILDING (Converted to a Utility Shed in 1991)
4	CALENDER BUILDING	24	BOILER HOUSE		
4A	CALENDER LINE 4	25	GAS REDUCING STATION		
5	TRANSFER HOUSE - EAST	26	FUEL OIL STORAGE		
6	TRACK SCALE	27	FUEL OIL PUMP HOUSE		
7		28	DEEP WATER WELLS		
8	V.C. STORAGE (SPHERE) (Inoperative)	29	SEWAGE TREATMENT		
9	V.C. RECOVERY (DAY TANKS) (Inoperative)	30	FABRICS BUILDING		
10	R.R. LOADING HOUSE	31	ADMINISTRATION BUILDING		
11	BLOWER HOUSE (SILOS)	31A	ADDITION TO ADMIN. BLDG.		
12	SWITCH HOUSE	32	GAS HOUSE		
13	BLOWER HOUSE (SILOS)	33	T & D WAREHOUSE		
14	COMP. BLDG. (MONOMER UNLOAD) (Inop.)	34	BLOWER HOUSE (SILOS)		
15	CATALYST BUILDING (Inoperative)	35	PROCEDYNE HOUSE (Inoperative)		
16	FIRE PROTECTION HOUSE	36	BLOWER HOUSE (PROCEDYNE) (Inoperative)		
17	CHILLER HOUSE (Inoperative)	37	ELECTRICAL SUB STATION		
18	POLYMERIZATION PLANT (RESINS) (Inop.)	38			
19	COMPOUND PLANT	39	CONTRACTOR GATE		
19A	BLOWER HOUSE (COMPOUND)	40	INCINERATOR (EPA) (Inoperative)		
20	COOLING TOWERS	41	RECOVERY (EPA) (Inoperative)		

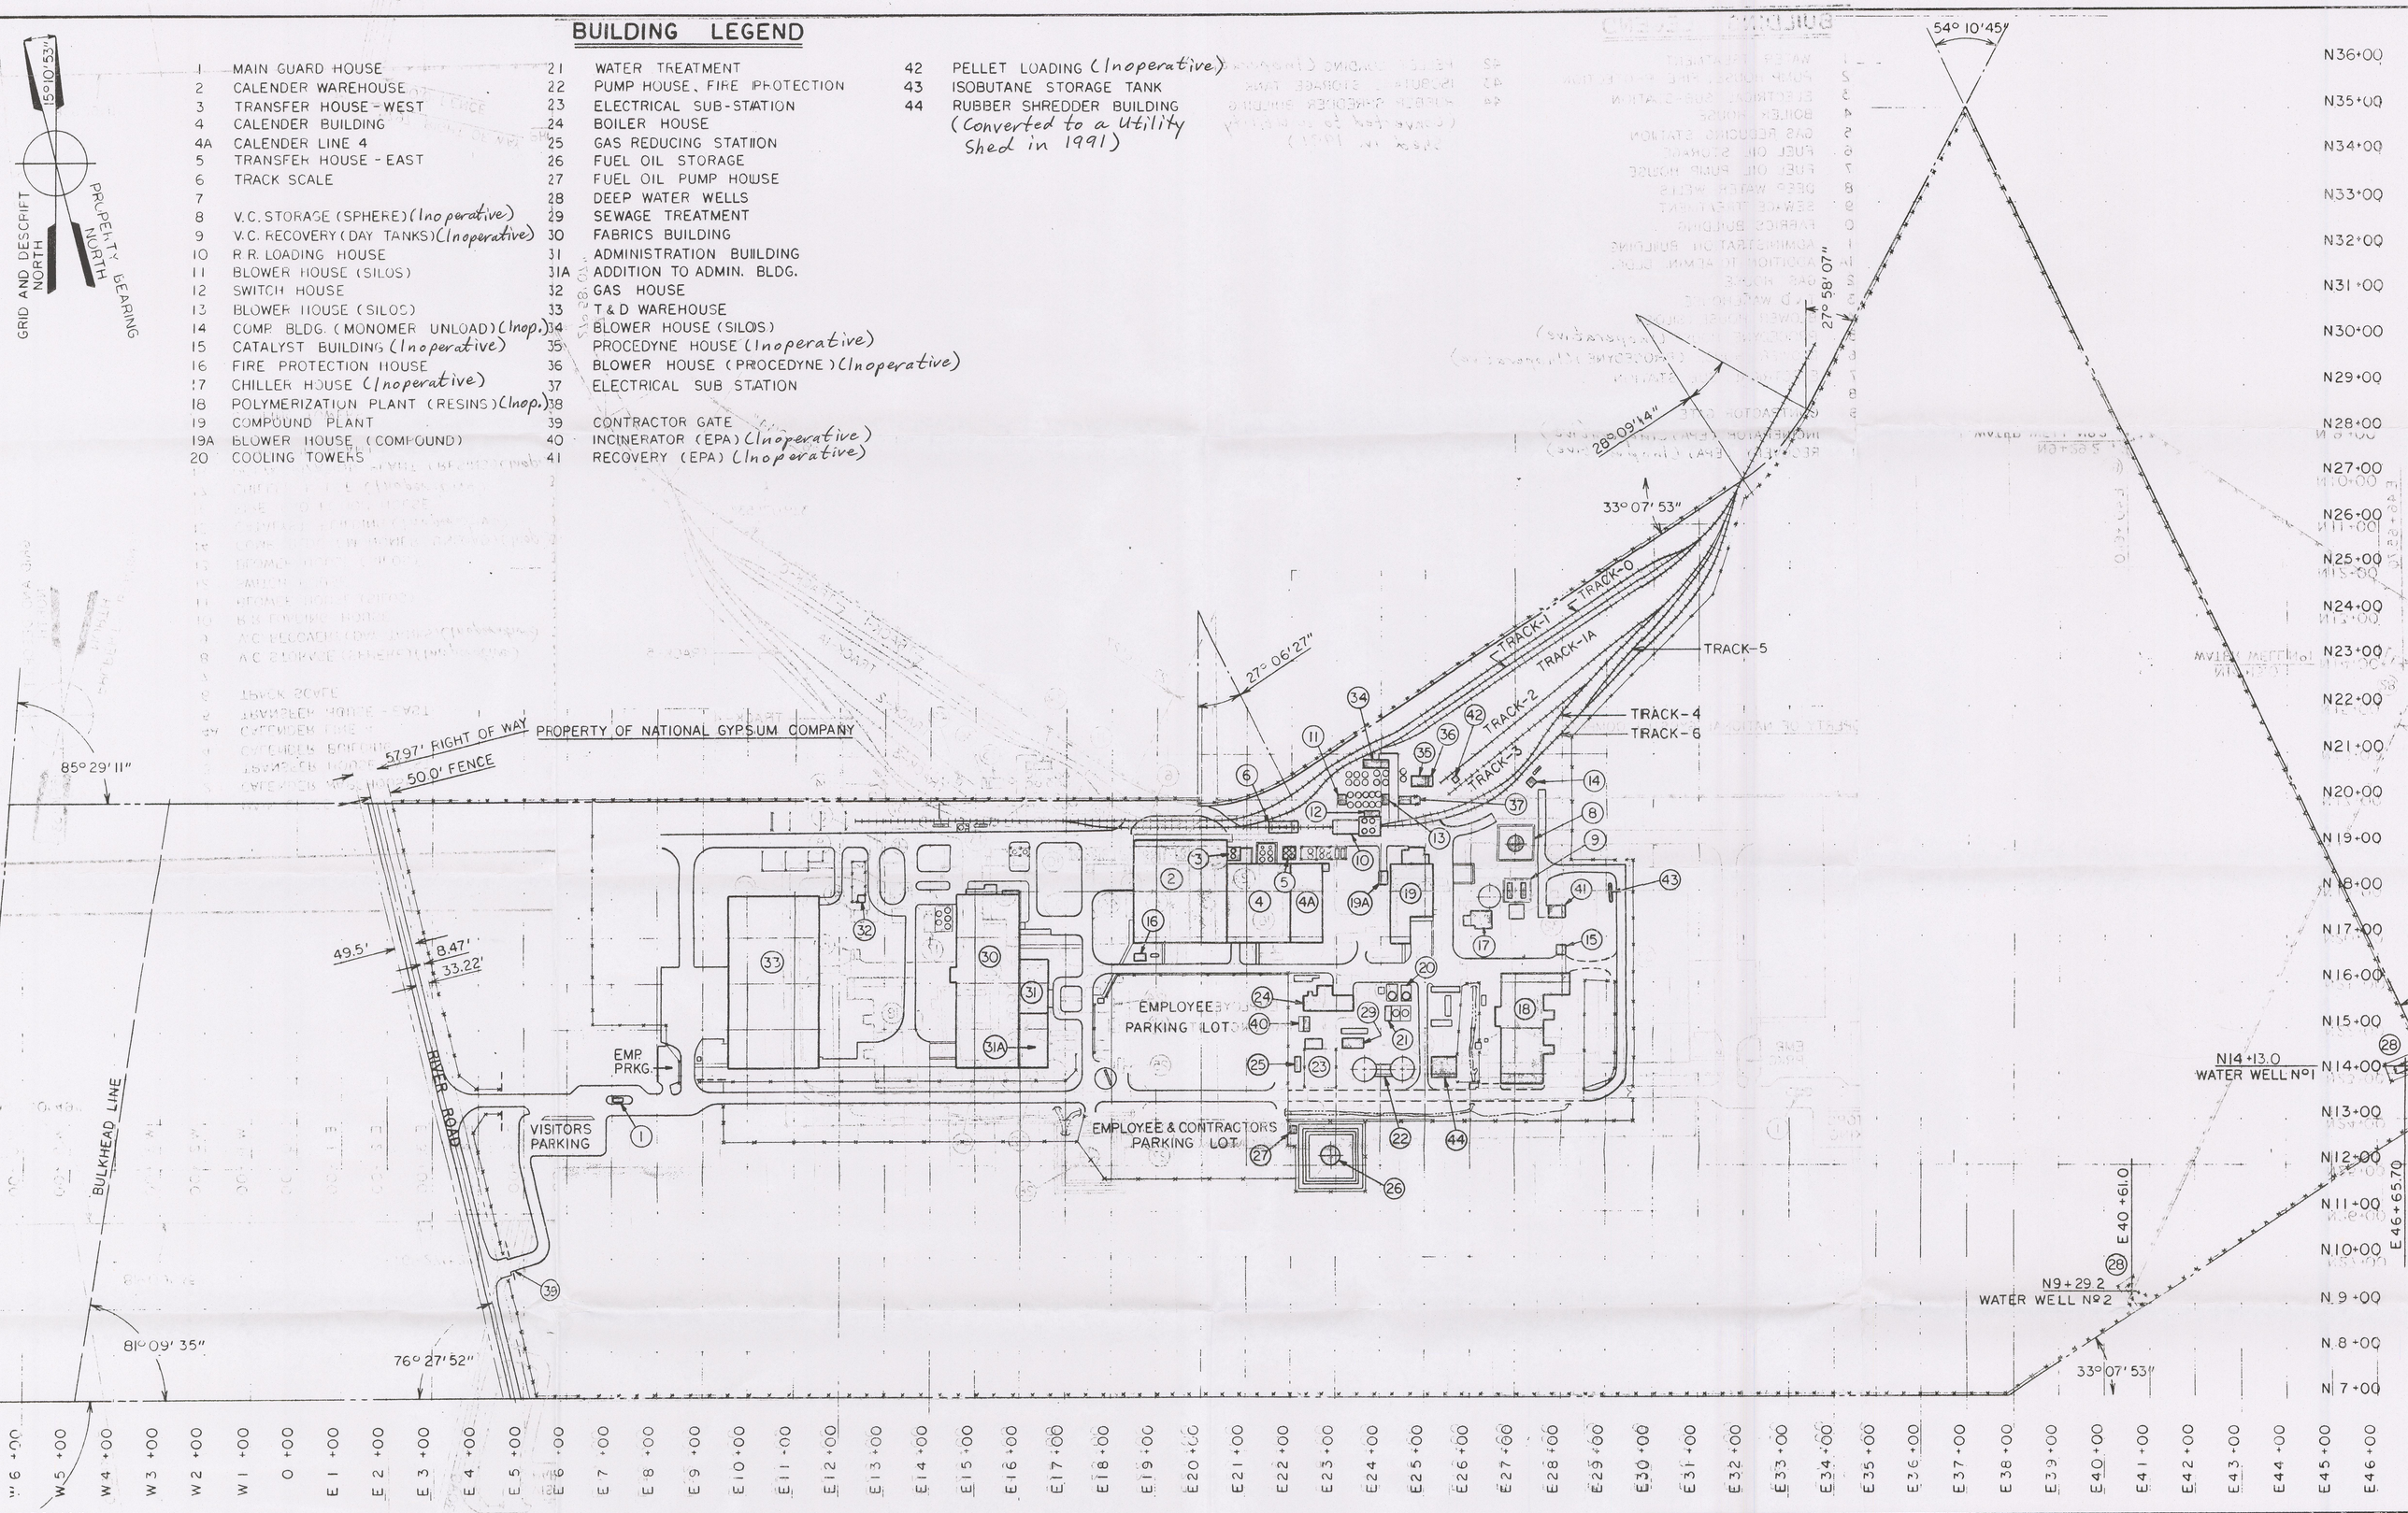

NOTE

18-08-01 THIS DWG. SUPERSEDES DWG. A98-410 DATED 10-30-81

THIS DRAWING INCLUDING THE INFORMATION, DATA AND DESIGN IS THE PROPERTY OF OCCIDENTAL CHEMICAL CORPORATION IT IS NOT TO BE COPIED, REPRODUCED, OR ITS CONTENTS DIVULGED WITHOUT THE WRITTEN PERMISSION OF OCCIDENTAL

NO	REVISIONS	APP	DATE

DRAWN BY M. BELLEVIEVE DATE 8-9-88
CHECKED BY Pw Cons 8-10-88
APPROVED —
SCALE 1/8" = 20'-0 —

OXY OCCIDENTAL CHEMICAL
BURLINGTON, NJ
PLANT LOCATION: - NORTH

BLDG. NO.

DWG A98-410

MASTER SITE PLAN