SFUND RECORDS CTR
2385808

LEGEND

- PCB TRANSFORMER LOCATIONS WHICH HAVE BEEN CHANGED TO DRY TYPE.
- EXISTING PCB TRANSFORMER LOCATIONS. (REPLACEMENT FUNDING REQUESTED FROM USAF).
- OIL FILLED TRANSFORMERS
- P.C.B. TRANSFORMERS. (REPLACEMENT FUNDING RECIEVED FROM USAF. CONTRACT AWARDED.)

11 LOCATIONS
11 TEAN 2 AREAS




# AIR FORCE PLANT 19 12 KV & 4800 VOLT DISTRIBUTION AND SUBSTATION SYSTEMS

## SYMBOLS

- D — OIL FUSE CUTOUT
- — OIL SWITCH
- — DISC SWITCH
- PB — PULL BOX

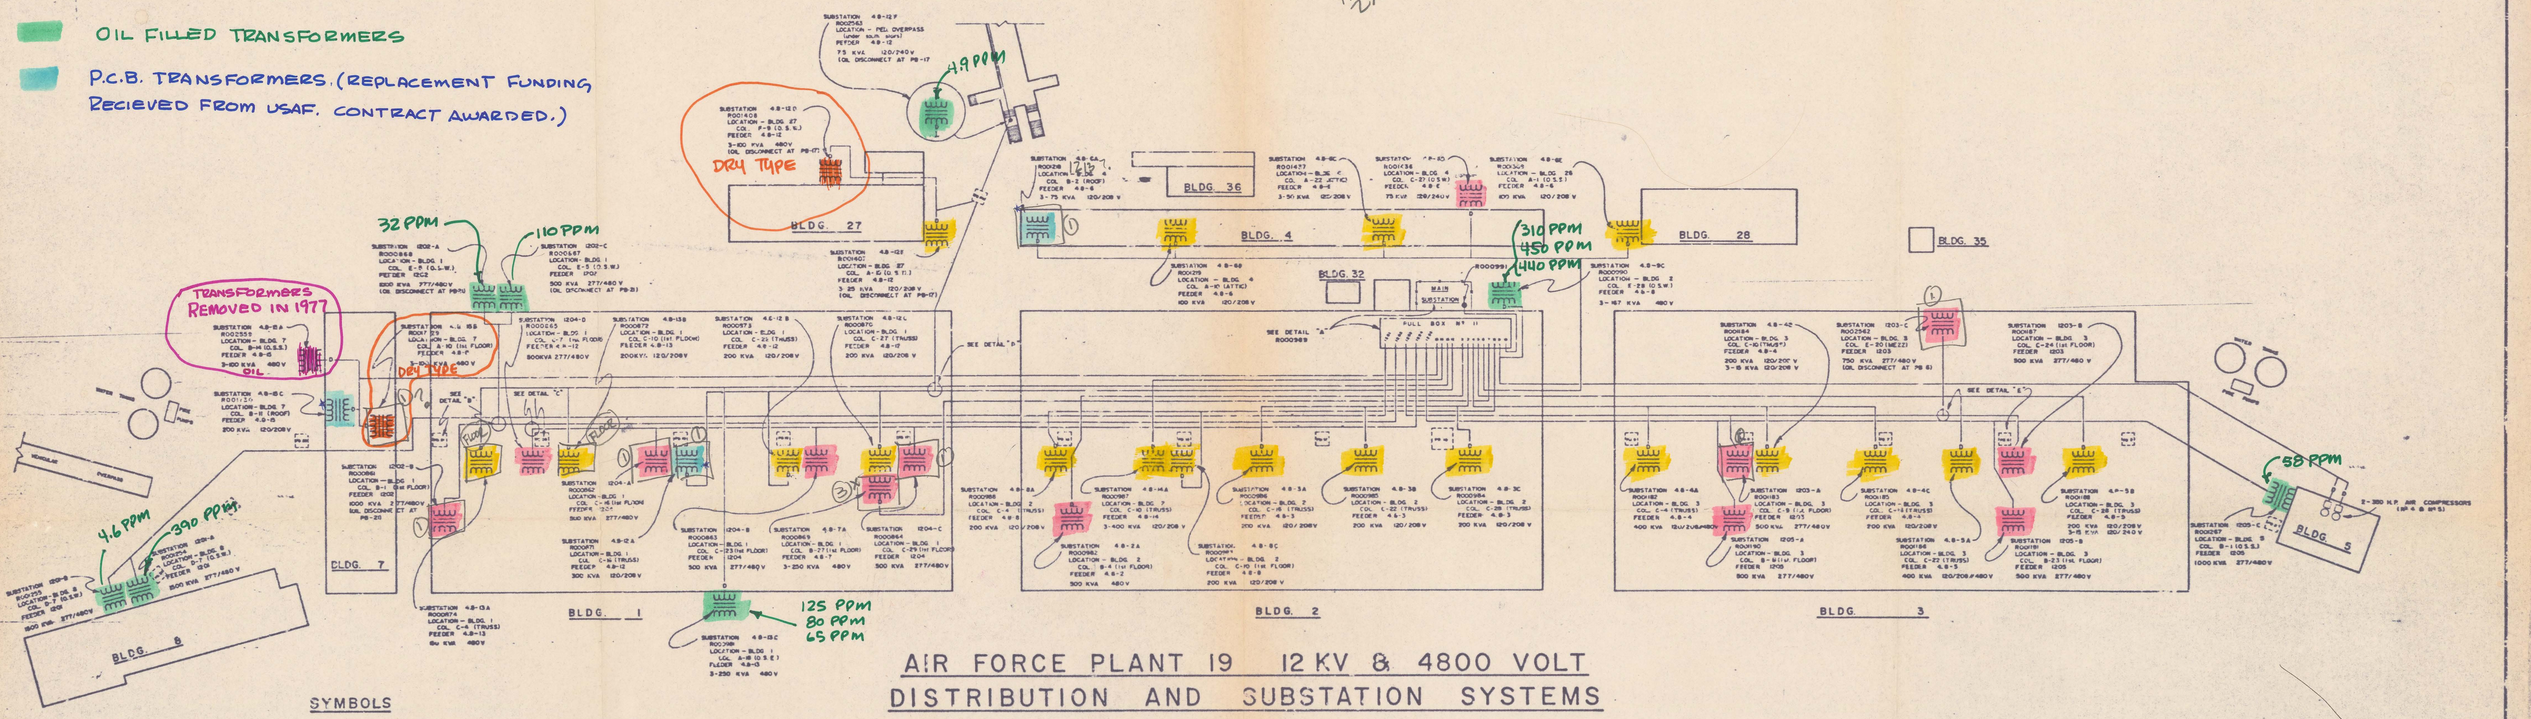


PULL BOX Nº 21
DETAIL "B"




PULL BOX Nº 20
DETAIL "C"




PULL BOX Nº 17
DETAIL "D"




MAIN SUBSTATION & SWITCHBOARD
(WEST SIDE BLDG. 2)
DETAIL "A"




PULL BOX Nº 6
DETAIL "E"

| SYM | REVISIONS | DATE | APPROVALS | | | PREPARED BY R. Eastin & W. Jones | SIZE |
|---|---|---|---|---|---|---|---|
| A | Update RPIE identification Nos. Correct KVA | | SIGNATURE | DEPT | DATE | CHECKED BY | |
| | Retange & Delete BSROOD888 Bldg. Cal 8-7 | 5-22-72 | CRC | | | ENGINEER | |
| | | | | | | SUPERVISOR | |
| | | | | | | AUTHORIZATION | |

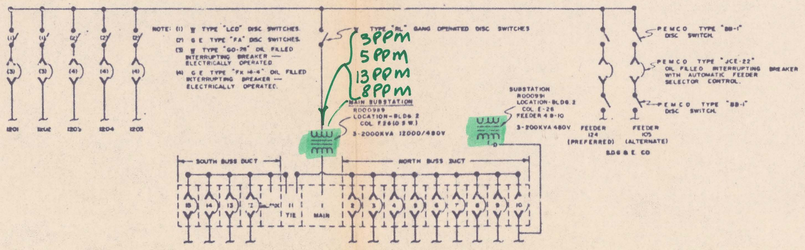GENERAL DYNAMICS
Convair Division
PLANT ENGINEERING

TITLE AIR FORCE PLANT 19 12 KV & 4800 VOLT DISTRIBUTION AND SUBSTATION SYSTEMS

| SCALE | PLT | BLDG | PLR | AREA | TYPE | NUMBER | SHEET | REV |
|---|---|---|---|---|---|---|---|---|
| NONE | 19 | | | | | 5-25027 | 1 of 2 | A |

ATTACHMENT 2
T(86)E017