SFUND RECORDS CTR
2385809

INDICATES OIL FUSED SWITCHS (AMMOUNT OF PCB CONCENTRATION)

SWITCHES TO BE REPLACED

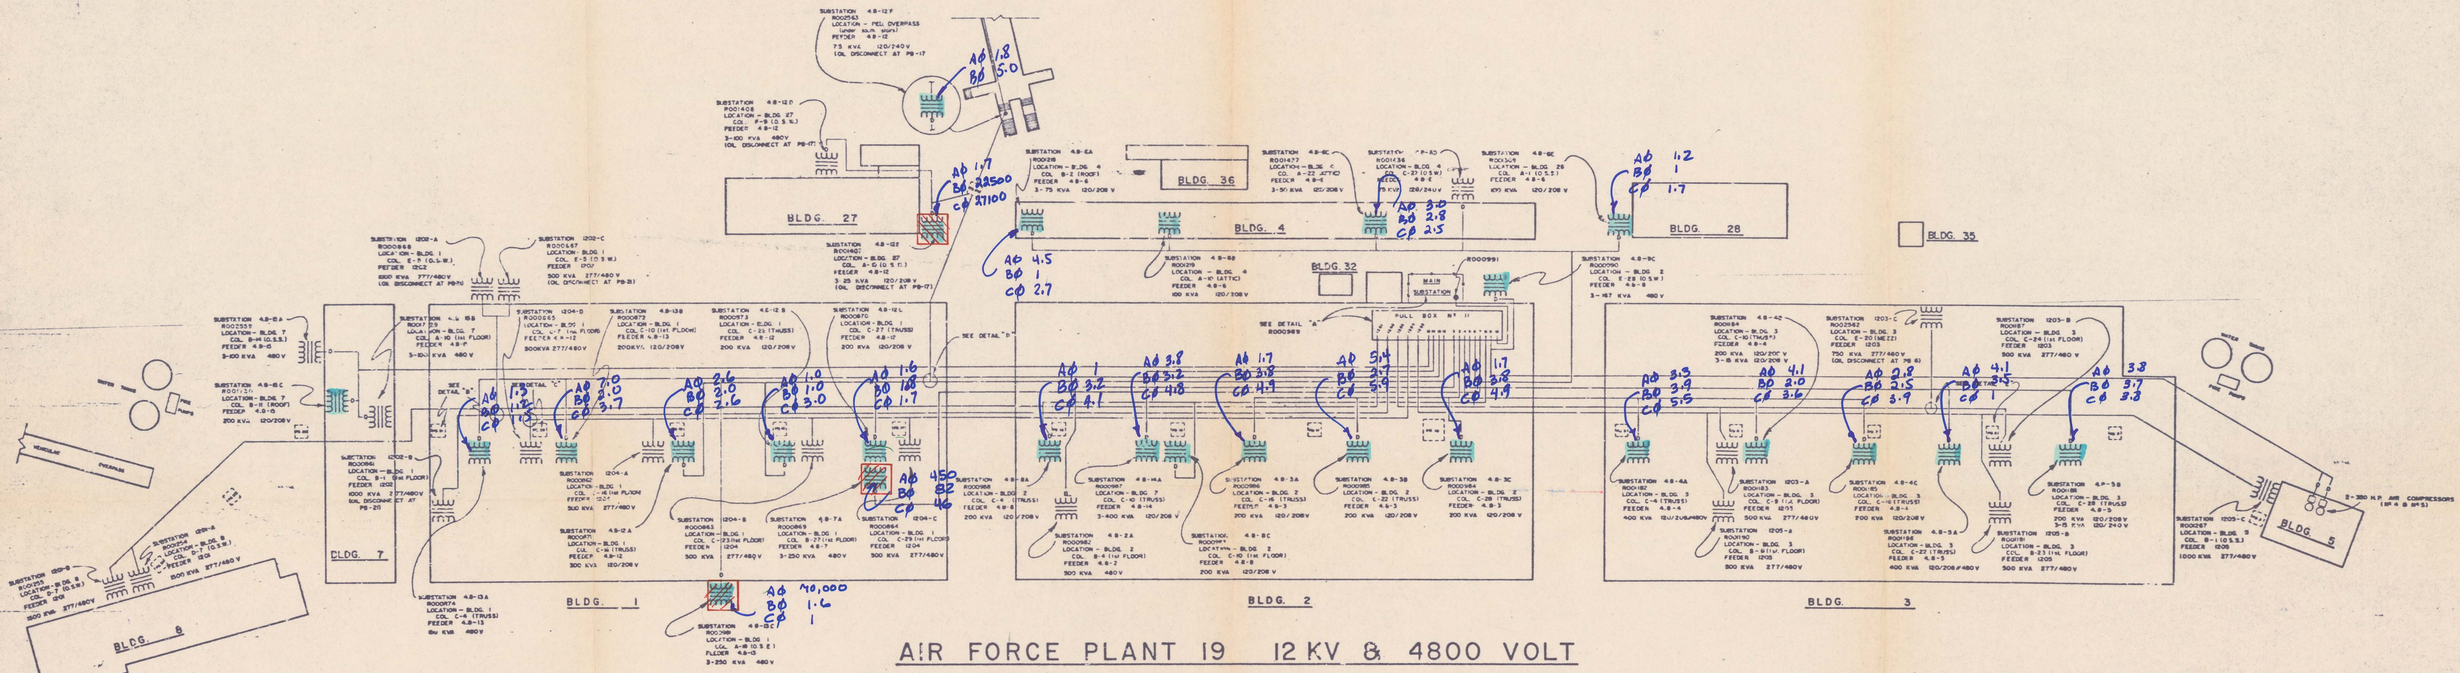

AIR FORCE PLANT 19 12 KV & 4800 VOLT DISTRIBUTION AND SUBSTATION SYSTEMS

SYMBOLS

D — OIL FUSE CUTOUT

— OIL SWITCH

— DISC SWITCH

PB — PULL BOX



PULL BOX Nº 21
DETAIL "B"



PULL BOX Nº 20
DETAIL "C"



PULL BOX Nº 17
DETAIL "D"

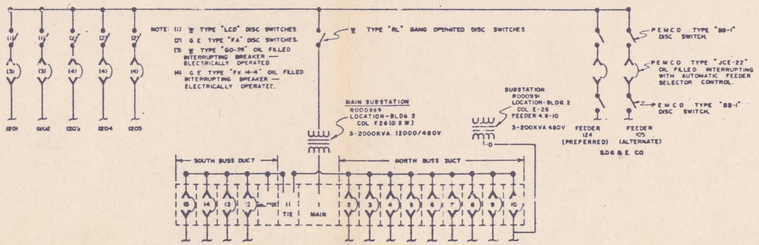

MAIN SUBSTATION & SWITCHBOARD
(WEST SIDE BLDG. 2)
DETAIL "A"



PULL BOX Nº 6
DETAIL "E"

SYM	REVISIONS	DATE	APPROVALS				PREPARED BY R. Evans W. Jones	DATE
A	Update RPIE Identification Nos. Correct KVA Ratings & Delete 93-0000588 Bldg. Cat. R7	5-22-72	SIGNATURE	DEPT	DATE	CHECKED BY		
						ENGINEER		
						SUPERVISOR		
						AUTHORIZATION		

GENERAL DYNAMICS
Convair Division
PLANT ENGINEERING

TITLE AIR FORCE PLANT 19 12 KV & 4800 VOLT DISTRIBUTION AND SUBSTATION SYSTEMS

SUB TITLE

SCALE	PLT	BLDG	PLR	AREA	TYPE	DRAWING	SHEET	REV
NONE	1B					5-25027	1 of 2	A

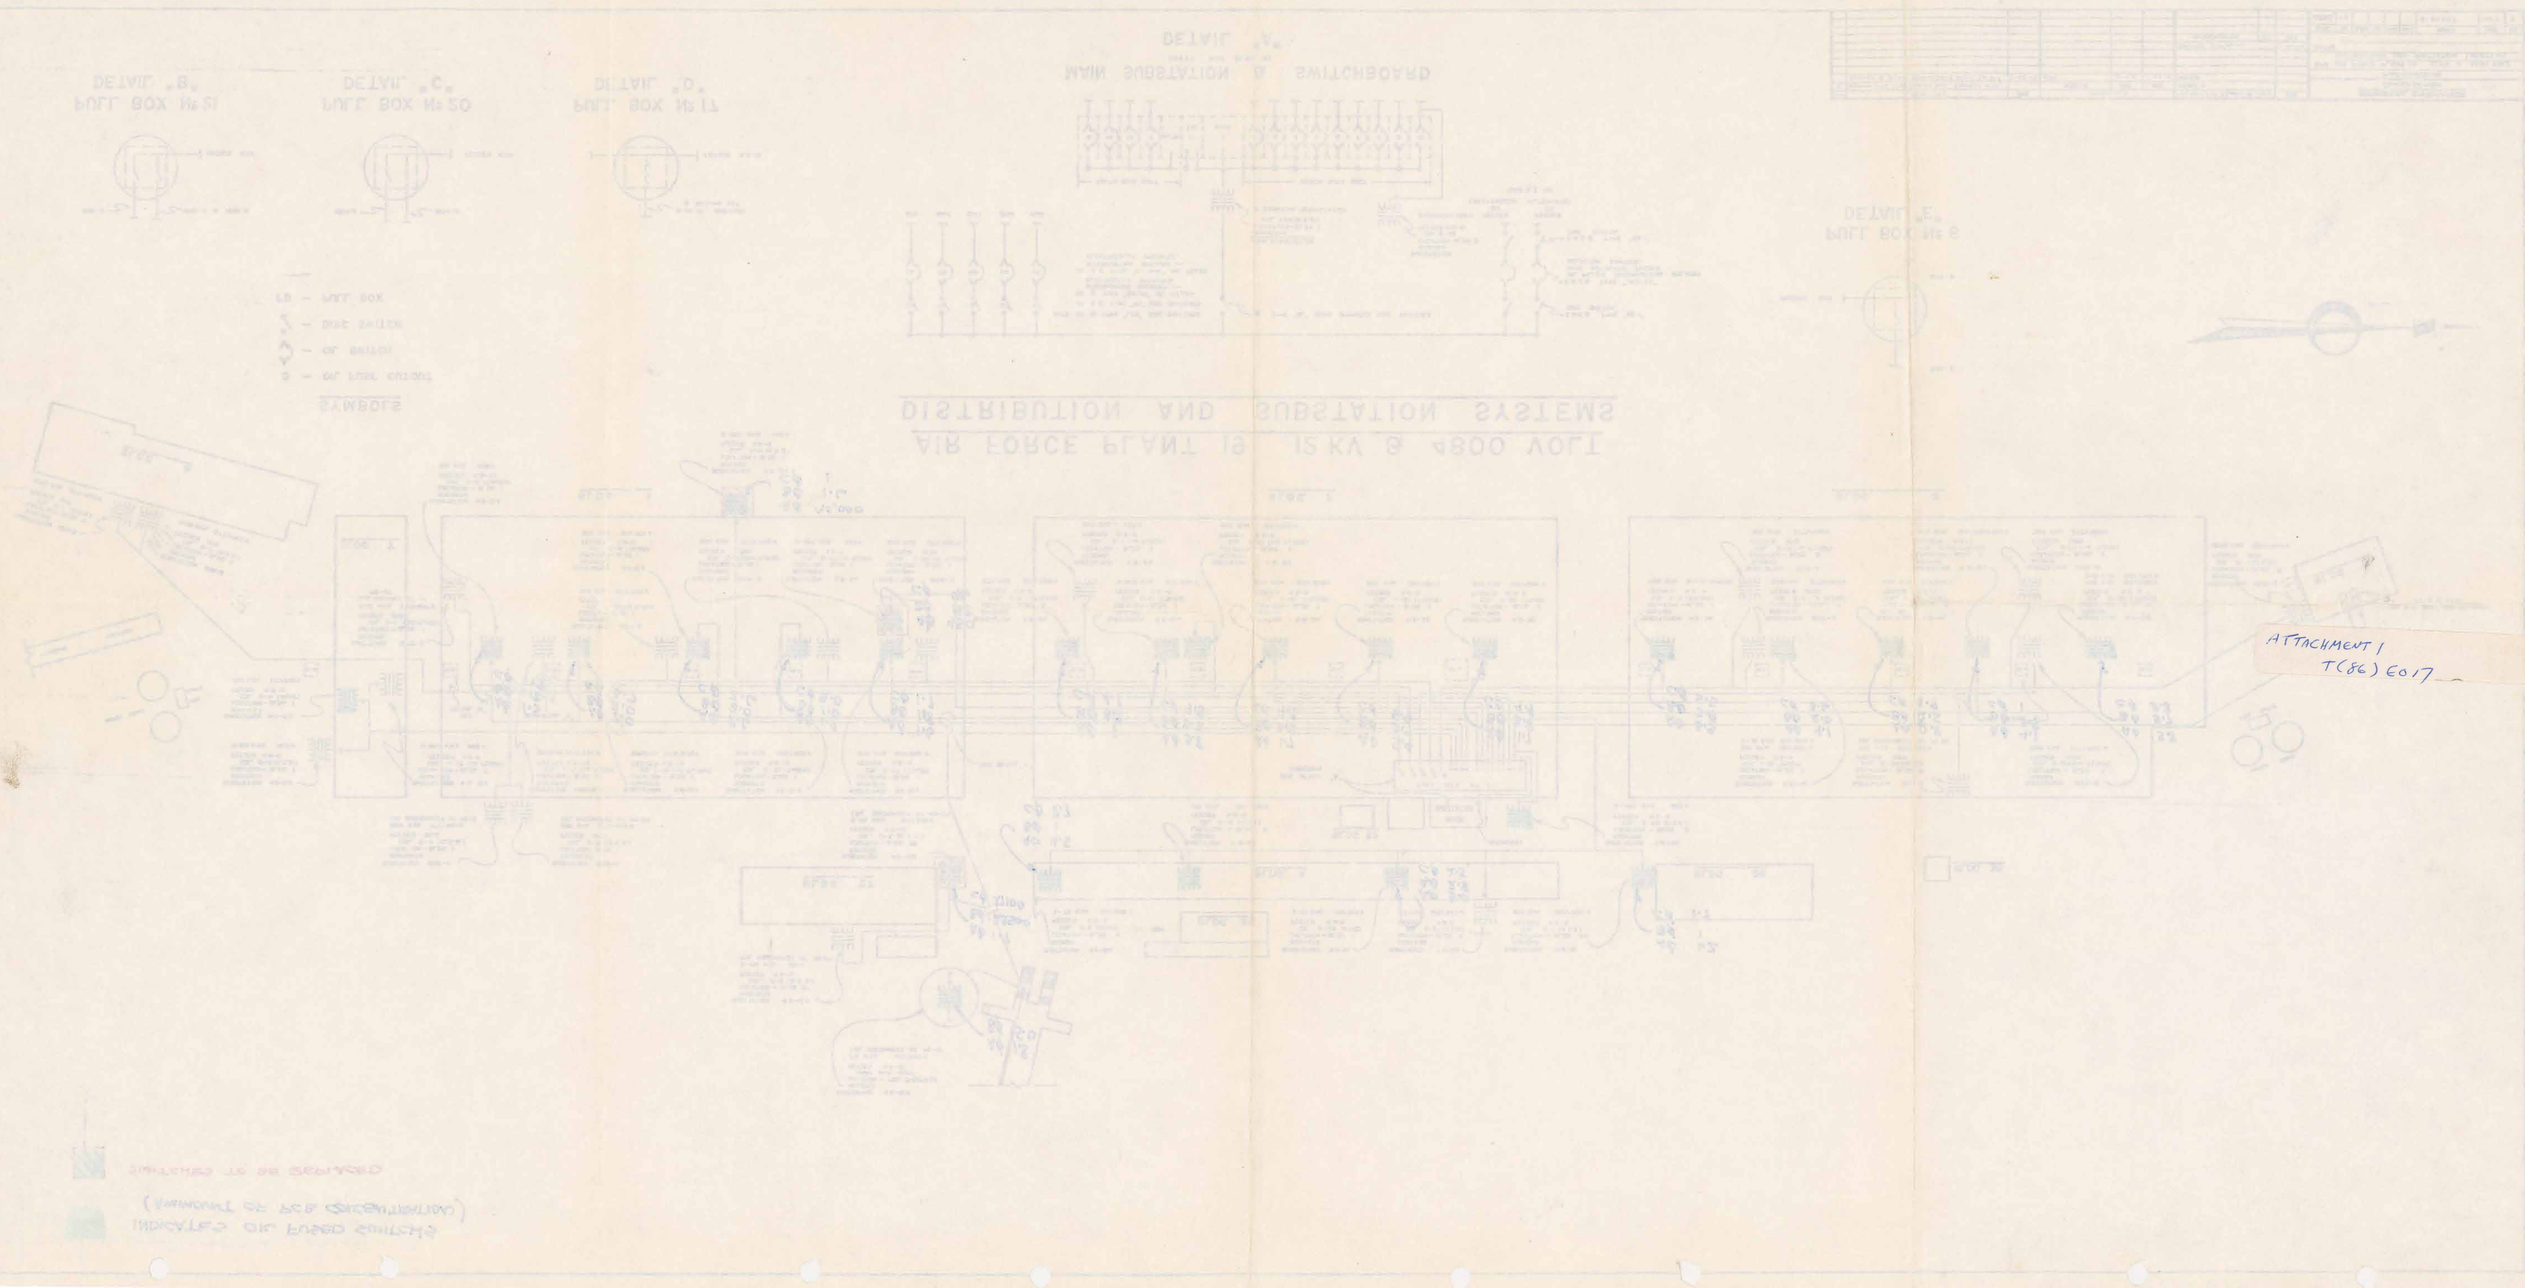

ATTACHMENT 1
T(86) E017