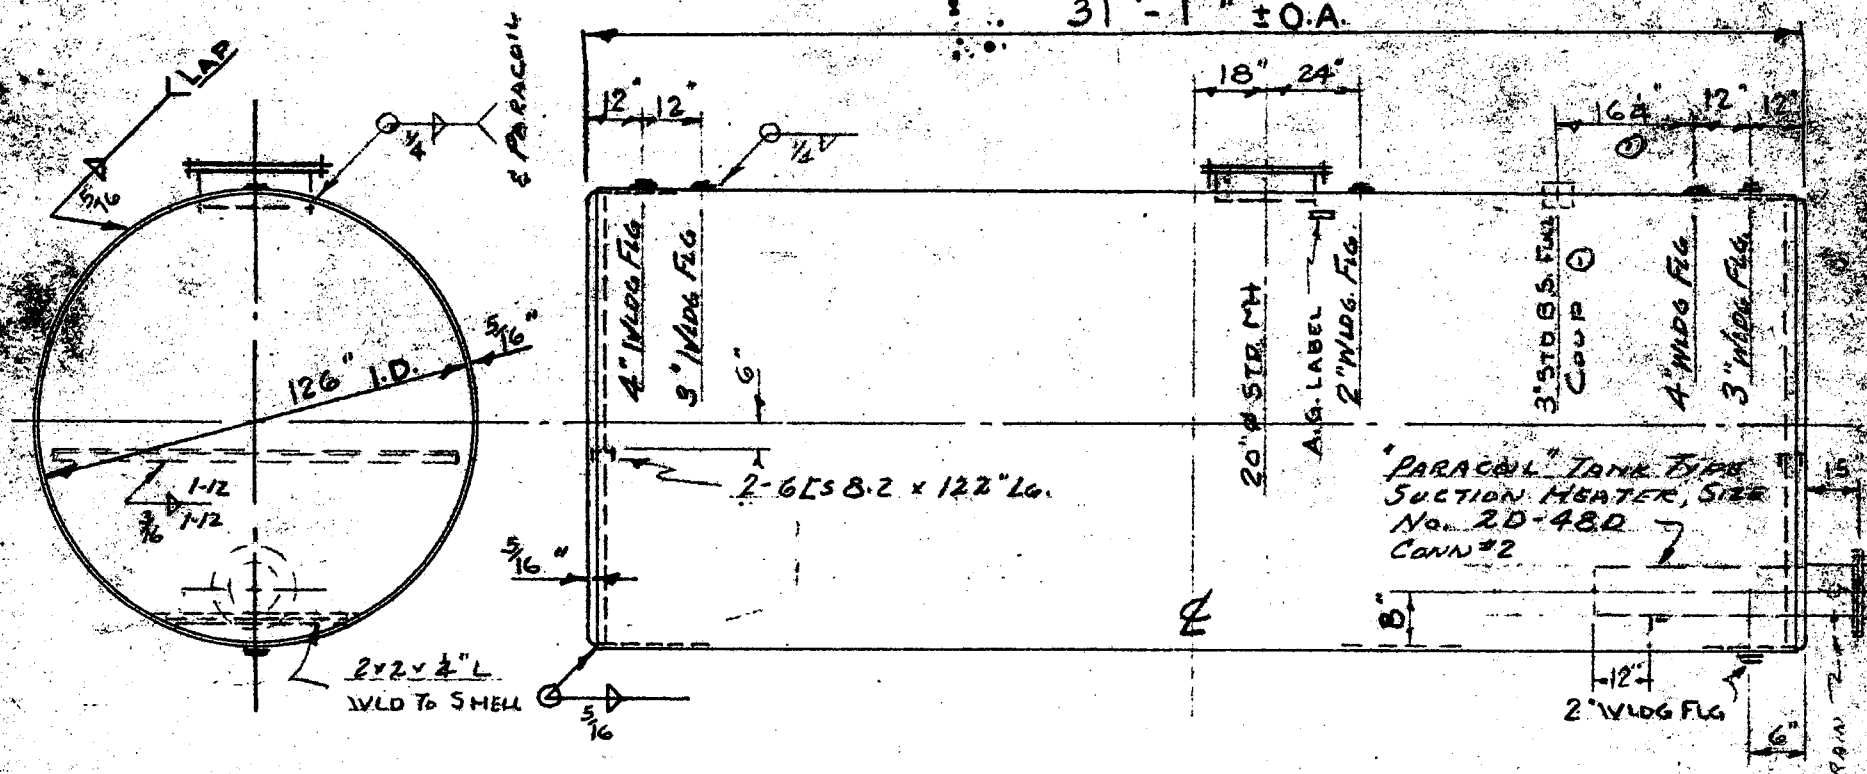

Fuel Oil Storage Tk

SHOP DWG.

PATERSON BOILER & TANK INC.
150 RAILROAD AVE. PATERSON 3, N. J.

ARKANSAS COMPANY, INC.
NEWARK 5 N.J.
CUSTOMERS ORDER NO. 4579

NOTES-
1 TANK REQ'D. 20,000 GAL. CAP.
UNDERWRITERS ABOVEGROUND SPEC'S.
PAINT
1 CT. RED OXIDE O.S. ONLY
MIN. SIZE & VENT 1.P.S.

APPRVD BY-

				SCALE	DRAWN TAD	CHECKED
①	11-29-55	TAD		NO. SHEETS	DRWG. NO. HZ-704	CONTRACT NO. HZ-704
REVISIONS				DATE 9-15-55		

433420

NO. 179

Mu7 2400

Davis Engineering Corp

Elizabeth N.J.

Paracoil

Heat Exchange Equipment

2D - 48D Sutton Oil Heater

Shell test 225 Tube test 225

SO 84829

Manning & Lewis.