POOR QUALITY ORIGINAL

French Limited Site
Crosby, Texas

Groundwater Monitoring and Remedial Progress Report

2nd Half, 2000

Prepared For:

FLTG, Inc., Channelview, TX

Prepared By:

Lyondell Chemical Co., Channelview, Texas, And
Remedial Operations Group, Crosby, Texas

Submitted To:

U.S. Environmental Protection Agency - Region 6, Dallas, Texas

November, 2000

100004098

Table of Contents

1.0 INTRODUCTION 1

2.0 PROGRESS MONITORING 2
- 2.1 Concentration > MCL 2
- 2.2 Residual Nitrate 2
- 2.3 pH 2
- 2.4 Contour Maps 6
  - 2.4.1 Water Levels 6
  - 2.4.2 Nitrate 7
  - 2.4.3 Dissolved Oxygen 7
  - 2.4.4 Total Organic Carbon 7
  - 2.4.5 Benzene 7
  - 2.4.6 1,2-DCA 7
  - 2.4.7 Vinyl Chloride 9
  - 2.4.8 Carbon Tetrachloride 9
  - 2.4.9 Affected Groundwater 9
- 2.5 Five Year Sampling 9

3.0 MODELING UPDATE 11

4.0 CONCLUSIONS 12

5.0 ACTION PLAN 13

6.0 S1-123 and INT-139R/RS RESPONSE PLAN 14
- 6.1 Current Status 14
- 6.2 Response Options 14
- 6.3 Response Option Comparison 15
- 6.4 Recommended Response Plan 16

Figures
123-2 S1 Unit, 1,2-Dichloroethane Concentrations, August, 2000 8
123-1 INT Unit, Carbon Tetrachloride Concentrations, August, 2000 10

Tables
2-1 French Ltd. Progress Evaluation 3
2-2 Concentrations >MCL, July, 2000 4
2-3 Residual Nitrate (mg/L) as N 5
6-3 Option Comparison 17

Appendices
Appendix A - July, 2000, Semi-Annual Groundwater Monitoring Event Analytical Results
Appendix B - Migration Wall Evaluation
Appendix C - July, 2000, Water Level and Chemical Concentration Figures
Appendix D - Concentration Trend Graphs

1.0 INTRODUCTION

This report presents the results of groundwater sampling performed at the French Limited Superfund site, Crosby, Texas, for the 2nd half of 2000. Aquifer measurements and sampling were completed in July, 2000.

Analytical results of the July, 2000, sampling are tabulated in Appendix A, including historic results since the shutdown of active remedial operations in December, 1995, and QAQC summary.

The July, 2000, water level and chemical concentration figures are shown in Appendix C.

2.0 PROGRESS MONITORING

Groundwater measurements and sampling were performed by Remedial Operations Group, Inc., (ROG), on July 6, 7, 10, 11, 12, 13, 14, 17, 18, and 19, 2000. Measurements and sampling were performed in general accordance with Table 12.1, "Progress Monitoring Wells (1996-2005)", of the approved site closure plan[1].

Locations of wells used for sampling and water level monitoring are shown in Figures 2-1 through 2-3. These figures also shown the area where the S1 and INT units are not separated by the C1 clay aquitard. The area of this "C1 window", where the C1 clay unit is absent, is taken from *Evaluation of Stratigraphic Controls on DNAPL Migration*[2].

Data management and QA/QC were performed by ROG. Analytical results were tabulated by ROG (Appendix A). Table 2-1 summarizes the analytical results for all wells. Appendix D contains the concentration trend graphs for the wells highlighted in Table 2-1.

2.1 Concentration > MCL

Groundwater samples from the wells with concentrations at or exceeding MCL's are presented in Table 2-2 for July, 2000.

2.2 Residual Nitrate

Residual nitrate exceeded 0.5 mg/L-N at 11 wells, summarized in Table 2-3.

2.3 pH

Field pH values at nearly all wells were within the range 6.0-8.0, which is conducive to intrinsic bioremedial activity. Nearly all wells had pH values falling inside this range. Field pH values falling outside this range were 9.54 at INT-118 and 8.69 at INT-144 for July, 2000.

[1] Southwestern Environmental Consulting, Inc. January, 1996. *Site Closure Plan, French Limited Project, Crosby, Texas.*
[2] Applied Hydrology Associates, Inc. September, 1995. *Evaluation of Stratigraphic Controls on DNAPL Migration.*

Table 2-1
French Ltd. Progress Evaluation

Well Name	Comments
FLTG-013	11DCA (4 ppb); Compound concentration has been consistently at low levels (<10 ppb) since 1992 with intermittent ND
FLTG-014	Chlorinated chemicals detected at low levels in January event; All ND in July sample
INT-022	Bnz at 3 ppb in January event; All ND in July sample
INT-026	Bnz concentration increased in Feb'98 from ~50 to ~300 ppb; Concentration has not changed significantly since Feb'98
INT-059-P-2	Typically a metals only well; All ND in July sample
INT-060-P-3	All ND in July sample
INT-101	Bnz staying in the low ppb range (detected at less than 10 ug/L) since January '99
INT-106	Chlorinated chemicals detected at low levels (less than 150 ppb) in July '00 event; No significant change since January '99
INT-108	All ND in July sample
INT-118	All ND in July sample
INT-120	Chlorinated chemicals detected at low levels (less than 50 ppb) in July '00 event; No significant change since April '96
INT-123	Chlorinated chemicals detected at low levels (less than 50 ppb) in July '00 event; No significant change since January '99
INT-127	Bnz concentration increasing slightly since October '98; Other BTEX compounds also detected intermittently
INT-130R	Chlorinated chemicals detected at high levels in July '00 event; No significant change since '98
INT-130RS	Chlorinated chemicals detected at medium-high levels in July '00 event; No significant change since '98
INT-134	Bnz and chlorinated compounds fluctuating but decreasing slightly since January '99
INT-135	Vinyl chloride persistent and other chlorinated compounds intermittently detected at low levels (less than 50 ppb)
INT-144	Vinyl chloride detected at low level (less than 10 ppb); VC intermittently detected over last few years
INT-214	All ND in July sample
INT-217	Bnz, 11DCA and VC detected at low levels (less than 25 ppb); Concentrations fluctuating but no significant trend since '98
INT-233	Bnz and chlorinated compounds fluctuating with possible upward trend since '97
S1-031	Bnz detected below cleanup criteria
S1-033	All ND in July sample
S1-051-P-3	Bnz increased to 23 ppb; Never detected above cleanup criteria during monitoring phase
S1-106A	Bnz and some chlorinated compounds fluctuating at low levels (less than 30 ppb)
S1-106R	Bnz fluctuating but less than 50 ppb
S1-108A	All ND in July sample
S1-111	Typically a metals only well; All ND in July sample
S1-118	All ND in July sample
S1-121	Bnz and chlorinated compounds fluctuating with possible upward trend since '97
S1-123	Chlorinated chemicals detected at high levels in July '00 event; Fluctuating with no significant trend since '97
S1-131	Bnz fluctuating but less than 50 ppb
S1-135	All ND in July sample

Bold print indicates wells with potential significant data trends - Concentration trend graphs were prepared for these wells (see Appendix D)

Table 2-2
Concentrations > MCL, July, 2000, (also where DL > MCL)

Well	Constituents and concentrations > MCL (ug/L)	
INT-022	Vinyl Chloride	3 J
INT-026	Arsenic	271
	Benzene	330
INT-059-P-2	Arsenic	69.4
INT-060-P-3	Nitrate	48.8
INT-101	Arsenic	78.5
	Benzene	6
INT-106	1,2-Dichloroethane	79
	Benzene	6
	Vinyl Chloride	24
INT-120	Nitrate	56.6
	1,2-Dichloroethane	8
	Vinyl Chloride	20
INT-123	Nitrate	16.4
	1,2-Dichloroethane	13
	Vinyl Chloride	25
INT-127	Arsenic	128
	Benzene	180
INT-130R	Nitrate	15.4
	1,2-Dichloroethane	200
	Benzene	42
	Vinyl Chloride	28
INT-130RS	1,2-Dichloroethane	240
	Benzene	41
	Vinyl Chloride	210
INT-134	Nitrate	25.4
	1,2-Dichloroethane	57
	Benzene	5
	Vinyl Chloride	86
INT-135	1,2-Dichloroethane	7
	Vinyl Chloride	11
INT-144	Vinyl Chloride	4 J
INT-214	Arsenic	55.7
INT-217	Benzene	9
	Vinyl Chloride	25
INT-233	Arsenic	132
	1,2-Dichloroethane	20
	Benzene	320
S1-051-P-3	Benzene	23
S1-106A	1,2-Dichloroethane	6
S1-106R	Benzene	42
S1-121	1,2-Dichloroethane	21
	Vinyl Chloride	17
S1-123	1,2-Dichloroethane	165,000
	Benzene	320
	Vinyl Chloride	3,200
S1-131	Benzene	28
S1-135	Arsenic	74.4

Note: Nitrate values in ppm (mg/L)

Table 2-3
Residual Nitrate (mg/L) as N

Well Name	Apr-96	Jul-96	Oct-96	Jan-97	Apr-97	Jul-97	Oct-97	Jan-98	Jul-98	Jan-99	Jul-99	Jan-00	Jul-00
INT-060-P-3	112	100	91	74.4	50.5	91.2	32.7	45	105	61	76	60	48.8
INT-106	< 0.2	< 0.05	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	0.6	7.5	10	12.8	3.3
INT-120	23.3	66	21.1	47.4	31	38.4	33.1	26.5	62.6	55.1	59	68.4	56.6
INT-123	23.2	21	20.1	23.3	19.2	27.3	27.8	26.7	53.4	8.4	5	5.2	16.4
INT-127	47.9	< 0.05	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	1.2	0.6	2	1.2	< 0.2
INT-130R	30.6	32	32	33	30.6	31.9	34.6	26.8	45	29.1	25	23	15.4
INT-130RS	23.2	20	17.5	14	12.5	12.7	10	3.6	20.3	11.1	13	15.9	3.5
INT-134	0.45	0.78	2	2.9	1	2.6	7.1	9.7	9.2	16.8	22	17.2	25.4
INT-144	< 0.2	0.12	< 0.2	0.2	0.7	0.2	< 0.2	< 0.2	4.8	6.1	8	13.8	8.6
INT-217	< 0.2	< 0.05	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	10.3	1.8	< 0.2	0.2	< 0.2	< 0.2
INT-233	< 0.2	< 0.05	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	1.8	4.8	< 0.4	< 0.2	< 0.2	< 0.2
S1-106A	16.6	23.3	11.4	16.2	15.4	12.9	9.8	7	10.8	8.51	2	12.2	9
S1-121	< 0.2	0.75	6	9.9	< 0.2	0.3	7.8	< 0.2	0.5	1.56	< 0.2	0.4	< 0.2
S1-123	0.2	< 0.05	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	0.05	< 0.2	< 0.2	< 0.2

2.4 Contour Maps

Contour maps for water level, nitrate, dissolved oxygen (DO), total organic carbon (TOC), benzene, 1,2-dichloroethane (1,2-DCA), vinyl chloride and affected groundwater for the S1 and INT units in July, 2000, are presented in Figures 2-4 through 2-17 in Appendix C and discussed in Section 2.4.1. through Section 2.4.8. Contours are inferred from, the July, 2000, sampling results at progress monitoring wells, results of previous quarterly sampling at wells which are now plugged, and monitoring data obtained during active operations (between January, 1992, and December, 1995). Therefore, the contours presented are not based solely on the data shown on the contour maps, but incorporate judgement based on four years of historic monitoring data at a significantly wider well network. Former wells are shown on the chemical plume maps.

2.4.1 Water Levels

The water level measurements in July, 2000, were used to develop the respective groundwater contours and flow direction maps.

Water levels for the post-operational phase tend to reflect short-term, localized influences. Short-term rainfall events and beaver activity in the area affect the water level in the South Pond and other surface water bodies, which act as localized recharge or discharge areas depending on recent rainfall relative to average. The normal maximum level for the South Pond appears to be controlled by a downstream beaver dam. The South Pond was near the normal maximum level during the July, 2000, sampling event.

The S1 and INT water level maps indicate that significant downward leakage from the S1 unit to the INT unit occurs in a localized area south of the west end of the former lagoon, where the C1 clay is absent ("C1 window"). In this area, the average hydraulic gradient in the S1 unit is northeast towards the C1 window, whereas the average hydraulic gradient in the INT unit is to the southwest, away from the C1 window. This trend has been consistent since active remediation ended.

The other consistent feature is the low hydraulic gradient south of the former lagoon and east of the C1 window. In both the S1 and INT units, the gradient is generally to the southeast, away from the clay window. Overall, it appears that the cutoff wall has created stagnant groundwater flow conditions in the area south of the former lagoon.

Three sets of paired S1 unit monitoring wells track head differences across the cutoff wall, which enclosed an active phytoremediation area. The well pairs are P-6/P-5; S1-119/S1-121; and S1-126/S1-64. The first well of each pair is inside the cutoff wall; the second well is outside. Head differences are shown in Figure 2-4. In July, 2000, hydraulic gradients were generally outward. It is planned that phytoremediation will eventually reverse this head difference.

The effectiveness of the steel sheetpile cutoff wall system used at the French Limited site was confirmed by testing described in *INT-11 DNAPL area, cutoff wall installation and*

permeability certification report[3]. This report concluded that the cutoff wall is equivalent to a conventional 2.5-foot thick slurry wall with a permeability of 1 x 10^{-9} cm/sec. Hence, an outward hydraulic gradient will not result in significant outward migration of groundwater. The integrity of the wall was tested in May, 2000, and the results indicate no degradation of the wall; the test plan and results are in Appendix B.

2.4.2 Nitrate

Nitrate contour maps for July, 2000, are presented in Figures 2-6 and 2-7. There was little change over the last 6 months in the S1 unit and most of the INT unit. This is consistent with the slow movement of groundwater over much of the area south of the steel sheetpile cutoff wall (see Section 2.5.1).

2.4.3 Dissolved Oxygen

Dissolved oxygen contour maps for January, 2000, are presented in Figures 2-8 and 2-9. Elevated DO concentrations in wells in both units reflect residual DO from the oxygen addition program. The area of elevated DO, and the maximum DO concentrations, have both decreased significantly in both units from a post-injection high in July, 1998. This may indicate use by aerobic bacteria to break down site chemicals.

2.4.4 Total Organic Carbon

Total organic carbon contour maps for July, 2000, are presented in Figures 2-10 and 2-11. TOC concentrations are generally similar to the previous 12 months in both the S1 and INT units.

2.4.5 Benzene

Benzene contour maps for July, 2000, are presented in Appendix C. Benzene concentrations are generally similar to the previous 12 months in both S1 and INT units. There were no significant changes in benzene concentrations over the last 6 months; there is no indication of rebound.

2.4.6 1,2-DCA

1,2-DCA contour maps for July, 2000, are presented in Appendix C. 1,2-DCA concentrations are generally similar to the previous 6 months in both the S1 and INT units. The concentration remains elevated at S1-123, but there have been no increases in adjacent wells. Three S1 wells were installed in the vicinity of S1-123 to define the extent of the 1,2-DCA; the localized 1,2-DCA plume in the vicinity of S1-123 is shown in Figure 123-2; the extent of the plume is undefined to the east; the elevated S1 concentrations of 1,2-DCA appear to be limited to the S1-123 area; two additional monitoring wells may be installed to better define the 1,2-DCA in the MW-123 area.

[3] Applied Hydrology Associates, Inc. August 1995.

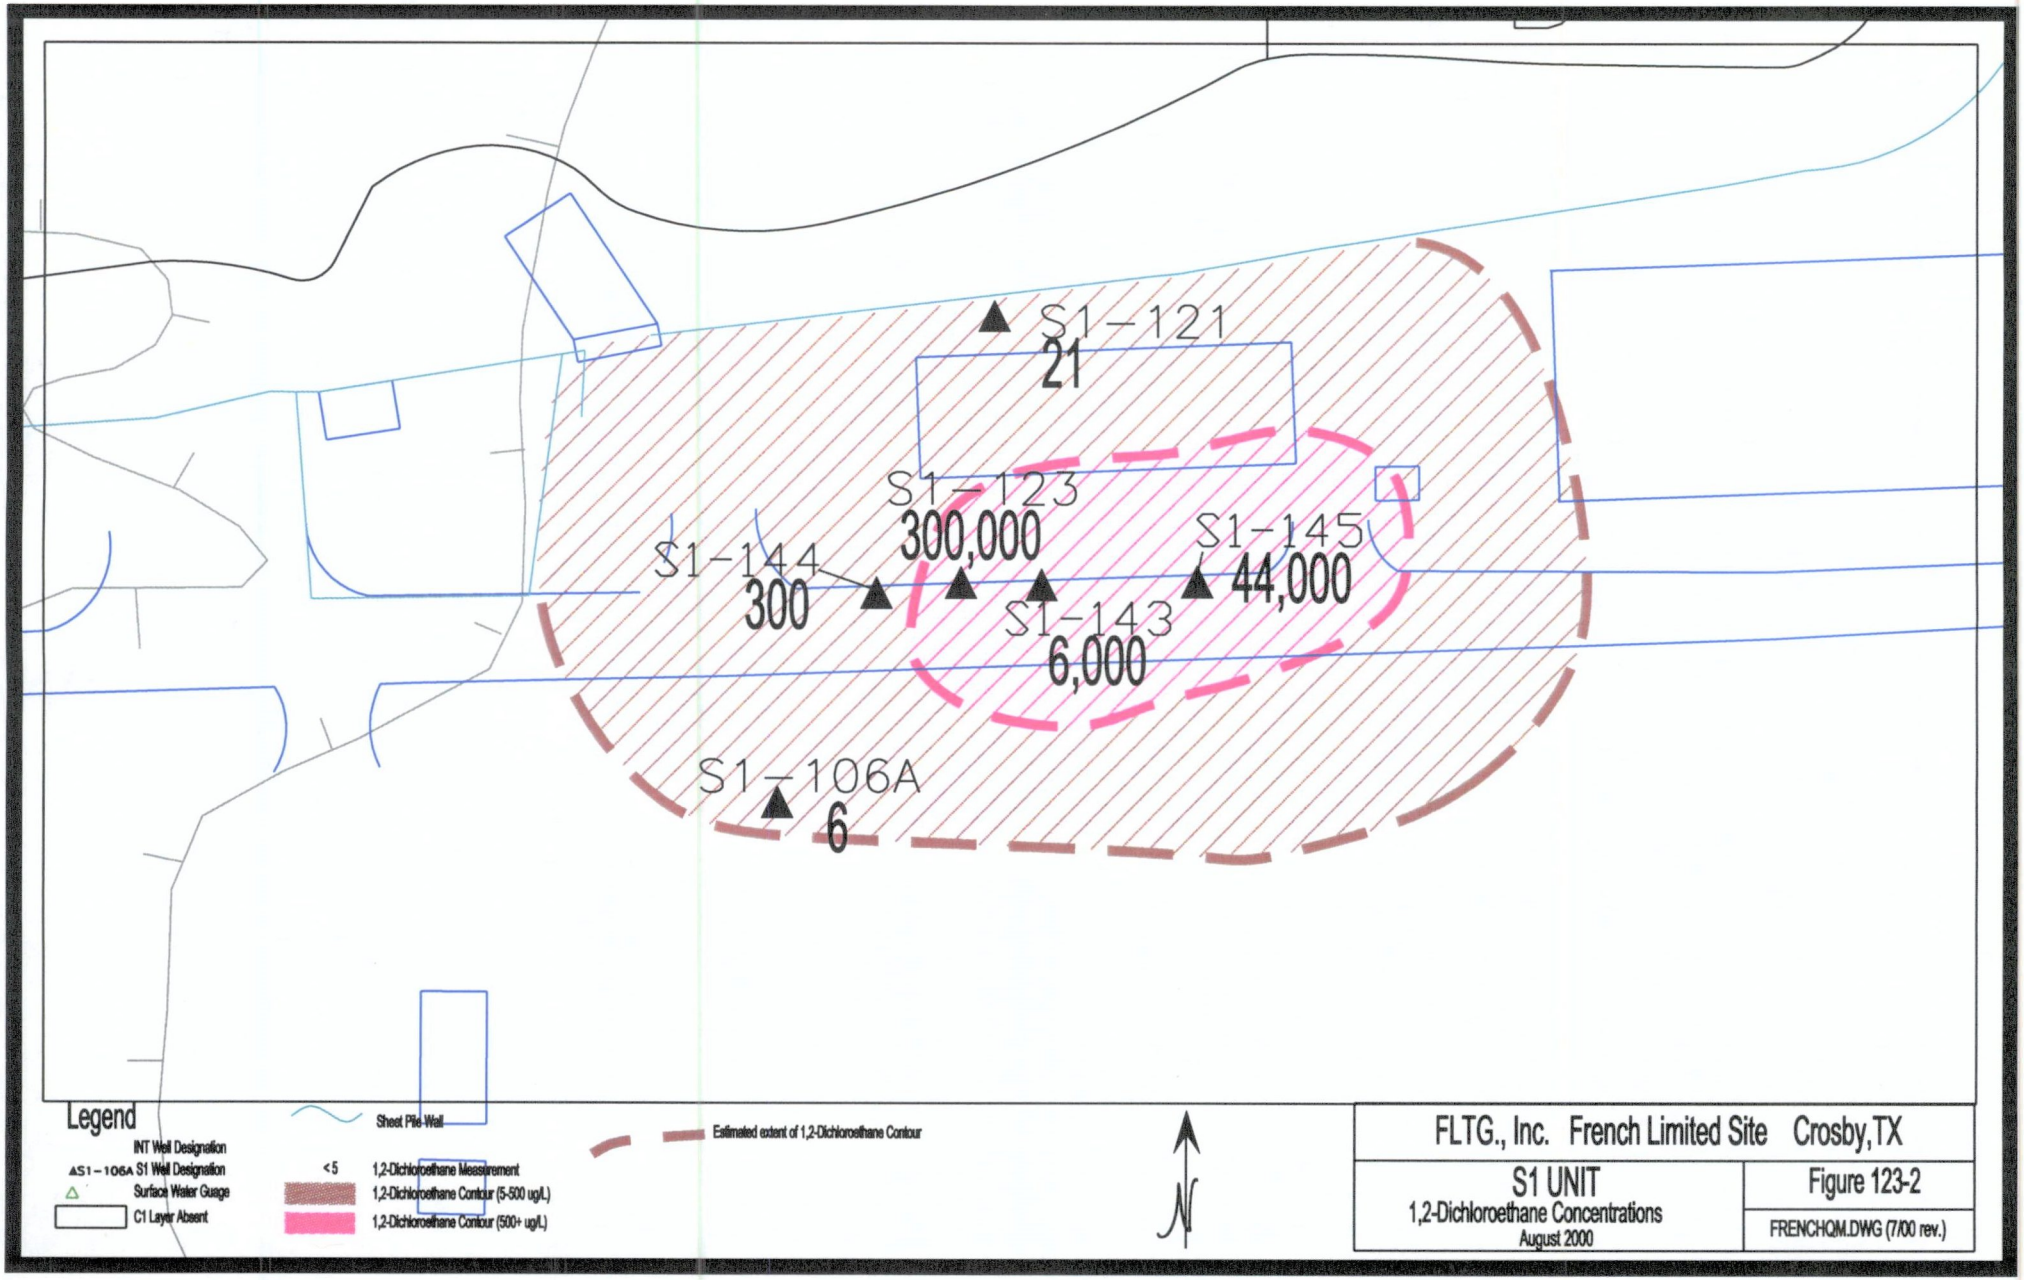
S1-121
21
S1-123
300,000
S1-144
300
S1-145
44,000
S1-143
6,000
S1-106A
6
Legend
INT Well Designation
S1-106A S1 Well Designation
Surface Water Guage
C1 Layer Absent
Sheet Pile Wall
<5 1,2-Dichloroethane Measurement
1,2-Dichloroethane Contour (5-500 ug/L)
1,2-Dichloroethane Contour (500+ ug/L)
Estimated extent of 1,2-Dichloroethane Contour
N
FLTG., Inc. French Limited Site Crosby,TX
S1 UNIT
1,2-Dichloroethane Concentrations
August 2000
Figure 123-2
FRENCHQM.DWG (7/00 rev.)

2.4.7 Vinyl Chloride

Vinyl chloride contour maps for July, 2000, are presented in Appendix C. Vinyl chloride concentrations are generally similar to the previous 6 months in both the S1 and INT units. There does appear to be some attenuation in the southwest INT extension.

2.4.8 Carbon Tetrachloride

An INT carbon tetrachloride plume contour map for the INT-130R/RS area is presented in Figure 123-1. Carbon tetrachloride concentrations in INT-103R, INT-130RS, and INT-106 are generally similar to previous results. Five wells were installed in the vicinity of INT-130R/S to define the extent of carbon tetrachloride in this area; the results of these five wells have defined the general extent of the INT chloroform.

2.4.9 Affected Groundwater

The affected areas in July, 2000, have not greatly changed over the last 6 months. The affected S1 and INT groundwater does not represent a threat to the public health or the environment, because FLTG controls all property that contains elevated concentrations of chemicals in groundwater, and all areas containing affected groundwater are potentially subject to institutional controls.

However, the very limited groundwater movement, the absence of natural attenuation trends in many areas, and the elevated VOC's at S1-123 and INT-130R/RS, indicate that natural attenuation trends need to be closely evaluated over the next several years.

2.5 Five Year Sampling

The site monitoring plan calls for regular monitoring of certain groundwater wells for volatile organic chemicals, which are the "target" chemicals at the site. However, once every five years, the available groundwater monitoring wells are sampled and analyzed for:

- Volatile organics
- Semi-volatile organics
- Metals
- Pesticides
- PCB's

The objective of the broad analytical list once every five years is to determine if any substances should be considered for inclusion on the "regular" analytical list.

The results of the July, 2000, "broad" analytical effort are included in Appendix A; the results do not indicate any significant changes from the previous "broad" analytical effort. It is concluded that regular monitoring for volatile organics will continue to accurately represent site status.

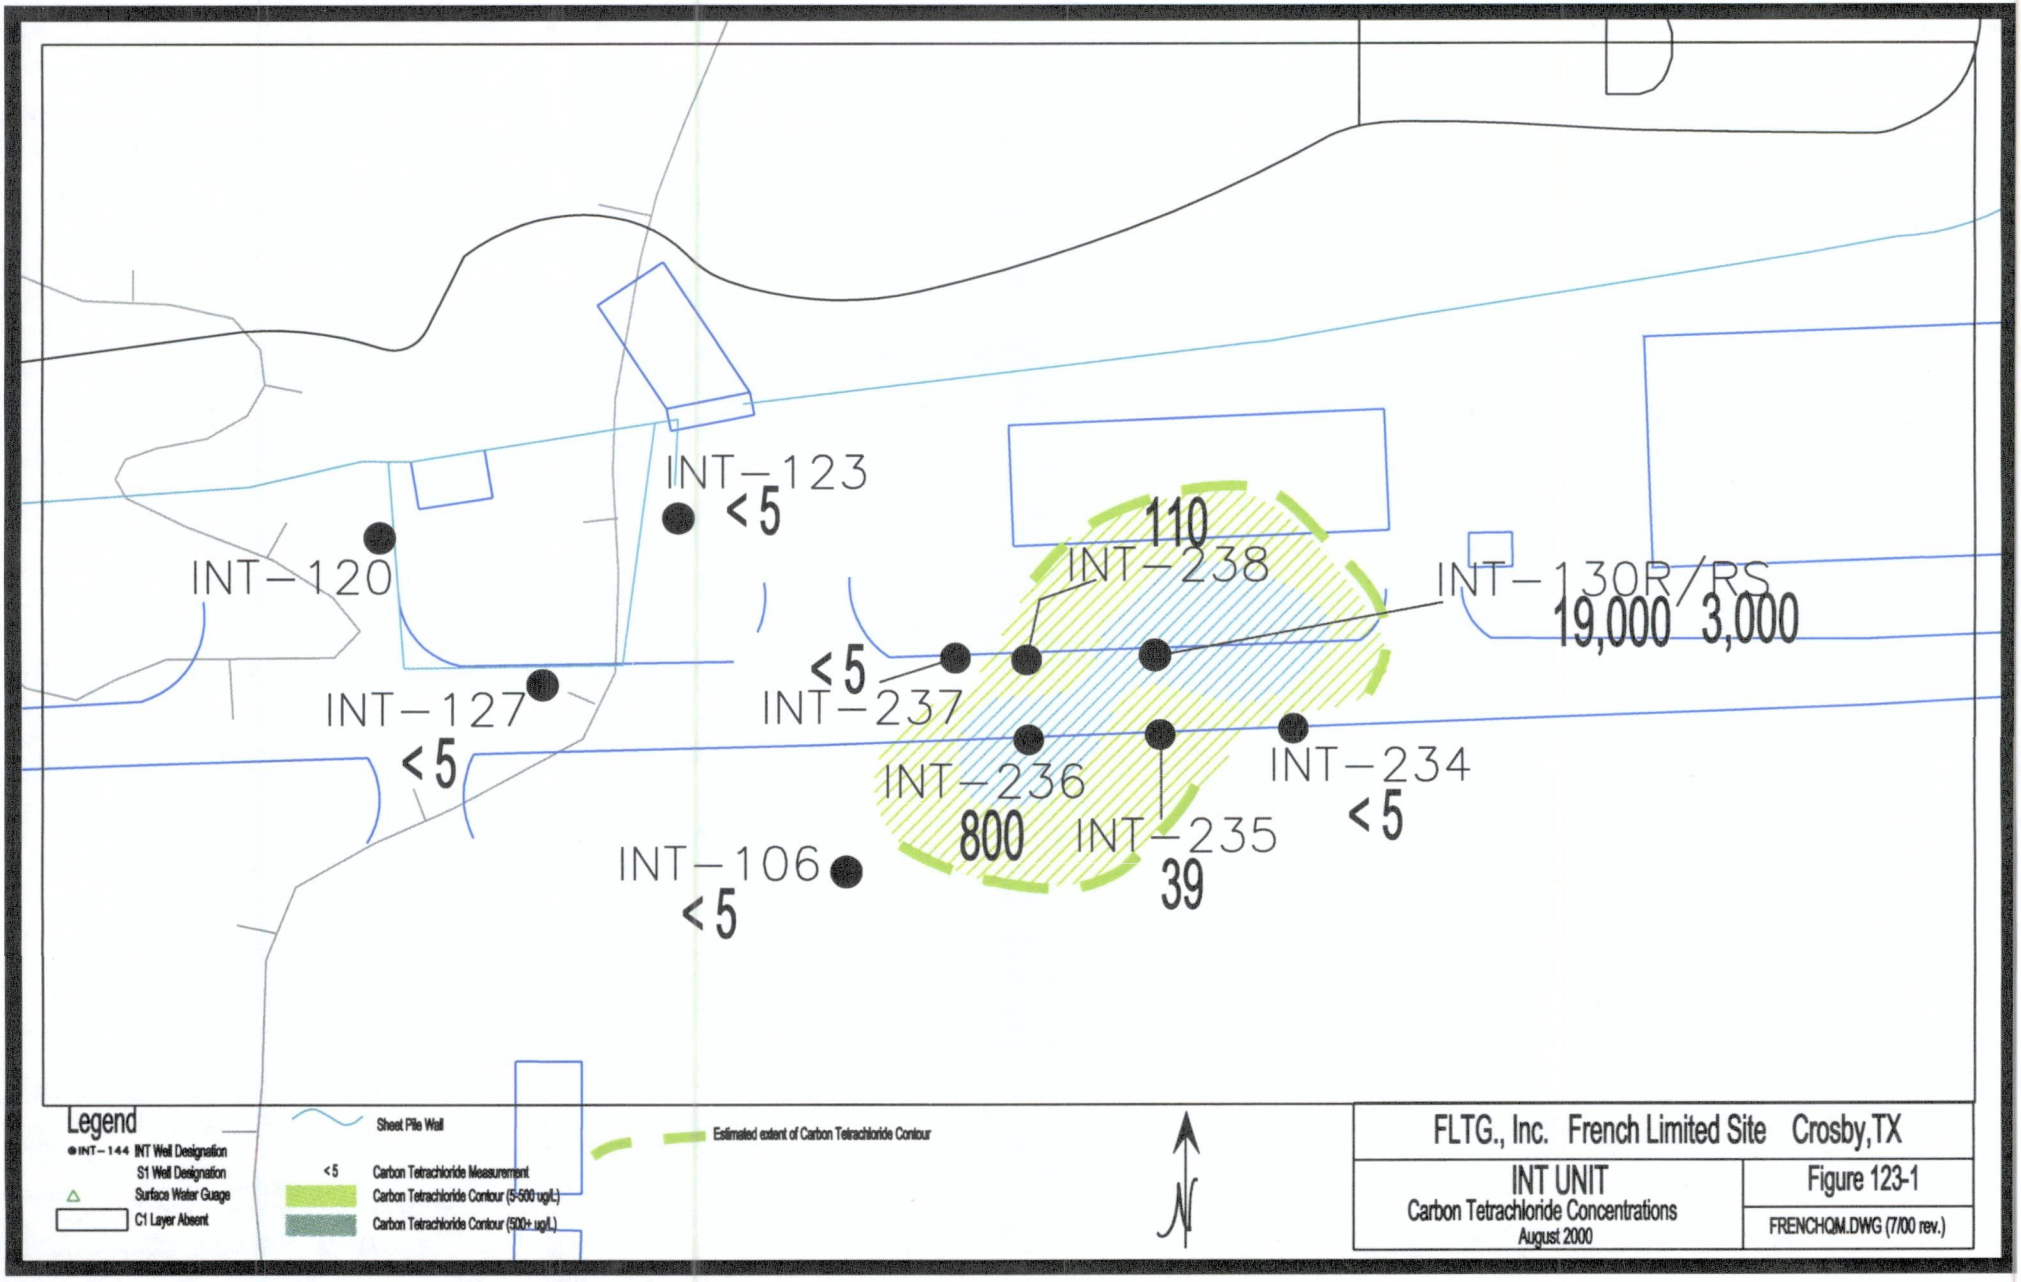
INT-123
<5
110
INT-238
INT-130R/RS
19,000
3,000
INT-120
<5
INT-237
INT-127
<5
INT-236
800
INT-235
39
INT-234
<5
INT-106
<5
Legend
INT-144 INT Well Designation
S1 Well Designation
Surface Water Guage
C1 Layer Absent
Sheet Pile Wall
<5 Carbon Tetrachloride Measurement
Carbon Tetrachloride Contour (5-500 ug/L)
Carbon Tetrachloride Contour (500+ ug/L)
Estimated extent of Carbon Tetrachloride Contour
N
FLTG., Inc. French Limited Site Crosby,TX
INT UNIT
Carbon Tetrachloride Concentrations
August 2000
Figure 123-1
FRENCHQM.DWG (7/00 rev.)

3.0 MODELING UPDATE

The low migration rates and the generally stable chemical concentrations are consistent with the model. The plumes are starting to elongate to the southwest consistent with the natural gradients. The public health continues to be protected. Actual field data over the next 2-3 years will confirm the original model.

4.0 CONCLUSIONS

There have been no significant changes in the physical or chemical groundwater trends. There is no evidence of chemical "rebound" in any areas. The S1 and INT zones immediately downgradient of the cutoff wall show stagnant flow conditions. The INT plume to the southwest is attenuating consistent with the local gradient. The S1-123 area may require future focused action to address the elevated 1,2-DCA and other chlorinateds; the INT-130R/RS area may require future focused action to address the elevated chloroform and other chlorinateds.

5.0 ACTION PLAN

Measure water levels and sample wells twice per year. Maintain site and well security. Evaluate response options for S1-123 area and for INT-130R/RS.

6.0 S1-123 and INT-139R/RS RESPONSE PLAN

6.1 Current Status

The chlorinated concentrations in the S1-123 area and the INT-130R/RS area are elevated and persistent and are not expected to naturally attenuate in 30 years; the chlorinateds in these two areas do not currently create a threat to public health or the environment. Some additional work may be done to better define the extent of both the S1 and the INT plumes in this area.

The INT plume extends across Gulf Pump Road; there are elevated concentrations of chloroform in INT-236, which is south of the road. The S1 plume may extend across Gulf Pump Road; this would need to be determined as part of a response plan.

6.2 Response Options

The response options for the S1-123 are and the INT-130R/RS area are described below:

1. Better define the nature and extent of the chlorinateds in the S1 and INT.
   Monitor.
   Develop final plan based on better definition.

2. No specific action.
   Monitor as per site closure plan.
   Evaluate risk.

3. Purchase property south of Gulf Pump Road.
   Extend groundwater compliance boundary 600' to the southwest.
   Monitor as per site closure plan.

4. Focused pumping of S1 and INT wells and discharge to lagoon area.
   Monitor as per site closure plan.

5. Excavate soils containing DNAPL and dispose off-site.
   Backfill with clean soil and oxidizer.
   Monitor as per site closure plan.

6. Excavate soils containing DNAPL and treat on-site in bio pile.
   Dispose of soils as non-hazardous.
   Backfill with clean soils and oxidizer.

7. Contain the affected S1 water-bearing zone and the affected INT water-bearing zone with interlocking sheet steel sealed to the underlying Beaumont clay.
   Monitor as per site closure plan.

8. Contain the affected zones with a grout curtain sealed to the underlying Beaumont clay.
   Monitor as per site closure plan.
   Grout curtain material may be bentonite-based or polymer-based.

9. Install subsurface gate to focus groundwater migration in both zones. Treat water as the water passes through the gate with bioremediation or chemical oxidation. Focus the plumes through the gate with downgradient pumping wells.
   Discharge pumped water to lagoon area.
   Evaluate progress quarterly.

10. Install and operate in-situ bioremediation system.
    Pump from both the S1 and the INT zones; pump from the center of the affected zones.
    Discharge the pumped water to the lagoon area.
    Inject "clean" water with 20-30 ppm of dissolved oxygen and nutrients on the perimeter of the affected S1 and INT zones.
    Evaluate progress and refine the system quarterly.

11. Wash the affected soils by alternating cycles of injection for 30 days followed by pumping for 30 days.
    Inject "clean" water with oxygen and nutrients.
    Discharge pumped water to lagoon area.
    Evaluate progress and refine the system quarterly.

12. In-situ thermal desorption, soil vapor extraction, and vapor phase oxidation.
    Pump both zones to lower water levels to the bottom of the S1 and the INT zones.
    Evaluate progress and refine the system monthly.

13. Direct chemical oxidation of the chlorinated chemicals.
    Use H_2O_2 or permanganate.
    Direct inject oxidizer into the affected S1 and INT zones.
    Evaluate progress and refine the system monthly.

14. Cosolvent flushing with methanol or isopropyl alcohol.
    Evaluate progress and refine the system monthly.

6.3 Response Option Comparison

The response options are compared based upon:

a) Regulatory compliance.
b) Reduction in toxicity, mobility, or volume.
c) Short-term effectiveness.
d) Long-term effectiveness.
e) Implementability.

f) Cost.
g) Schedule.
h) Protect human health and the environment.

Table 6-3 compares the 13 options based on the criteria listed. Except where specifically noted, each option and criteria are rated on a scale of 1-10 with "1" being poor, negative, inadequate, and "10" being positive, excellent, satisfactory.

6.4 Recommended Response Plan

Option #3 (Purchase property south of Gulf Pump Road and extend compliance boundary 600' to the southwest) appears to be the most timely, cost-effective, and environmentally-sound option.

Table 6-3
Option Comparison

Option	Evaluation Criteria								
				Effectiveness			Cost		
	Regulatory Compliance	Protect Human Health and Environment	Reduction	Short-term	Long-term	Implementability	Design/ Construction	Operation	Active Remediation Schedule (months)
1. Definition future plan	5	3	1	5	NA	9	10,000	NA + 60K/yr	12+
2. Monitor	6	3	1	5	3	10	NA	60K/yr	NA
3. Purchase property	6	7	1	7	5	9	150,000	60K/yr	3
4. Focused pump	5	7	7	9	6	8	15,000	15K/mo + 60K/yr	12-15
5. Excavate/dispose	7	8	9	9	6	2	450,000	NA + 60K/yr	4
6. Excavate/treat	6	7	8	8	6	2	250,000	150,000 + 60K/yr	8-12
7. Sheet pile wall	6	8	8	9	8	5	300,000	NA + 60K/yr	5
8. Grout curtain	6	8	8	9	6	7	200,000	NA + 60K/yr	3
9. Subsurface gate/treatment	7	8	8	5	7	6	150,000	6K/mo + 60K/yr	12-15
10. In-situ bioremediation	8	8	8	4	7	7	130,000	20K/mo + 60K/yr	24-36
11. Soil washing	7	7	8	5	6	5	100,000	15K/mo + 60K/yr	12-18
12. In-situ thermal desorption	7	8	9	9	5	7	180,000	30K/mo + 60K/yr	6
13. Chemical oxidation	6	7	7	5	6	5	180,000	20K/mo + 60K/yr	3-6
14. Cosolvent flushing	4	5	6	4	6	4	100,000	25K/mo + 60K/yr	3-6

Appendix A

July, 2000, Semi-Annual Groundwater Monitoring Event Analytical Results

Remedial Operations Group, Inc.

TO: Dick Sloan

FROM: Ron Jansen

CC: Jim Thomson

DATE: August 18, 2000

RE: French Ltd. Project - Semi-annual Groundwater Monitoring

Attached are the analytical results for the July 2000 semi-annual ground water monitoring event at the French Limited Site in Crosby, Texas. All wells were sampled using the 'hybrid' well purge method as described in Ron Jansen's memo dated June 30, 1999(see Attachment D).

1.0 Sampling Summary

A total of forty-two (42) groundwater monitoring wells were sampled on July 6, 7, 10, 11, 12,13, 14, 17 18 and 19, 2000. All samples were analyzed by American Analytical and Technical Services - Baton Rouge(AATS-BR) and the Remedial Operations Group, Inc. Lab at the Turtle Bayou Project. All samples were submitted to the lab under properly executed chain-of-custody documents. A sample collection summary is presented in Table 1. Table 2 lists the field QC samples with complete precision reports in Attachment C. A analysis description and methodology summary is presented in Table 3. The EPA contractor collected split samples on ten of the forty-two wells (S1-111, S1-121, S1-131, INT-026, INT-106, INT-123, INT-134, INT-135, INT-155 and INT-217). The data for the split samples was not available for evaluation at the printing of this report.

Table 1
Sample Collection Summary

Sample Number	Well / Sample Name	Date Collected	Analyses Requested
01558	S1-143	7/ 6/00	Volatile organics
01559	S1-144	7/ 6/00	Volatile organics
01560	S1-145	7/ 6/00	Volatile organics
01561	INT-237	7/ 6/00	Volatile organics
01562	INT-238	7/ 6/00	Volatile organics
01563	INT-234	7/ 7/00	Volatile organics
01564	INT-235	7/ 7/00	Volatile organics
01565	INT-236	7/ 7/00	Volatile organics
01566	FLTG-013	7/10/00	Volatile organics
01567	FLTG-014	7/10/00	Volatile organics
01568	INT-060-P-3	7/10/00	Volatile organics
01569	INT-108	7/10/00	Volatile organics
01570	INT-118	7/11/00	Volatile organics
01571	FLTG-013	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01572	FLTG-014	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01573	INT-060-P-3	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01574	INT-108	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01575	INT-118	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01576	INT-144	7/11/00	Volatile organics
01577	INT-214	7/11/00	Volatile organics
01579	S1-033	7/11/00	Volatile organics
01580	INT-144	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01581	INT-214	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01583	S1-033	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01584	S1-111	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01585	INT-135	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01586	S1-121	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients

Table 1
Sample Collection Summary

Sample Number	Well / Sample Name	Date Collected	Analyses Requested
01587	S1-121DUP	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01588	S1-131	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01589	S1-111	7/12/00	Volatile organics
01590	INT-135	7/12/00	Volatile organics
01591	S1-121	7/12/00	Volatile organics
01592	S1-121DUP	7/12/00	Volatile organics
01593	S1-131	7/12/00	Volatile organics
01594	FIELD BLK#1	7/12/00	Volatile organics
01595	TRIP BLK #1	7/12/00	Volatile organics
01596	TRIP BLK #2	7/12/00	Volatile organics
01597	INT-217	7/13/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01598	INT-106	7/13/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01599	INT-026	7/13/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01601	INT-217	7/13/00	Volatile organics
01602	INT-106	7/13/00	Volatile organics
01603	INT-026	7/13/00	Volatile organics
01605	FIELD BLANK	7/13/00	Volatile organics
01606	TRIP BLK #3	7/13/00	Volatile organics
01607	INT-123	7/14/00	Volatile organics
01608	INT-134	7/14/00	Volatile organics
01609	INT-155	7/14/00	Volatile organics
01610	S1-031	7/14/00	Volatile organics
01611	INT-134-D	7/14/00	Volatile organics
01612	FIELD BLANK	7/14/00	Volatile organics
01613	TRIP BLANK #4	7/14/00	Volatile organics
01614	INT-123	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01615	INT-134	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01616	INT-155	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01617	S1-031	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01618	INT-134-D	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01619	FIELD BLANK	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01620	S1-051-P-3	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01621	S1-106A	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01622	S1-108A	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01623	S1-118	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01624	S1-135	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01625	INT-022	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01626	INT-022MS	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01627	INT-022MSD	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01628	S1-051-P-3	7/17/00	Volatile organics
01629	S1-106A	7/17/00	Volatile organics
01630	S1-108A	7/17/00	Volatile organics
01631	S1-118	7/17/00	Volatile organics
01632	S1-135	7/17/00	Volatile organics
01633	INT-022	7/17/00	Volatile organics
01634	INT-022MS	7/17/00	Volatile organics

Table 1
Sample Collection Summary

Sample Number	Well / Sample Name	Date Collected	Analyses Requested
01635	INT-022MSD	7/17/00	Volatile organics
01636	INT-059-P-2	7/18/00	Volatile organics
01637	S1-106R	7/18/00	Volatile organics
01638	INT-101	7/18/00	Volatile organics
01639	INT-120	7/18/00	Volatile organics
01640	FIELD BLK	7/18/00	Volatile organics
01641	TRIP BLK#5	7/18/00	Volatile organics
01642	INT-059-P-2	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01643	S1-106R	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01644	INT-101	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01645	INT-120	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01646	INT-127	7/19/00	Volatile organics
01647	INT-127DUP	7/19/00	Volatile organics
01648	INT-130RS	7/19/00	Volatile organics
01649	S1-123	7/19/00	Volatile organics
01650	S1-123MS	7/19/00	Volatile organics
01651	S1-123MSD	7/19/00	Volatile organics
01652	INT-130R	7/19/00	Volatile organics
01653	INT-233	7/19/00	Volatile organics
01654	INT-233MS	7/19/00	Volatile organics
01655	INT-233MSD	7/19/00	Volatile organics
01656	FIELD BLK	7/19/00	Volatile organics
01657	TRIP BLK#6	7/19/00	Volatile organics
01658	INT-127	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01659	INT-127DUP	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01660	INT-130RS	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01661	S1-123	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01662	S1-123MS	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01663	S1-123MSD	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01664	INT-130R	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01665	INT-233	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01666	INT-233MS	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01667	INT-233MSD	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients

DUP suffix on well name indicates field duplicate

MS or MSD suffix on well name indicates MS/MSD QC set

Table 2
Quality Control / Quality Assurance Sample Summary

Sample Name	QC Type	Date Collected	Parameters
S1-121	FIELD DUP	07/12/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
Field Blank	Blank	07/12/00	Volatile Organics
Trip Blank	Blank	07/12/00	Volatile Organics
Trip Blank	Blank	07/12/00	Volatile Organics
Field Blank	Blank	07/13/00	Volatile Organics
Trip Blank	Blank	07/13/00	Volatile Organics
Field Blank	Blank	07/14/00	Volatile Organics
Trip Blank	Blank	07/14/00	Volatile Organics
Field Blank	Blank	07/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients

Table 2
Quality Control / Quality Assurance Sample Summary

Sample Name	QC Type	Date Collected	Parameters
INT-134	FIELD DUP	07/14/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
INT-022	MS/MSD	07/14/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
Trip Blank	Blank	07/18/00	Volatile Organics
Field Blank	Blank	07/18/00	Volatile Organics
INT-127	FIELD DUP	07/19/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
Trip Blank	Blank	07/19/00	Volatile Organics
Field Blank	Blank	07/19/00	Volatile Organics
S1-123	MS/MSD	07/19/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
INT-233	MS/MSD	07/19/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients

Table 3
Summary of Requested Analyses

Parameter	Analysis Description	Method
VOA	Volatile organics Target compound list	SW846 - 8260
Semivolatiles	Semivolatile organics - Priority Pollutant list	SW846 - 8270
Pesticides/PCBs	Pesticides/PCBs - Priority Pollutant list	SW846 - 8080
Priority Pollutant Metals	Arsenic, Copper, Antimony, Beryllium, Cadmium, Chromium, Lead, Mercury, Nickel, Selenium, Silver, Thallium, Zinc	EPA 200.7 / SW 6010
TOC	Total Organic Carbon	EPA 415.1
Nutrients	Potassium	EPA 200.7 / SW 6010
	Ammonia as N	EPA 350.3
	Nitrate as N	EPA 353.2
	Orthophosphate (P)	EPA 365.2

1.1 Analytical Data Validation

All analytical data was validated manually for these samples. Table 4 outlines the QC checks made on this data as applicable to the analytical method. All analytical data met QA/QC requirements with the exception of those listed in Table 5. Field duplicate precision summaries, field and trip blank analytical summaries and MS/MSD analytical summaries are presented in Attachment C.

TABLE 4
QA/QC Validation Check Summary

Validation Check
Holding Time - Method stated time between date sampled and date of extraction or analysis.
Method Sequence - Method stated sequence of analyses for instrument calibration and duration of sample analysis time after compliant calibration.
Initial Calibration (%RSD & RRF) - Percent relative standard deviation(%RSD): Verifies linearity over the stated calibration range - method specific. Relative response factor(RRF): Criteria ensures adequate instrument sensitivity for method specified analytes.
Continuing Calibration (%D) - Method stated percent difference range for calibration verification
Internal Standard Response(where applicable) - A measure of instrument stability
Surrogate Recovery - Surrogate compounds are added to the analysis procedure at a known concentration to verify method effectiveness. Surrogate recoveries are method specific ranges used to qualify analytical results.
Method Blank and Trip Blank Cleanliness - Laboratory prepared sample to verify sampling and analytical procedures in a clean matrix
MS/MSD Recovery & Precision Data - Checks sampling, preparation and analysis accuracy and precision
Blind Field Duplicate(BFD) Precision - Checks sampling, preparation and analysis reproducibility

TABLE 4
QA/QC Validation Check Summary

Validation Check
Blind Field Duplicate(BFD) Precision - Checks sampling, preparation and analysis reproducibility

Table 5
QC Exception Summary - July 2000 Event

Problem	Comment
Internal std area count for naphthalene-d8 was outside control limits (low) for samples INT-237, Trip Blank#5 and INT-120.	Samples were not reanalyzed. Naphthalene is not a target analyte for this project. No corrective action necessary.
% recovery for chloroform on the end of analytical batch LCS from 07/24/00 was outside control limits (low).	The % recovery was based on a 50 ug/L purge, not a 5 ug/L purge. No corrective action required.
An incorrect surrogate solution was used for the pesticide/PCB analysis on samples INT-127, INT-127-D, INT-130RS, S1-123, INT-130R and INT-233.	The samples were initially extracted within holding times, but with the wrong surrogate solution added. The samples were subsequently extracted using the correct surrogate solution, but outside appropriate extraction holding times.
Surrogates were outside control limits for the semivolatile analysis of sample S1-123.	The sample was re-extracted one day outside appropriate extraction holding time and reanalyzed. All surrogates were within control limits for the second extraction/analysis.
Surrogate 12DCB-d4 was outside control limits for the semivolatile analysis of sample S1-106R.	The sample was re-extracted and reanalyzed. Surrogate 12DCB-d4 was outside control limits for the second extraction/analysis also.
The spike % recoveries for phenol and acenaphthene were outside control limits for the MSD on sample INT-120.	Precision (RPD) was within control limits for all compounds on the MS/MSD pair.
Precision (RPD) for 4-Nitrophenol was outside control limits for the MS/MSD pair on sample INT-233.	Acceptable spike % recovery ranges (accuracy) for this compound is very wide. The % recovery for the MS/MSD pair was 1% and 3% respectively.
Surrogate 12DCB-d4 was outside control limits for the semivolatile analysis of sample S1-108A.	The sample was not re-extracted and reanalyzed.
Surrogates 12DCB-d4 and Nbz-d5 were outside control limits for the semivolatile analysis of sample INT-022MS.	The sample was not re-extracted and reanalyzed.
Surrogate Nbz-d5 was outside control limits for the semivolatile analysis of sample INT-026.	The sample was not re-extracted and reanalyzed.
The spike for Hexachlorocyclopentadiene for the semivolatile analysis was outside control limits (low) for most of the Lab control samples (LCS) associated with the analysis of these samples.	No corrective action required.
Internal std area counts for the semivolatile analysis were outside control limits (low) for samples INT-022, INT-022MSD, S1-106A and S1-135.	Samples were INT-022, S1-106A and S1-135 were reanalyzed. The same internal std was still outside control limits. No corrective action required.
The Thallium spike % recovery was outside control limits (low) for all of the samples submitted for metals analysis.	The spike sample and spike sample duplicate % recoveries were both low for 24 of the samples (one sample delivery group). All of the LCS % recoveries for Thallium were within control limits. No corrective action required.
Arsenic values are estimated for 14 of the samples because of the presence of interference.	
The Mercury spike % recovery was outside control limits (low) for 14 of the samples submitted for metals analysis.	The spike sample and spike sample duplicate % recoveries were both low for 14 of the samples (one sample delivery group). All of the LCS % recoveries for Mercury were within control limits. No corrective action required.

Table 6
Field Duplicate QC Summary

Sample Name	Duplicate Name	Comments
INT-127	INT-127 Dup	SV: Di-N-butylphthalate RPD was 66.7%. Analyte also found in blank. Common lab contaminant. Nutrient: Ammonia-N RPD was 89.4%. Analyte detected just above detection limit of 0.1mg/L. Metals: Thallium RPD was 74.3%. Analyte apparently had some matrix interferences. See Table 5.
INT-134	INT-134 Dup	SV: Di-N-butylphthalate RPD was 66.7%. Analyte detected below detection limit ("J" qualifier). Common lab contaminant. Metals: Arsenic, nickel and zinc RPDs were 53.8%, 37.5% and 27.1% respectively.
S1-121	S1-121 Dup	SV: Bis(2-ethylhexyl)Phthalate and Di-N-butylphthalate RPDs were 100% and 66.7% respectively. %. Analyte detected below detection limit ("J" qualifier). Common lab contaminant. Metals: Nickel and zinc RPDs were 22.2% and 53.5% respectively.

1.2 Submissions

All samples were analyzed using appropriate methods and analysis sequences for the requested parameters. There were no QC issues with respect to calibration or (where applicable) internal standard or surrogate compound responses. All laboratory control samples reported results within acceptance limits. All field duplicate samples were readily reproducible for all parameters requested. All samples met project QC criteria except for those listed in Table 5.

The QC issues presented in Table 5 do not adversely affect the data for its intended use.

Historical analytical data summaries for all compliance wells are presented in Attachment A. Full analytical data summaries for all requested parameters are presented in Attachment B.

1.3 Data Evaluation

All analytical data was summarized and submitted to project consultants and management for review. All analytical data reports submitted by the laboratory were examined for completeness and validated prior to entering the data into the project database. Complete analytical packages from the lab are available for review upon request.

Attachment A

French Ltd. Project

Historical Analytical Summaries for Compliance Wells

(through July 2000)

Attachment B

French Ltd. Project

Analytical Summaries for Compliance Wells - July 2000 Event

Remedial Operations Group, Inc.

TO: Dick Sloan

FROM: Ron Jansen

CC: Jim Thomson

DATE: August 18, 2000

RE: French Ltd. Project - Semi-annual Groundwater Monitoring

Attached are the analytical results for the July 2000 semi-annual ground water monitoring event at the French Limited Site in Crosby, Texas. All wells were sampled using the 'hybrid' well purge method as described in Ron Jansen's memo dated June 30, 1999(see Attachment D).

1.0 Sampling Summary

A total of forty-two (42) groundwater monitoring wells were sampled on July 6, 7, 10, 11, 12,13, 14, 17 18 and 19, 2000. All samples were analyzed by American Analytical and Technical Services - Baton Rouge(AATS-BR) and the Remedial Operations Group, Inc. Lab at the Turtle Bayou Project. All samples were submitted to the lab under properly executed chain-of-custody documents. A sample collection summary is presented in Table 1. Table 2 lists the field QC samples with complete precision reports in Attachment C. A analysis description and methodology summary is presented in Table 3. The EPA contractor collected split samples on ten of the forty-two wells (S1-111, S1-121, S1-131, INT-026, INT-106, INT-123, INT-134, INT-135, INT-155 and INT-217). The data for the split samples was not available for evaluation at the printing of this report.

Table 1
Sample Collection Summary

Sample Number	Well / Sample Name	Date Collected	Analyses Requested
01558	S1-143	7/ 6/00	Volatile organics
01559	S1-144	7/ 6/00	Volatile organics
01560	S1-145	7/ 6/00	Volatile organics
01561	INT-237	7/ 6/00	Volatile organics
01562	INT-238	7/ 6/00	Volatile organics
01563	INT-234	7/ 7/00	Volatile organics
01564	INT-235	7/ 7/00	Volatile organics
01565	INT-236	7/ 7/00	Volatile organics
01566	FLTG-013	7/10/00	Volatile organics
01567	FLTG-014	7/10/00	Volatile organics
01568	INT-060-P-3	7/10/00	Volatile organics
01569	INT-108	7/10/00	Volatile organics
01570	INT-118	7/11/00	Volatile organics
01571	FLTG-013	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01572	FLTG-014	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01573	INT-060-P-3	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01574	INT-108	7/10/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01575	INT-118	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01576	INT-144	7/11/00	Volatile organics
01577	INT-214	7/11/00	Volatile organics
01579	S1-033	7/11/00	Volatile organics
01580	INT-144	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01581	INT-214	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01583	S1-033	7/11/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01584	S1-111	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01585	INT-135	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01586	S1-121	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients

Table 1
Sample Collection Summary

Sample Number	Well / Sample Name	Date Collected	Analyses Requested
01587	S1-121DUP	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01588	S1-131	7/12/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01589	S1-111	7/12/00	Volatile organics
01590	INT-135	7/12/00	Volatile organics
01591	S1-121	7/12/00	Volatile organics
01592	S1-121DUP	7/12/00	Volatile organics
01593	S1-131	7/12/00	Volatile organics
01594	FIELD BLK#1	7/12/00	Volatile organics
01595	TRIP BLK #1	7/12/00	Volatile organics
01596	TRIP BLK #2	7/12/00	Volatile organics
01597	INT-217	7/13/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01598	INT-106	7/13/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01599	INT-026	7/13/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01601	INT-217	7/13/00	Volatile organics
01602	INT-106	7/13/00	Volatile organics
01603	INT-026	7/13/00	Volatile organics
01605	FIELD BLANK	7/13/00	Volatile organics
01606	TRIP BLK #3	7/13/00	Volatile organics
01607	INT-123	7/14/00	Volatile organics
01608	INT-134	7/14/00	Volatile organics
01609	INT-155	7/14/00	Volatile organics
01610	S1-031	7/14/00	Volatile organics
01611	INT-134-D	7/14/00	Volatile organics
01612	FIELD BLANK	7/14/00	Volatile organics
01613	TRIP BLANK #4	7/14/00	Volatile organics
01614	INT-123	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01615	INT-134	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01616	INT-155	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01617	S1-031	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01618	INT-134-D	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01619	FIELD BLANK	7/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01620	S1-051-P-3	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01621	S1-106A	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01622	S1-108A	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01623	S1-118	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01624	S1-135	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01625	INT-022	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01626	INT-022MS	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01627	INT-022MSD	7/17/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01628	S1-051-P-3	7/17/00	Volatile organics
01629	S1-106A	7/17/00	Volatile organics
01630	S1-108A	7/17/00	Volatile organics
01631	S1-118	7/17/00	Volatile organics
01632	S1-135	7/17/00	Volatile organics
01633	INT-022	7/17/00	Volatile organics
01634	INT-022MS	7/17/00	Volatile organics

Table 1
Sample Collection Summary

Sample Number	Well / Sample Name	Date Collected	Analyses Requested
01635	INT-022MSD	7/17/00	Volatile organics
01636	INT-059-P-2	7/18/00	Volatile organics
01637	S1-106R	7/18/00	Volatile organics
01638	INT-101	7/18/00	Volatile organics
01639	INT-120	7/18/00	Volatile organics
01640	FIELD BLK	7/18/00	Volatile organics
01641	TRIP BLK#5	7/18/00	Volatile organics
01642	INT-059-P-2	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01643	S1-106R	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01644	INT-101	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01645	INT-120	7/18/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01646	INT-127	7/19/00	Volatile organics
01647	INT-127DUP	7/19/00	Volatile organics
01648	INT-130RS	7/19/00	Volatile organics
01649	S1-123	7/19/00	Volatile organics
01650	S1-123MS	7/19/00	Volatile organics
01651	S1-123MSD	7/19/00	Volatile organics
01652	INT-130R	7/19/00	Volatile organics
01653	INT-233	7/19/00	Volatile organics
01654	INT-233MS	7/19/00	Volatile organics
01655	INT-233MSD	7/19/00	Volatile organics
01656	FIELD BLK	7/19/00	Volatile organics
01657	TRIP BLK#6	7/19/00	Volatile organics
01658	INT-127	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01659	INT-127DUP	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01660	INT-130RS	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01661	S1-123	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01662	S1-123MS	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01663	S1-123MSD	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01664	INT-130R	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01665	INT-233	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01666	INT-233MS	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients
01667	INT-233MSD	7/19/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients

DUP suffix on well name indicates field duplicate

MS or MSD suffix on well name indicates MS/MSD QC set

Table 2
Quality Control / Quality Assurance Sample Summary

Sample Name	QC Type	Date Collected	Parameters
S1-121	FIELD DUP	07/12/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
Field Blank	Blank	07/12/00	Volatile Organics
Trip Blank	Blank	07/12/00	Volatile Organics
Trip Blank	Blank	07/12/00	Volatile Organics
Field Blank	Blank	07/13/00	Volatile Organics
Trip Blank	Blank	07/13/00	Volatile Organics
Field Blank	Blank	07/14/00	Volatile Organics
Trip Blank	Blank	07/14/00	Volatile Organics
Field Blank	Blank	07/14/00	Priority pollutant semivolatile organics, pesticides and metals; TOC and Nutrients

Table 2
Quality Control / Quality Assurance Sample Summary

Sample Name	QC Type	Date Collected	Parameters
INT-134	FIELD DUP	07/14/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
INT-022	MS/MSD	07/14/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
Trip Blank	Blank	07/18/00	Volatile Organics
Field Blank	Blank	07/18/00	Volatile Organics
INT-127	FIELD DUP	07/19/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
Trip Blank	Blank	07/19/00	Volatile Organics
Field Blank	Blank	07/19/00	Volatile Organics
S1-123	MS/MSD	07/19/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients
INT-233	MS/MSD	07/19/00	Priority pollutant volatile & semivolatile organics, pesticides and metals; TOC and Nutrients

Table 3
Summary of Requested Analyses

Parameter	Analysis Description	Method
VOA	Volatile organics Target compound list	SW846 - 8260
Semivolatiles	Semivolatile organics - Priority Pollutant list	SW846 - 8270
Pesticides/PCBs	Pesticides/PCBs - Priority Pollutant list	SW846 - 8080
Priority Pollutant Metals	Arsenic, Copper, Antimony, Beryllium, Cadmium, Chromium, Lead, Mercury, Nickel, Selenium, Silver, Thallium, Zinc	EPA 200.7 / SW 6010
TOC	Total Organic Carbon	EPA 415.1
Nutrients	Potassium	EPA 200.7 / SW 6010
	Ammonia as N	EPA 350.3
	Nitrate as N	EPA 353.2
	Orthophosphate (P)	EPA 365.2

1.1 Analytical Data Validation

All analytical data was validated manually for these samples. Table 4 outlines the QC checks made on this data as applicable to the analytical method. All analytical data met QA/QC requirements with the exception of those listed in Table 5. Field duplicate precision summaries are presented in Attachment C.

TABLE 4
QA/QC Validation Check Summary

Validation Check
Holding Time - Method stated time between date sampled and date of extraction or analysis.
Method Sequence - Method stated sequence of analyses for instrument calibration and duration of sample analysis time after compliant calibration.
Initial Calibration (%RSD & RRF) - Percent relative standard deviation(%RSD): Verifies linearity over the stated calibration range - method specific. Relative response factor(RRF): Criteria ensures adequate instrument sensitivity for method specified analytes.
Continuing Calibration (%D) - Method stated percent difference range for calibration verification
Internal Standard Response(where applicable) - A measure of instrument stability
Surrogate Recovery - Surrogate compounds are added to the analysis procedure at a known concentration to verify method effectiveness. Surrogate recoveries are method specific ranges used to qualify analytical results.
Method Blank and Trip Blank Cleanliness - Laboratory prepared sample to verify sampling and analytical procedures in a clean matrix
MS/MSD Recovery & Precision Data - Checks sampling, preparation and analysis accuracy and precision
Blind Field Duplicate(BFD) Precision - Checks sampling, preparation and analysis reproducibility

Table 5
QC Exception Summary - July 2000 Event

Problem	Comment
Internal std area count for naphthalene-d8 was outside control limits (low) for samples INT-237, Trip Blank#5 and INT-120.	Samples were not reanalyzed. Naphthalene is not a target analyte for this project. No corrective action necessary.
% recovery for chloroform on the end of analytical batch LCS from 07/24/00 was outside control limits (low).	The % recovery was based on a 50 ug/L purge, not a 5 ug/L purge. No corrective action required.
An incorrect surrogate solution was used for the pesticide/PCB analysis on samples INT-127, INT-127-D, INT-130RS, S1-123, INT-130R and INT-233.	The samples were initially extracted within holding times, but with the wrong surrogate solution added. The samples were subsequently extracted using the correct surrogate solution, but outside appropriate extraction holding times.
Surrogates were outside control limits for the semivolatile analysis of sample S1-123.	The sample was re-extracted one day outside appropriate extraction holding time and reanalyzed. All surrogates were within control limits for the second extraction/analysis.
Surrogate 12DCB-d4 was outside control limits for the semivolatile analysis of sample S1-106R.	The sample was re-extracted and reanalyzed. Surrogate 12DCB-d4 was outside control limits for the second extraction/analysis also.
The spike % recoveries for phenol and acenaphthene were outside control limits for the MSD on sample INT-120.	Precision (RPD) was within control limits for all compounds on the MS/MSD pair.
Precision (RPD) for 4-Nitrophenol was outside control limits for the MS/MSD pair on sample INT-233.	Acceptable spike % recovery ranges (accuracy) for this compound is very wide. The % recovery for the MS/MSD pair was 1% and 3% respectively.
Surrogate 12DCB-d4 was outside control limits for the semivolatile analysis of sample S1-108A.	The sample was not re-extracted and reanalyzed.
Surrogates 12DCB-d4 and Nbz-d5 were outside control limits for the semivolatile analysis of sample INT-022MS.	The sample was not re-extracted and reanalyzed.
Surrogate Nbz-d5 was outside control limits for the semivolatile analysis of sample INT-026.	The sample was not re-extracted and reanalyzed.
The spike for Hexachlorocyclopentadiene for the semivolatile analysis was outside control limits (low) for most of the Lab control samples (LCS) associated with the analysis of these samples.	No corrective action required.
Internal std area counts for the semivolatile analysis were outside control limits (low) for samples INT-022, INT-022MSD, S1-106A and S1-135.	Samples were INT-022, S1-106A and S1-135 were reanalyzed. The same internal std was still outside control limits. No corrective action required.
The Thallium spike % recovery was outside control limits (low) for all of the samples submitted for metals analysis.	The spike sample and spike sample duplicate % recoveries were both low for 24 of the samples (one sample delivery group). All of the LCS % recoveries for Thallium were within control limits. No corrective action required.
Arsenic values are estimated for 14 of the samples because of the presence of interference.	
The Mercury spike % recovery was outside control limits (low) for 14 of the samples submitted for metals analysis.	The spike sample and spike sample duplicate % recoveries were both low for 14 of the samples (one sample delivery group). All of the LCS % recoveries for Mercury were within control limits. No corrective action required.

1.2 Submissions

All samples were analyzed using appropriate methods and analysis sequences for the requested parameters. There were no QC issues with respect to calibration or (where applicable) internal standard or surrogate compound responses. All laboratory control samples reported results within acceptance limits. All field duplicate samples were readily reproducible for all parameters requested. All samples met project QC criteria except for those listed in Table 5.

The QC issues presented in Table 5 do not adversely affect the data for its intended use.

Historical analytical data summaries for all compliance wells are presented in Attachment A. Full analytical data summaries for all requested parameters are presented in Attachment B.

1.3 Data Evaluation

All analytical data was summarized and submitted to project consultants and management for review. All analytical data reports submitted by the laboratory were examined for completeness and validated prior to entering the data into the project database. Complete analytical packages from the lab are available for review upon request.

Attachment A

French Ltd. Project

Historical Analytical Summaries for Compliance Wells

(through July 2000)

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
FLTG-013

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/09/92	FL 00597														11	< 10	7	16	4	< 10
07/15/92	FL 00598														< 5	< 10	< 5	< 5	< 5	< 10
09/29/92	FL 00599														< 5	5	7	< 5	< 5	< 10
12/14/92	FL 00600														< 5	< 10	3	< 5	3	< 10
12/29/93	FL 00601														< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00602	800	2.6		7.82	21				8.1	0.93	< 0.1	< 2	< 2	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
01/16/96	FL 00604	300	1.8		7.4	21				< 5	1.13	< 0.1	0.41	< 0.1	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
04/12/96	FL 00605	350	1.8		7.44	21				4.4	1.06	< 0.1	< 0.2	< 0.1	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
07/22/96	FL 00607	345	0.1		7.01	22				< 1	1.1	< 0.1	< 0.05	0.075	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
10/07/96	FL 00608	600	1	2.37	6.9	23				3.4	1.12	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 10
01/24/97	FL 00609	490	0.3	1.99	6.61	20				5.8	0.942	< 0.1	< 0.2	< 0.1	< 5	< 10	J 2	23	< 5	3
03/22/97	FL 00662			1.47																
04/14/97	FL 00708	400	0.4	1.61	6.73	20				4.8	0.89	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00763			1.36																
07/14/97	FL 00809	400	0.2	2.86	6.75	23				4.6	0.944	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00851			3.99																
09/11/97	FL 00910			4.54																
10/06/97	FL 00969			4.03																
10/14/97	FL 01028	500	0.3	4.03	7.02	22.8				3.9	1.2	0.11	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
01/19/98	FL 01068	450	0.6	1.42	7.16	19				7.7	1.78	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/15/98	FL 01125	1000	0.7	1.38	7.02	21				5	1	< 0.1	1.5	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/21/98	FL 01175	500	0.2	5.57	7.13	23				4.7	1.04	< 0.1	< 0.02	< 0.1						
07/21/98	FL 01184														< 5	< 20	< 5	< 5	< 10	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
FLTG-013

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/20/99	FL 01245	565	0.8	1.75	6.39	21.5				4.4	1.08	< 0 1	< 0.2	0.11						
01/20/99	FL 01251														< 5	< 20	< 5	< 5	< 10	< 2
07/08/99	FL 01390			2.03																
07/13/99	FL 01327	500	1.8	2.44	6.73	22									< 5	< 20	< 5	< 5	< 10	< 2
07/13/99	FL 01321									5.8	0.97	< 0.1	< 0.2	< 0.1						
01/11/00	FL 01491			2.67																
01/12/00	FL 01449	502	1.8	2.66	7.02	21				5.3	1030	0.2	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/10/00	FL 01571							< 0.5	< 1.8	6	927	< 0.1	< 0.2	0.34						
07/10/00	FL 01566	520	0.07	2.71	6.66	24.2									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
FLTG-014

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/09/92	FL 00610														2	< 10	< 5	6	< 5	< 10
07/15/92	FL 00611														< 5	< 10	< 5	< 5	< 5	< 10
09/29/92	FL 00612														< 5	< 10	6	< 5	< 5	< 10
12/14/92	FL 00613														< 5	< 10	2	< 5	2	< 10
12/29/93	FL 00614														< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00615	1000	2.4		7.77	21				8.2	1.82	< 0.1	< 2	< 2	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
01/16/96	FL 00617	220	1.4		7.15	19				< 3	1.3	0.5	< 0.2	< 0.1	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
04/12/96	FL 00618	300	1.7		7.03	22				5.9	1.61	0.7	< 0.2	< 0.1	< 0.8	< 6	7	< 5	3	< 1.2
07/22/96	FL 00620	390	0.1		6.97	22				< 1	1.8	0.87	< 0.05	0.37	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
10/07/96	FL 00621	1100	1.4	1.74	6.61	24				5.6	1.81	0.6	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 10
01/24/97	FL 00622	419	0.15	1.63	6.81	18				7.8	1.65	0.7	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
03/22/97	FL 00663			1.21																
04/14/97	FL 00709	350	0.4	1.31	6.76	20				6.4	1.59	0.6	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00764			1.05																
07/14/97	FL 00810	600	0.2	2.36	6.53	26				7.5	2.31	1.11	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00852			3.54																
09/11/97	FL 00911			4.2																
10/06/97	FL 00970			3.76																
10/14/97	FL 01029	450	0.4	3.76	6.88	23.7				6.4	1.9	1.43	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
01/19/98	FL 01069	350	0.5	1.26	7.28	19				8.4	1.8	0.62	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/15/98	FL 01126	950	0.6	1.24	6.99	19				5.9	1.5	0.93	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/21/98	FL 01176	400	2.4	5.23	7.04	25				5.3	2.11	0.73	< 0.02	< 0.1						
07/21/98	FL 01185														< 5	< 20	< 5	< 5	< 10	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
FLTG-014

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/20/99	FL 01246	554	0.8	1.44	6.32	20				5.2	1.42	0.32	< 0.2	0.11						
01/20/99	FL 01252														< 5	< 20	< 5	< 5	< 10	< 2
07/08/99	FL 01391			1.57																
07/13/99	FL 01328	780	1.8	2.09	6.56	25									< 5	< 20	< 5	< 5	< 10	< 2
07/13/99	FL 01322									10.5	1.2	0.2	< 0.2	0.11						
01/11/00	FL 01492			2.43																
01/12/00	FL 01450	460	1.8	2.47	6.89	20				6.6	1300	< 0.1	< 0.2	0.1	< 5	< 10	< 5	J 4	< 5	< 2
07/10/00	FL 01572							< 0.5	< 1.8	7.5	1430	0.18	< 0.2	0.34						
07/10/00	FL 01567	470	0.41	3.22	6.61	26.7									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-022

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/04/95	FL 00632									160										
10/02/95	FL 00633	850	4.2		7.09	24				25	83.8	0.8	16.7	< 0.2	9	< 6	9	< 0.5	< 0.5	19
01/17/96	FL 00634	550	1.8		6.88	23	21	< 10	< 5	< 0.4	31.7	0.8	2	2.6	< 0.8	< 6	44	< 0.5	3	26
04/12/96	FL 00635	600	1.6		6.9	21				4.2	33.1	0.4	0.24	< 0.1	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
07/22/96	FL 00637	650	0.2		7.21	22				< 1	39	0.13	0.07	0.08	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
10/07/96	FL 00638	875	0.8	5.29	7.01	23				4.1	28.8	0.3	< 0.2	< 0.1	< 5	< 10	4	< 5	3	< 10
01/24/97	FL 00639	775	0.2	4.88	6.81	21				6.5	27.9	0.2	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
03/22/97	FL 00664			3.8																
04/15/97	FL 00725	650	0.2	4.12	6.91	21				4.2	27.2	0.3	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00765			3.85																
07/15/97	FL 00827	650	0.2	4.68	6.79	23				4.6	24.1	0.4	< 0.2	< 0.2	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00853			5.27																
09/11/97	FL 00912			5.48																
10/06/97	FL 00971			4.91																
10/14/97	FL 01030	550	0.3	4.91	6.69	22.4				5.4	23.9	0.67	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
01/20/98	FL 01086	350	0.6	2.2	7.51	21				5.2	24.1	0.12	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/13/98	FL 01113	700	0.6	3.91	6.98	21				6	22.3	0.51	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/22/98	FL 01192	700	0.2	5.9	6.75	24				7.6	22.8	0.37	< 0.2	< 0.1						
07/22/98	FL 01203														< 5	< 20	< 5	< 5	< 10	< 2
01/22/99	FL 01273	838	0.7	3.89	6.34	22									< 5	< 20	J 1	< 5	< 10	J 2
01/22/99	FL 01281									8.3	23.5	0.43	0.03	0.1						
07/08/99	FL 01392			3.88																
07/16/99	FL 01356									12	19.9	0.26	< 0.2	< 0.1						
07/16/99	FL 01357	850	1.4	4.08	6.8	23.5									< 5	< 20	< 5	< 5	< 10	J 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-022

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/07/00	FL 01493			4.42																
01/17/00	FL 01467	558	2	4.43	7.73	22				9.6	16.2	< 0 1	< 0.2	0.1	< 5	< 10	J 3	< 5	< 5	< 2
07/17/00	FL 01633	670	0.01	4.55	6.79	25									< 5	< 5	< 5	< 5	< 5	J 3
07/17/00	FL 01625							< 0.5	< 1.8	9.5	16300	0.33	< 0.2	0.1						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-026

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/04/95	FL 00642									107										
01/17/96	FL 00643	800	2.5		6.37	22				<3	926	1.2	4	586	<0.8	<6	180	<0.5	7	<1.2
04/12/96	FL 00644	550	1.2		6.95	21				47.3	82.4	1.6	<0.2	37.4	<0.8	<6	98	<5	<0.5	<1.2
07/22/96	FL 00646	900	0.1		7	24				27.6	78	2	<0.05	35	<0.8	<6	100	<5	<0.5	<1.2
10/07/96	FL 00647	1000	0.7	3.68	6.95	23.5				34.1	43.7	1.5	<0.2	36.3	<5	<10	75	<5	<5	<10
01/24/97	FL 00648	810	0.2	2.56	7.22	20.5				27.5	18.7	0.6	<0.2	9.4	<5	<10	24	<5	<5	<2
03/22/97	FL 00665			2.52																
04/16/97	FL 00734	500	0.1	2.68	6.97	20				22	15.9	1.4	<0.2	6.9	<5	<10	24	<5	<5	<2
05/31/97	FL 00766			2.33																
07/16/97	FL 00836	800	0.1	3.15	6.69	22				17.6	11.3	1.2	<0.2	7.1	<5	<10	38	<5	<5	<2
07/16/97	FL 00846			3.15																
08/18/97	FL 00854			3.23																
09/11/97	FL 00913			3.05																
10/06/97	FL 00972			2.67																
10/14/97	FL 01031	510	0.2	2.67	6.52	22.4				31.8	7.8	1.86	<0.2	5.8	<5	<10	89	<5	<5	<2
01/21/98	FL 01095	285	0.4	2.05	7.27	21				11.9	5.22	0.27	<0.2	2.6	<5	<10	5	<5	<5	<2
02/17/98	FL 01128	1000	0.7	2.06	6.72	21				20.7	6	0.85	<0.2	3.8	<5	<10	49	<5	<5	<2
07/23/98	FL 01214	1000	0.2	2.82	6.35	24				89.4	4.08	<0.1	0.4	<0.1						
07/23/98	FL 01221														<5	<20	D 280	<5	J 3	3
01/27/99	FL 01299	1039	0.7	2.08	6.36	22									<10	<40	380	<10	J 3	<4
01/27/99	FL 01302									82.5	4.22	0.5	<0.2	<0.1						
07/08/99	FL 01393			1.56																
07/21/99	FL 01368									66.3	3.6	0.1	0.2	0.1						
07/21/99	FL 01373	800	1.3	1.5	6.7	23								.	<5	<5	D 290	<5	J 1	<2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-026

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/10/00	FL 01494			1.87																
01/19/00	FL 01480	559	2	1.87	6.84	22				83.7	3.25	0.2	< 0.2	0.3	< 5	< 10	290	< 5	2	< 2
07/13/00	FL 01603	865	0.03	1.98	6.5	25.5									< 5	< 5	D 330	< 5	< 5	< 2
07/13/00	FL 01599							< 0.5	< 1.8	71.7	3230	< 0.1	< 0.2	0.4						

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-060-P-3

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/18/96	FL 00009	500	15		6.77	22				<3	37.9	<0.1	41.6	0.2	<0 8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00010	850	15		7.02	21				2.2	118	0.1	112	<0.1	<0.8	<6	25	<5	11	<1.2
07/22/96	FL 00012	1380	15		7.14	24				<1	120	<0.1	100	0.065	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00013	1425	13	6.06	7.06	24.5				1.4	124	<0.1	91	<0.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00014	1150	9.7	4.99	7.17	21				4	85.6	<0.1	74.4	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00667			4.87																
04/14/97	FL 00710	900	9.8	5.07	7.11	21				3.3	59	<0.1	50.5	<0 1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00768			4.66																
07/14/97	FL 00811	1280	15	5.82	7.42	23				1.6	95.5	<0.1	91.2	5.1	<5	<10	<5	<5	<5	<2
08/18/97	FL 00856			5.78																
09/11/97	FL 00915			5.65																
10/06/97	FL 00974			5.21																
10/15/97	FL 01048	610	3.4	5.21	7.23	23.8				4.1	46.8	<0.1	32.7	<0.1	<5	<10	<5	<5	<5	<2
01/19/98	FL 01070	750	2.8	4.6	7.59	22				4	60	<0.1	45	0.1	<5	<10	<5	<5	<5	<2
02/15/98	FL 01123	1000	5.5	4.42	7.17	23				2.6	81.1	<0.1	70.5	<0.1	<5	<10	<5	<5	<5	<2
07/22/98	FL 01193	1200	2.8	5.55	7.09	24				1.2	106	<0.1	105	<0.1						
07/22/98	FL 01204														<5	<20	<5	<5	<10	<2
01/20/99	FL 01247	1287	4.7	4.68	6.67	23				2.4	45	<0.1	61	0.19						
01/20/99	FL 01253														<5	<20	<5	<5	<10	<2
07/08/99	FL 01395			5.8																
07/13/99	FL 01324									2.4	51.9	<0.1	76	0.12						
07/13/99	FL 01329	1200	3.4	4.46	7.16	24									<5	<20	<5	<5	<10	<2
01/11/00	FL 01496			4.58																
01/12/00	FL 01451	994	3.5	4.59	7.3	22.5				5.3	86.8	<0.1	60	0.1	<5	<10	<5	<5	<5	<2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
int-060-p-3

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/10/00	FL 01573							< 0.5	< 1.8	4.5	89400	< 0.1	48.8	0.39						
07/10/00	FL 01568	960	0.12	4.79	7.04	25.5									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-101

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
12/02/91	FL 00017	3000	2.2		7.1	30.2	80	< 20	< 25		3.5			7.5	1400	640	1800	< 500	< 500	2300
06/25/92	FL 00018									263		0.42	< 0.05	< 0.01	1100	< 100	2500	< 50	65	1300
09/27/92	FL 00019										3.7	< 0.1	< 0 02	1.8	530	< 250	1200	< 120	< 120	680
12/11/92	FL 00020	2500	2.8		6.97	20.06	46	< 4	< 30	251	16.3	0.45	< 0.05	0.01	< 250	< 500	2100	< 250	< 250	440
03/25/93	FL 00021	1900	2.7		11.38	20.8				208		0.2	< 0.05	0.03	1400	< 100	1100	66	57	270
06/22/93	FL 00022	2300	4.7		6.94	23.1				229	1.24	0.25	< 0.05	0.04	110	< 100	1100	< 50	< 50	220
09/10/93	FL 00023									173	2.02	0.25	< 0.05	0.5	622	< 10	1233	< 5	35	843
12/29/93	FL 00024						103	< 4	< 41	104	< 1120		< 0.05	0.11	26	< 30	497	< 2.5	25	< 6
12/29/93	FL 00025	1000	2.9		6.76	22														
03/22/94	FL 00026	1050	1		6.82	22														
03/22/94	FL 00027														33	< 30	535	< 2.5	18	24
06/07/94	FL 00028	1200	2.2		6.78	22									< 0.8	< 6	1000	< 0.5	21	140
09/05/94	FL 00029	1300	1.6			24						0.11	4.7	< 0.2	< 4	< 30	840	< 2.5	30	< 6
12/21/94	FL 00030	1550	2.6		6.74	21	130	< 2.6	< 2.5		1.66	0.14	< 2	< 2	< 4	< 30	530	< 2.5	< 2.5	< 6
12/21/94	FL 00031									39										
03/12/95	FL 00032	1000	0.1		6.75	21									< 2	< 15	290	< 1.25	< 1.25	< 3
03/12/95	FL 00033										0.91	< 0.1	< 0.2	0.3						
04/04/95	FL 00034	850	0.5		6.85	22				89					< 4	28	380	< 2.5	< 2.5	< 6
04/04/95	FL 00035										1.07	< 0.1	< 0.2	< 0.2						
05/05/95	FL 00036	480	0.3		6.67	23				60	0.97	< 0.1	< 0.7	< 0.7	< 1.6	< 12	220	< 1	< 1	< 2.4
06/06/95	FL 00037										1.65	0.1	< 0.2	0.3	< 1.6	< 12	220	< 1	< 1	< 2.4
06/06/95	FL 00038	1100	0.3		6.74	23														
07/05/95	FL 00039	890	0.8		6.76	23				85	1.28	< 0.1	< 0.1	< 0.1	< 0.8	< 6	160	< 0.5	< 0.5	< 1.2
08/02/95	FL 00040	700	0.3		6.53	23				86	1.25	< 0.1	< 0.1	< 0.1	< 2	< 15	400	< 1.25	< 1.25	< 3

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-101

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
09/01/95	FL 00041	850	0.3		6.37	23				112	1.52	<0.1	<0.2	<0.2	<2.664	<19.98	420	<1.665	<1.665	<3.996
10/02/95	FL 00042	400	1.7		7.14	24				99	0.7	<0.1	<0.2	<0.2	<0.8	150	300	<0.5	<0.5	<1.2
11/01/95	FL 00043	530	0.3		6.59	24				92	1.26	<0.1	<0.2	<0.2	<0.8	<6	120	<0.5	<0.5	<1.2
12/15/95	FL 00044	500	0.5		6.85	23	115	<10	<5	84	1.39	<0.1	<0.2	<0.1	<2.64	<19.8	218	<1.65	<1.65	<3.96
01/22/96	FL 00045	500	1		6.97	23	96	<10	<5	<3	0.694	<0.1	<0.2	<0.1	<0.8	<6	120	<0.5	<0.5	<1.2
04/12/96	FL 00046	470	1.4		6.79	21	60	<10	<5	29.4	0.66	<0.1	<0.2	0.48	<0.8	<6	36	<5	<0.5	<1.2
07/22/96	FL 00048	600	0.03		6.75	22	60	<10	<3	8.8	0.63	<0.1	<0.05	0.64	<0.8	<6	36	<5	<0.5	<1.2
10/07/96	FL 00049	650	0.9	5.48	6.99	23	65	<10	<5	12.5	0.611	<0.1	<0.2	0.2	<5	<10	33	<5	<5	<10
01/24/97	FL 00050	700	0.4	4.99	7.48	21	36	<10	<5	7.4	0.534	<0.1	<0.2	0.2	<5	<10	9	<5	<5	<2
03/22/97	FL 00668			4.03																
04/15/97	FL 00730	400	0.5	4.41	7.58		36	<10	<5	4.2	0.944	<0.1	<0.2	0.2	<5	<10	<5	J1	<5	<2
05/31/97	FL 00769			4.12																
07/16/97	FL 00832	400	0.1	4.95	6.82	22	48	<10	<5	5.8	0.619	<0.1	<0.2	0.3	<5	<10	11	<5	<5	<2
08/18/97	FL 00857			5.66																
09/11/97	FL 00916			5.96																
10/06/97	FL 00975			5.27																
10/14/97	FL 01032	420	0.2	5.27	7.18	22.6	39	<10	<5	5.5	0.68	<0.1	0.3	0.2	<5	<10	9	<5	<5	<2
01/21/98	FL 01091	550	0.4	4.2	7.58	20	43	<10	<5	3.6	0.796	<0.1	<0.2	0.4	<5	<10	<5	<5	<5	<2
02/17/98	FL 01132	1050	0.8	4.27	7.22	22	59	<10	<5	5.2	0.86	<0.1	0.4	0.3	<5	<10	5	<5	<5	<2
07/24/98	FL 01229	750	0.3	7.02	7.01	23	160	<10	<5	32.6	0.822	<0.1	<0.2	<0.1						
07/24/98	FL 01237														J3	<20	57	<5	<10	9
01/25/99	FL 01291	592	1.9	4.58	6.65	23	98	<10	<5	9	0.526	<0.1	<0.02	0.2						
01/25/99	FL 01295														<5	<20	7	<5	<10	<2
07/08/99	FL 01396			4.43																

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-101

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/21/99	FL 01364						92	< 10	< 5	8.1	0.55	0.1	0.2	0.1						
07/21/99	FL 01369	550	1.4	4.56	7.18	24.5									< 5	< 5	8	< 5	< 5	< 2
01/11/00	FL 01497			4.91																
01/18/00	FL 01476	439	1.6	4.97	7.15	23	104	< 0.5	2.1	5.6	0.76	< 0.1	< 0.2	0.2	< 5	< 10	6	< 5	< 5	< 2
07/18/00	FL 01644						78.5	< 0.5	< 1.8	11	815	< 0.1	< 0.2	0.2						
07/18/00	FL 01638	570	0.13	5.22	7.02	25.1									< 5	< 5	6	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-106

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
12/02/91	FL 00055				7.61		20	< 20	< 25		2.2		0.09	10	250	27	< 10	40	< 10	< 20
12/19/92	FL 00056									145	2.13	< 0.1	< 0.05	< 0.01	< 500	6800	< 500	< 500	< 500	< 1000
12/21/92	FL 00057	1300	2.2		6.99	20														
03/24/93	FL 00058	1350	3.2		11.13	21.9				91	3.24	0.24	< 0.05	< 0.01	1900	< 500	180	< 250	< 250	< 500
06/24/93	FL 00059									21					290	170	24	< 5	3	10
06/25/93	FL 00060	600	5.2		6.13	24.1														
09/15/93	FL 00061	900	2.2			26.2				25	11.4	2.2	0.21	0.02	415	< 10	37	< 5	5	171
12/29/93	FL 00062	900	15		7.45	21.2				< 1	1.89	0.11	68	0.09	91	< 6	< 0.3	< 0.5	< 0.5	11
03/22/94	FL 00063	800	15		7.38	22									3	< 6	< 0.3	< 0.5	< 0.5	< 1.2
06/07/94	FL 00064	800	15		7.16	22									330	< 60	< 3	< 5	< 5	< 12
12/21/94	FL 00065	800	15		7.6	24					13	< 0.1	24.7	< 2	3	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00066									3.1										
03/12/95	FL 00067	1100	0.7		6.78	23									200	< 15	13	< 1.25	< 1.25	24
03/12/95	FL 00068										3.83	< 0.1	3.1	< 0.2						
04/04/95	FL 00070										3.38	< 0.1	1.4	< 0.2						
04/04/95	FL 00069	1100	0		6.75	23				34					220	< 15	20	< 1.25	< 1.25	23
05/05/95	FL 00071	1250	0.4		6.67	24				47	3.3	< 0.1	2.3	< 0.7	140	< 6	23	< 0.5	< 0.5	17
06/06/95	FL 00072	1050	0.5		6.74	23					3.56	< 0.1	1.5	< 0.2	140	< 6	31	< 0.5	< 0.5	20
07/05/95	FL 00073	1060	0.8		6.69	23				51	3.02	< 0.1	< 0.1	< 0.1	200	< 6	33	< 0.5	< 0.5	23
08/02/95	FL 00074	950	0.3		6.56	23				51	3.01	< 0.1	0.7	< 0.1	110	< 6	22	< 0.5	< 0.5	23
09/01/95	FL 00075	800	0.3		6.57	23				44	3.37	< 0.1	0.5	< 0.2	60	< 6	14	< 0.5	< 0.5	16
10/02/95	FL 00076	600	0.3		6.45	23				102	2.8	< 0.1	0.8	< 0.2	52	43	9	< 0.5	< 0.5	20
11/01/95	FL 00077	525	0.3		6.83	23					2.26	< 0.1	2.3	< 0.2	37	< 6	6	< 0.5	< 0.5	8
12/15/95	FL 00078	550	0.4		7.03	23				30	3.12	< 0.1	13.4	< 0.1	43	< 6	< 0.3	< 0.5	< 0.5	9

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-106

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/17/96	FL 00079	550	0.4		6.93	23				< 1.2	2.66	< 0.1	3	< 0.1	22	< 6	< 0.3	< 0.5	< 0.5	< 1.2
04/12/96	FL 00080	600	1.4		7.1	21				22.2	2.51	< 0.1	< 0.2	< 0.1	63	< 6	6	< 5	< 0.5	< 1.2
07/22/96	FL 00082	900	0.1		7.16	22				10.7	2.4	0.11	< 0.05	0.09	54	< 6	4	< 5	< 0.5	< 1.2
10/07/96	FL 00083	1050	0.6	2.82	7.35	24				23.6	1.71	0.1	< 0.2	< 0.1	30	< 10	10	< 5	< 5	< 10
01/24/97	FL 00084	1050	0.2	1.63	6.97	21				27.1	1.9	< 0.1	< 0.2	< 0.1	< 5	< 10	5	< 5	< 5	< 2
03/22/97	FL 00669			1.5																
04/15/97	FL 00733	650	0.2	0.39	6.99	21				11.9	2.48	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00770			0.91																
07/16/97	FL 00835	1250	0.2	2.91	7.4	23				5.6	2	< 0.1	< 0.2	< 0.2	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00858			3.66																
09/11/97	FL 00917			3.73																
10/06/97	FL 00976			3.04																
10/15/97	FL 01049	670	0.4	3.04	6.9	22.7				17.2	2	0.23	< 0.2	< 0 1	J 4	< 10	J 3	< 5	< 5	5
01/21/98	FL 01094	220	0.6	1.1	7.62	21				10.4	1.93	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/17/98	FL 01130	1000	0.4	1.83	7.2	21				8.6	2.3	< 0.1	0.7	0.1	5	< 10	< 5	< 5	< 5	< 2
07/23/98	FL 01215	700	0.2	4.12	6.48	24				19.6	2.03	< 0.1	0.6	< 0.1						
07/23/98	FL 01222														30	< 20	J 4	< 5	< 10	8
01/27/99	FL 01298	868	1	1.5	6.55	23									170	< 20	10	< 5	< 10	69
01/27/99	FL 01301									14.2	2.36	0.1	7.5	< 0.1						
07/08/99	FL 01397			1.57																
07/21/99	FL 01367									16.7	2.6	0.1	10	0.1						
07/21/99	FL 01372	850	1.3	1.27	6.86	23									180	< 5	9	< 5	< 5	82
01/07/00	FL 01498			1.86																
01/19/00	FL 01479	645	2.3	1.7	6.86	22				10.9	2.33	< 0.1	12.8	0.1	220	< 200	< 100	< 100	< 100	54

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-106

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
05/23/00	FL 01550														120	<5	8	<5	<5	41
05/23/00	FL 01551										1.7	<0.1	5.8	<0.2						
07/13/00	FL 01602	800	0.11	3.03	6.84	25.8									79	<5	6	<5	<5	24
07/13/00	FL 01598							<0.5	<1.8	17.6	1880	<0.1	3.3	0.3						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-108

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
12/02/91	FL 00087	3400	1.8		6.63	18.4	100	< 20	< 25		36		< 0.02	86	120	21000	700	< 25	150	< 50
12/19/92	FL 00088	2300	2.2		7	22.9				343	30.4	< 0.1	< 0.05	0.06	< 50	< 100	1400	< 50	310	< 100
03/24/93	FL 00089	2150	2.2		7.35	22.2				344	46.2	3.2	< 0.05	1.3	< 50	< 100	790	< 50	120	< 100
06/24/93	FL 00090									128					< 25	< 50	380	< 25	20	< 50
06/26/93	FL 00091	1360	1.8		7.17	25.1														
09/15/93	FL 00092									29	31.6	9.5	< 0.05	11	< 5	< 10	21	< 5	< 5	< 10
12/29/93	FL 00093									19	16.3	2.24	< 0.05	6	< 0.8	< 6	29	< 0.5	6	< 1.2
03/22/94	FL 00094	392	2.3		7.22	21														
03/22/94	FL 00095														< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
06/07/94	FL 00096	600	0.6		6.37	23									< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00098									14										
12/21/94	FL 00097	400	2.1		6.97	25					8.5	1.1	< 2	4.4	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
05/05/95	FL 00099	460	1.5		6.58	23									< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
05/05/95	FL 00100										22	3.2	< 0.2	1.6						
06/06/95	FL 00101	390	1.4		6.59	22														
08/02/95	FL 00102	480	1.5		6.46	25				13	44.1	< 0.1	0.5	1.9	25	< 6	3	< 0.5	< 0.5	< 1.2
09/01/95	FL 00103	320	0.6		6.45	27				5										
09/01/95	FL 00104														7	< 6	< 0.3	< 0.5	< 0.5	< 1.2
09/01/95	FL 00105										41.8	0.61	1.8	0.4						
10/02/95	FL 00106	400	1.2		6.37	23				5.7										
10/02/95	FL 00107										41.7	0.3	2.7	0.4	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
11/01/95	FL 00108	420	3		6.49	25				10	33	0.3	< 0.2	0.6	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/15/95	FL 00109	410	3.8		6.76	23				7	9.8	1	< 0.2	0.27	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
01/16/96	FL 00110	390	0.6		6.8	23				< 0.4	41.4	0.2	4	0.82	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-108

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/12/96	FL 00111	450	1.5		7.19	21				5.5	39.3	<0.1	1.2	0.9	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00113	750	0.1		6.99	26				<1	43	0.38	<0.05	1.1	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00114	800	0.7	4.91	6.66	24.5				4.8	35.4	0.6	<0.2	1.9	<5	<10	<5	<5	<5	<10
01/24/97	FL 00115	700	0.2	3.59	6.78	20				8.1	34	0.9	<0.2	2.3	<5	<10	<5	<5	<5	<2
03/22/97	FL 00670			3.57																
04/14/97	FL 00711	600	0.4	3.83	6.85	21				4.9	35.5	<0.1	<0.2	1.3	<5	<10	<5	<5	<5	<2
05/31/97	FL 00771			3.3																
07/14/97	FL 00812	680	0.2	4.57	6.96	24				5.3	33.2	0.46	<0.2	2.1	<5	<10	<5	<5	<5	<2
08/18/97	FL 00859			4.77																
09/11/97	FL 00918			4.61																
10/06/97	FL 00977			4.16																
10/14/97	FL 01034	650	0.4	4.16	6.64	23.9				5.9	39.4	0.88	<0.2	2.3	<5	<10	<5	<5	<5	<2
01/19/98	FL 01071	650	0.6	3.4	7.19	21				5.7	35.1	0.25	0.2	2.5	<5	<10	<5	<5	<5	<2
02/12/98	FL 01109	700	0.6	3.28	6.85	23				5.8	34.7	8.34	<0.2	2.4	10	<10	<5	<5	<5	<2
07/21/98	FL 01177	675	0.4	4.53	6.85	26				8.4	31.4	0.68	<0.02	2.4						
07/21/98	FL 01186														<5	<20	<5	<5	<10	<2
01/20/99	FL 01248	736	0.7	3.49	6.39	23.5				11.6	26.8	0.6	<0.2	2.06						
01/20/99	FL 01254														<5	<20	<5	<5	<10	<2
07/08/99	FL 01398			3.1																
07/13/99	FL 01325									13.7	27.6	1.1	<0.2	4.2						
07/13/99	FL 01330	700	1.6	3.33	6.61	25									<5	<20	<5	<5	<10	<2
01/10/00	FL 01499			3.26																
01/12/00	FL 01452	593	1	3.35	6.7	23				13.6	29.2	0.4	<8	4.3	<5	<10	<5	<5	<5	<2
07/10/00	FL 01574							0.92	<1.8	13.5	28700	55	<0.2	2.3						

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-108

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/10/00	FL 01569	590	0.11	3.7	6.56	26.7									<5	<5	<5	<5	<5	<2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-118

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
05/22/92	FL 00128														< 5	< 10	< 5	< 5	< 5	< 10
12/17/92	FL 00129	355	3.9		7.01	24.4				1.5					< 5	< 10	< 5	< 5	< 5	< 10
12/29/93	FL 00130									4.2										
12/29/93	FL 00131	800	2.5		8.04	22									4	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00132	280	2		8.11	240	< 3.9	5.9	< 2.5		2.62	< 0.1	< 2	< 2	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00133									5										
12/15/95	FL 00134	210	1.3		8.19	24				2.4					< 0 8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
01/15/96	FL 00135	245	1.1		8.25	24	< 10	< 10	< 5	5	1.17	< 0.1	0.2	< 0.1	< 0.8	< 6	< 0.3	< 0.5	< 0 5	< 1.2
04/12/96	FL 00136	400	4.6		8.6	22	< 10	< 10	< 5	< 2	3.48	< 0.1	371	< 0 1	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
07/22/96	FL 00138	300	5.4		9.76	24	< 10	< 10	< 3	< 1	4.3	< 0.1	0.39	0.026	< 0 8	< 6	< 0.3	< 5	2	< 1.2
10/07/96	FL 00139	400	1.2	10	8.56	25	< 10	< 10	< 5	1.4	1.54	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 10
01/24/97	FL 00140	310	0.2	10.12	8.28	23	< 10	< 10	< 5	2.7	0.942	0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
03/22/97	FL 00671			8.25																
04/14/97	FL 00712	480	4.6	8.6	10.48	23	< 10	< 10	< 5	1.1	6.96	< 0.1	0.8	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00772			8.03																
07/14/97	FL 00813	200	0.2	9.26	9.44	24	< 10	< 10	< 5	1.2	4.76	< 0.1	0.3	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00861			10.13																
09/11/97	FL 00920			10.67																
10/06/97	FL 00979			9.96																
10/14/97	FL 01035	280	0.1	9.96	8.46	24.9	< 10	< 10	< 5	< 1	1.2	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
01/19/98	FL 01072	350	0.7	8.31	8.58	23	< 10	< 10	< 5	< 1	0.78	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/13/98	FL 01116	350	0.7	8.46	7.92	24	< 10	< 10	< 5	< 1	1	< 0.1	6.6	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/22/98	FL 01205														< 5	< 20	< 5	< 5	< 10	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-118

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/98	FL 01194	300	0.1	11.81	7.98	25	< 10	< 10	< 5	< 1	1.17	< 0 1	< 0.2	< 0.1						
01/20/99	FL 01249	363	0.8	8.91	7.27	24	< 10	< 10	< 5	< 1	0.802	< 0 1	< 0.2	0.13						
01/20/99	FL 01255														< 5	< 20	< 5	< 5	< 10	< 2
07/08/99	FL 01400			9.26																
07/13/99	FL 01326						< 10	< 10	< 5	2	0.81	< 0.1	< 0.2	0.14						
07/13/99	FL 01331	300	3.2	9.42	9.54	25.5									< 5	< 20	< 5	< 5	< 10	< 2
01/11/00	FL 01501			10.45																
01/12/00	FL 01453	329	1.8	10.46	8.05	24.5	2.2	< 0.5	< 1 5	3.4	0.893	< 0.1	< 8	0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/11/00	FL 01575							< 0.5	< 1.8	< 1	662	< 0.1	< 0.2	0.27						
07/11/00	FL 01570	370	0.14	9.22	7.7	26.1									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-120

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
03/25/93	FL 00142									2660	1.59	< 0.1	< 0 05	0.05	2900	34000	1200	< 2500	< 2500	6000
06/22/93	FL 00143									42	< 0.934	0.07	< 0.05	0.04	630	680	110	< 25	20	19
12/21/94	FL 00145	800	2		6.98	22									10000	< 600	< 30	1700	< 50	< 120
12/21/94	FL 00146											0.15	< 2	< 2						
03/12/95	FL 00147	600	0.4		6.59	24														
03/12/95	FL 00148										3.15	< 0.1	12.8	< 0.2						
04/04/95	FL 00149	700	3.5		6.86	23				21	4.4	0.1	16.8	< 0.2	46000	4600	< 75	< 125	< 125	640
06/06/95	FL 00150	700	15		7.32	24														
06/06/95	FL 00151										8.96	0.2	21.3	< 0.2	1500	160	< 3	< 5	< 5	< 12
07/05/95	FL 00152	700	15		7.61	24				11	22.1	< 0.1	45.4	< 0.1	1200	180	< 3	< 5	< 5	< 12
08/02/95	FL 00153		15			23				32										
09/01/95	FL 00155										66.8	< 0.1	24.4	< 0.2						
09/01/95	FL 00154	800	15		7.15	30				23					1400	160	13	4	5	50
10/02/95	FL 00156	900	15		7.14	25				12	63.3	0.2	32.2	< 0.2	1200	57	8	7	3	26
11/01/95	FL 00157	825	13.5		7.05	24				32	54.2	< 0.1	19.7	< 0.2	320	< 300	< 15	< 25	< 25	< 60
12/15/95	FL 00158	1300	3.8		7.33	23				18	94.1	< 0.1	329	37.4	1400	< 120	< 6	< 10	< 10	< 24
01/23/96	FL 00159	900	15		7.18	24				150	834	0.94	36.1	470	8400	< 300	< 15	< 25	< 25	260
04/12/96	FL 00160	750	1.6		7.05	22				4.4	122	0.9	23.3	21.6	21	< 15	5	< 12	< 1.25	< 3
07/22/96	FL 00162	1350	0.12		7.86	23				< 1	130	0.25	66	10	87	< 6	3	< 5	< 0.5	10
10/07/96	FL 00163	1350	1.1	8.84	7.52	25				2.6	107	0.4	21.1	4.1	34	< 10	5	< 5	< 5	< 10
01/24/97	FL 00164	1300	0.2	7.45	7.59	21				4	83.6	0.3	47.4	3.5	27	< 10	J 4	< 5	< 5	3
03/22/97	FL 00672			7.46																
04/15/97	FL 00731	1050	0.3	7.75	7.25	22				3.1	65.6	0.5	31	3.8	34	< 10	13	< 5	< 5	2
05/31/97	FL 00773			7.25																

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-120

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/16/97	FL 00833	1050	0.1	8.57	8.32	24				4.4	88.5	0.18	38.4	2.2	16	< 10	J 4	< 5	< 5	< 2
08/18/97	FL 00862			8.97																
09/11/97	FL 00921			8.87																
10/06/97	FL 00980			8.41																
10/15/97	FL 01050	1150	0.2	8.41	7.49	25.2				3.5	73.5	0.54	33.1	2.2	360	< 50	44	< 25	< 25	< 10
01/21/98	FL 01092	1100	0.6	7.34	7.38	22				4.2	63.6	0.24	26.5	2.4	160	< 10	9	< 5	< 5	6
02/18/98	FL 01141	1200	0.7	7.12	7.08	22				9.8	104	0.18	57.5	1.2	420	J 12	J 6	J 7	< 12	25
07/23/98	FL 01216	1350	0.2	9.01	6.88	25				2.5	121	< 0.1	62.6	< 0.1						
07/23/98	FL 01223														33	< 20	J 3	J 4	< 10	14
01/25/99	FL 01292	1373	0.8	7.52	6.93	21				2.3	94.8	0.2	55.1	0.71						
01/25/99	FL 01296														27	< 40	J 4	< 10	< 20	J 25
07/08/99	FL 01401			7.36																
07/21/99	FL 01365									17.7	101	0.1	59	0.29						
07/21/99	FL 01370	1300	4.6	7.25	7.49	23.5									< 5	< 5	J 2	< 5	< 5	20
01/10/00	FL 01502			7.54																
01/18/00	FL 01477	975	4.6	7.59	7.87	23.5				< 1	98.6	< 0.1	68.4	0.3	10	< 10	J 2	< 5	< 5	8
07/18/00	FL 01645						5.2	< 0.5	< 1.8	2.1	105000	< 0.1	56.6	0.4						
07/18/00	FL 01639	1270	0.12	8.08	7.15	26.8									8	< 5	< 5	< 5	< 5	20

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-123

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/16/93	FL 00166														10000	1700	<5	<5	11	250
12/21/94	FL 00167	750	4.8		9.84	20.7					57	0.12	<2	<2	1200	<60	<3	<5	<5	230
12/21/94	FL 00168									9.1										
03/12/95	FL 00169										45	0.23	37.5	<0.2	1200	200	<3	<5	<5	220
04/04/95	FL 00170	900	15		9.02	22				25	23.9	0.2	16.1	<0.2	12000	3200	<30	<50	<50	1300
05/05/95	FL 00391	820	15		8.18	24				7										
05/05/95	FL 00392										44	<0.1	36.5	<0.2	1700	140	<3	<5	<5	260
06/06/95	FL 00393	950	15		8.53	28					63.1	<0.1	43.1	<0.2	1000	200	<3	<5	<5	100
07/05/95	FL 00394	700	15		9.25	24				9	64.2	<0.1	39.5	<0.1	920	<60	<3	<5	<5	220
08/02/95	FL 00395	700	15		9.11	26				6	75	<0.1	40.5	<0.1	610	38	12	<0.5	3	300
09/01/95	FL 00396	410	15		8.04	25				7					1200	120	7	<0.5	<0.5	240
09/01/95	FL 00397										76	<0.1	28.4	<0.2						
10/02/95	FL 00398	500	15		9.42	24				3	61.8	<0.1	37.4	<0.2	220	36	6	<0.5	<0.5	82
11/01/95	FL 00399	500	15		6.92	23				7	68	<0.1	30.2	<0.2	200	<6	8	<0.5	<0.5	70
12/15/95	FL 00400	495	15		7.2	23				8	68.4	<0.1	119	4.14	580	<30	<1.5	<2.5	<2.5	77
01/23/96	FL 00401	500	15		8.63	24				<3	73.6	<0.1	25.6	0.74	120	20	<0.3	<0.5	<0.5	15
04/12/96	FL 00402	500	6.4		8.2	22				4.2	58.9	<0.1	23.2	0.37	210	<12	<0.6	<10	<1	<2.4
07/22/96	FL 00404	800	0.79		9.66	23				<1	62	<0.1	21	0.27	270	<6	2	<5	<0.5	3
10/07/96	FL 00405	900	2	9.19	9.61	25				4.2	53.3	0.1	20.1	0.2	300	<10	5	<5	<5	<10
01/24/97	FL 00406	925	4.6	7.88	10.67	23				4.3	54.3	0.1	23.3	0.2	280	<20	28	<10	J7	16
03/22/97	FL 00673			7.64																
04/16/97	FL 00739	700	8.6	7.97	10.61	22				4	51.5	0.2	19.2	<0.1	150	<10	<5	<5	<5	4
05/31/97	FL 00774			7.45																
07/16/97	FL 00840	650	15	9.1	9.96	24				2.5	60	<0.1	27.3	0.3	110	<10	<5	<5	<5	5

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-123

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
08/18/97	FL 00863			9.75																
09/11/97	FL 00922			9.73																
10/06/97	FL 00981			9.21																
10/15/97	FL 01051	710	9.4	9.21	7.38	25				2.1	69	0.12	27.8	0.1	140	< 10	< 5	< 10	< 5	< 2
01/22/98	FL 01099	700	13.6	7.22	10.32	21				< 1	60.3	< 0.1	26.7	0.2	190	< 20	< 10	< 10	< 10	< 4
02/19/98	FL 01144	700	12.5	7.54	8.32					2.1	70.3	< 0.1	28.2	0.3	190	< 20	J 5	< 10	< 10	44
07/24/98	FL 01230	1000	1	10.25	7.65	25				3.6	93.6	< 0.1	53.4	< 0.1						
07/24/98	FL 01238														140	< 20	J 3	< 5	< 10	50
01/28/99	FL 01306	543	1	8.02	8.13	23				8.5	21.2	0.7	8.4	0.61						
01/28/99	FL 01315														14	< 20	J 4	< 5	< 10	42
07/08/99	FL 01402			8.05																
07/22/99	FL 01376									12.1	24.7	1	5	1.2						
07/22/99	FL 01389														< 5	< 5	< 5	< 5	< 5	27
01/10/00	FL 01503			8.12																
01/20/00	FL 01484	230	1.9	8.31	7.64	22				1.4	16.5	< 0.1	5.2	1.51	10	< 10	< 5	21	< 5	< 2
07/14/00	FL 01614						12.3	6.4	< 1 8	6.4	48900	< 0.1	16.4	0.49						
07/14/00	FL 01607	620	5	9.21	9.28	25.2									13	< 5	J 3	< 5	< 5	25

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-127

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/16/93	FL 00409														4700	7000	110	< 5	63	530
12/21/94	FL 00410	850	4.2		7.61	24					23	< 0.1	< 2	< 2	90	28	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00411									14.8										
03/12/95	FL 00412	900	6.6		7.19	22					1.74	0.39	12.8	< 0.2	120	930	200	< 5	63	70
04/04/95	FL 00413	2220	5.4		6.76	23				192	19.5	0.3	2.8	0.4	180	4300	360	< 12.5	110	120
05/05/95	FL 00414	1500	7.78		6.57	24				175										
05/05/95	FL 00415										20	0.2	8.8	0.4	100	1900	300	< 5	84	120
06/06/95	FL 00416										13.7	< 0.1	3.2	< 0.2	< 26 664	3700	270	< 16.665	75	< 39 996
06/06/95	FL 00417	1800	1.3		6.48	24														
07/05/95	FL 00418	1420	1.4		6.47	24				145	83.6	0.9	34.1	< 0 1	12	< 6	< 0.3	< 0.5	< 0 5	28
08/02/95	FL 00419	1190	3.2		6.53	24				124	8.64	< 0 1	5	< 0.1	< 0.8	740	220	< 0.5	63	20
09/01/95	FL 00420	650	3.1		6.64	24				98					14	640	140	< 0.5	38	6
09/01/95	FL 00421										10.3	< 0 1	< 0 2	< 0.2						
10/02/95	FL 00422	750	0.5		6.45	24				144	6.18	< 0.1	3.3	< 0.2	< 0 8	E 320	120	< 0 5	39	< 1 2
11/01/95	FL 00423	750	0.7		6.93	23				9	3.11	< 0 1	0.2	< 0.2	< 0.8	36	140	< 0.5	34	< 1.2
12/15/95	FL 00424	700	1.7		6.8	23				90	11.1	0.1	24.1	0.18	< 0 8	84	140	< 0.5	36	< 1.2
01/22/96	FL 00425	750	2		6.31	24				77.7	6.01	0.1	4	< 0 1	< 0 8	120	150	< 0.5	37	< 1.2
04/12/96	FL 00426	850	0.8		6.73	22				70	10.9	0.7	47.9	< 0 1	< 0 8	< 6	160	< 5	34	< 1.2
07/22/96	FL 00428	1650	0.1		6.68	23				44	14	0.85	< 0 05	0.027	< 8	< 60	170	< 50	43	< 12
10/07/96	FL 00429	1750	0.7	2.39	6.31	26				78.3	9.17	0.6	< 0.2	< 0.1	< 5	< 10	200	< 5	50	< 10
01/24/97	FL 00430	1710	0.2	1	6.73	22				76.6	11	0.4	< 0 2	< 0.1	< 10	< 20	180	< 10	44	< 4
03/22/97	FL 00674			0.72																
04/16/97	FL 00736	1200	0.1	1.15	6.81	22				54.3	12.9	0.5	< 0.2	< 0.1	< 5	< 10	65	< 5	13	< 2
05/31/97	FL 00775			0.8																

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-127

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/16/97	FL 00837	1250	0.1	2.25	6.77	26				50.1	16.1	0.72	< 0.2	< 0.2	< 5	< 10	67	< 5	7	< 2
08/18/97	FL 00864			2.8																
09/11/97	FL 00923			2.73																
10/06/97	FL 00982			2.16																
10/15/97	FL 01052	140	0.3	2.16	7.92	26.3				10.3	3.3	0.14	< 0.2	< 0.1	< 5	12	< 5	< 5	< 5	< 2
01/22/98	FL 01096	160	0.4	0.3	7.2	22				4.5	2.03	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/18/98	FL 01136	800	0.6	0.61	7.3	22				5.2	2.2	0.22	< 0 2	< 0.1	< 5	< 10	5	< 5	< 5	< 2
07/24/98	FL 01239														< 5	< 20	59	< 5	J 3	< 2
07/24/98	FL 01231	1400	15	3.44	6.29	28				46	7.84	< 0 1	1.2	< 0.1						
01/28/99	FL 01303	625	4	0.64	6.4	23				9.8	4.83	0.4	0.6	< 0 1						
01/28/99	FL 01312														< 5	< 20	J 3	< 5	< 10	< 2
07/08/99	FL 01403			1.45																
07/22/99	FL 01374									50.9	5.8	0.2	2	< 0 1						
07/22/99	FL 01382	1550	1.4	0.8	6.72	26.5									< 5	< 5	150	< 5	19	< 2
01/06/00	FL 01504			1.96																
01/19/00	FL 01481	924	1.8	1.17	6.32	24				57.8	5.13	< 0.1	1.2	0.1	< 10	< 20	120	< 10	14	< 4
07/19/00	FL 01646	1470	0.3	1.98	6.66	29.5									< 5	< 5	180	< 5	J 5	< 2
07/19/00	FL 01658						128	< 0 5	< 1 8	61.5	4980	0.13	< 0 2	0.1						
08/07/00	FL 01669														< 5	< 5	160	< 5	< 5	< 5
08/08/00	FL 01681														< 5	< 5	180	< 5	6	< 5
08/09/00	FL 01693														< 5	< 5	180	< 5	6	< 5

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-130R

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/93	FL 00432									3.1					45	< 10	< 5	2	< 5	< 10
12/21/94	FL 00433									16.6										
04/12/96	FL 00434	850	1.7		7.43	26				12.7	1.46	< 0 1	30.6	< 0 1	500	< 1000	< 500	10000	< 500	< 1000
07/22/96	FL 00435	900	1.4		7.47	23				2.9	2.4	0.2	32	< 0.1	450	< 6	27		5	< 1.2
10/07/96	FL 00436	925	2.1	2.45	7.21	25				11.9	1.64	0.2	32	< 0.1	450	< 1000	< 500	9500	< 500	< 1000
01/24/97	FL 00437	975	0.3	0.89	7.55	22				13.5	1.58	0.1	33	< 0.1	260	< 10	49	7600	9	4
03/22/97	FL 00675			0.7																
04/16/97	FL 00742	800	0.2	0.71	7.6	22				10.9	1.41	0.1	30.6	< 0 1	220	< 10	29	8300	< 5	< 2
05/31/97	FL 00776			0.8																
07/16/97	FL 00843	750	0.1	2.52	7.36	24				10.2	1.36	0.13	31.9	< 0.2	226	< 10	36	10000	< 5	< 2
08/18/97	FL 00865			3.31																
09/11/97	FL 00924			3.47																
10/06/97	FL 00983			2.79																
10/15/97	FL 01054	780	0.2	2.79	7.44	25.3				12.8	1.9	0.2	34.6	< 0.1	E 460	< 10	52	10000	< 5	8
01/22/98	FL 01102	790	0.4	0.6	7.3	22				7.7	4.14	< 0.1	26.8	0.1	9	< 10	< 5	4100	< 5	< 2
02/18/98	FL 01139	750	0.5	1.15	7.47	23				10.1	1.6	0.14	34.3	< 0.1	J 330	< 1000	< 500	12000	< 500	< 200
04/15/98	FL 01163										1.24	< 0 1	31.5	< 0 1	J 390	< 1000	< 500	12000	< 500	< 1000
04/15/98	FL 01162										1.32	< 0 1	34.3	< 0 1	J 350	< 1000	< 500	13000	< 500	< 1000
07/24/98	FL 01233	850	0.2	3.91	7.2	25				20.4	1.1	< 0.1	45	0.1						
07/24/98	FL 01241														210	< 40	49	D 9200	< 20	42
01/29/99	FL 01309	828	1	1.04	6.93	23.5				15.7	1.02	< 0 1	29.1	< 0.1						
01/29/99	FL 01318														180	< 20	63	D 12000	< 10	25
07/08/99	FL 01404			1.36																
07/22/99	FL 01387	900	1.4	0.75	7.46	26.5									J 140	< 200	J 68	D 13000	< 200	< 200

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
int-130r

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/99	FL 01378									17.1	1	0.1	25	< 0 1						
01/10/00	FL 01505			1.3																
01/20/00	FL 01487	710	2	1.6	7.23	22.5				14.1	1.04	< 0.1	23	< 0.1	160	< 100	82	10000	< 50	29
07/19/00	FL 01652	790	0.1	2.8	7.01	26.9									D 200	< 5	42	D 15000	< 5	28
07/19/00	FL 01664						3.3	< 0.5	< 1 8	18.3	1140	< 0.1	15.4	0.1						
08/07/00	FL 01670														190	< 5	43	D 9000	< 5	22
08/08/00	FL 01682														< 500	< 500	< 500	D 17000	< 500	< 500
08/09/00	FL 01694														< 500	< 500	< 500	D 19000	< 500	< 500

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-130RS

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/93	FL 00438									3.1					45	< 10	< 5	2	< 5	< 10
12/21/94	FL 00439									16.6										
04/12/96	FL 00440	900	2.1		7.24	25				17.4	1.82	< 0.1	23.2	< 0 1	1800	< 200	< 100	2600	< 100	180
07/22/96	FL 00441	1050	0.1		7.16	23				2.9	3.3	< 0.1	20	0.1	290	< 6	21	8600	< 0.5	250
10/07/96	FL 00442	1100	0.6	2.85	6.89	26				15.9	1.89	0.1	17.5	< 0 1	100	< 250	< 120	2800	< 120	180
01/24/97	FL 00443	1100	0.2	2.2	7.21	22				20.8	2.02	< 0 1	14	< 0 1	130	< 10	34	1900	J 1	250
03/22/97	FL 00676			1.15																
04/16/97	FL 00738	900	0.2	1.44	7.11	21				16.9	1.52	< 0 1	12.5	< 0.1	65	< 10	25	1100	< 5	160
05/31/97	FL 00777			1.09																
07/16/97	FL 00847			2.91																
07/16/97	FL 00839	900	0.2	2.91	7.03	24				15.4	1.48	< 0.1	12.7	< 0 2	64	< 10	31	1100	< 5	180
08/18/97	FL 00866			3.73																
09/11/97	FL 00925			3.86																
10/06/97	FL 00984			2.18																
10/15/97	FL 01055	850	0.1	2.18	7.21	25.5				16	1.4	0.13	10	< 0 1	110	< 10	36	1200	< 5	160
01/22/98	FL 01098	550	0.4	0.98	6.98	22				12	1.53	< 0 1	3.6	0.1	7	< 10	< 5	63	< 5	10
02/18/98	FL 01142	750	0.5	1.07	7.14	23				13.6	1.5	< 0.1	9.3	< 0 1	370	< 250	< 125	2000	< 125	< 50
04/15/98	FL 01161										1.2	< 0.1	22.7	< 0 1	760	J 230	< 250	5800	< 250	< 500
04/15/98	FL 01160										1.24	< 0.1	23.8	< 0 1	780	< 500	< 250	4900	< 250	< 500
07/24/98	FL 01234	750	0.2	4.35	6.88	25				17.5	1.22	< 0.1	20.3	0.1						
07/24/98	FL 01242														97	< 40	27	D 1700	< 20	73
01/28/99	FL 01305	804	0.8	1.35	6.49	24				18.4	1.08	0.2	11.1	< 0 1						
01/28/99	FL 01314														480	< 400	J 36	1700	< 200	J 170
07/08/99	FL 01405			1.78																

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
int-130rs

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/99	FL 01375									20.2	1.2	0.1	13	< 0.1						
07/22/99	FL 01384	900	1.5	1.05	7.03	26.5									D 1200	< 5	31	D 2200	< 5	D 230
01/10/00	FL 01506			1.71																
01/19/00	FL 01482	614	5.6	1.99	7.1	24				19.8	0.976	< 0.1	15.9	0.1	630	< 100	J 26	3000	< 50	66
07/19/00	FL 01648	750	0.04	3.2	6.65	26.8									240	< 5	41	D 2900	< 5	210
07/19/00	FL 01660						5.8	< 0.5	< 1.8	20.8	1190	< 0.1	3.5	0.1						
08/07/00	FL 01671														140	< 5	49	D 1800	< 5	300
08/08/00	FL 01683														< 200	< 200	< 200	2800	< 200	< 200
08/09/00	FL 01695														< 200	< 200	< 200	3000	< 200	< 200

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-134

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/28/99	FL 01307	1104	0.8	9.68	6.91	22.5				45.3	2.15	< 0.1	16.8	0.16						
01/28/99	FL 01316														110	< 20	30	< 5	< 10	190
07/08/99	FL 01406			9.69																
07/22/99	FL 01385	1100	1.5	9.7	7.34	25									85	< 5	24	< 5	< 5	190
07/22/99	FL 01377									31.5	2	1.3	22	0.1						
01/07/00	FL 01507			10.23																
01/20/00	FL 01485	823	1.8	10.3	7.33	22				22.9	1.57	< 0 1	17.2	0.13	51	< 10	7	< 5	< 5	59
07/14/00	FL 01615						3.3	< 0.5	< 1.8	17	1860	< 0.1	25.4	0.22						
07/14/00	FL 01608	900	0.07	10.64	7.15	24.7									57	< 5	5	< 5	< 5	86

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-135

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
06/07/94	FL 00465	700	0.4		7.09	2									40	< 12	< 0.6	< 1	< 1	160
12/21/94	FL 00466	650	6.8		7.2	23	< 3.9	7.5	2.6		1.95	< 0.1	< 2	< 2	66	< 12	6	< 1	< 1	300
12/21/94	FL 00467									11										
05/05/95	FL 00468	600	0.2		7.4	23														
06/06/95	FL 00469	475	1.5		7.14	23														
07/05/95	FL 00470	480	1		6.99	23				6	0.999	< 0.1	< 0.1	< 0.1	51	< 6	< 0.3	< 0.5	< 0.5	120
08/02/95	FL 00471	400	1.4		6.82	23				22										
12/15/95	FL 00472	325	3.8		6.98	23				10	1.15	< 0.1	0.52	< 0.1	29	< 12	< 0.6	< 1	< 1	146
01/17/96	FL 00473	440	1		6.95	23	< 10	< 10	< 5	< 3	1.16	< 0.1	2.2	< 1	15	< 6	< 0.3	< 0.5	< 0.5	66
04/12/96	FL 00474	500	1		6.88	23	20	< 10	< 5	14.3	1.19	0.1	< 0.2	< 0.1	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
07/22/96	FL 00476	820	0.15		6.76	22	22	< 10	< 3	8.1	1.2	0.11	< 0.05	0.039	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
10/07/96	FL 00477	800	0.8	12.06	6.76	24	23	< 10	< 5	11.8	1.14	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 10
01/24/97	FL 00478	700	0.2	11.62	6.75	22	28	< 10	< 5	16	1.24	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
03/22/97	FL 00678			10.43																
04/14/97	FL 00713	600	1.8	10.7	6.56	22	12	< 10	8	13.3	1.13	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00779			10.6																
07/14/97	FL 00814	625	0.2	11.54	6.74	24	29	< 10	< 5	13.7	1.24	0.14	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00868			12.3																
09/11/97	FL 00927			12.49																
10/06/97	FL 00986			11.92																
10/14/97	FL 01037	650	0.6	11.92	6.79	23.8	30	< 10	< 5	13.4	1.4	0.17	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
01/19/98	FL 01073	825	0.9	10.58	7.22	23	30	< 10	< 5	13.7	1.22	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/12/98	FL 01108	700	0.6	10.71	6.78	22	110	< 10	< 5	13.1	8.84	0.26	0.2	< 0.1	6	< 10	< 5	< 5	< 5	13
04/30/98	FL 01168						21	< 10	< 5		1.29	< 0.1	0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 10

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-135

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/30/98	FL 01169						19	< 10	< 5		1.26	< 0.1	0.3	0.1	5	< 10	< 5	< 5	< 5	12
07/22/98	FL 01206														J 5	< 20	< 5	< 5	< 10	7
07/22/98	FL 01195	675	0.3	13.58	6.71	24	17	< 10	< 5	13.3	1.4	0.1	< 0.2	< 0.1						
01/20/99	FL 01250	840	0.8	10.72	6.19	23	24	< 10	< 5	17.2	1.22	0.19	< 0.02	0.15						
01/21/99	FL 01256														6	< 20	J 2	< 5	: 10	J 14
07/08/99	FL 01407			10.9																
07/14/99	FL 01332						29	< 10	< 5	17.5	1.4	0.1	1	0.1						
07/14/99	FL 01336	780	1.9	11.02	7.05	23.5									11	< 20	< 5	< 5	< 10	24
01/07/00	FL 01508			11.45																
01/13/00	FL 01454	732	1.4	11.46	6.56	23	31.6	< 0.5	< 1.5	15.2	1.3	< 0.1	2.6	0.1	20	< 10	5	< 5	< 5	29
07/12/00	FL 01590	790	0.07	11.84	6.34	25									7	< 5	< 5	< 5	< 5	11
07/12/00	FL 01585							< 0.5	< 1.8	24.6	1510	0.11	0.9	0.23						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-144

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
05/04/94	FL 00498				9.04															
05/05/94	FL 00499	440	2			22														
12/21/94	FL 00500	420	3.3		8.68	20														
12/21/94	FL 00501										2.63	0.17	<20	<2	<0.8	<6	<0.3	<0.5	3	9
12/21/94	FL 00502									7.3										
03/12/95	FL 00503	390	0.5		8.91	22									2	<6	<0.3	<0.5	<0.5	4
03/12/95	FL 00504										2.17	<0.1	<0.2	<0.2						
04/04/95	FL 00505	425	1.5		9.01	21				0	1.23	<0.1	<0.2	<0.2	<0.8	7	<0.3	<0.5	<0.5	5
05/05/95	FL 00506	400	0.2		8.38	23				1										
05/05/95	FL 00507										1.27	<0.1	<0.2	<0.2	<0.8	150	<0.3	<0.5	<0.5	<1.2
06/06/95	FL 00508	350	2.6		8.75	22					1.81	<0.1	<0.2	<0.2	<0.8	<6	<0.3	<0.5	<0.5	<1.2
07/05/95	FL 00509	380	2.3		8.41	22				1.6	0.948	<0.1	<0.1	<0.1	<0.8	<6	<0.3	<0.5	<0.5	<1.2
08/02/95	FL 00510	350	1		8.23	22				12	1.15	<0.1	<0.1	<0.1	<0.8	<6	<0.3	<0.5	<0.5	<1.2
10/02/95	FL 00511	300	0.3		8.04	23				0	0.65	<0.1	<0.2	<0.2	<0.8	<6	<0.3	<0.5	<0.5	4
11/01/95	FL 00512	270	0.7		8.47	22				2	1.32	<0.1	<0.2	<0.2	<0.8	<6	<0.3	<0.5	<0.5	<1.2
12/15/95	FL 00513	300	0.7		8.8	21				1.5	1.2	<0.1	<0.2	0.2	<0.8	<6	<0.3	<0.5	<0.5	3
01/15/96	FL 00514	310	0.7		8.63	23	<10	<10	<5	<3	0.94	0.2	<0.2	<0.1	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00515	325	2.4		8.84	21	20	<10	<5	<2	1.03	<0.1	<0.2	<0.1	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00517	370	1.8		9.66	21	17	<10	<3	<1	0.95	<0.1	0.12	0.1	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00518	925	2.4	15.62	9.11	23.5	17	<10	<5	<1	0.857	<0.1	<0.2	<0.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00519	320	1.6	15.17	9.37	21	18	<10	<5	1.4	0.889	<0.1	0.2	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00679			13.82																
04/14/97	FL 00714	300	0.5	13.91	9.31	21	16	<10	7	1.2	4.57	<0.1	0.7	<0.1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00780			14.03																
07/15/97	FL 00815	300	1.2	15.16	8.35	22	14	<10	<5	1.2	2.88	<0.1	0.2	0.2	<5	<10	<5	<5	<5	<2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-144

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
08/18/97	FL 00869			15.91																
09/11/97	FL 00928			16.04																
10/06/97	FL 00987			15.52																
10/14/97	FL 01038	330	0.2	15.52	9.01	22.7	14	< 10	< 5	< 1	1.4	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	3
01/19/98	FL 01074	400	1.1	14.05	9.37	22	16	< 10	< 5	3.7	2.17	< 0.1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
02/13/98	FL 01115	400	0.6	14.15	8.75	21	11	< 10	< 5	< 1	1.9	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	12
05/04/98	FL 01173						< 10	< 10	< 5		0.88	< 0.1	3.4	< 0.1	6	< 10	< 5	< 5	< 5	30
05/04/98	FL 01172						< 10	< 10	< 5		0.81	< 0.1	1.9	< 0.1	J 4	< 10	< 5	< 5	< 5	16
07/22/98	FL 01196	500	12.4	17.25	8.51	22	< 10	< 10	< 5	< 1	0.89	< 0.1	4.8	0.1						
07/22/98	FL 01207														6	< 20	< 5	< 5	< 10	9
01/21/99	FL 01257	483	3.3	14.15	7.84	22	10	< 10	< 5	< 1	1.15	< 0.1	6.1	0.17						
01/21/99	FL 01264														J 4	< 20	< 5	< 5	< 10	< 2
07/08/99	FL 01408			14.53																
07/14/99	FL 01333						< 10	< 10	< 5	< 1	0.79	< 0.1	8	0.1						
07/14/99	FL 01337	420	4.7	14.52	8.69	22.5									< 5	< 20	< 5	< 5	< 10	J 7
01/07/00	FL 01509			15.04																
01/13/00	FL 01455	412	3.8	15.05	8.57	22	11.5	< 0.5	< 1.5	2.5	0.87	< 0.1	13.8	0.1	J 4	< 10	< 5	< 5	< 5	8
07/11/00	FL 01580							< 0.5	< 1.8	< 1	854	< 0.1	8.6	0.29						
07/11/00	FL 01576	510	6.7	15.75	8.29	24.5									< 5	< 5	< 5	< 5	< 5	J 4

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-155

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
08/18/97	FL 00903			8.12																
09/11/97	FL 00962			8.67																
10/06/97	FL 01021			8.14																
07/08/99	FL 01444			6.94																
01/10/00	FL 01545			7.39																
07/14/00	FL 01616						< 1.7	< 0.5	< 1.8	5.5	1360	< 0.1	14.4	0.18						
07/14/00	FL 01609	630	0.14	8.04	7.49	24.9									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-214

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
02/05/95	FL 00525														7	<6	19	<0.5	<0.5	61
01/18/96	FL 00526	700	1		6.9	23				<0.7	188	0.2	5.5	60.6	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00527	575	1.4		7.48	21				3	88.9	<0.1	1.53	5.95	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00529	750	0.1		7.2	22				<1	70	<0.1	<0.05	1.7	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00530	800	0.7	3.03	6.7	23.5				2.5	60.5	0.2	<0.2	1.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00531	700	0.1	2.52	6.63	21				4.2	63	<0.1	<0.2	0.8	<5	<10	<5	<5	<5	<2
03/22/97	FL 00680			1.72																
04/14/97	FL 00715	625	0.5	2.01	6.55	21				3.6	63.1	0.9	<0.2	1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00784			1.72																
07/15/97	FL 00816	700	0.2	2.47	6.53	22.5				4.4	57.4	2.3	<0.2	2.6	<5	<10	<5	<5	<5	<2
08/18/97	FL 00870			2.89																
09/11/97	FL 00929			2.93																
10/06/97	FL 00988			2.44																
10/14/97	FL 01039	680	0.4	2.44	6.3	22.7				4.9	66.4	3.62	<0.2	1.8	<5	<10	<5	<5	<5	<2
01/19/98	FL 01075	350	0.5	1.64	7.15	21				8.8	21.6	0.2	<0.2	0.6	<5	<10	<5	<5	<5	<2
02/12/98	FL 01107	500	0.4	1.68	6.59	22				5.9	38.1	1.43	<0.2	1.2	<5	<10	<5	<5	<5	<2
07/21/98	FL 01178	700	0.3	3.55	6.55	24				6.3	58.5	1.6	0.1	2.2						
07/21/98	FL 01187														<5	<20	<5	<5	<10	<2
01/21/99	FL 01258	734	0.8	2	5.89	23				6.6	55.4	1.46	<0.02	1.16						
01/21/99	FL 01265														<5	<20	<5	<5	<10	<2
07/08/99	FL 01409			1.89																
07/14/99	FL 01334									4	60.4	1.9	<0.2	1.3						
07/14/99	FL 01338	800	1.6	2.03	6.48	23									<5	<20	<5	<5	<10	<2
01/07/00	FL 01510			2.31																

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-214

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/13/00	FL 01456	705	1.2	2.43	6.44	23				6.9	57.2	< 0.1	< 0.2	1.6	< 5	< 10	< 5	< 5	< 5	< 2
07/11/00	FL 01581							< 0.5	< 1.8	9.7	61900	21	< 0.2	2.6						
07/11/00	FL 01577	760	0.06	2.35	6.46	26.8									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-217

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
04/04/95	FL 00532									75										
10/02/95	FL 00533	1150	4.6		6.67	24				58	1.45	0.6	<0.2	<0.2	30	<6	24	<0.5	<0.5	63
11/01/95	FL 00534	750	0.4		6.53	23				74	1.33	<0.1	0.8	<0.2	<0.8	<6	14	<0.5	<0.5	41
01/16/96	FL 00535	1000	0.4		6.9	23				<2.5	385	1.1	0.51	206	<0.8	<6	22	<0.5	<0.5	51
04/12/96	FL 00536	805	0.9		6.74	21				56.8	19.6	0.4	<0.2	5.9	<0.8	<6	51	<5	12	8
07/22/96	FL 00538	1300	0.1		6.69	22				48.4	2.1	0.1	<0.05	1	<0.8	<6	16	<5	<0.5	9
10/07/96	FL 00539	1200	1	3.48	6.34	23				53.8	1.35	0.1	<0.2	0.4	<5	<10	22	<5	<5	17
01/24/97	FL 00540	415	0.2	2.6	6.78	21				54.9	0.78	<0.1	<0.2	<0.1	<5	<10	18	<5	6	5
03/22/97	FL 00681			1.82																
04/15/97	FL 00732	1000	0.2	2.13	6.57	21				44.8	0.982	0.1	<0.2	<0.1	<5	<10	<5	<5	<5	6
05/31/97	FL 00782			1.92																
07/16/97	FL 00834	1000	0.1	2.78	6.44	23				2.4	0.902	<0.1	<0.2	<0.2	<5	<10	16	<5	<5	<2
08/18/97	FL 00871			3.28																
09/11/97	FL 00930			3.35																
10/06/97	FL 00989			2.88																
10/15/97	FL 01046	900	0.7	2.88	6.57	22.2				46.5	0.72	<0.1	<0.2	<0.1	<5	<10	14	<5	<5	13
01/21/98	FL 01093	450	0.6	1.76	7.12	22				16.7	2.29	<0.1	10.3	0.3	<5	<10	J2	<5	<5	<2
02/17/98	FL 01129	1000	0.8	1.73	6.55	21				39.5	1.7	<0.1	0.4	<0.1	<5	<10	11	<5	<5	14
04/16/98	FL 01165									45	1.63	<0.1	<0.2	0.2	<5	<10	13	<5	<5	22
04/16/98	FL 01166									46	1.61	<0.1	0.2	0.2	<5	<10	14	<5	<5	32
07/23/98	FL 01219	1050	0.2	3.82	6.41	24				52.9	1.62	<0.1	1.8	<0.1						
07/23/98	FL 01226														<5	<20	13	<5	<10	41
01/27/99	FL 01297	1046	0.8	2.02	6.21	22.5									<5	<20	10	<5	<10	40
01/27/99	FL 01300									46.6	1.33	<0.1	<0.2	<0.1						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-217

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/08/99	FL 01410			1.91																
07/21/99	FL 01371	900	1.6	2.04	6.58	23									< 5	< 5	10	< 5	< 5	28
07/21/99	FL 01366									45.7	0.97	0.1	0.2	0.1						
01/07/00	FL 01511			2.4																
01/18/00	FL 01478	681	1.7	2.4	6.8	22				44.6	1.43	< 0.1	< 0.2	0.1	< 5	< 10	8	< 5	< 5	23
07/13/00	FL 01601	900	0.02	2.6	6.33	25.4									< 5	< 5	9	< 5	< 5	25
07/13/00	FL 01597							< 0.5	< 1.8	46.1	1020	< 0.1	< 0.2	0.4						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-233

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
09/01/95	FL 00543	3000	1.2		6.08	25				3130	4.72	< 0 1	0.3	< 0.2	< 400	76000	2300	< 250	< 250	8500
11/01/95	FL 00544	4000	0.3		6.37	21				2850	2.83	0.4	0.3	< 0.2	< 80	7600	1400	< 50	< 50	3000
01/23/96	FL 00545	750			6.84	24				1800	16.2	2.6	< 0.2	< 0.1	< 160	27000	740	< 100	< 100	< 240
04/12/96	FL 00546	1200	0.7		6.79	22				264	10.5	1.2	< 0.2	5.52	< 2.7	< 19.8	370	< 17	140	< 4
07/22/96	FL 00548	2050	0.12		6.65	22				100	13	7.8	< 0.05	5.5	< 8	< 60	350	< 50	100	< 12
10/07/96	FL 00549	1800	0.7	6.48	6.7	25				98.9	9.09	8.7	< 0.2	4.6	< 16	< 33	500	< 16	19	< 33
01/24/97	FL 00550	1500	0.1	5.92	7.21	21				59.1	9.63	5.7	< 0.2	3.9	< 5	< 10	< 5	< 5	J 2	< 2
03/22/97	FL 00682			5.15																
04/16/97	FL 00743	1200	0.1	5.42	7.13	22				34.2	9.19	2.7	< 0.2	0.1	< 5	< 10	100	< 5	< 5	< 2
05/31/97	FL 00783			5.1																
07/16/97	FL 00844	1200	0.1	5.85	6.87	23				50.7	9.38	6.2	4	9.4	< 5	< 10	180	< 5	5	4
08/18/97	FL 00872			6.25																
09/11/97	FL 00931			6.36																
10/06/97	FL 00990			5.87																
10/15/97	FL 01056	1310	0.2	5.87	7	24.6				36.1	7.8	5.81	< 0.2	0.1	< 25	< 50	230	< 25	< 25	< 10
01/22/98	FL 01103	1200	0.4	4.7	7.67	22				34.2	8.22	3.77	1.8	0.5	< 10	< 20	240	< 10	< 10	< 4
02/18/98	FL 01135	1100	0.4	5.08	7	23				25.4	8.1	4.86	< 0.2	0.2	< 10	< 20	240	< 10	< 10	< 4
07/24/98	FL 01235	1800	0.1	6.78	6.46	25				235	5.55	< 0.1	4.8	2.8						
07/24/98	FL 01243														16	< 40	D 620	< 10	80	< 4
01/29/99	FL 01310	1032	0.6	5.15	6.4	23				208	4.23	2.07	< 0.4	0.68						
01/29/99	FL 01319														< 25	< 100	730	< 25	J 27	< 10
07/08/99	FL 01411			4.96																
07/22/99	FL 01379									57.1	7.2	0.11	< 0.2	< 0 1						
07/22/99	FL 01388	1150	1.2	4.87	6.84	26									< 5	< 5	D 390	13	J 2	< 2

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
INT-233

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/10/00	FL 01512			5.39																
01/20/00	FL 01488	687	1.8	5.53	6.81	22				15	9.25	0.3	< 0.2	0.12	J 4	< 10	98	J 3	< 5	< 2
07/19/00	FL 01665						132	< 0 5	< 1.8	16.2	11200	< 0.1	< 0.2	0.2						
07/19/00	FL 01653	850	0.03	5.49	6.58	26.8									20	< 5	D 320	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-234

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/07/00	FL 01563	790	0.09	3.54	6.71	26.3									37	<5	<5	<5	<5	<5
08/07/00	FL 01672														27	<5	<5	<5	<5	<5
08/08/00	FL 01684														27	<5	<5	<5	<5	<5
08/09/00	FL 01696														26	<5	<5	<5	<5	<5

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-235

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/07/00	FL 01564	780	0.11	3.17	6.8	26									89	<5	<5	10	<5	35
08/07/00	FL 01673														55	<5	<5	42	<5	22
08/08/00	FL 01685														55	<5	<5	37	<5	23
08/09/00	FL 01697														53	<5	<5	39	<5	23

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-236

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/07/00	FL 01565	510	0.27	7.88	7.23	24.9									D 2500	< 5	< 5	D 220	< 5	77
08/07/00	FL 01674														D 34000	97	110	D 800	47	490
08/08/00	FL 01686														86000	< 4000	< 4000	< 4000	< 4000	< 4000
08/09/00	FL 01698														66000	< 2000	< 2000	< 2000	< 2000	< 2000

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-237

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
06/12/00	FL 01552														25	<5	<5	J3	<5	<5
07/06/00	FL 01561	600	0.06	3.19	6.5	26.6									<5	<5	<5	<5	<5	<5
08/07/00	FL 01675														<5	<5	<5	<5	<5	<5
08/08/00	FL 01687														<5	<5	<5	<5	<5	<5
08/09/00	FL 01699														<5	<5	<5	<5	<5	<5

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
INT-238

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/06/00	FL 01562	830	0.04	2.78	6.87	26.3									78	< 5	11	40	< 5	20
08/07/00	FL 01676														66	< 5	9	40	< 5	15
08/08/00	FL 01688														110	< 50	< 50	74	< 50	< 50
08/09/00	FL 01700														160	< 50	< 50	110	< 50	< 50

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-031

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
09/05/94	FL 00180														< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
08/02/95	FL 00181	700	15		6.91	24				15										
01/17/96	FL 00182	600	0.6		7.22	23	< 10	13	5	9	144	0.2	26.5	5.48	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
04/12/96	FL 00183	300	1.5		7.49	21	< 10	< 10	< 5	4.1	93.8	0.6	2.8	1.7	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
07/22/96	FL 00185	450	0.02		7.4	23	< 10	< 10	< 3	< 1	32	0.29	0.16	0.52	< 0.8	< 6	< 0.3	< 5	< 0.5	< 1.2
10/07/96	FL 00186	1050	0.9	7.46	6.84	25.5	< 10	< 10	< 5	11.4	10.9	0.2	< 0.2	0.2	< 5	< 10	< 5	< 5	< 5	< 10
01/24/97	FL 00187	850	0.1	6.82	7.06	21	< 10	< 10	< 5	8.8	4.7	0.2	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
03/22/97	FL 00685			8.14																
04/14/97	FL 00716	525	0.3	6.43	7.03	21	< 10	< 10	< 5	6.4	3.87	0.3	0.6	0.1	< 5	< 10	< 5	< 5	< 5	< 2
05/31/97	FL 00786			6.05																
07/15/97	FL 00817	650	0.3	6.86	7.16	23	12	< 10	< 5	5.9	27.1	1.09	< 0.2	< 0.2	< 5	< 10	< 5	< 5	< 5	< 2
08/18/97	FL 00875			7.27																
09/11/97	FL 00934			7.31																
10/06/97	FL 00993			6.81																
10/15/97	FL 01057	550	0.2	6.81	7.06	24.6	< 10	< 10	< 5	5.9	7.2	0.75	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
01/19/98	FL 01076	500	0.8	5.99	7.55	22	< 10	< 10	< 5	5.3	14	0.38	< 0.2	0.2	< 5	< 10	< 5	< 5	< 5	< 2
02/13/98	FL 01118	700	0.6	6.03	7.09	23	23	< 10	< 5	10.4	51.9	0.88	< 0.2	0.1	< 5	< 10	6	< 5	< 5	< 2
07/22/98	FL 01197	800	0.2	9.36	7.15	25	42	< 10	< 5	10.4	69.7	0.53	< 0.2	< 0.1						
07/22/98	FL 01208														< 5	< 20	J 4	< 5	< 10	< 2
01/21/99	FL 01259	804	0.6	6.03	6.49	23.5	37	< 10	< 5	9.1	60.1	0.71	0.06	0.15						
01/21/99	FL 01266														< 5	< 20	J 4	< 5	< 10	< 2
07/08/99	FL 01414			5.97																
07/14/99	FL 01335						34	< 10	< 5	5.5	64.8	0.38	< 0.2	0.1						
07/14/99	FL 01339	800	1.5	6.15	7.02	24									< 5	< 20	< 5	< 5	< 10	< 2

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-031

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/10/00	FL 01515			6.41																
01/13/00	FL 01457	771	1.4	6.52	7.02	23.5	29.7	< 0.5	< 1.5	5.5	75.2	0.2	< 0.2	0.2	< 5	< 10	J 2	< 5	< 5	< 2
07/14/00	FL 01617						21.8	< 0.5	< 1.8	8.5	79200	< 0.1	< 0.2	0.15						
07/14/00	FL 01610	800	0.02	6.52	6.87	26.5									< 5	< 5	J 2	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-033

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
03/22/94	FL 00190														<0.8	<6	<0.3	<0.5	<0.5	<1.2
01/16/96	FL 00191	495	0.4		6.48	23	<10	<10	<5	<3	68.1	<0.1	131	1.2	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00192	450	1.6		7.23	20	<10	<10	<5	3.5	59.5	<0.1	288	0.6	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00194	700	0.16		6.69	22	<10	<10	<3	<1	88	<0.1	0.78	0.49	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00195	1150	1.2	3.43	6.58	24	13	<10	<5	7.6	65.3	0.2	<0.2	0.4	<5	<10	<5	<5	<5	<10
01/24/97	FL 00196	510	0.15	3.04	6.75	21	<10	<10	<5	9.6	63.4	0.2	<0.2	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00686			1.88																
04/14/97	FL 00717	410	0.2	2.22	6.67	20	<10	<10	<5	9.8	56.7	0.5	<0.2	<0.1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00787			1.83																
07/15/97	FL 00818	500	0.2	2.76	5.97	23	17	<10	<5	10.4	63.4	0.87	<0.2	<0.2	<5	<10	<5	<5	<5	<2
08/18/97	FL 00876			3.33																
09/11/97	FL 00935			3.58																
10/06/97	FL 00994			2.99																
10/14/97	FL 01040	550	0.5	2.98	6.58	23.3	25	<10	<5	11.3	80.7	1.19	<0.2	0.1	<5	<10	<5	<5	<5	<2
01/19/98	FL 01077	325	0.7	1.9	7.01	21	<10	<10	<5	8.6	28.8	<0.1	<0.2	0.1	<5	<10	<5	<5	<5	<2
02/12/98	FL 01110	500	0.6	1.9	6.56	22	17	<10	<5	9.6	53.6	0.75	<0.2	<0.1	<5	<10	<5	<5	<5	<2
07/22/98	FL 01198	775	0.3	4.26	6.49	24	22	<10	<5	11.2	54.4	0.9	<0.2	<0.1						
07/22/98	FL 01209														<5	<20	<5	<5	<10	<2
01/21/99	FL 01260	964	0.6	1.95	6.18	22	32	<10	<5	13.3	42.2	1.89	0.05	<0.1						
01/21/99	FL 01267														<5	<20	<5	<5	<10	<2
07/08/99	FL 01415			2.05																
07/15/99	FL 01340						39	<10	<5	15.2	40.6	2.4	0.2	0.1						
07/15/99	FL 01346	1000	1.6	2.23	6.79	22.5									<5	<20	<5	<5	<10	<2
01/07/00	FL 01516			2.58																

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-033

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/13/00	FL 01458	833	1.5	2.66	6.71	22.5	42.5	< 0.5	< 1 5	8.2	42.6	1	< 0.2	0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/11/00	FL 01583							< 0.5	< 1.8	14.1	44200	41	0.2	0.47						
07/11/00	FL 01579	870	0.09	2.64	6.53	26.1									< 5	< 5	< 5	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-051-P-3

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/18/96	FL 00197	500	0.6		6.86	21				<3	37.9	0.8	7.4	<0.1	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00198	450	1.8		6.92	20				11.3	54.8	0.9	4.2	<0.1	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00200	820	1.7		6.87	23				7.8	81	0.96	3.8	0.086	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00201	900	0.7	3.67	6.63	24				14.8	72	1.3	<0.2	<0.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00202	800	0.1	2.61	6.53	21				16.7	72.1	1.7	<0.2	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00687			2.47																
04/14/97	FL 00718	700	0.2	2.65	6.58	20				15.8	72	1.2	<0.2	<0.1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00788			2.3																
07/15/97	FL 00819	550	0.2	3.1	5.97	23				13.7	44.6	2.4	<0.2	0.2	<5	<10	<5	<5	<5	<2
08/18/97	FL 00877			3.17																
09/11/97	FL 00936			3																
10/06/97	FL 00995			2.6																
10/14/97	FL 01041	700	0.4	2.6	6.33	23.1				14.6	60.9	3.78	<0.2	0.1	<5	<10	<5	<5	<5	<2
01/19/98	FL 01078	775	0.8	1.29	6.98	21				13.7	49	2.39	<0.2	<0.1	<5	<10	<5	<5	<5	<2
02/13/98	FL 01114	700	0.7	2.15	6.64	20				13.7	47.2	4.13	<0.2	0.1	<5	<10	<5	<5	<5	<2
07/21/98	FL 01179	750	0.2	2.9	6.55	24				14.7	50.1	1.34	0.1	<0.1						
07/21/98	FL 01188														<5	<20	J2	<5	<10	<2
01/21/99	FL 01261	828	0.8	2.2	6.03	22				14.9	57	<0.1	0.06	0.16						
01/21/99	FL 01268														<5	<20	J4	<5	<10	<2
07/08/99	FL 01416			1.73																
07/15/99	FL 01341									15.1	45.9	2	0.2	0.46						
07/15/99	FL 01347	780	1.4	1.97	6.45	23									<5	<20	<5	<5	<10	<2
01/10/00	FL 01517			1.97																
01/13/00	FL 01459	774	1.4	2.04	6.37	22.5				15.1	55.8	0.6	<0.2	0.4	<5	<10	<5	<5	<5	<2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
s1-051-p-3

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/17/00	FL 01628	750	0.03	2.15	6.05	25									<5	<5	23	<5	<5	<2
07/17/00	FL 01620							1.1	<18	19.7	48100	2.1	<0.2	0.2						

Number in parantheses indicates compound's cleanup criteria I

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-106A

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
11/01/95	FL 00246	470	15		6.74	25				3	35	<0.1	21.7	<0.2	<0.8	<6	<0.3	<0.5	<0.5	<1.2
01/15/96	FL 00247	450	15		6.7	24				<3	47	<0.1	92.3	0.71	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00248	400	12.6		7.52	21				<2	43.1	0.2	16.6	0.6	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00250	800	7.6		7.26	22				<1	52	<0.1	23.3	1	7	<6	<0.3	8	<0.5	<1.2
10/07/96	FL 00251	850	1	2.28	6.96	24				2.5	29	<0.1	11.4	0.6	<5	<10	<5	<5	<5	<10
01/24/97	FL 00252	800	1	0.7	6.85	20				3.9	36.5	<0.1	16.2	0.8	<5	<10	<5	<5	<5	<2
03/22/97	FL 00689			0.6																
04/15/97	FL 00719	600	0.4	0.87	6.75	20				1.1	46.8	<0.1	15.4	1.2	<5	<10	<5	J2	<5	<2
05/31/97	FL 00791			0.37																
07/15/97	FL 00820	700	0.1	2.48	6.73	23				2.7	44	<0.1	12.9	1.6	32	<10	8	52	<5	39
08/18/97	FL 00880			3.22																
09/11/97	FL 00939			3.2																
10/06/97	FL 00998			2.57																
10/15/97	FL 01058	700	0.5	2.57	6.93	23.2				2.1	47.1	0.15	9.8	1.5	J4	<10	<5	<5	<5	2
01/20/98	FL 01079	550	0.4	0.6	6.96	20				5.1	35.2	<0.1	7	0.8	J4	<10	<5	<5	<5	2
02/15/98	FL 01124	600	0.7	0.5	6.81	21				4.1	59	0.26	8	1	13	<10	6	J2	<5	15
04/14/98	FL 01158										51.6	<0.1	7.6	1.3	J20	<50	<25	<25	<25	J24
04/14/98	FL 01159										53.2	0.1	7	1.2	<50	<100	<50	<50	<50	J38
07/21/98	FL 01180	775	13.8	3.65	6.86	24				2.3	57.8	<0.1	10.8	1.2						
07/21/98	FL 01189														<5	<20	<5	<5	<10	<2
01/21/99	FL 01262	875	5.4	0.68	6.16	22				2.7	64.4	<0.1	8.51	1.32						
01/21/99	FL 01269														J4	<20	<5	J1	<10	<2
07/08/99	FL 01419			1																
07/15/99	FL 01342									5.5	71.4	0.1	2	1.3						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-106A

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/15/99	FL 01348	900	1.8	1.6	6.69	23									45	< 20	< 5	< 5	< 10	J 11
01/07/00	FL 01520			1.41																
01/14/00	FL 01460	685	9.6	1.3	6.55	21				1.8	60.4	< 0.1	12.2	1.8	< 5	< 10	< 5	< 5	< 5	< 2
07/17/00	FL 01629	790	8	2.57	6.65	25									6	< 5	< 5	J 2	< 5	< 2
07/17/00	FL 01621							< 0.5	< 1.8	3.6	74200	< 0.1	9	1.3						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-106R

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
03/22/97	FL 00690			4.62																
05/31/97	FL 00792			4.47																
01/21/98	FL 01089	1000	0.4	4.8	6.8	20				26.7	41.1	2.41	< 0.2	6.7	< 5	< 10	53	< 5	< 5	< 2
02/15/98	FL 01127	950	0.8	4.54	6.65	21				25.7	38.7	3.93	< 0.2	6.8	< 5	< 10	57	< 5	< 5	< 2
07/22/98	FL 01210														J 3	< 20	27	< 5	< 10	< 2
07/22/98	FL 01199	800	0.2	8.59	7.74	22				14.8	70.6	0.93	< 0.2	5.6						
01/22/99	FL 01285									14.7	60.5	< 0.1	0.06	6.6						
01/22/99	FL 01277	942	0.8	4.98	6.19	22									J 2	< 20	22	< 5	< 10	J 3
07/08/99	FL 01420			5.57																
07/16/99	FL 01358	1000	1.4	6.25	6.71	22									< 5	< 20	49	< 5	< 10	< 2
07/16/99	FL 01354									23.2	73.1	0.62	< 0.2	8.4						
01/10/00	FL 01521			5.43																
01/18/00	FL 01474	750	1.8	5.65	6.91	21				7.3	61.8	0.2	< 0.2	6.8	7	< 10	14	< 5	< 5	< 2
07/18/00	FL 01643						4.8	< 0.5	< 1.8	15	62400	0.19	< 0.2	6.9						
07/18/00	FL 01637	750	0.08	7.36	6.67	24.7									< 5	< 5	42	< 5	< 5	< 2

Number in parantheses indicates compound's cleanup criteria l

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-108A

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
11/01/95	FL 00255	425	0.5		5.98	25				8	17.9	0.8	5.8	<0.2	10	<6	<0.3	<0.5	<0.5	<1.2
01/15/96	FL 00256	470	2		6.07	22				51.6	28.2	0.2	51.6	0.33	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00257	400	1.8		7.08	20				3.8	34.2	<0.1	4.2	0.1	<0.8	<6	4	<5	3	<1.2
07/22/96	FL 00259	650	0.1		6.8	25				1.1	38	0.67	0.47	0.23	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00260	775	0.8	5.61	6.42	25				4.5	34.7	0.4	0.3	0.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00261	625	0.1	4.26	6.52	20				8	28.7	0.4	<0.2	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00691			4.3																
04/15/97	FL 00720	500	0.6	4.59	6.5	19				6	37.1	0.4	<0.2	0.1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00793			4.01																
07/15/97	FL 00821	600	0.1	5.32	6.34	23				7.5	35.4	0.75	<0.2	<0.2	<5	J4	<5	<5	<5	<2
08/18/97	FL 00882			5.47																
09/11/97	FL 00941			5.33																
10/06/97	FL 01000			4.88																
10/14/97	FL 01042	600	0.3	4.88	6.31	24.2				7.4	38.8	1.81	<0.2	0.4	<5	<10	<5	<5	<5	<2
01/20/98	FL 01080	600	0.7	4.09	6.74	20				7.2	40.4	0.75	<0.2	0.1	<5	<10	<5	<5	<5	<2
02/12/98	FL 01106	550	0.5	3.95	6.52	20				8.4	38.5	2.2	<0.2	0.1	<5	<10	<5	<5	<5	<2
07/21/98	FL 01181	675	0.1	5.26	6.56	25				22.8	27.9	1.38	0.3	0.1						
07/21/98	FL 01190														J1	<20	22	<5	<10	<2
01/21/99	FL 01263	653	0.8	4.4	6.11	22				10.3	27.5	1.35	<0.02	0.12						
01/21/99	FL 01270														<5	<20	<5	<5	<10	<2
07/08/99	FL 01421			3.8																
07/15/99	FL 01343									10.9	27.1	1.2	0.2	0.15						
07/15/99	FL 01349	650	1.4	4.1	6.71	24.5									<5	<20	<5	<5	<10	<2
01/10/00	FL 01522			3.96																

Number in parantheses indicates compound's cleanup criteria !

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-108A

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/14/00	FL 01461	435	2.1	4.08	6.63	20				7.8	21.2	0.4	< 0.2	0.8	< 5	< 10	< 5	< 5	< 5	< 2
07/17/00	FL 01630	550	0.01	4.36	6.44	27.3									< 5	< 5	< 5	< 5	< 5	< 2
07/17/00	FL 01622							< 0.5	< 1.8	16.2	22100	1.6	< 0.2	0.4						

Number in parantheses indicates compound's cleanup criteria I

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-111

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
12/02/91	FL 00264	1790	0.2		6.45	21.4	8	< 20	< 25		40		< 0.02	290	81	360	1700	< 50	430	< 100
07/22/92	FL 00265									42					< 25	350	320	< 25	78	16
09/26/92	FL 00266														< 10	210	210	< 10	21	18
12/16/92	FL 00267	900	4		6.91	19.2				19					3	130	120	< 5	20	< 10
12/26/92	FL 00268										8.05	1.2	< 0.05	< 0.01						
03/24/93	FL 00269	438	2.8		6.95	18.7				16	5.7	1.51	< 0.05	0.03	< 5	110	89	< 5	17	< 10
06/24/93	FL 00270									16					< 5	57	33	< 5	4	< 10
06/25/93	FL 00271	248	2.8		6.97	23.5														
09/07/93	FL 00272									25.8	7.81	1.82	0.09	0.03	4	< 10	71	< 5	10	< 10
12/29/93	FL 00274									16	3.58	0.88	< 0.05	0.25	< 5	< 10	16	< 5	< 5	< 10
03/22/94	FL 00275	380	1.4		6.92	16									< 0.8	< 6	8	< 0.5	< 0.5	< 1.2
06/07/94	FL 00276	330	0.2		6.85	21														
06/07/94	FL 00277														< 0.8	< 6	5	< 0.5	< 0.5	< 1.2
12/21/94	FL 00278	800	15		9.3	24	26.3	132	98.4		155	< 0.1	< 2	< 2	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
12/21/94	FL 00279									3.4										
12/15/95	FL 00280	525	15		7.84	21				6.7	126	< 0.1	231	18.5	< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
01/15/96	FL 00281	900	15		7.74	22	< 10	12	9	9										
04/12/96	FL 00282	600	15		7.18	21	< 10	< 10	< 5											
07/22/96	FL 00284	1050	15		7.53	22	< 10	< 10	< 3		170									
10/07/96	FL 00285	1050	8.9	3.79	6.8	24	< 10	< 10	< 5											
01/24/97	FL 00286	850	2.2	2.72	6.97	21	< 10	< 10	< 5											
03/22/97	FL 00692			2.53																
04/15/97	FL 00721	720	0.6	2.7	6.96	20	< 10	< 10	< 5											

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-111

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
05/31/97	FL 00794			2.38																
07/15/97	FL 00822	700	0.2	3.11	6.61	23	< 10	< 10	< 5											
08/18/97	FL 00883			3.18																
09/11/97	FL 00942			3.07																
10/06/97	FL 01001			2.68																
10/14/97	FL 01043	720	0.5	2.68	6.65	23.5	< 10	< 10	< 5											
01/20/98	FL 01081	750	0.7	2.12	7.01	21	< 10	< 10	< 5											
02/12/98	FL 01105	700	0.6	2.14	6.58	21	< 10	< 10	16											
07/21/98	FL 01183	700	0.1	3.03	6.55	25	< 10	< 10	< 5											
01/22/99	FL 01287	727	0.8	2.2	6.09	23	< 10	< 10	< 5											
07/08/99	FL 01422			1.81																
07/15/99	FL 01344	720	1.4	2.03	6.63	23.5	< 10	< 10	< 5											
01/10/00	FL 01523			2.08																
01/14/00	FL 01462	698	2.1	2.17	6.63	22	7.7	< 0.5	< 1.5		104									
07/12/00	FL 01589	830	0.04	2.22	6.32	24.7									< 5	< 5	< 5	< 5	< 5	< 2
07/12/00	FL 01584							< 0.5	< 1.8	11.3	15000	0.51	< 0.2	1.3						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-118

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
05/22/92	FL 00295														<5	<10	5	<5	<5	<10
12/17/92	FL 00296	230	5.4		6.91	22.9				8					<5	<10	<5	<5	<5	<10
12/29/93	FL 00297									19										
12/29/93	FL 00298														7	<6	<0.3	<0.5	<0.5	<1.2
03/22/94	FL 00299	315	2		6.66	22														
12/21/94	FL 00300	308	3.4		6.55	24	5.6	5.3	6.3		3.63	0.13	<2	<2	<0.8	22	<0.3	<0.5	<0.5	<1.2
12/21/94	FL 00301									9.4										
12/15/95	FL 00302	470	2.2		8	21				9					<0.8	<6	<0.3	<0.5	<0.5	<1.2
01/15/96	FL 00303	200	1.6		6.67	24	<10	<10	<5	<0.5	2.7	<0.1	<0.2	<0.1	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00304	500	1.6		6.74	21	<10	<10	<5	6.2	1.72	0.1	<0.2	<0.1	<0.8	<6	<0.3	<5	<0.5	<1.2
07/22/96	FL 00306	310	0.8		6.28	26	<10	<10	<3	6.1	1.5	0.2	<0.05	0.055	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00307	825	1.2	8.95	6.35	27	<10	<10	<5	5.7	1.89	0.3	<0.2	<0.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00308	355	0.15	8.99	6.5	23	27	<10	<5	9.1	1.74	<0.1	0.4	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00693			7.02																
04/15/97	FL 00722	300	0.4	7.44	6.62	20	<10	<10	<5	6.3	1.94	0.2	<0.2	<0.1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00795			6.72																
07/15/97	FL 00823	200	0.1	8.15	6.19	25	10	<10	<5	6.6	1.84	0.23	<0.2	<0.2	<5	<10	<5	<5	<5	<2
08/18/97	FL 00885			9.06																
09/11/97	FL 00944			9.61																
10/06/97	FL 01003			9.9																
10/14/97	FL 01044	315	1.1	9.9	6.06	26	10.2	<10	<5	7.7	2.3	0.36	<0.2	<0.1	<5	<10	<5	<5	<5	<2
01/20/98	FL 01082	335	0.6	7.25	7.62	22	<10	<10	<5	7.4	2.04	0.16	<0.2	0.1	<5	<10	<5	<5	<5	<2
02/13/98	FL 01117	350	0.5	7.17	6.58	23	<10	<10	<5	7.9	2	0.34	<0.2	<0.1	<5	<10	<5	<5	<5	<2

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-118

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/98	FL 01212														< 5	< 20	< 5	< 5	< 10	< 2
07/22/98	FL 01201	300	3.5	10.71	6.25	27	< 10	< 10	< 5	6.6	2.2	0.17	< 0.2	< 0.1						
01/25/99	FL 01288	374	2	7.95	5.92	24	< 10	< 10	< 5	8.3	1.86	0.1	0.02	< 0 1						
01/25/99	FL 01293														< 5	< 20	< 5	< 5	< 10	< 2
07/08/99	FL 01424			8.16																
07/15/99	FL 01345						10	< 10	< 5	8.3	2.1	0.1	0.2	0.1						
07/15/99	FL 01350	375	1.4	8.42	6.31	26.5									< 5	< 20	< 5	< 5	< 10	< 2
01/11/00	FL 01525			9.39																
01/14/00	FL 01463	233	4.6	9.43	6.53	24	7.7	< 0 5	< 1 5	5.6	1.93	< 0.1	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
07/17/00	FL 01631	290	0.31	9.22	6.43	28									< 5	< 5	< 5	< 5	< 5	< 2
07/17/00	FL 01623							< 0.5	< 1.8	8.3	1880	0.13	< 0.2	0.1						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-121

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
06/20/93	FL 00309									32					< 25	< 50	220	< 25	< 25	< 50
12/29/93	FL 00311									762	8.71	1.2	< 0.05	0.09	215147	76036	1055	< 25	364	7278
06/07/94	FL 00312	1700	2		6.18	23									69	< 6	74	< 0.5	21	45
12/21/94	FL 00313	900	3.1		778	23	10.1	9	7.2		3.1	0.43	< 2	< 2	26	< 6	2	< 0.5	< 0.5	< 1.2
12/21/94	FL 00314									20										
05/05/95	FL 00315	700	3		6.56	23					9.4	< 0.1	1.3	< 0.7	< 0 8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
06/06/95	FL 00316	700	5.6		6.59	23					7.4	< 0.1	4.1	< 0.2	6	< 6	< 0.3	< 0.5	< 0.5	< 1.2
09/01/95	FL 00317	650	15		6.45	25				6.6	2.79	< 0 1	< 0.2	< 0.2	4	< 6	< 0.3	< 0.5	< 0.5	< 1.2
10/02/95	FL 00318	525	6.2		6.51	26				36	3.89	< 0.1	< 0.2	< 0.2	41	< 6	12	< 0.5	7	140
11/01/95	FL 00319	750	0.6		6.32	24				17										
11/01/95	FL 00320										3.86	0.1	2.4	< 0.2	12	< 6	6	< 0.5	2	49
12/15/95	FL 00321	700	4.4		6.66	25				35	4.79	0.1	< 0.2	< 0.1	48	324	57	< 0.5	24	311
01/18/96	FL 00322	750	10.2		6.8	24				108	108	0.1	56.2	< 0 1	40	< 6	< 0.3	< 0.5	< 0 5	17
04/12/96	FL 00323	750	1.7		6.84	23				14.6	19	0.7	< 0.2	< 0.1	24	< 6	5	< 5	< 0.5	66
07/22/96	FL 00325	1300	0.1		6.85	23				5.2	43	0.58	0.75	0.031	8	< 6	4	< 5	< 0.5	8
10/07/96	FL 00326	1300	1	8.79	6.89	25				5.1	34.6	< 0.1	6	< 0.1	3	< 10	< 5	< 5	< 5	< 10
01/24/97	FL 00327	1150	0.1	7.88	6.77	22				9.5	53.8	< 0.1	9.9	< 0.1	< 5	< 10	< 5	< 5	< 5	< 2
03/22/97	FL 00695			7.14																
04/15/97	FL 00724	1200	0.2	7.45	6.86					11.3	29.9	0.2	< 0.2	< 0.1	< 5	< 10	12	< 5	< 5	< 2
05/31/97	FL 00797			7.03																
07/15/97	FL 00825	1300		8.86	6.6	24				29.6	31	0.63	4.4	10	< 5	< 10	J 3	< 5	J 4	< 2
08/18/97	FL 00887			9.77																
09/11/97	FL 00946			9.61																
10/06/97	FL 01005			9.16																

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-121

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
11/05/97	FL 01063	1150	1.2	8.27	6.4	24.5				4.5	42.6	<0 1	7.8	<0.2	<5	<10	<5	<5	<5	<2
01/20/98	FL 01084	1100	0.4	7.12	7.31	23				6.2	55.4	<0.1	<0.2	<0.1	<5	<10	J2	<5	<5	<2
02/13/98	FL 01119	1200		7.09	6.76	23				7.4	44.4	<0.1	1.2	<0.1	<5	<10	J2	<5	<5	<2
07/21/98	FL 01182	1125	0.1	10.42	6.68	25				7.4	56	<0.1	0.5	<0.1						
07/21/98	FL 01191														<5	<20	<5	<5	<10	<2
01/22/99	FL 01279									9.8	41.7	<0.1	1.56	0.12						
01/22/99	FL 01271	1211	4.9	7.28	6.23	24									64	<100	J6	<25	<50	J15
07/08/99	FL 01426			7.67																
07/16/99	FL 01352									10.2	39.2	<0 1	<0.2	<0.1						
07/16/99	FL 01359	1200	3	8.32	6.54	24.5									<5	<20	<5	<5	<10	J4
01/10/00	FL 01527			7.87																
01/17/00	FL 01465	961	1.3	8.07	6.64	24				9.3	32.8	0.2	0.4	0.1	6	<10	<5	<5	<5	5
07/12/00	FL 01591	1080	0.06	9.26	6.65	28.2									21	<5	J2	<5	<5	17
07/12/00	FL 01586							<0.5	<1.8	11.2	29800	0.15	<0.2	0.34						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
S1-123

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/22/93	FL 00330														4100	< 500	< 250	480	< 250	< 500
12/29/93	FL 00331	700	1.8		8.94	22				11	26.7	< 0.1	< 0 05	0.13	3561	74	50	21	20	135
06/07/94	FL 00332	800	4		6.73	24									2400	< 300	< 15	410	< 25	< 60
09/05/94	FL 00333	220	15		6.5	30									4	10	< 0.3	< 0.5	< 0.5	< 1.2
09/05/94	FL 00334											< 0.1	5.2	< 0 2						
12/21/94	FL 00335	600	8		7.18	23.5					16.9	0.11	4.2	< 2	320	< 120	< 6	160	< 10	< 24
03/12/95	FL 00336	725	15		6.99	23					15.3	< 0.1	12.6	0.2	110	220	< 7 5	560	< 12.5	< 30
04/04/95	FL 00337	600	14.6		6.91	23				12					< 0.8	< 6	< 0.3	< 0.5	< 0.5	< 1.2
04/04/95	FL 00338										3.51	< 0 1	< 0.2	< 0 2						
05/05/95	FL 00339	600	15		6.86	23				11	6.1	< 0.1	2.8	< 0.7	17	< 6	< 0 3	< 0.5	< 0.5	< 1 2
06/06/95	FL 00340										8.89	< 0 1	0.2	< 0.2	2	< 6	< 0 3	< 0 5	< 0.5	< 1.2
06/06/95	FL 00341	500	15		6.99	24														
07/05/95	FL 00342	575	0.6		6.91	24				9	21.2	< 0.1	1.1	0.1	17	< 6	< 0.3	8	< 0.5	< 1.2
08/02/95	FL 00343	550	6.1		6.75	24				15	24.2	0.43	< 0 1	< 0.1	46	19	< 0.3	5	< 0 5	< 1 2
09/01/95	FL 00345										28.1	25.9	< 0 2	< 0.2						
09/01/95	FL 00344	550	0.3		6.64	24				2					260	< 60	< 3	< 5	< 5	< 12
10/02/95	FL 00346	420	9.6		6.62	24				26	23.8	0.1	0.3	< 0 2	730	< 6	6	E 470	4	4
11/01/95	FL 00347	475	15		6.79	25				6	24.9	< 0 1	9.9	< 0 2	1000	< 150	< 7 5	570	< 12.5	< 30
12/15/95	FL 00348	370	14.6		6.76	24				8	5.3	< 0 1	7.35	0.81	18	< 12	< 0.6	12	< 1	< 2.4
01/23/96	FL 00349	500	3.2		7.13	25				0.43	8.2	< 0 1	2.4	0.43	180	4	< 0 3	< 0 5	< 0.5	4
04/12/96	FL 00350	550	2.2		6.98	22				4.8	17	0.3	0.2	0.3	680	< 60	< 3	< 50	< 5	< 12
07/22/96	FL 00352	1130	5		6.84	24				9.3	28	0.44	< 0 05	0.94	19000	< 60	< 3	< 50	43	2600
10/07/96	FL 00353	1100	1.2	1.67	6.58	26				6.8	7.85	0.6	< 0.2	0.2	4	< 10	< 5	< 5	< 5	21
01/24/97	FL 00354	975	0.2	0.1	6.95	23				11.4	8.05	0.6	< 0.2	< 0.1	< 5	< 10	< 5	< 5	< 5	5

Number in parantheses indicates compound's cleanup criteria

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
S1-123

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
03/22/97	FL 00696			0																
04/15/97	FL 00727	400	0.2	0.35	6.89	23				4.3	5.67	0.3	< 0 2	0.3	28	< 10	< 5	< 5	< 5	2
05/31/97	FL 00798			0																
07/15/97	FL 00829	1125	0.1	1.96	6.66	24				9.5	7.41	0.3	< 0 2	< 0.2	1500	< 10	69	< 5	62	310
08/18/97	FL 00888			2.87																
09/11/97	FL 00947			2.84																
10/06/97	FL 01006			2.29																
10/15/97	FL 01060	1100	0.3	2.29	6.78	25.3				15.3	13.3	0.41	< 0 2	2.2	17000	< 50	< 25	< 25	32	2800
10/31/97	FL 01062	1600	0.2	1.25	6.47	22				42.4	20.6	0.18	< 0 2	0.9	68000	18000	< 2500	< 2500	< 2500	4900
01/20/98	FL 01088	580	0.3	0	7.04	22				8.4	7	0.17	< 0.2	0.1	160	< 10	< 5	< 5	< 5	37
02/18/98	FL 01137	800	0.6	0	6.8	23				9.5	9.5	0.37	< 0 2	0.1	4300	< 500	< 250	< 250	< 250	470
04/13/98	FL 01156														46000	< 5000	< 2500	< 2500	< 2500	< 5000
04/14/98	FL 01157														11000	J 460	< 500	< 500	< 500	< 1000
04/15/98	FL 01164														12000	J 410	< 500	< 500	< 500	J 450
04/16/98	FL 01167														31000	< 2000	< 1000	< 1000	< 1000	1100
07/24/98	FL 01228	1400	0.1	2.9	6.58	25				82	43.5	< 0 1	< 0.2	< 0.1						
07/24/98	FL 01236														D 240000	J 170	510	3200	J 190	3900
01/22/99	FL 01275	1452	0.7	0.4	6.24	24									65000	< 10000	< 2500	< 2500	< 5000	J 2400
01/22/99	FL 01283									40.4	28.9	0.2	0.05	0.13						
07/08/99	FL 01427			0.75																
07/16/99	FL 01353									94.5	36.3	< 0.1	< 0 2	< 0 1						
07/16/99	FL 01360	1400	4.5	1.31	6.58	24.5									D 120000	D 1800	D 290	14	240	D 4000
01/10/00	FL 01528			0.7																
01/17/00	FL 01471	929	1.3	0.94	6.8	25				60.1	34.4	0.1	< 0 2	0.1	150000	< 1000	620	2300	J 300	3600
07/19/00	FL 01649	1400	0.07	2.31	6.64	27.6									D 165000	< 200	320	J 180	J 120	3200

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
S1-123

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/19/00	FL 01661						34.1	< 0.5	< 1 8	63	33700	< 0 1	< 0 2	0.1						
08/07/00	FL 01677														2500	260	490	980	260	D 3400
08/08/00	FL 01689														D 270000	< 5000	< 5000	< 5000	< 5000	< 5000
08/09/00	FL 01701														D 300000	< 5000	< 5000	< 5000	< 5000	< 5000

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-131

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/17/93	FL 00359														< 25	< 50	600	< 25	48	< 50
05/05/95	FL 00360	1000	5		6.96	24					14	0.1	5.7	< 0.7	< 80	10000	< 30	< 50	< 50	< 120
06/06/95	FL 00361	1200	9.4		6.88	24														
01/23/96	FL 00362	600	9		7.22	24				< 3	62.6	< 0.1	8.6	< 0.1	< 0.8	< 6	8	< 0.5	3	< 1.2
04/12/96	FL 00363	550	1.4		7.53	22				20.8	91.9	1.8	306	< 0.1	< 0.8	< 6	21	< 5	< 0 5	< 1.2
07/22/96	FL 00365	1300	0.07		6.98	23				17	94	2.2	< 0.05	0.027	6	17	31	< 5	< 0.5	< 1.2
10/07/96	FL 00366	1300	0.8	3.24	7.16	25				42.7	93.4	2.2	0.4	< 0.1	< 5	< 10	32	< 5	< 5	< 10
01/24/97	FL 00367	900	0.1	5.8	7.81	21				26.1	19	1.9	3.1	< 0.1	< 5	< 10	J 3	< 5	< 5	< 2
03/22/97	FL 00698			5.45																
04/15/97	FL 00729	950	0.2	5.61	7.32	22				40	34.7	0.3	< 0.2	< 0.1	< 5	< 10	J 4	< 5	< 5	< 2
05/31/97	FL 00800			5.24																
07/15/97	FL 00831	1000	0.2	6.14	6.95					43.9	62.4	1.4	< 0.2	0.2	< 5	< 10	21	< 5	< 5	< 2
08/18/97	FL 00890			7.12																
09/11/97	FL 00949			7.58																
10/06/97	FL 01008			6.87																
10/15/97	FL 01061	1000	0.7	6.87	7.11					38.2	66.8	2.12	< 0.2	< 0.1	< 5	< 10	21	< 5	< 5	< 2
01/21/98	FL 01090	980	0.6	5.4	7.37	22				46.8	66.9	1.3	< 0.2	0.1	< 5	< 10	6	< 5	< 5	< 2
02/17/98	FL 01133	1000	0.7	5.32	6.85	23				35	78.6	0.75	0.2	< 0 1	< 5	< 10	58	< 5	< 5	< 2
07/23/98	FL 01220	900	0.4	9.37	6.5	24				25.8	74.7	< 0.1	0.3	< 0.1						
07/23/98	FL 01227														< 5	< 20	8	< 5	< 10	< 2
01/22/99	FL 01278	1030	1	5.83	6.17	23									< 5	< 20	41	< 5	< 10	< 2
01/22/99	FL 01286									34.1	64	0.13	< 0.2	0.1						
07/08/99	FL 01429			5.9																
07/16/99	FL 01355									37.5	61.7	< 0.1	< 0.2	0.12						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-131

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/16/99	FL 01361	1050	1.4	6.22	6.58	24									< 5	< 5	21	< 5	< 5	< 2
01/10/00	FL 01530			6.34																
01/18/00	FL 01475	896	1.5	6.42	6.78	23.5				43.2	57	0.2	< 0.2	0.1	< 5	< 10	24	< 5	< 5	< 2
07/12/00	FL 01593	1020	0.04	7.19	6.59	26.3									< 5	< 5	28	< 5	< 5	< 2
07/12/00	FL 01588							< 0.5	< 1 8	41.2	56900	0.58	< 0.2	0.7						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-135

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
12/29/93	FL 00373	400	2.8		6.12	20														
12/29/93	FL 00372														<0.8	<6	<0.3	<0.5	5	<1.2
12/21/94	FL 00374	455	0.8		6.17	24	209	4.9	<2.5		3.98	0.38	<2	<2	<0.8	<6	<0.3	<0.5	<0.5	<1.2
12/21/94	FL 00375									18.1										
12/15/95	FL 00376						195	13	<5						<0.8	<6	<0.3	<0.5	<0.5	<1.2
12/15/95	FL 00377	420	0.6		6.24	25				52										
01/15/96	FL 00378	350	1.6		6.46	23	169	13	5	<0.5	7.33	0.9	<0.2	<0.1	<0.8	<6	<0.3	<0.5	<0.5	<1.2
04/12/96	FL 00379	300	1.7		6.58	21	40	<10	<5	16.4	5.57	0.7	<0.2	<0.1	<0.8	<6	3	<5	<0.5	<1.2
07/22/96	FL 00381	450	0.1		6.27	23	62	<10	5.1	16	3.8	0.44	<0.05	0.18	<0.8	<6	<0.3	<5	<0.5	<1.2
10/07/96	FL 00382	1000	0.6	7.18	6.28	25	69	<10	<5	16.5	3.81	0.4	<0.2	<0.1	<5	<10	<5	<5	<5	<10
01/24/97	FL 00383	400	0.1	6.96	6.22	21	47.9	5.2	<0.8	18.4	3.61	0.2	<0.2	<0.1	<5	<10	<5	<5	<5	<2
03/22/97	FL 00699			4.9																
04/15/97	FL 00723	300	0.2	5.24	6.38	21	98	<10	<5	15.2	3.66	<0.1	<0.2	<0.1	<5	<10	<5	<5	<5	<2
05/31/97	FL 00801			4.42																
07/15/97	FL 00824	600	0.1	6.25	6.27	24	97	<10	8	27.8	5.94	0.76	<0.2	<0.2	<5	<10	<5	<5	<5	<2
09/11/97	FL 00960			7.88																
10/06/97	FL 01019			7.07																
10/14/97	FL 01045	570	0.1	7.07	6.4	25.8	64	<10	<5	29.5	6.7	0.98	<0.2	0.2	<5	<10	<5	<5	<5	<2
01/20/98	FL 01083	750	0.5	5.15	6.81	22	130	<10	<5	32.9	8.4	0.96	<0.2	0.1	<5	<10	<5	<5	<5	<2
02/12/98	FL 01104	700	0.7	4.92	6.43	22	26	<10	<5	34.3	1.22	2.83	<0.2	0.1	<5	<10	<5	<5	<5	<2
07/22/98	FL 01202	725	0.2	8.88	6.35	26	112	<10	<5	30.3	11.3	1.11	<0.2	0.2						
07/22/98	FL 01213														<5	<20	<5	<5	<10	<2
01/25/99	FL 01289	745	0.7	5.68	6.06	23	78	<10	<5	30.1	11.9	1.3	<0.02	<0.1						

Number in parantheses indicates compound's cleanup criteria I

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
July, 2000

Well Name
S1-135

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
01/25/99	FL 01294														<5	<20	<5	<5	<10	<2
07/08/99	FL 01430			6.19																
07/16/99	FL 01362	900	1.6	6.48	6.54	24.5									<5	<5	<5	<5	<5	<2
07/16/99	FL 01351						120	<10	<5	40.5	13.2	0.72	<0.2	1.7						
01/07/00	FL 01531			7.27																
01/17/00	FL 01464	581	1.9	7.34	6.5	22	112	2.7	<1.5	25	9.1	0.2	<0.2	0.1	<5	J6	<5	<5	<5	<2
07/17/00	FL 01632	490	0	7.27	6.08	25									<5	<5	<5	<5	<5	<2
07/17/00	FL 01624							<0.5	<1.8	21.4	9050	0.93	<0.2	0.1						

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
S1-143

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/06/00	FL 01558	910	0.04	3	6.56	26.5									9000	< 500	< 500	< 500	< 500	< 500
08/07/00	FL 01678														D 5900	< 5	22	< 5	< 5	310
08/08/00	FL 01690														5400	< 200	< 200	< 200	< 200	210
08/09/00	FL 01702														6000	< 200	< 200	< 200	< 200	210

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
S1-144

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
06/12/00	FL 01553														D 16000	< 200	< 200	< 200	< 200	1900
07/06/00	FL 01559	740	0.03	2.76	6.79	26.9									470	< 10	< 10	< 10	< 10	22
08/07/00	FL 01679														210	< 5	< 5	< 5	< 5	15
08/08/00	FL 01691														240	< 5	< 5	< 5	< 5	19
08/09/00	FL 01703														300	< 5	< 5	< 5	< 5	25

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

SEMI-ANNUAL GROUNDWATER MONITORING
S1-123 Area, September 2000

Well Name
S1-145

French Limited Project
FLTG, Inc.

Date Coll'd	Sample Number	CONDUCT umhos	DO PPM	DtoWTR Ft	FLDpH pH un	TEMP Deg C	AS ug/L	CR ug/L	PB ug/L	TOC mg/L	K mg/L	NH3N mg/L	NO3N mg/L	o-PO4-P mg/L	12DCA ug/L	ACET ug/L	BENZ ug/L	CCL4 ug/L	TOL ug/L	VINCHL ug/L
07/06/00	FL 01560	940	0.03	3.09	6.68	25.7									17000	< 500	< 500	< 500	< 500	590
08/07/00	FL 01680														D 19000	< 5	82	< 5	7	D 500
08/08/00	FL 01692														D 22000	< 500	< 500	< 500	< 500	1400
08/09/00	FL 01704														44000	< 500	< 500	< 500	< 500	1400

Number in parantheses indicates compound's cleanup criteria i

CONDU = Specific Conductivity (NC)
FLDPH = Field pH (NC)
CR = Chromium (100)
K = Potassium (NC)
O-PO4-P = Orthophosphate-P (NC)
BENZ = Benzene (5)
VINCHL = Vinyl chloride (2)

DO = Dissolved Oxygen (NC)
TEMP = Temperature (NC)
PB = Lead (15)
NH3N = Ammonia-N (NC)
12DCA = 1,2-Dichloroethane (5)
CCL4 = CARBON TETRACHLORIDE (NC)

DTOWT = Depth to Water (NC)
AS = Arsenic (50)
TOC = Total Organic Carbon (NC)
NO3N = Nitrate-N (NC)
ACET = Acetone (3500)
TOL = Toluene (1000)

< Less than shown detection limit
J Detected conc. below detection limit
E Conc. exceeded instrument calibration range
B Analyte also found in method blank
D Concentration derived from dilution
NC = No cleanup criteria

Attachment B

French Ltd. Project

Analytical Summaries for Compliance Wells - July 2000 Event

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0100

Sample Name: FLTG-013

Sample # : FL 01566

Date Coll'd : 7/10/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	J 4.	ug/L
	1,1-DICHLOROETHENE	< 5	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0101

Sample Name: FLTG-013

Sample # : FL 01571

Date Coll'd : 7/10/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< 05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	28.2	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	2.7	ug/L
	BERYLLIUM	.62	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	1.9	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	7.3	ug/L
	ZINC	17.6	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0101 | Sample Name: FLTG-013

Sample # : FL 01571 | Date Coll'd : 7/10/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	25.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	25.	ug/L	FS
	2-NITROPHENOL	<	10	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	25.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	25	ug/L	FS
	4-NITROPHENOL	<	25.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J	7.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	1.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0101				Sample Name:	FLTG-013
Sample # :	FL01571	Compound	Concentration	Units	Date Coll'd :	7/10/2000
	SV	DIBENZOFURAN	< 10	ug/L		FS
		DIETHYLPHTHALATE	< .10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	J 1.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0100

Sample Name: FLTG-014

Sample # : FL 01567

Date Coll'd : 7/10/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0101 | Sample Name: FLTG-014

Sample # : FL 01572 | Date Coll'd : 7/10/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	6.1	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1 7	ug/L
	BERYLLIUM	.25	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	< 1.7	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	5.6	ug/L
	ZINC	12.6	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0101 | Sample Name: FLTG-014

Sample # : FL 01572 | Date Coll'd : 7/10/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 25.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 25.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 25	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 25.	ug/L	FS
	4-NITROPHENOL	< 25.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J 9.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0101				Sample Name:	FLTG-014
Sample # :	FL01572	Compound	Concentration	Units	Date Coll'd :	7/10/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	J 4.	ug/L		FS
		NAPHTHALENE	< 10	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0111

Sample Name: int-022

Sample # : FL01633

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5	ug/L
	2-BUTANONE	< 50	ug/L
	2-HEXANONE	< 5	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	J 3.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110

Sample Name: int-022

Sample # : FL01625

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	8.8	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	19.6	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	6.4	ug/L
	ZINC	7.4	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110 | Sample Name: int-022

Sample # : FL01625 | Date Coll'd : 7/17/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50	ug/L	FS
	ACENAPHTHENE	< 10	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J 3.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0110				Sample Name:	int-022
Sample # :	FL01625	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0107					Sample Name:	INT-026
Sample # :	FL 01603	Compound	Concentration		Units	Date Coll'd :	7/13/2000
	VOA	1,1,1-TRICHLOROETHANE	<	5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	<	5.	ug/L		
		1,1,2-TRICHLOROETHANE	<	5.	ug/L		
		1,1-DICHLOROETHANE	<	5.	ug/L		
		1,1-DICHLOROETHENE	<	5.	ug/L		
		1,2-DICHLOROETHANE	<	5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	<	5.	ug/L		
		1,2-DICHLOROPROPANE	<	5.	ug/L		
		2-BUTANONE	<	50.	ug/L		
		2-HEXANONE	<	5.	ug/L		
		4-METHYL-2-PENTANONE	<	5	ug/L		
		ACETONE	<	5	ug/L		
		BENZENE	D	330.	ug/L		
		BROMODICHLOROMETHANE	<	5.	ug/L		
		BROMOFORM	<	5.	ug/L		
		BROMOMETHANE	<	5	ug/L		
		CARBON DISULFIDE	<	5	ug/L		
		CARBON TETRACHLORIDE	<	5	ug/L		
		CHLOROBENZENE	J	5.	ug/L		
		CHLOROETHANE	<	5	ug/L		
		CHLOROFORM	<	5	ug/L		
		CHLOROMETHANE	<	5.	ug/L		
		CIS-1,2-DICHLOROETHENE	<	5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	<	5.	ug/L		
		DIBROMOCHLOROMETHANE	<	5	ug/L		
		ETHYLBENZENE	J	3.	ug/L		
		METHYLENE CHLORIDE	<	5.	ug/L		
		STYRENE	<	5.	ug/L		
		TETRACHLOROETHENE	<	5.	ug/L		
		TOLUENE	<	5	ug/L		
		TRANS-1,2-DICHLOROETHENE	<	5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	<	5.	ug/L		
		TRICHLOROETHENE	<	5.	ug/L		
		VINYL CHLORIDE	<	2.	ug/L		
		XYLENE(TOTAL)	J	8.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0106

Sample Name: INT-026

Sample # : FL01599

Date Coll'd : 7/13/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< 1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	.051	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	.16	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	.055	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	271.	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.3	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	8.	ug/L
	SELENIUM	4.6	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	6.6	ug/L
	ZINC	9.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0106 | Sample Name: INT-026

Sample # : FL 01599 | Date Coll'd : 7/13/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 50.	ug/L	DL
	1,2-DICHLOROBENZENE	< 50.	ug/L	DL
	1,3-DICHLOROBENZENE	< 50.	ug/L	DL
	1,4-DICHLOROBENZENE	< 50.	ug/L	DL
	2,4,5-TRICHLOROPHENOL	< 120.	ug/L	DL
	2,4,6-TRICHLOROPHENOL	< 50.	ug/L	DL
	2,4-DICHLOROPHENOL	< 50.	ug/L	DL
	2,4-DIMETHYLPHENOL	< 50.	ug/L	DL
	2,4-DINITROPHENOL	< 120.	ug/L	DL
	2,4-DINITROTOLUENE	< 50.	ug/L	DL
	2,6-DINITROTOLUENE	< 50.	ug/L	DL
	2-CHLORONAPHTHALENE	< 50.	ug/L	DL
	2-CHLOROPHENOL	< 50	ug/L	DL
	2-METHYLNAPHTHALENE	< 50.	ug/L	DL
	2-METHYLPHENOL	< 50.	ug/L	DL
	2-NITROANILINE	< 120.	ug/L	DL
	2-NITROPHENOL	< 50.	ug/L	DL
	3,3'-DICHLOROBENZIDINE	< 50.	ug/L	DL
	3-NITROANILINE	< 120.	ug/L	DL
	4,6-DINITRO-2-METHYLPHENOL	< 120.	ug/L	DL
	4-BROMOPHENYL-PHENYLETHER	< 50.	ug/L	DL
	4-CHLORO-3-METHYLPHENOL	< 50.	ug/L	DL
	4-CHLOROANILINE	< 50	ug/L	DL
	4-CHLOROPHENYL-PHENYLETHER	< 50.	ug/L	DL
	4-METHYLPHENOL	< 50	ug/L	DL
	4-NITROANILINE	< 120	ug/L	DL
	4-NITROPHENOL	< 120	ug/L	DL
	ACENAPHTHENE	J 6.	ug/L	DL
	ACENAPHTHYLENE	< 50.	ug/L	DL
	ANTHRACENE	< 50.	ug/L	DL
	BENZO(A)ANTHRACENE	< 50.	ug/L	DL
	BENZO(A)PYRENE	< 50	ug/L	DL
	BENZO(B)FLUORANTHENE	< 50.	ug/L	DL
	BENZO(G,H,I)PERYLENE	< 50.	ug/L	DL
	BENZO(K)FLUORANTHENE	< 50	ug/L	DL
	BENZOIC ACID	< 250.	ug/L	DL
	BENZYL ALCOHOL	< 50.	ug/L	DL
	BIS(2-CHLOROETHOXY)METHANE	< 50	ug/L	DL
	BIS(2-CHLOROETHYL)ETHER	< 50.	ug/L	DL
	BIS(2-CHLOROISOPROPYL)ETHER	< 50.	ug/L	DL
	BIS(2-ETHYLHEXYL)PHTHALATE	J 10.	ug/L	DL
	BUTYLBENZYLPHTHALATE	< 50.	ug/L	DL
	CHRYSENE	< 50	ug/L	DL
	DI-N-BUTYLPHTHALATE	< 50.	ug/L	DL
	DI-N-OCTYLPHTHALATE	< 50	ug/L	DL
	DIBENZ(A,H)ANTHRACENE	< 50.	ug/L	DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0106 | Sample Name: INT-026

Sample # : FL01599 | Date Coll'd : 7/13/2000

	Compound	Concentration	Units	
SV	DIBENZOFURAN	< 50.	ug/L	DL
	DIETHYLPHTHALATE	< 50.	ug/L	DL
	DIMETHYLPHTHALATE	< 50.	ug/L	DL
	FLUORANTHENE	< 50.	ug/L	DL
	FLUORENE	< 50.	ug/L	DL
	HEXACHLOROBENZENE	< 50.	ug/L	DL
	HEXACHLOROBUTADIENE	< 50.	ug/L	DL
	HEXACHLOROCYCLOPENTADIENE	< 50.	ug/L	DL
	HEXACHLOROETHANE	< 50.	ug/L	DL
	INDENO(1,2,3-CD)PYRENE	< 50.	ug/L	DL
	ISOPHORONE	< 50.	ug/L	DL
	N-NITROSO-DI-N-PROPYLAMINE	< 50.	ug/L	DL
	N-NITROSODIPHENYLAMINE	< 50.	ug/L	DL
	NAPHTHALENE	< 50.	ug/L	DL
	NITROBENZENE	< 50.	ug/L	DL
	PENTACHLOROPHENOL	< 120.	ug/L	DL
	PHENANTHRENE	< 50.	ug/L	DL
	PHENOL	< 50.	ug/L	DL
	PYRENE	< 50.	ug/L	DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0112

Sample Name: INT-059-P-2

Sample # : FL 01636

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0113

Sample Name: INT-059-P-2

Sample # : FL01642

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	69.4	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< 5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< 2	ug/L
	NICKEL	3.1	ug/L
	SELENIUM	5.	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	3.4	ug/L
	ZINC	9.7	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0113 | Sample Name: INT-059-P-2

Sample # : FL01642 | Date Coll'd : 7/18/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10	ug/L	FS
	BENZOIC ACID	J	1.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B	2.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	B	2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0113				Sample Name:	INT-059-P-2
Sample # :	FL01642	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	J 2.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50	ug/L		FS
		PHENANTHRENE	< 10	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0100

Sample Name: INT-060-P-3

Sample # : FL 01568

Date Coll'd : 7/10/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0101

Sample #: FL01573

Sample Name: int-060-p-3

Date Coll'd: 7/10/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	22.5	ug/L
	COPPER	2.3	ug/L
	ANTIMONY	2.1	ug/L
	BERYLLIUM	.24	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	4.9	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	2.7	ug/L
	ZINC	12.2	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0101 | Sample Name: int-060-p-3

Sample # : FL01573 | Date Coll'd : 7/10/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	25	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10	ug/L	FS
	2-METHYLNAPHTHALENE	<	10	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	25	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	25.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10	ug/L	FS
	4-NITROANILINE	<	25.	ug/L	FS
	4-NITROPHENOL	<	25.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B	10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	6.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0101				Sample Name:	int-060-p-3
Sample # :	FL 01573	Compound	Concentration	Units	Date Coll'd :	7/10/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	J 1.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	J 2.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0112				Sample Name:	INT-101
Sample # :	FL 01638	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	6.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5	ug/L		
		CHLOROBENZENE	< 5	ug/L		
		CHLOROETHANE	< 5	ug/L		
		CHLOROFORM	< 5	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5	ug/L		
		TRICHLOROETHENE	< 5	ug/L		
		VINYL CHLORIDE	< 2	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0113

Sample Name: INT-101

Sample # : FL 01644

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< 1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	78.5	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	< 1 7	ug/L
	SELENIUM	4.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	2.6	ug/L
	ZINC	10.1	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0113 | Sample Name: INT-101

Sample # : FL 01644 | Date Coll'd : 7/18/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50	ug/L	FS
	2-NITROPHENOL	<	10	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10	ug/L	FS
	3-NITROANILINE	<	50	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50	ug/L	FS
	4-NITROPHENOL	<	50	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10	ug/L	FS
	ANTHRACENE	<	10	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	**B**	**6.**	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	**B**	**2.**	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0113				Sample Name:	INT-101
Sample # :	FL 01644	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10	ug/L		FS
		FLUORENE	< 10	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0107

Sample Name: INT-106

Sample # : FL 01602

Date Coll'd : 7/13/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	**30.**	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	**79.**	ug/L
	1,2-DICHLOROETHENE(TOTAL)	**120.**	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	**6.**	ug/L
	BROMODICHLOROMETHANE	< 5	ug/L
	BROMOFORM	< 5	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5	ug/L
	CARBON TETRACHLORIDE	< 5	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	**109.**	ug/L
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	**99.**	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	**11.**	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	**25.**	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	**7.**	ug/L
	VINYL CHLORIDE	**24.**	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0106 | Sample Name: INT-106

Sample # : FL 01598 | Date Coll'd : 7/13/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< 1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	6.7	ug/L
	COPPER	.91	ug/L
	ANTIMONY	< 1 7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	3.4	ug/L
	SELENIUM	4.5	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	5.4	ug/L
	ZINC	18.2	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT **FLTG, INC.**

Ground Water

French Limited

ArCoC #:	FL0106				Sample Name:	INT-106
Sample # :	FL01598	Compound	Concentration	Units	Date Coll'd :	7/13/2000
	SV	1,2,4-TRICHLOROBENZENE	< 50.	ug/L		DL
		1,2-DICHLOROBENZENE	< 50.	ug/L		DL
		1,3-DICHLOROBENZENE	< 50.	ug/L		DL
		1,4-DICHLOROBENZENE	< 50	ug/L		DL
		2,4,5-TRICHLOROPHENOL	< 120.	ug/L		DL
		2,4,6-TRICHLOROPHENOL	< 50.	ug/L		DL
		2,4-DICHLOROPHENOL	< 50.	ug/L		DL
		2,4-DIMETHYLPHENOL	< 50.	ug/L		DL
		2,4-DINITROPHENOL	< 120.	ug/L		DL
		2,4-DINITROTOLUENE	< 50.	ug/L		DL
		2,6-DINITROTOLUENE	< 50.	ug/L		DL
		2-CHLORONAPHTHALENE	< 50.	ug/L		DL
		2-CHLOROPHENOL	< 50.	ug/L		DL
		2-METHYLNAPHTHALENE	< 50.	ug/L		DL
		2-METHYLPHENOL	< 50.	ug/L		DL
		2-NITROANILINE	< 120	ug/L		DL
		2-NITROPHENOL	< 50.	ug/L		DL
		3,3'-DICHLOROBENZIDINE	< 50.	ug/L		DL
		3-NITROANILINE	< 120	ug/L		DL
		4,6-DINITRO-2-METHYLPHENOL	< 120.	ug/L		DL
		4-BROMOPHENYL-PHENYLETHER	< 50	ug/L		DL
		4-CHLORO-3-METHYLPHENOL	< 50.	ug/L		DL
		4-CHLOROANILINE	< 50.	ug/L		DL
		4-CHLOROPHENYL-PHENYLETHER	< 50.	ug/L		DL
		4-METHYLPHENOL	< 50	ug/L		DL
		4-NITROANILINE	< 120	ug/L		DL
		4-NITROPHENOL	< 120	ug/L		DL
		ACENAPHTHENE	< 50	ug/L		DL
		ACENAPHTHYLENE	< 50	ug/L		DL
		ANTHRACENE	< 50	ug/L		DL
		BENZO(A)ANTHRACENE	< 50.	ug/L		DL
		BENZO(A)PYRENE	< 50.	ug/L		DL
		BENZO(B)FLUORANTHENE	< 50.	ug/L		DL
		BENZO(G,H,I)PERYLENE	< 50.	ug/L		DL
		BENZO(K)FLUORANTHENE	< 50.	ug/L		DL
		BENZOIC ACID	< 250	ug/L		DL
		BENZYL ALCOHOL	< 50.	ug/L		DL
		BIS(2-CHLOROETHOXY)METHANE	< 50.	ug/L		DL
		BIS(2-CHLOROETHYL)ETHER	< 50	ug/L		DL
		BIS(2-CHLOROISOPROPYL)ETHER	< 50.	ug/L		DL
		BIS(2-ETHYLHEXYL)PHTHALATE	< 50	ug/L		DL
		BUTYLBENZYLPHTHALATE	< 50.	ug/L		DL
		CHRYSENE	< 50.	ug/L		DL
		DI-N-BUTYLPHTHALATE	< 50	ug/L		DL
		DI-N-OCTYLPHTHALATE	< 50	ug/L		DL
		DIBENZ(A,H)ANTHRACENE	< 50.	ug/L		DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0106				Sample Name:	INT-106
Sample # :	FL01598	Compound	Concentration	Units	Date Coll'd :	7/13/2000
	SV	DIBENZOFURAN	< 50	ug/L		DL
		DIETHYLPHTHALATE	< 50.	ug/L		DL
		DIMETHYLPHTHALATE	< 50.	ug/L		DL
		FLUORANTHENE	< 50.	ug/L		DL
		FLUORENE	< 50	ug/L		DL
		HEXACHLOROBENZENE	< 50.	ug/L		DL
		HEXACHLOROBUTADIENE	< 50.	ug/L		DL
		HEXACHLOROCYCLOPENTADIENE	< 50.	ug/L		DL
		HEXACHLOROETHANE	< 50.	ug/L		DL
		INDENO(1,2,3-CD)PYRENE	< 50.	ug/L		DL
		ISOPHORONE	< 50.	ug/L		DL
		N-NITROSO-DI-N-PROPYLAMINE	< 50.	ug/L		DL
		N-NITROSODIPHENYLAMINE	< 50.	ug/L		DL
		NAPHTHALENE	< 50.	ug/L		DL
		NITROBENZENE	< 50.	ug/L		DL
		PENTACHLOROPHENOL	< 120.	ug/L		DL
		PHENANTHRENE	< 50.	ug/L		DL
		PHENOL	< 50.	ug/L		DL
		PYRENE	< 50.	ug/L		DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0100

Sample Name: INT-108

Sample # : FL 01569

Date Coll'd : 7/10/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5	ug/L
	1,1-DICHLOROETHENE	< 5	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5	ug/L
	ACETONE	< 5	ug/L
	BENZENE	< 5	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0101

Sample Name: int-108

Sample # : FL 01574

Date Coll'd : 7/10/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< 05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	8.1	ug/L
	COPPER	.69	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.25	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	.92	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	3.5	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	2.7	ug/L
	ZINC	15.2	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0101 | Sample Name: int-108

Sample # : FL01574 | Date Coll'd : 7/10/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 25	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 25.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 25.	ug/L	FS
	2-NITROPHENOL	< 10	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 25	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 25	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 25.	ug/L	FS
	4-NITROPHENOL	< 25.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50	ug/L	FS
	BENZYL ALCOHOL	< 10	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J 9.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0101				Sample Name:	int-108
Sample # :	FL01574	Compound	Concentration	Units	Date Coll'd :	7/10/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	J 4.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0102				Sample Name:	INT-118
Sample # :	FL01570	Compound	Concentration	Units	Date Coll'd :	7/11/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5	ug/L		
		CARBON DISULFIDE	< 5	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0103

Sample Name: INT-118

Sample # : FL01575

Date Coll'd : 7/11/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	2.2	ug/L
	COPPER	.69	ug/L
	ANTIMONY	2.4	ug/L
	BERYLLIUM	.2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1 8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	2.9	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	10.9	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0103 | Sample Name: INT-118

Sample # : FL 01575 | Date Coll'd : 7/11/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 25.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 25.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 25.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10	ug/L	FS
	4-NITROANILINE	< 25.	ug/L	FS
	4-NITROPHENOL	< 25	ug/L	FS
	ACENAPHTHENE	< 10	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	B 10.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0103				Sample Name:	INT-118
Sample # :	FL01575	Compound	Concentration	Units	Date Coll'd :	7/11/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	J. 1.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	J 3.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0112

Sample Name: INT-120

Sample # : FL 01639

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	**20.**	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	**8.**	ug/L
	1,2-DICHLOROETHENE(TOTAL)	**34.**	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	**20.**	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	**26.**	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	**8.**	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	**20.**	ug/L
	XYLENE(TOTAL)	< 5	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0113

Sample Name: INT-120

Sample # : FL01645

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	5.2	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	.26	ug/L
	NICKEL	1.9	ug/L
	SELENIUM	4.4	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	3.8	ug/L
	ZINC	11.3	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0113 | Sample Name: INT-120

Sample # : FL 01645 | Date Coll'd : 7/18/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 5.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	B 1.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0113				Sample Name:	INT-120
Sample # :	FL 01645	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0108				Sample Name:	INT-123
Sample # :	FL 01607	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	52.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	13.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	22.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	J 3.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	33.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	16.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5	ug/L		
		TRANS-1,2-DICHLOROETHENE	6.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	25.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109

Sample Name: INT-123

Sample # : FL 01614

Date Coll'd : 7/14/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 3.4	ug/L
	ARSENIC	12.3	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	6.4	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	1.9	ug/L
	SELENIUM	6.5	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	19.8	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109 | Sample Name: INT-123

Sample # : FL 01614 | Date Coll'd : 7/14/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10	ug/L	FS
	ANTHRACENE	<	10	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J	1.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	1.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109

Sample Name: INT-123

Sample # : FL 01614

Date Coll'd : 7/14/2000

	Compound	Concentration	Units	
SV	DIBENZOFURAN	< 10.	ug/L	FS
	DIETHYLPHTHALATE	< 10.	ug/L	FS
	DIMETHYLPHTHALATE	< 10.	ug/L	FS
	FLUORANTHENE	< 10.	ug/L	FS
	FLUORENE	< 10.	ug/L	FS
	HEXACHLOROBENZENE	< 10	ug/L	FS
	HEXACHLOROBUTADIENE	< 10.	ug/L	FS
	HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L	FS
	HEXACHLOROETHANE	< 10.	ug/L	FS
	INDENO(1,2,3-CD)PYRENE	< 10.	ug/L	FS
	ISOPHORONE	< 10.	ug/L	FS
	N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L	FS
	N-NITROSODIPHENYLAMINE	< 10.	ug/L	FS
	NAPHTHALENE	< 10.	ug/L	FS
	NITROBENZENE	< 10.	ug/L	FS
	PENTACHLOROPHENOL	< 50.	ug/L	FS
	PHENANTHRENE	< 10.	ug/L	FS
	PHENOL	< 10.	ug/L	FS
	PYRENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114

Sample Name: INT-127

Sample # : FL 01646

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	7.	ug/L
	1,1-DICHLOROETHENE	< 5	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	180.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	18.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	J 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	J 9.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample Name: INT-127

Sample # : FL01658

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	.06	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	1.7	ug/L
	ARSENIC	128.	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.51	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	6.6	ug/L
	SELENIUM	4.9	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	7.2	ug/L
	ZINC	6.9	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115 | Sample Name: INT-127

Sample # : FL01658 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10	ug/L	FS
	4-CHLOROANILINE	< 10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50	ug/L	FS
	BENZYL ALCOHOL	< 10	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 24.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	B 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115				Sample Name:	INT-127
Sample # :	FL 01658	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	J 7.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114

Sample Name: INT-127DUP

Sample # : FL 01647

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	7.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	180.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	18.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	J 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2	ug/L
	XYLENE(TOTAL)	J 9.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample Name: INT-127DUP

Sample # : FL01659

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	.055	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< 05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	121.	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.42	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	6.6	ug/L
	SELENIUM	< 3 8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	3.3	ug/L
	ZINC	7.7	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115 | Sample Name: INT-127DUP

Sample # : FL 01659 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10	ug/L	FS
	4-CHLOROANILINE	< 10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50	ug/L	FS
	4-NITROPHENOL	< 50	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 28.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	B 1.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115					Sample Name:	INT-127DUP
Sample # :	FL 01659	Compound	Concentration		Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	<	10.	ug/L		FS
		DIETHYLPHTHALATE	<	10.	ug/L		FS
		DIMETHYLPHTHALATE	<	10.	ug/L		FS
		FLUORANTHENE	<	10.	ug/L		FS
		FLUORENE	<	10.	ug/L		FS
		HEXACHLOROBENZENE	<	10.	ug/L		FS
		HEXACHLOROBUTADIENE	<	10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	<	10.	ug/L		FS
		HEXACHLOROETHANE	<	10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	<	10.	ug/L		FS
		ISOPHORONE	<	10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	<	10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	<	10.	ug/L		FS
		NAPHTHALENE	<	10.	ug/L		FS
		NITROBENZENE	<	10.	ug/L		FS
		PENTACHLOROPHENOL	<	50.	ug/L		FS
		PHENANTHRENE	<	10.	ug/L		FS
		PHENOL	<	10.	ug/L		FS
		PYRENE	<	10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114 | Sample Name: INT-130R

Sample # : FL 01652 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	210.	ug/L
	1,1-DICHLOROETHENE	59.	ug/L
	1,2-DICHLOROETHANE	D 200.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	D 1,200.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	42.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	D 15,000.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	D 8,200.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	D 870.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	20.	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	D 8,700.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	D 320.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	D 980.	ug/L
	VINYL CHLORIDE	28.	ug/L
	XYLENE(TOTAL)	160.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample #: FL01664

Sample Name: INT-130R

Date Coll'd: 7/19/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	.16	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	.14	ug/L
	ENDRIN ALDEHYDE	.13	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	.076	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	3.3	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	2.6	ug/L
	SELENIUM	3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	8.8	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115 | Sample Name: INT-130R

Sample # : FL 01664 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 200.	ug/L	DL
	1,2-DICHLOROBENZENE	< 200.	ug/L	DL
	1,3-DICHLOROBENZENE	< 200.	ug/L	DL
	1,4-DICHLOROBENZENE	< 200	ug/L	DL
	2,4,5-TRICHLOROPHENOL	< 1,000.	ug/L	DL
	2,4,6-TRICHLOROPHENOL	< 200.	ug/L	DL
	2,4-DICHLOROPHENOL	< 200.	ug/L	DL
	2,4-DIMETHYLPHENOL	< 200.	ug/L	DL
	2,4-DINITROPHENOL	< 1,000.	ug/L	DL
	2,4-DINITROTOLUENE	< 200.	ug/L	DL
	2,6-DINITROTOLUENE	< 200.	ug/L	DL
	2-CHLORONAPHTHALENE	< 200.	ug/L	DL
	2-CHLOROPHENOL	< 200.	ug/L	DL
	2-METHYLNAPHTHALENE	J 24.	ug/L	DL
	2-METHYLPHENOL	< 200.	ug/L	DL
	2-NITROANILINE	< 1,000.	ug/L	DL
	2-NITROPHENOL	< 200.	ug/L	DL
	3,3'-DICHLOROBENZIDINE	< 200.	ug/L	DL
	3-NITROANILINE	< 1,000.	ug/L	DL
	4,6-DINITRO-2-METHYLPHENOL	< 1,000.	ug/L	DL
	4-BROMOPHENYL-PHENYLETHER	< 200.	ug/L	DL
	4-CHLORO-3-METHYLPHENOL	< 200.	ug/L	DL
	4-CHLOROANILINE	< 200.	ug/L	DL
	4-CHLOROPHENYL-PHENYLETHER	< 200	ug/L	DL
	4-METHYLPHENOL	< 200.	ug/L	DL
	4-NITROANILINE	< 1,000.	ug/L	DL
	4-NITROPHENOL	< 1,000.	ug/L	DL
	ACENAPHTHENE	J 61.	ug/L	DL
	ACENAPHTHYLENE	< 200.	ug/L	DL
	ANTHRACENE	< 200.	ug/L	DL
	BENZO(A)ANTHRACENE	< 200.	ug/L	DL
	BENZO(A)PYRENE	< 200.	ug/L	DL
	BENZO(B)FLUORANTHENE	< 200	ug/L	DL
	BENZO(G,H,I)PERYLENE	< 200.	ug/L	DL
	BENZO(K)FLUORANTHENE	< 200.	ug/L	DL
	BENZOIC ACID	< 1,000.	ug/L	DL
	BENZYL ALCOHOL	< 200	ug/L	DL
	BIS(2-CHLOROETHOXY)METHANE	< 200.	ug/L	DL
	BIS(2-CHLOROETHYL)ETHER	< 200.	ug/L	DL
	BIS(2-CHLOROISOPROPYL)ETHER	< 200.	ug/L	DL
	BIS(2-ETHYLHEXYL)PHTHALATE	< 200.	ug/L	DL
	BUTYLBENZYLPHTHALATE	< 200.	ug/L	DL
	CHRYSENE	< 200.	ug/L	DL
	DI-N-BUTYLPHTHALATE	< 200	ug/L	DL
	DI-N-OCTYLPHTHALATE	< 200	ug/L	DL
	DIBENZ(A,H)ANTHRACENE	< 200.	ug/L	DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0115					Sample Name:	INT-130R
Sample # :	FL01664	Compound	Concentration		Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	<	200.	ug/L		DL
		DIETHYLPHTHALATE	<	200.	ug/L		DL
		DIMETHYLPHTHALATE	<	200.	ug/L		DL
		FLUORANTHENE	<	200.	ug/L		DL
		FLUORENE	J	35.	ug/L		DL
		HEXACHLOROBENZENE	<	200.	ug/L		DL
		HEXACHLOROBUTADIENE	J	120.	ug/L		DL
		HEXACHLOROCYCLOPENTADIENE	<	200.	ug/L		DL
		HEXACHLOROETHANE	J	140.	ug/L		DL
		INDENO(1,2,3-CD)PYRENE	<	200.	ug/L		DL
		ISOPHORONE	<	200.	ug/L		DL
		N-NITROSO-DI-N-PROPYLAMINE	<	200.	ug/L		DL
		N-NITROSODIPHENYLAMINE	<	200.	ug/L		DL
		NAPHTHALENE		680.	ug/L		DL
		NITROBENZENE	<	200.	ug/L		DL
		PENTACHLOROPHENOL	<	1,000.	ug/L		DL
		PHENANTHRENE	<	200.	ug/L		DL
		PHENOL	<	200.	ug/L		DL
		PYRENE	<	200.	ug/L		DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0114

Sample Name: INT-130RS

Sample # : FL01648

Date Coll'd : 7/19/2000

	Compound		Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	<	5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	<	5.	ug/L
	1,1,2-TRICHLOROETHANE	<	5.	ug/L
	1,1-DICHLOROETHANE		170.	ug/L
	1,1-DICHLOROETHENE		12.	ug/L
	1,2-DICHLOROETHANE		240.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	D	660.	ug/L
	1,2-DICHLOROPROPANE	<	5.	ug/L
	2-BUTANONE	<	50	ug/L
	2-HEXANONE	<	5.	ug/L
	4-METHYL-2-PENTANONE	<	5.	ug/L
	ACETONE	<	5.	ug/L
	BENZENE		41.	ug/L
	BROMODICHLOROMETHANE	<	5.	ug/L
	BROMOFORM	<	5.	ug/L
	BROMOMETHANE	<	5.	ug/L
	CARBON DISULFIDE	<	5.	ug/L
	CARBON TETRACHLORIDE	D	2,900.	ug/L
	CHLOROBENZENE	<	5.	ug/L
	CHLOROETHANE	<	5.	ug/L
	CHLOROFORM	D	2,100.	ug/L
	CHLOROMETHANE	<	5.	ug/L
	CIS-1,2-DICHLOROETHENE	D	510.	ug/L
	CIS-1,3-DICHLOROPROPENE	<	5.	ug/L
	DIBROMOCHLOROMETHANE	<	5	ug/L
	ETHYLBENZENE	<	5	ug/L
	METHYLENE CHLORIDE		23.	ug/L
	STYRENE	<	5.	ug/L
	TETRACHLOROETHENE	D	7,900.	ug/L
	TOLUENE	<	5.	ug/L
	TRANS-1,2-DICHLOROETHENE	D	150.	ug/L
	TRANS-1,3-DICHLOROPROPENE	<	5.	ug/L
	TRICHLOROETHENE	D	210.	ug/L
	VINYL CHLORIDE		210.	ug/L
	XYLENE(TOTAL)		140.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115

Sample Name: INT-130RS

Sample # : FL 01660

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	.094	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	.11	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	.12	ug/L
	ENDRIN	.31	ug/L
	ENDRIN ALDEHYDE	.11	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	5.8	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	3.3	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	3.5	ug/L
	ZINC	8.3	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115 | Sample Name: INT-130RS

Sample # : FL01660 | Date Coll'd : 7/19/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	J	6.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	J	4.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	E	100.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B	10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10	ug/L	FS
	DI-N-BUTYLPHTHALATE	B	2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0115				Sample Name:	INT-130RS
Sample # :	FL01660	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	33.	ug/L		FS
		DIETHYLPHTHALATE	<. 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	61.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	60.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	E 280.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	41.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115 | Sample Name: INT-130RS

Sample # : FL 01660 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 250.	ug/L	DL
	1,2-DICHLOROBENZENE	< 250.	ug/L	DL
	1,3-DICHLOROBENZENE	< 250.	ug/L	DL
	1,4-DICHLOROBENZENE	< 250	ug/L	DL
	2,4,5-TRICHLOROPHENOL	< 1,200.	ug/L	DL
	2,4,6-TRICHLOROPHENOL	< 250.	ug/L	DL
	2,4-DICHLOROPHENOL	< 250	ug/L	DL
	2,4-DIMETHYLPHENOL	< 250.	ug/L	DL
	2,4-DINITROPHENOL	< 1,200.	ug/L	DL
	2,4-DINITROTOLUENE	< 250.	ug/L	DL
	2,6-DINITROTOLUENE	< 250.	ug/L	DL
	2-CHLORONAPHTHALENE	< 250.	ug/L	DL
	2-CHLOROPHENOL	< 250.	ug/L	DL
	2-METHYLNAPHTHALENE	< 250.	ug/L	DL
	2-METHYLPHENOL	< 250.	ug/L	DL
	2-NITROANILINE	< 1,200.	ug/L	DL
	2-NITROPHENOL	< 250.	ug/L	DL
	3,3'-DICHLOROBENZIDINE	< 250.	ug/L	DL
	3-NITROANILINE	< 1,200.	ug/L	DL
	4,6-DINITRO-2-METHYLPHENOL	< 1,200.	ug/L	DL
	4-BROMOPHENYL-PHENYLETHER	< 250.	ug/L	DL
	4-CHLORO-3-METHYLPHENOL	< 250.	ug/L	DL
	4-CHLOROANILINE	< 250.	ug/L	DL
	4-CHLOROPHENYL-PHENYLETHER	< 250.	ug/L	DL
	4-METHYLPHENOL	< 250.	ug/L	DL
	4-NITROANILINE	< 1,200.	ug/L	DL
	4-NITROPHENOL	< 1,200.	ug/L	DL
	ACENAPHTHENE	D 96.	ug/L	DL
	ACENAPHTHYLENE	< 250.	ug/L	DL
	ANTHRACENE	< 250.	ug/L	DL
	BENZO(A)ANTHRACENE	< 250.	ug/L	DL
	BENZO(A)PYRENE	< 250.	ug/L	DL
	BENZO(B)FLUORANTHENE	< 250.	ug/L	DL
	BENZO(G,H,I)PERYLENE	< 250.	ug/L	DL
	BENZO(K)FLUORANTHENE	< 250	ug/L	DL
	BENZOIC ACID	< 1,200.	ug/L	DL
	BENZYL ALCOHOL	< 250.	ug/L	DL
	BIS(2-CHLOROETHOXY)METHANE	< 250.	ug/L	DL
	BIS(2-CHLOROETHYL)ETHER	< 250.	ug/L	DL
	BIS(2-CHLOROISOPROPYL)ETHER	< 250	ug/L	DL
	BIS(2-ETHYLHEXYL)PHTHALATE	< 250.	ug/L	DL
	BUTYLBENZYLPHTHALATE	< 250.	ug/L	DL
	CHRYSENE	< 250.	ug/L	DL
	DI-N-BUTYLPHTHALATE	< 250	ug/L	DL
	DI-N-OCTYLPHTHALATE	< 250.	ug/L	DL
	DIBENZ(A,H)ANTHRACENE	< 250.	ug/L	DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT **FLTG, INC.**

Ground Water

French Limited

ArCoC #:	FL 0115				Sample Name:	INT-130RS
Sample # :	FL 01660	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	D 35.	ug/L		DL
		DIETHYLPHTHALATE	< 250.	ug/L		DL
		DIMETHYLPHTHALATE	< 250.	ug/L		DL
		FLUORANTHENE	< 250.	ug/L		DL
		FLUORENE	D 64.	ug/L		DL
		HEXACHLOROBENZENE	< 250.	ug/L		DL
		HEXACHLOROBUTADIENE	< 250.	ug/L		DL
		HEXACHLOROCYCLOPENTADIENE	< 250.	ug/L		DL
		HEXACHLOROETHANE	D 65.	ug/L		DL
		INDENO(1,2,3-CD)PYRENE	< 250.	ug/L		DL
		ISOPHORONE	< 250.	ug/L		DL
		N-NITROSO-DI-N-PROPYLAMINE	< 250.	ug/L		DL
		N-NITROSODIPHENYLAMINE	< 250.	ug/L		DL
		NAPHTHALENE	D 840.	ug/L		DL
		NITROBENZENE	< 250.	ug/L		DL
		PENTACHLOROPHENOL	< 1,200.	ug/L		DL
		PHENANTHRENE	D 38.	ug/L		DL
		PHENOL	< 250.	ug/L		DL
		PYRENE	< 250.	ug/L		DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0108				Sample Name:	INT-134
Sample # :	FL 01608	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	**32.**	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	**57.**	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	**17.**	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	**5.**	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	**J 5.**	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	**17.**	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	**86.**	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109

Sample Name: INT-134

Sample # : FL 01615

Date Coll'd : 7/14/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< 05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	3.3	ug/L
	BERYLLIUM	< 2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	3.8	ug/L
	SELENIUM	7.9	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	2.6	ug/L
	ZINC	13.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109 | Sample Name: INT-134

Sample # : FL 01615 | Date Coll'd : 7/14/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	12.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 1.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0109				Sample Name:	INT-134
Sample # :	FL01615	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0108				Sample Name:	INT-134-D
Sample # :	FL01611	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	32.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	57.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	16.	ug/L		
		1,2-DICHLOROPROPANE	< 5	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	J 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	16.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5	ug/L		
		VINYL CHLORIDE	84.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109

Sample Name: INT-134-D

Sample # : FL 01618

Date Coll'd : 7/14/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	1.9	ug/L
	BERYLLIUM	< 2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	2.6	ug/L
	SELENIUM	8.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	9.9	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0109 | Sample Name: INT-134-D

Sample # : FL01618 | Date Coll'd : 7/14/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	12.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0109				Sample Name:	INT-134-D
Sample # :	FL 01618	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0105				Sample Name:	INT-135
Sample # :	FL 01590	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	J 3.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	7.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	11.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0104

Sample Name: INT-135

Sample # : FL 01585

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	37.8	ug/L
	COPPER	1.4	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.27	ug/L
	CADMIUM	.72	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	.2	ug/L
	NICKEL	< 1.7	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	2.4	ug/L
	ZINC	20.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0104 | Sample Name: INT-135

Sample # : FL 01585 | Date Coll'd : 7/12/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	25.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	25.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	25.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	25	ug/L	FS
	4-NITROPHENOL	<	25	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10	ug/L	FS
	BENZOIC ACID	J	2.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J	4.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	7.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	INT-135
Sample # :	FL 01585	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	J 1.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	J 2.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0102

Sample Name: INT-144

Sample # : FL01576

Date Coll'd : 7/11/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	J 4.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0103

Sample Name: INT-144

Sample # : FL01580

Date Coll'd : 7/11/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< 1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	8.6	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	3.2	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1 8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	2.	ug/L
	SELENIUM	6.7	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	11.6	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0103 | Sample Name: INT-144

Sample # : FL01580 | Date Coll'd : 7/11/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	25	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	25.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	25	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	25	ug/L	FS
	4-NITROPHENOL	<	25.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10	ug/L	FS
	BENZO(A)PYRENE	<	10	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B	10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0103				Sample Name:	INT-144
Sample # :	FL01580	Compound	Concentration	Units	Date Coll'd :	7/11/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0102				Sample Name:	INT-214
Sample # :	FL 01577	Compound	Concentration	Units	Date Coll'd :	7/11/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0103

Sample Name: INT-214

Sample # : FL01581

Date Coll'd : 7/11/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	55.7	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	4.9	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	6.2	ug/L
	ZINC	11.9	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0103 | Sample Name: INT-214

Sample # : FL 01581 | Date Coll'd : 7/11/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 25	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 25	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 25.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 25.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 25.	ug/L	FS
	4-NITROPHENOL	< 25.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	**J 3.**	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	**J 2.**	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0103				Sample Name:	INT-214
Sample # :	FL01581	Compound	Concentration	Units	Date Coll'd :	7/11/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0108				Sample Name:	INT-155
Sample # :	FL 01609	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5	ug/L		
		CARBON DISULFIDE	< 5	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109

Sample Name: INT-155

Sample # : FL 01616

Date Coll'd : 7/14/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< 1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ANTIMONY	3.	ug/L
	ARSENIC	< 1.7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	< 1 7	ug/L
	SELENIUM	4.6	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	3.	ug/L
	ZINC	11.3	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109 | Sample Name: INT-155

Sample # : FL 01616 | Date Coll'd : 7/14/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	<	10	ug/L	FS
	ACENAPHTHYLENE	<	10	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10	ug/L	FS
	BENZO(A)PYRENE	<	10	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	**J**	**3.**	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10	ug/L	FS
	DI-N-BUTYLPHTHALATE	**J**	**1.**	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0109				Sample Name:	INT-155
Sample # :	FL01616	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0107

Sample Name: INT-217

Sample # : FL 01601

Date Coll'd : 7/13/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	**10.**	**ug/L**
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5	ug/L
	1,2-DICHLOROPROPANE	< 5	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5	ug/L
	4-METHYL-2-PENTANONE	< 5	ug/L
	ACETONE	< 5	ug/L
	BENZENE	**9.**	**ug/L**
	BROMODICHLOROMETHANE	< 5	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5	ug/L
	CARBON TETRACHLORIDE	< 5	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	**25.**	**ug/L**
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0106

Sample Name: INT-217

Sample # : FL 01597

Date Coll'd : 7/13/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	34.8	ug/L
	COPPER	1.5	ug/L
	ANTIMONY	< 1 7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.38	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	11.	ug/L
	SELENIUM	4.1	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	6.2	ug/L
	ZINC	11.8	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0106 | Sample Name: INT-217

Sample # : FL 01597 | Date Coll'd : 7/13/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 50.	ug/L	DL
	1,2-DICHLOROBENZENE	< 50.	ug/L	DL
	1,3-DICHLOROBENZENE	< 50.	ug/L	DL
	1,4-DICHLOROBENZENE	< 50.	ug/L	DL
	2,4,5-TRICHLOROPHENOL	< 120.	ug/L	DL
	2,4,6-TRICHLOROPHENOL	< 50.	ug/L	DL
	2,4-DICHLOROPHENOL	< 50.	ug/L	DL
	2,4-DIMETHYLPHENOL	< 50.	ug/L	DL
	2,4-DINITROPHENOL	< 120.	ug/L	DL
	2,4-DINITROTOLUENE	< 50.	ug/L	DL
	2,6-DINITROTOLUENE	< 50.	ug/L	DL
	2-CHLORONAPHTHALENE	< 50.	ug/L	DL
	2-CHLOROPHENOL	< 50.	ug/L	DL
	2-METHYLNAPHTHALENE	< 50.	ug/L	DL
	2-METHYLPHENOL	< 50.	ug/L	DL
	2-NITROANILINE	< 120.	ug/L	DL
	2-NITROPHENOL	< 50	ug/L	DL
	3,3'-DICHLOROBENZIDINE	< 50.	ug/L	DL
	3-NITROANILINE	< 120.	ug/L	DL
	4,6-DINITRO-2-METHYLPHENOL	< 120.	ug/L	DL
	4-BROMOPHENYL-PHENYLETHER	< 50.	ug/L	DL
	4-CHLORO-3-METHYLPHENOL	< 50.	ug/L	DL
	4-CHLOROANILINE	< 50	ug/L	DL
	4-CHLOROPHENYL-PHENYLETHER	< 50.	ug/L	DL
	4-METHYLPHENOL	< 50	ug/L	DL
	4-NITROANILINE	< 120	ug/L	DL
	4-NITROPHENOL	< 120	ug/L	DL
	ACENAPHTHENE	< 50	ug/L	DL
	ACENAPHTHYLENE	< 50	ug/L	DL
	ANTHRACENE	< 50.	ug/L	DL
	BENZO(A)ANTHRACENE	< 50.	ug/L	DL
	BENZO(A)PYRENE	< 50.	ug/L	DL
	BENZO(B)FLUORANTHENE	< 50.	ug/L	DL
	BENZO(G,H,I)PERYLENE	< 50.	ug/L	DL
	BENZO(K)FLUORANTHENE	< 50	ug/L	DL
	BENZOIC ACID	< 250.	ug/L	DL
	BENZYL ALCOHOL	< 50	ug/L	DL
	BIS(2-CHLOROETHOXY)METHANE	< 50.	ug/L	DL
	BIS(2-CHLOROETHYL)ETHER	< 50.	ug/L	DL
	BIS(2-CHLOROISOPROPYL)ETHER	< 50.	ug/L	DL
	BIS(2-ETHYLHEXYL)PHTHALATE	< 50.	ug/L	DL
	BUTYLBENZYLPHTHALATE	< 50.	ug/L	DL
	CHRYSENE	< 50.	ug/L	DL
	DI-N-BUTYLPHTHALATE	< 50	ug/L	DL
	DI-N-OCTYLPHTHALATE	< 50.	ug/L	DL
	DIBENZ(A,H)ANTHRACENE	< 50	ug/L	DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0106				Sample Name:	INT-217
Sample # :	FL01597	Compound	Concentration	Units	Date Coll'd :	7/13/2000
	SV	DIBENZOFURAN	< 50.	ug/L		DL
		DIETHYLPHTHALATE	< 50.	ug/L		DL
		DIMETHYLPHTHALATE	< 50.	ug/L		DL
		FLUORANTHENE	< 50.	ug/L		DL
		FLUORENE	< 50.	ug/L		DL
		HEXACHLOROBENZENE	< 50.	ug/L		DL
		HEXACHLOROBUTADIENE	< 50.	ug/L		DL
		HEXACHLOROCYCLOPENTADIENE	< 50.	ug/L		DL
		HEXACHLOROETHANE	< 50.	ug/L		DL
		INDENO(1,2,3-CD)PYRENE	< 50.	ug/L		DL
		ISOPHORONE	< 50.	ug/L		DL
		N-NITROSO-DI-N-PROPYLAMINE	< 50	ug/L		DL
		N-NITROSODIPHENYLAMINE	< 50.	ug/L		DL
		NAPHTHALENE	< 50.	ug/L		DL
		NITROBENZENE	< 50.	ug/L		DL
		PENTACHLOROPHENOL	< 120.	ug/L		DL
		PHENANTHRENE	< 50	ug/L		DL
		PHENOL	< 50.	ug/L		DL
		PYRENE	< 50.	ug/L		DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114

Sample Name: INT-233

Sample # : FL 01653

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	**20.**	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	**D 320.**	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	**28.**	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5..	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	**42.**	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	**6.**	ug/L
	VINYL CHLORIDE	< 2	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115 | Sample Name: INT-233

Sample # : FL 01665 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< 1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< 1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	132.	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.21	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	< 1.7	ug/L
	SELENIUM	4.3	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	8.9	ug/L
	ZINC	6.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample Name: INT-233

Sample # : FL01665

Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 5.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	B 4.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115				Sample Name:	INT-233
Sample # :	FL 01665	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0099				Sample Name:	INT-234
Sample # :	FL 01563	Compound	Concentration	Units	Date Coll'd :	7/7/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	56.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	37.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 5.	ug/L		
		XYLENE(TOTAL)	< 5	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0099

Sample Name: INT-235

Sample # : FL 01564

Date Coll'd : 7/7/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	72.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	89.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	J 7.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	10.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	18.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	7.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	7.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	35.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0099

Sample Name: INT-236

Sample # : FL 01565

Date Coll'd : 7/7/2000

	Compound		Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	<	5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	<	5.	ug/L
	1,1,2-TRICHLOROETHANE	<	5.	ug/L
	1,1-DICHLOROETHANE	D	300.	ug/L
	1,1-DICHLOROETHENE		5.	ug/L
	1,2-DICHLOROETHANE	D	2,500.	ug/L
	1,2-DICHLOROETHENE(TOTAL)		1,800.	ug/L
	1,2-DICHLOROPROPANE	<	5.	ug/L
	2-BUTANONE	<	50.	ug/L
	2-HEXANONE	<	5.	ug/L
	4-METHYL-2-PENTANONE	<	5.	ug/L
	ACETONE	<	5.	ug/L
	BENZENE	<	5.	ug/L
	BROMODICHLOROMETHANE	<	5.	ug/L
	BROMOFORM	<	5.	ug/L
	BROMOMETHANE	<	5.	ug/L
	CARBON DISULFIDE	<	5.	ug/L
	CARBON TETRACHLORIDE	D	220.	ug/L
	CHLOROBENZENE	<	5	ug/L
	CHLOROETHANE	<	5.	ug/L
	CHLOROFORM	D	16,000.	ug/L
	CHLOROMETHANE	<	5.	ug/L
	CIS-1,2-DICHLOROETHENE	D	1,500.	ug/L
	CIS-1,3-DICHLOROPROPENE	<	5 .	ug/L
	DIBROMOCHLOROMETHANE	<	5.	ug/L
	ETHYLBENZENE	<	5.	ug/L
	METHYLENE CHLORIDE		190.	ug/L
	STYRENE	<	5	ug/L
	TETRACHLOROETHENE	D	350.	ug/L
	TOLUENE	<	5.	ug/L
	TRANS-1,2-DICHLOROETHENE	D	340.	ug/L
	TRANS-1,3-DICHLOROPROPENE	<	5.	ug/L
	TRICHLOROETHENE		160.	ug/L
	VINYL CHLORIDE		77.	ug/L
	XYLENE(TOTAL)	<	5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0099				Sample Name:	INT-237
Sample # :	FL 01561	Compound	Concentration	Units	Date Coll'd :	7/6/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5	ug/L		
		CHLOROFORM	< 5	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 5.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0099

Sample Name: INT-238

Sample # : FL 01562

Date Coll'd : 7/6/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	95.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	78.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	410.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	11.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	40.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	D 1,700.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	D 280.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	6.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	120.	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	130.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	39.	ug/L
	VINYL CHLORIDE	20.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0108				Sample Name:	S1-031
Sample # :	FL 01610	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	J 2.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0109 | Sample Name: S1-031

Sample # : FL 01617 | Date Coll'd : 7/14/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	21.8	ug/L
	BERYLLIUM	.83	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	1.8	ug/L
	SELENIUM	< 7.6	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	6.3	ug/L
	ZINC	10.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0109 | Sample Name: S1-031

Sample # : FL01617 | Date Coll'd : 7/14/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J 4.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	< 10	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0109				Sample Name:	S1-031
Sample # :	FL 01617	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0102

Sample #: FL 01579

Sample Name: S1-033

Date Coll'd: 7/11/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0103

Sample Name: S1-033

Sample # : FL 01583

Date Coll'd : 7/11/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< 1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< 05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	40.5	ug/L
	COPPER	.77	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	1.8	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	5.7	ug/L
	ZINC	13.2	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0103 | Sample Name: S1-033

Sample # : FL 01583 | Date Coll'd : 7/11/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 25.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 25.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 25.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 25.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 25.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 25.	ug/L	FS
	4-NITROPHENOL	< 25.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 13.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	B 13.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0103				Sample Name:	S1-033
Sample # :	FL 01583	Compound	Concentration	Units	Date Coll'd :	7/11/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	J 2.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	J 6.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0111

Sample #: FL01628

Sample Name: s1-051-p-3

Date Coll'd: 7/17/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5	ug/L
	BENZENE	23.	ug/L
	BROMODICHLOROMETHANE	< 5	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT **FLTG, INC.**

Ground Water

French Limited

ArCoC #:	FL 0110				Sample Name:	s1-051-p-3
Sample # :	FL 01620	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	PEST	4,4-DDD	< 1	ug/L		
		4,4-DDE	< .1	ug/L		
		4,4-DDT	< .1	ug/L		
		ALDRIN	< .05	ug/L		
		ALPHA-BHC	< .05	ug/L		
		ALPHA-CHLORDANE	< .05	ug/L		
		AROCLOR-1016	< 1.	ug/L		
		AROCLOR-1221	< 2.	ug/L		
		AROCLOR-1232	< 1.	ug/L		
		AROCLOR-1242	< 1.	ug/L		
		AROCLOR-1248	< 1.	ug/L		
		AROCLOR-1254	< 1.	ug/L		
		AROCLOR-1260	< 1.	ug/L		
		BETA-BHC	< .05	ug/L		
		DELTA-BHC	< .05	ug/L		
		DIELDRIN	< .1	ug/L		
		ENDOSULFAN I	< .05	ug/L		
		ENDOSULFAN II	< .1	ug/L		
		ENDOSULFAN SULFATE	< .1	ug/L		
		ENDRIN	< .1	ug/L		
		ENDRIN ALDEHYDE	< .1	ug/L		
		GAMMA-BHC(LINDANE)	< .05	ug/L		
		GAMMA-CHLORDANE	< .05	ug/L		
		HEPTACHLOR	< .05.	ug/L		
		HEPTACHLOR EPOXIDE	< .05	ug/L		
		TOXAPHENE	< 5.	ug/L		
	MET	ARSENIC	1.7	ug/L		
		COPPER	< .6	ug/L		
		ANTIMONY	< 1.7	ug/L		
		BERYLLIUM	.38	ug/L		
		CADMIUM	< .2	ug/L		
		CHROMIUM	1.1	ug/L		
		LEAD	< 1 8	ug/L		
		MERCURY	< .2	ug/L		
		NICKEL	1.9	ug/L		
		SELENIUM	< 3.8	ug/L		
		SILVER	< 1.1	ug/L		
		THALLIUM	3.2	ug/L		
		ZINC	9.5	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0110 | Sample Name: s1-051-p-3

Sample # : FL 01620 | Date Coll'd : 7/17/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10	ug/L	FS
	2,6-DINITROTOLUENE	< 10	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10	ug/L	FS
	ACENAPHTHYLENE	< 10	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10	ug/L	FS
	BENZOIC ACID	< 50	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B 23.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0110				Sample Name:	s1-051-p-3
Sample # :	FL 01620	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	J 3.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0112				Sample Name:	S1-106R
Sample # :	FL 01637	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	42.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5	ug/L		
		DIBROMOCHLOROMETHANE	< 5	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0113 | Sample Name: S1-106R

Sample # : FL 01643 | Date Coll'd : 7/18/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	4.8	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	< 1.7	ug/L
	SELENIUM	5.6	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	4.7	ug/L
	ZINC	9.5	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0113 | Sample Name: S1-106R

Sample # : FL 01643 | Date Coll'd : 7/18/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10	ug/L	FS
	4-CHLOROANILINE	<	10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	B	11.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10	ug/L	FS
	DI-N-BUTYLPHTHALATE	B	3.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0113				Sample Name:	S1-106R
Sample # :	FL 01643	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0113 | Sample Name: S1-106R

Sample # : FL 01643 | Date Coll'd : 7/18/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	RE
	1,2-DICHLOROBENZENE	<	10.	ug/L	RE
	1,3-DICHLOROBENZENE	<	10.	ug/L	RE
	1,4-DICHLOROBENZENE	<	10.	ug/L	RE
	2,4,5-TRICHLOROPHENOL	<	50	ug/L	RE
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	RE
	2,4-DICHLOROPHENOL	<	10.	ug/L	RE
	2,4-DIMETHYLPHENOL	<	10.	ug/L	RE
	2,4-DINITROPHENOL	<	50.	ug/L	RE
	2,4-DINITROTOLUENE	<	10.	ug/L	RE
	2,6-DINITROTOLUENE	<	10.	ug/L	RE
	2-CHLORONAPHTHALENE	<	10.	ug/L	RE
	2-CHLOROPHENOL	<	10.	ug/L	RE
	2-METHYLNAPHTHALENE	<	10.	ug/L	RE
	2-METHYLPHENOL	<	10.	ug/L	RE
	2-NITROANILINE	<	50.	ug/L	RE
	2-NITROPHENOL	<	10	ug/L	RE
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	RE
	3-NITROANILINE	<	50.	ug/L	RE
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	RE
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	RE
	4-CHLORO-3-METHYLPHENOL	<	10	ug/L	RE
	4-CHLOROANILINE	<	10.	ug/L	RE
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	RE
	4-METHYLPHENOL	<	10.	ug/L	RE
	4-NITROANILINE	<	50.	ug/L	RE
	4-NITROPHENOL	<	50.	ug/L	RE
	ACENAPHTHENE	<	10.	ug/L	RE
	ACENAPHTHYLENE	<	10.	ug/L	RE
	ANTHRACENE	<	10.	ug/L	RE
	BENZO(A)ANTHRACENE	<	10.	ug/L	RE
	BENZO(A)PYRENE	<	10.	ug/L	RE
	BENZO(B)FLUORANTHENE	<	10	ug/L	RE
	BENZO(G,H,I)PERYLENE	<	10	ug/L	RE
	BENZO(K)FLUORANTHENE	<	10.	ug/L	RE
	BENZOIC ACID	<	50	ug/L	RE
	BENZYL ALCOHOL	<	10	ug/L	RE
	BIS(2-CHLOROETHOXY)METHANE	<	10	ug/L	RE
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	RE
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	RE
	BIS(2-ETHYLHEXYL)PHTHALATE	B	11.	ug/L	RE
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	RE
	CHRYSENE	<	10.	ug/L	RE
	DI-N-BUTYLPHTHALATE	B	2.	ug/L	RE
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	RE
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	RE

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0113				Sample Name:	S1-106R
Sample # :	FL01643	Compound	Concentration	Units	Date Coll'd :	7/18/2000
	SV	DIBENZOFURAN	< 10.	ug/L		RE
		DIETHYLPHTHALATE	< 10.	ug/L		RE
		DIMETHYLPHTHALATE	< 10.	ug/L		RE
		FLUORANTHENE	< 10.	ug/L		RE
		FLUORENE	< 10.	ug/L		RE
		HEXACHLOROBENZENE	< 10.	ug/L		RE
		HEXACHLOROBUTADIENE	< 10.	ug/L		RE
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		RE
		HEXACHLOROETHANE	< 10.	ug/L		RE
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		RE
		ISOPHORONE	< 10.	ug/L		RE
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		RE
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		RE
		NAPHTHALENE	< 10.	ug/L		RE
		NITROBENZENE	< 10.	ug/L		RE
		PENTACHLOROPHENOL	< 50.	ug/L		RE
		PHENANTHRENE	< 10.	ug/L		RE
		PHENOL	< 10.	ug/L		RE
		PYRENE	< 10.	ug/L		RE

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0111

Sample Name: s1-106a

Sample # : FL 01629

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	**6.**	**ug/L**
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	**6.**	**ug/L**
	1,2-DICHLOROETHENE(TOTAL)	< 5	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	**J 2.**	**ug/L**
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	**25.**	**ug/L**
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	**13.**	**ug/L**
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0110 | Sample Name: s1-106a

Sample # : FL 01621 | Date Coll'd : 7/17/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< 1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< 05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	4.9	ug/L
	COPPER	2.	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.36	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	8.3	ug/L
	SELENIUM	12.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	11.8	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110 | Sample Name: s1-106a

Sample # : FL01621 | Date Coll'd : 7/17/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	J	2.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10	ug/L	FS
	BENZO(A)ANTHRACENE	<	10	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J	5.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0110				Sample Name:	s1-106a
Sample # :	FL 01621	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0111				Sample Name:	s1-108a
Sample # :	FL 01630	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5	ug/L		
		TRICHLOROETHENE	< 5	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110

Sample Name: s1-108a

Sample # : FL01622

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< 05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	4.2	ug/L
	COPPER	.62	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.38	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< 2	ug/L
	NICKEL	1.8	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1 1	ug/L
	THALLIUM	3.5	ug/L
	ZINC	12.7	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110 | Sample Name: s1-108a

Sample # : FL01622 | Date Coll'd : 7/17/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10	ug/L	FS
	BENZO(A)PYRENE	<	10	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J	8.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	4.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0110				Sample Name:	s1-108a
Sample # :	FL01622	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	J 1.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0105

Sample Name: S1-111

Sample # : FL01589

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0104

Sample Name: S1-111

Sample # : FL01584

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	14.2	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1 7	ug/L
	BERYLLIUM	.33	ug/L
	CADMIUM	.99	ug/L
	CHROMIUM	< 5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	5.9	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	4.8	ug/L
	THALLIUM	3.2	ug/L
	ZINC	8.8	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	S1-111
Sample # :	FL 01584	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L		FS
		1,2-DICHLOROBENZENE	< 10.	ug/L		FS
		1,3-DICHLOROBENZENE	< 10.	ug/L		FS
		1,4-DICHLOROBENZENE	< 10.	ug/L		FS
		2,4,5-TRICHLOROPHENOL	< 25.	ug/L		FS
		2,4,6-TRICHLOROPHENOL	< 10.	ug/L		FS
		2,4-DICHLOROPHENOL	< 10.	ug/L		FS
		2,4-DIMETHYLPHENOL	< 10.	ug/L		FS
		2,4-DINITROPHENOL	< 25.	ug/L		FS
		2,4-DINITROTOLUENE	< 10.	ug/L		FS
		2,6-DINITROTOLUENE	< 10.	ug/L		FS
		2-CHLORONAPHTHALENE	< 10.	ug/L		FS
		2-CHLOROPHENOL	< 10.	ug/L		FS
		2-METHYLNAPHTHALENE	< 10.	ug/L		FS
		2-METHYLPHENOL	< 10.	ug/L		FS
		2-NITROANILINE	< 25.	ug/L		FS
		2-NITROPHENOL	< 10.	ug/L		FS
		3,3'-DICHLOROBENZIDINE	< 10.	ug/L		FS
		3-NITROANILINE	< 25.	ug/L		FS
		4,6-DINITRO-2-METHYLPHENOL	< 25.	ug/L		FS
		4-BROMOPHENYL-PHENYLETHER	< 10	ug/L		FS
		4-CHLORO-3-METHYLPHENOL	< 10.	ug/L		FS
		4-CHLOROANILINE	< 10.	ug/L		FS
		4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L		FS
		4-METHYLPHENOL	< 10.	ug/L		FS
		4-NITROANILINE	< 25	ug/L		FS
		4-NITROPHENOL	< 25.	ug/L		FS
		ACENAPHTHENE	< 10.	ug/L		FS
		ACENAPHTHYLENE	< 10.	ug/L		FS
		ANTHRACENE	< 10.	ug/L		FS
		BENZO(A)ANTHRACENE	< 10.	ug/L		FS
		BENZO(A)PYRENE	< 10.	ug/L		FS
		BENZO(B)FLUORANTHENE	< 10	ug/L		FS
		BENZO(G,H,I)PERYLENE	< 10.	ug/L		FS
		BENZO(K)FLUORANTHENE	< 10.	ug/L		FS
		BENZOIC ACID	< 50.	ug/L		FS
		BENZYL ALCOHOL	< 10.	ug/L		FS
		BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L		FS
		BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L		FS
		BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L		FS
		BIS(2-ETHYLHEXYL)PHTHALATE	J 2.	ug/L		FS
		BUTYLBENZYLPHTHALATE	< 10	ug/L		FS
		CHRYSENE	< 10	ug/L		FS
		DI-N-BUTYLPHTHALATE	J 8.	ug/L		FS
		DI-N-OCTYLPHTHALATE	< 10.	ug/L		FS
		DIBENZ(A,H)ANTHRACENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	S1-111
Sample # :	FL 01584	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0111				Sample Name:	s1-118
Sample # :	FL 01631	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	< 5	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5	ug/L		
		BENZENE	< 5	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110

Sample Name: s1-118

Sample # : FL01623

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1	ug/L
	AROCLOR-1242	< 1	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	10.	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.44	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	2.	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1 1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	9.2	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0110 | Sample Name: s1-118

Sample # : FL 01623 | Date Coll'd : 7/17/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 10	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	< 10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 10.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	< 10.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 10.	ug/L	FS
	4-CHLOROANILINE	< 10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 10.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J 4.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10.	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J 2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0110				Sample Name:	s1-118
Sample # :	FL01623	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

,rCoC #:	FL 0105				Sample Name:	S1-121
Sample # :	FL 01591	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	23.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	21.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	120.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	J 2.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	J 2.	ug/L		
		CHLOROMETHANE	< 5	ug/L		
		CIS-1,2-DICHLOROETHENE	92.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	78.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	23.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	139.	ug/L		
		VINYL CHLORIDE	17.	ug/L		
		XYLENE(TOTAL)	< 5	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0104

Sample Name: S1-121

Sample # : FL01586

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .2	ug/L
	4,4-DDE	< .2	ug/L
	4,4-DDT	< .2	ug/L
	ALDRIN	< .1	ug/L
	ALPHA-BHC	< .1	ug/L
	ALPHA-CHLORDANE	< .1	ug/L
	AROCLOR-1016	< 2.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 2.	ug/L
	AROCLOR-1242	< 2.	ug/L
	AROCLOR-1248	< 2.	ug/L
	AROCLOR-1254	< 2.	ug/L
	AROCLOR-1260	< 2.	ug/L
	BETA-BHC	< .1	ug/L
	DELTA-BHC	< .1	ug/L
	DIELDRIN	< .2	ug/L
	ENDOSULFAN I	< .1	ug/L
	ENDOSULFAN II	< .2	ug/L
	ENDOSULFAN SULFATE	< .2	ug/L
	ENDRIN	< .2	ug/L
	ENDRIN ALDEHYDE	< .2	ug/L
	GAMMA-BHC(LINDANE)	< .1	ug/L
	GAMMA-CHLORDANE	< .1	ug/L
	HEPTACHLOR	< .1	ug/L
	HEPTACHLOR EPOXIDE	< .1	ug/L
	TOXAPHENE	< 10.	ug/L
MET	ARSENIC	5.	ug/L
	COPPER	.92	ug/L
	ANTIMONY	< 1 7	ug/L
	BERYLLIUM	.27	ug/L
	CADMIUM	.26	ug/L
	CHROMIUM	< 5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	9.	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	< 2.3	ug/L
	ZINC	15.4	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0104 | Sample Name: S1-121

Sample # : FL 01586 | Date Coll'd : 7/12/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	< 20.	ug/L	FS
	1,2-DICHLOROBENZENE	< 20.	ug/L	FS
	1,3-DICHLOROBENZENE	< 20.	ug/L	FS
	1,4-DICHLOROBENZENE	< 20.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 20.	ug/L	FS
	2,4-DICHLOROPHENOL	< 20.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 20.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	< 20.	ug/L	FS
	2,6-DINITROTOLUENE	< 20.	ug/L	FS
	2-CHLORONAPHTHALENE	< 20.	ug/L	FS
	2-CHLOROPHENOL	< 20.	ug/L	FS
	2-METHYLNAPHTHALENE	< 20.	ug/L	FS
	2-METHYLPHENOL	< 20.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 20.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 20.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 20.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	< 20.	ug/L	FS
	4-CHLOROANILINE	< 20.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 20.	ug/L	FS
	4-METHYLPHENOL	< 20.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	< 20.	ug/L	FS
	ACENAPHTHYLENE	< 20.	ug/L	FS
	ANTHRACENE	< 20.	ug/L	FS
	BENZO(A)ANTHRACENE	< 20.	ug/L	FS
	BENZO(A)PYRENE	< 20.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 20.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 20.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 20.	ug/L	FS
	BENZOIC ACID	< 100	ug/L	FS
	BENZYL ALCOHOL	< 20.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 20.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 20.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 20	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	**J 4.**	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 20	ug/L	FS
	CHRYSENE	< 20	ug/L	FS
	DI-N-BUTYLPHTHALATE	**J 6.**	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 20	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 20.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	S1-121
Sample # :	FL 01586	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	DIBENZOFURAN	< 20.	ug/L		FS
		DIETHYLPHTHALATE	< 20.	ug/L		FS
		DIMETHYLPHTHALATE	< 20.	ug/L		FS
		FLUORANTHENE	< 20.	ug/L		FS
		FLUORENE	< 20.	ug/L		FS
		HEXACHLOROBENZENE	< 20.	ug/L		FS
		HEXACHLOROBUTADIENE	J 5.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 20.	ug/L		FS
		HEXACHLOROETHANE	< 20.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 20.	ug/L		FS
		ISOPHORONE	< 20.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 20.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 20.	ug/L		FS
		NAPHTHALENE	< 20.	ug/L		FS
		NITROBENZENE	< 20.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 20.	ug/L		FS
		PHENOL	< 20.	ug/L		FS
		PYRENE	< 20.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0105				Sample Name:	S1-121DUP
Sample # :	FL 01592	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	23.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	22.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	120.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5	ug/L		
		BENZENE	J 2.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	J 2.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	94.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	82.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	24.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	145.	ug/L		
		VINYL CHLORIDE	17.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0104

Sample Name: S1-121DUP

Sample # : FL01587

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< 2	ug/L
	4,4-DDE	< .2	ug/L
	4,4-DDT	< .2	ug/L
	ALDRIN	< .1	ug/L
	ALPHA-BHC	< .1	ug/L
	ALPHA-CHLORDANE	< .1	ug/L
	AROCLOR-1016	< 2.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 2.	ug/L
	AROCLOR-1242	< 2.	ug/L
	AROCLOR-1248	< 2.	ug/L
	AROCLOR-1254	< 2.	ug/L
	AROCLOR-1260	< 2.	ug/L
	BETA-BHC	< .1	ug/L
	DELTA-BHC	< .1	ug/L
	DIELDRIN	< .2	ug/L
	ENDOSULFAN I	< .1	ug/L
	ENDOSULFAN II	< .2	ug/L
	ENDOSULFAN SULFATE	< .2	ug/L
	ENDRIN	< .2	ug/L
	ENDRIN ALDEHYDE	< .2	ug/L
	GAMMA-BHC(LINDANE)	< .1	ug/L
	GAMMA-CHLORDANE	< .1	ug/L
	HEPTACHLOR	< .1	ug/L
	HEPTACHLOR EPOXIDE	< 1	ug/L
	TOXAPHENE	< 10.	ug/L
MET	ARSENIC	4.5	ug/L
	COPPER	.92	ug/L
	ANTIMONY	< 1 7	ug/L
	BERYLLIUM	.23	ug/L
	CADMIUM	.26	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	7.2	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	3.2	ug/L
	ZINC	8.9	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0104 | Sample Name: S1-121DUP

Sample # : FL01587 | Date Coll'd : 7/12/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	20.	ug/L	DP
	1,2-DICHLOROBENZENE	<	20.	ug/L	DP
	1,3-DICHLOROBENZENE	<	20.	ug/L	DP
	1,4-DICHLOROBENZENE	<	20.	ug/L	DP
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	DP
	2,4,6-TRICHLOROPHENOL	<	20.	ug/L	DP
	2,4-DICHLOROPHENOL	<	20.	ug/L	DP
	2,4-DIMETHYLPHENOL	<	20.	ug/L	DP
	2,4-DINITROPHENOL	<	50.	ug/L	DP
	2,4-DINITROTOLUENE	<	20.	ug/L	DP
	2,6-DINITROTOLUENE	<	20.	ug/L	DP
	2-CHLORONAPHTHALENE	<	20.	ug/L	DP
	2-CHLOROPHENOL	<	20.	ug/L	DP
	2-METHYLNAPHTHALENE	<	20.	ug/L	DP
	2-METHYLPHENOL	<	20.	ug/L	DP
	2-NITROANILINE	<	50.	ug/L	DP
	2-NITROPHENOL	<	20.	ug/L	DP
	3,3'-DICHLOROBENZIDINE	<	20.	ug/L	DP
	3-NITROANILINE	<	50.	ug/L	DP
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	DP
	4-BROMOPHENYL-PHENYLETHER	<	20.	ug/L	DP
	4-CHLORO-3-METHYLPHENOL	<	20.	ug/L	DP
	4-CHLOROANILINE	<	20	ug/L	DP
	4-CHLOROPHENYL-PHENYLETHER	<	20.	ug/L	DP
	4-METHYLPHENOL	<	20.	ug/L	DP
	4-NITROANILINE	<	50	ug/L	DP
	4-NITROPHENOL	<	50.	ug/L	DP
	ACENAPHTHENE	<	20.	ug/L	DP
	ACENAPHTHYLENE	<	20.	ug/L	DP
	ANTHRACENE	<	20.	ug/L	DP
	BENZO(A)ANTHRACENE	<	20.	ug/L	DP
	BENZO(A)PYRENE	<	20.	ug/L	DP
	BENZO(B)FLUORANTHENE	<	20	ug/L	DP
	BENZO(G,H,I)PERYLENE	<	20.	ug/L	DP
	BENZO(K)FLUORANTHENE	<	20.	ug/L	DP
	BENZOIC ACID	<	100.	ug/L	DP
	BENZYL ALCOHOL	<	20.	ug/L	DP
	BIS(2-CHLOROETHOXY)METHANE	<	20.	ug/L	DP
	BIS(2-CHLOROETHYL)ETHER	<	20.	ug/L	DP
	BIS(2-CHLOROISOPROPYL)ETHER	<	20.	ug/L	DP
	BIS(2-ETHYLHEXYL)PHTHALATE	J	12.	ug/L	DP
	BUTYLBENZYLPHTHALATE	<	20.	ug/L	DP
	CHRYSENE	<	20	ug/L	DP
	DI-N-BUTYLPHTHALATE	J	3.	ug/L	DP
	DI-N-OCTYLPHTHALATE	<	20.	ug/L	DP
	DIBENZ(A,H)ANTHRACENE	<	20.	ug/L	DP

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	S1-121DUP
Sample # :	FL 01587	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	DIBENZOFURAN	< 20.	ug/L		DP
		DIETHYLPHTHALATE	< 20.	ug/L		DP
		DIMETHYLPHTHALATE	< 20.	ug/L		DP
		FLUORANTHENE	< 20.	ug/L		DP
		FLUORENE	< 20.	ug/L		DP
		HEXACHLOROBENZENE	< 20.	ug/L		DP
		HEXACHLOROBUTADIENE	J 5.	ug/L		DP
		HEXACHLOROCYCLOPENTADIENE	< 20.	ug/L		DP
		HEXACHLOROETHANE	< 20.	ug/L		DP
		INDENO(1,2,3-CD)PYRENE	< 20.	ug/L		DP
		ISOPHORONE	< 20.	ug/L		DP
		N-NITROSO-DI-N-PROPYLAMINE	< 20.	ug/L		DP
		N-NITROSODIPHENYLAMINE	< 20.	ug/L		DP
		NAPHTHALENE	< 20.	ug/L		DP
		NITROBENZENE	< 20.	ug/L		DP
		PENTACHLOROPHENOL	< 50.	ug/L		DP
		PHENANTHRENE	< 20.	ug/L		DP
		PHENOL	< 20.	ug/L		DP
		PYRENE	< 20.	ug/L		DP

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0114

Sample Name: S1-123

Sample # : FL01649

Date Coll'd : 7/19/2000

	Compound		Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	<	200.	ug/L
	1,1,2,2-TETRACHLOROETHANE	<	200.	ug/L
	1,1,2-TRICHLOROETHANE	<	200.	ug/L
	1,1-DICHLOROETHANE		3,800.	ug/L
	1,1-DICHLOROETHENE	<	200.	ug/L
	1,2-DICHLOROETHANE	D	165,000.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	D	23,500.	ug/L
	1,2-DICHLOROPROPANE	<	200.	ug/L
	2-BUTANONE	<	2,000.	ug/L
	2-HEXANONE	<	200.	ug/L
	4-METHYL-2-PENTANONE	<	200.	ug/L
	ACETONE	<	200.	ug/L
	BENZENE		320.	ug/L
	BROMODICHLOROMETHANE	<	200.	ug/L
	BROMOFORM	<	200.	ug/L
	BROMOMETHANE	<	200.	ug/L
	CARBON DISULFIDE	<	200.	ug/L
	CARBON TETRACHLORIDE	J	180.	ug/L
	CHLOROBENZENE	<	200.	ug/L
	CHLOROETHANE		840.	ug/L
	CHLOROFORM	D	150,000.	ug/L
	CHLOROMETHANE	<	200	ug/L
	CIS-1,2-DICHLOROETHENE	D	17,600.	ug/L
	CIS-1,3-DICHLOROPROPENE	<	200.	ug/L
	DIBROMOCHLOROMETHANE	<	200.	ug/L
	ETHYLBENZENE	<	200	ug/L
	METHYLENE CHLORIDE		4,500.	ug/L
	STYRENE	<	200.	ug/L
	TETRACHLOROETHENE		3,830.	ug/L
	TOLUENE	J	120.	ug/L
	TRANS-1,2-DICHLOROETHENE		5,980.	ug/L
	TRANS-1,3-DICHLOROPROPENE	<	200.	ug/L
	TRICHLOROETHENE		7,150.	ug/L
	VINYL CHLORIDE		3,200.	ug/L
	XYLENE(TOTAL)	<	200.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample Name: S1-123

Sample # : FL01661

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	.056	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	.11	ug/L
	ENDOSULFAN I	< 05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	.23	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	.099	ug/L
	TOXAPHENE	< 5	ug/L
MET	ANTIMONY	< 1.7	ug/L
	ARSENIC	34.1	ug/L
	BERYLLIUM	< .2	ug/L
	CADMIUM	.23	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	4.3	ug/L
	SELENIUM	9.3	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	7.4	ug/L
	ZINC	14.5	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115 | Sample Name: S1-123

Sample # : FL 01661 | Date Coll'd : 7/19/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	100.	ug/L	DL
	1,2-DICHLOROBENZENE	<	100.	ug/L	DL
	1,3-DICHLOROBENZENE	<	100.	ug/L	DL
	1,4-DICHLOROBENZENE	<	100.	ug/L	DL
	2,4,5-TRICHLOROPHENOL	<	500.	ug/L	DL
	2,4,6-TRICHLOROPHENOL	<	100.	ug/L	DL
	2,4-DICHLOROPHENOL	<	100.	ug/L	DL
	2,4-DIMETHYLPHENOL	<	100.	ug/L	DL
	2,4-DINITROPHENOL	<	500.	ug/L	DL
	2,4-DINITROTOLUENE	<	100.	ug/L	DL
	2,6-DINITROTOLUENE	<	100	ug/L	DL
	2-CHLORONAPHTHALENE	<	100	ug/L	DL
	2-CHLOROPHENOL	<	100.	ug/L	DL
	2-METHYLNAPHTHALENE	**J**	**25.**	**ug/L**	**DL**
	2-METHYLPHENOL	**J**	**23.**	**ug/L**	**DL**
	2-NITROANILINE	<	500.	ug/L	DL
	2-NITROPHENOL	<	100.	ug/L	DL
	3,3'-DICHLOROBENZIDINE	<	100.	ug/L	DL
	3-NITROANILINE	<	500.	ug/L	DL
	4,6-DINITRO-2-METHYLPHENOL	<	500	ug/L	DL
	4-BROMOPHENYL-PHENYLETHER	<	100.	ug/L	DL
	4-CHLORO-3-METHYLPHENOL	<	100.	ug/L	DL
	4-CHLOROANILINE	<	100.	ug/L	DL
	4-CHLOROPHENYL-PHENYLETHER	<	100.	ug/L	DL
	4-METHYLPHENOL	**J**	**32.**	**ug/L**	**DL**
	4-NITROANILINE	<	500.	ug/L	DL
	4-NITROPHENOL	<	500.	ug/L	DL
	ACENAPHTHENE	**J**	**30.**	**ug/L**	**DL**
	ACENAPHTHYLENE	<	100	ug/L	DL
	ANTHRACENE	<	100	ug/L	DL
	BENZO(A)ANTHRACENE	<	100	ug/L	DL
	BENZO(A)PYRENE	<	100.	ug/L	DL
	BENZO(B)FLUORANTHENE	<	100.	ug/L	DL
	BENZO(G,H,I)PERYLENE	<	100	ug/L	DL
	BENZO(K)FLUORANTHENE	<	100.	ug/L	DL
	BENZOIC ACID	**J**	**77.**	**ug/L**	**DL**
	BENZYL ALCOHOL	<	100.	ug/L	DL
	BIS(2-CHLOROETHOXY)METHANE	<	100.	ug/L	DL
	BIS(2-CHLOROETHYL)ETHER	<	100.	ug/L	DL
	BIS(2-CHLOROISOPROPYL)ETHER	<	100	ug/L	DL
	BIS(2-ETHYLHEXYL)PHTHALATE	**B**	**11.**	**ug/L**	**DL**
	BUTYLBENZYLPHTHALATE	<	100	ug/L	DL
	CHRYSENE	<	100	ug/L	DL
	DI-N-BUTYLPHTHALATE	<	100.	ug/L	DL
	DI-N-OCTYLPHTHALATE	<	100.	ug/L	DL
	DIBENZ(A,H)ANTHRACENE	<	100.	ug/L	DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115					Sample Name:	S1-123
Sample # :	FL 01661	Compound	Concentration		Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	J	14.	ug/L		DL
		DIETHYLPHTHALATE	<	100.	ug/L		DL
		DIMETHYLPHTHALATE	<	100.	ug/L		DL
		FLUORANTHENE	<	100.	ug/L		DL
		FLUORENE	J	16.	ug/L		DL
		HEXACHLOROBENZENE	<	100.	ug/L		DL
		HEXACHLOROBUTADIENE	J	46.	ug/L		DL
		HEXACHLOROCYCLOPENTADIENE	<	100.	ug/L		DL
		HEXACHLOROETHANE	<	100.	ug/L		DL
		INDENO(1,2,3-CD)PYRENE	<	100.	ug/L		DL
		ISOPHORONE	<	100.	ug/L		DL
		N-NITROSO-DI-N-PROPYLAMINE	<	100.	ug/L		DL
		N-NITROSODIPHENYLAMINE	<	100.	ug/L		DL
		NAPHTHALENE		530.	ug/L		DL
		NITROBENZENE	<	100.	ug/L		DL
		PENTACHLOROPHENOL	<	500.	ug/L		DL
		PHENANTHRENE	J	10.	ug/L		DL
		PHENOL	J	76.	ug/L		DL
		PYRENE	<	100.	ug/L		DL

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0105

Sample Name: S1-131

Sample # : FL01593

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	28.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0104

Sample Name: S1-131

Sample # : FL 01588

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	.08	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5	ug/L
MET	ARSENIC	23.	ug/L
	COPPER	2.4	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.28	ug/L
	CADMIUM	.44	ug/L
	CHROMIUM	< 5	ug/L
	LEAD	< 1 8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	4.4	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	4.	ug/L
	ZINC	7.4	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	S1-131
Sample # :	FL 01588	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	1,2,4-TRICHLOROBENZENE	< 10.	ug/L		FS
		1,2-DICHLOROBENZENE	< 10.	ug/L		FS
		1,3-DICHLOROBENZENE	< 10.	ug/L		FS
		1,4-DICHLOROBENZENE	< 10.	ug/L		FS
		2,4,5-TRICHLOROPHENOL	< 25.	ug/L		FS
		2,4,6-TRICHLOROPHENOL	< 10.	ug/L		FS
		2,4-DICHLOROPHENOL	< 10	ug/L		FS
		2,4-DIMETHYLPHENOL	< 10.	ug/L		FS
		2,4-DINITROPHENOL	< 25.	ug/L		FS
		2,4-DINITROTOLUENE	< 10.	ug/L		FS
		2,6-DINITROTOLUENE	< 10.	ug/L		FS
		2-CHLORONAPHTHALENE	< 10.	ug/L		FS
		2-CHLOROPHENOL	< 10.	ug/L		FS
		2-METHYLNAPHTHALENE	< 10.	ug/L		FS
		2-METHYLPHENOL	< 10.	ug/L		FS
		2-NITROANILINE	< 25.	ug/L		FS
		2-NITROPHENOL	< 10	ug/L		FS
		3,3'-DICHLOROBENZIDINE	< 10.	ug/L		FS
		3-NITROANILINE	< 25.	ug/L		FS
		4,6-DINITRO-2-METHYLPHENOL	< 25.	ug/L		FS
		4-BROMOPHENYL-PHENYLETHER	< 10	ug/L		FS
		4-CHLORO-3-METHYLPHENOL	< 10.	ug/L		FS
		4-CHLOROANILINE	< 10.	ug/L		FS
		4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L		FS
		4-METHYLPHENOL	< 10.	ug/L		FS
		4-NITROANILINE	< 25.	ug/L		FS
		4-NITROPHENOL	< 25.	ug/L		FS
		ACENAPHTHENE	< 10	ug/L		FS
		ACENAPHTHYLENE	< 10.	ug/L		FS
		ANTHRACENE	< 10	ug/L		FS
		BENZO(A)ANTHRACENE	< 10.	ug/L		FS
		BENZO(A)PYRENE	< 10	ug/L		FS
		BENZO(B)FLUORANTHENE	< 10	ug/L		FS
		BENZO(G,H,I)PERYLENE	< 10.	ug/L		FS
		BENZO(K)FLUORANTHENE	< 10	ug/L		FS
		BENZOIC ACID	< 50	ug/L		FS
		BENZYL ALCOHOL	< 10.	ug/L		FS
		BIS(2-CHLOROETHOXY)METHANE	< 10	ug/L		FS
		BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L		FS
		BIS(2-CHLOROISOPROPYL)ETHER	< 10	ug/L		FS
		BIS(2-ETHYLHEXYL)PHTHALATE	**J 8.**	ug/L		FS
		BUTYLBENZYLPHTHALATE	< 10	ug/L		FS
		CHRYSENE	< 10.	ug/L		FS
		DI-N-BUTYLPHTHALATE	**J 2.**	ug/L		FS
		DI-N-OCTYLPHTHALATE	< 10.	ug/L		FS
		DIBENZ(A,H)ANTHRACENE	< 10	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0104				Sample Name:	S1-131
Sample # :	FL 01588	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 25.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0111

Sample Name: s1-135

Sample # : FL 01632

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0110

Sample Name: s1-135

Sample # : FL01624

Date Coll'd : 7/17/2000

	Compound	Concentration	Units
PEST	4,4-DDD	< .1	ug/L
	4,4-DDE	< .1	ug/L
	4,4-DDT	< .1	ug/L
	ALDRIN	< .05	ug/L
	ALPHA-BHC	< .05	ug/L
	ALPHA-CHLORDANE	< .05	ug/L
	AROCLOR-1016	< 1.	ug/L
	AROCLOR-1221	< 2.	ug/L
	AROCLOR-1232	< 1.	ug/L
	AROCLOR-1242	< 1.	ug/L
	AROCLOR-1248	< 1.	ug/L
	AROCLOR-1254	< 1.	ug/L
	AROCLOR-1260	< 1.	ug/L
	BETA-BHC	< .05	ug/L
	DELTA-BHC	< .05	ug/L
	DIELDRIN	< .1	ug/L
	ENDOSULFAN I	< .05	ug/L
	ENDOSULFAN II	< .1	ug/L
	ENDOSULFAN SULFATE	< .1	ug/L
	ENDRIN	< .1	ug/L
	ENDRIN ALDEHYDE	< .1	ug/L
	GAMMA-BHC(LINDANE)	< .05	ug/L
	GAMMA-CHLORDANE	< .05	ug/L
	HEPTACHLOR	< .05	ug/L
	HEPTACHLOR EPOXIDE	< .05	ug/L
	TOXAPHENE	< 5.	ug/L
MET	ARSENIC	74.4	ug/L
	COPPER	< .6	ug/L
	ANTIMONY	< 1.7	ug/L
	BERYLLIUM	.49	ug/L
	CADMIUM	< .2	ug/L
	CHROMIUM	< .5	ug/L
	LEAD	< 1.8	ug/L
	MERCURY	< .2	ug/L
	NICKEL	< 1.7	ug/L
	SELENIUM	< 3.8	ug/L
	SILVER	< 1.1	ug/L
	THALLIUM	5.1	ug/L
	ZINC	11.5	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0110 | Sample Name: s1-135

Sample # : FL 01624 | Date Coll'd : 7/17/2000

	Compound	Concentration		Units	
SV	1,2,4-TRICHLOROBENZENE	<	10.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE	<	10.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE	<	10.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL	<	10.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	<	10.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE	<	10.	ug/L	FS
	ACENAPHTHYLENE	<	10	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10.	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50.	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	J	5.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	J	2.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0110				Sample Name:	s1-135
Sample # :	FL01624	Compound	Concentration	Units	Date Coll'd :	7/17/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	< 10	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	< 50.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	< 10.	ug/L		FS
		PYRENE	< 10	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0099

Sample Name: S1-143

Sample # : FL 01558

Date Coll'd : 7/6/2000

	Compound		Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	<	500.	ug/L
	1,1,2,2-TETRACHLOROETHANE	<	500.	ug/L
	1,1,2-TRICHLOROETHANE	<	500.	ug/L
	1,1-DICHLOROETHANE	<	500.	ug/L
	1,1-DICHLOROETHENE	<	500.	ug/L
	1,2-DICHLOROETHANE		**9,000.**	**ug/L**
	1,2-DICHLOROETHENE(TOTAL)	**J**	**1,800.**	**ug/L**
	1,2-DICHLOROPROPANE	<	500.	ug/L
	2-BUTANONE	<	5,000.	ug/L
	2-HEXANONE	<	500.	ug/L
	4-METHYL-2-PENTANONE	<	500.	ug/L
	ACETONE	<	500.	ug/L
	BENZENE	<	500.	ug/L
	BROMODICHLOROMETHANE	<	500.	ug/L
	BROMOFORM	<	500.	ug/L
	BROMOMETHANE	<	500.	ug/L
	CARBON DISULFIDE	<	500.	ug/L
	CARBON TETRACHLORIDE	<	500.	ug/L
	CHLOROBENZENE	<	500	ug/L
	CHLOROETHANE	<	500	ug/L
	CHLOROFORM		**15,000.**	**ug/L**
	CHLOROMETHANE	<	500.	ug/L
	CIS-1,2-DICHLOROETHENE		**1,800.**	**ug/L**
	CIS-1,3-DICHLOROPROPENE	<	500.	ug/L
	DIBROMOCHLOROMETHANE	<	500.	ug/L
	ETHYLBENZENE	<	500.	ug/L
	METHYLENE CHLORIDE	<	500.	ug/L
	STYRENE	<	500	ug/L
	TETRACHLOROETHENE	<	500.	ug/L
	TOLUENE	<	500.	ug/L
	TRANS-1,2-DICHLOROETHENE	<	500.	ug/L
	TRANS-1,3-DICHLOROPROPENE	<	500	ug/L
	TRICHLOROETHENE		**850.**	**ug/L**
	VINYL CHLORIDE	<	500.	ug/L
	XYLENE(TOTAL)	<	500.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0099

Sample Name: S1-144

Sample # : FL 01559

Date Coll'd : 7/6/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 10.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 10.	ug/L
	1,1,2-TRICHLOROETHANE	< 10.	ug/L
	1,1-DICHLOROETHANE	**17.**	ug/L
	1,1-DICHLOROETHENE	< 10.	ug/L
	1,2-DICHLOROETHANE	**470.**	ug/L
	1,2-DICHLOROETHENE(TOTAL)	**130.**	ug/L
	1,2-DICHLOROPROPANE	< 10.	ug/L
	2-BUTANONE	< 100.	ug/L
	2-HEXANONE	< 10.	ug/L
	4-METHYL-2-PENTANONE	< 10.	ug/L
	ACETONE	< 10.	ug/L
	BENZENE	< 10.	ug/L
	BROMODICHLOROMETHANE	< 10.	ug/L
	BROMOFORM	< 10.	ug/L
	BROMOMETHANE	< 10.	ug/L
	CARBON DISULFIDE	< 10	ug/L
	CARBON TETRACHLORIDE	< 10.	ug/L
	CHLOROBENZENE	< 10.	ug/L
	CHLOROETHANE	< 10.	ug/L
	CHLOROFORM	< 10.	ug/L
	CHLOROMETHANE	< 10.	ug/L
	CIS-1,2-DICHLOROETHENE	**110.**	ug/L
	CIS-1,3-DICHLOROPROPENE	< 10.	ug/L
	DIBROMOCHLOROMETHANE	< 10.	ug/L
	ETHYLBENZENE	< 10	ug/L
	METHYLENE CHLORIDE	< 10.	ug/L
	STYRENE	< 10.	ug/L
	TETRACHLOROETHENE	< 10.	ug/L
	TOLUENE	< 10.	ug/L
	TRANS-1,2-DICHLOROETHENE	**18.**	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 10.	ug/L
	TRICHLOROETHENE	< 10	ug/L
	VINYL CHLORIDE	**22.**	ug/L
	XYLENE(TOTAL)	< 10.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0099					Sample Name:	S1-145
Sample # :	FL 01560	Compound	Concentration		Units	Date Coll'd :	7/6/2000
	VOA	1,1,1-TRICHLOROETHANE	<	500.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	<	500.	ug/L		
		1,1,2-TRICHLOROETHANE	<	500.	ug/L		
		1,1-DICHLOROETHANE		600.	ug/L		
		1,1-DICHLOROETHENE	<	500.	ug/L		
		1,2-DICHLOROETHANE		17,000.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)		3,300.	ug/L		
		1,2-DICHLOROPROPANE	<	500.	ug/L		
		2-BUTANONE	<	5,000	ug/L		
		2-HEXANONE	<	500.	ug/L		
		4-METHYL-2-PENTANONE	<	500.	ug/L		
		ACETONE	<	500.	ug/L		
		BENZENE	<	500.	ug/L		
		BROMODICHLOROMETHANE	<	500.	ug/L		
		BROMOFORM	<	500	ug/L		
		BROMOMETHANE	<	500.	ug/L		
		CARBON DISULFIDE	<	500.	ug/L		
		CARBON TETRACHLORIDE	<	500	ug/L		
		CHLOROBENZENE	<	500	ug/L		
		CHLOROETHANE	<	500	ug/L		
		CHLOROFORM		19,000.	ug/L		
		CHLOROMETHANE	<	500.	ug/L		
		CIS-1,2-DICHLOROETHENE		2,700.	ug/L		
		CIS-1,3-DICHLOROPROPENE	<	500.	ug/L		
		DIBROMOCHLOROMETHANE	<	500.	ug/L		
		ETHYLBENZENE	<	500.	ug/L		
		METHYLENE CHLORIDE	<	500.	ug/L		
		STYRENE	<	500	ug/L		
		TETRACHLOROETHENE	<	500	ug/L		
		TOLUENE	<	500.	ug/L		
		TRANS-1,2-DICHLOROETHENE		630.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	<	500.	ug/L		
		TRICHLOROETHENE		800.	ug/L		
		VINYL CHLORIDE		590.	ug/L		
		XYLENE(TOTAL)	<	500.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

Attachment C

French Ltd. Project

Field Duplicate Precision Summaries

Field and Trip Blank Summaries

MS/MSD Summaries

Groundwater Monitoring - July 2000

Field Duplicate Precision Report

Sample		Duplicate	
INT-127		INT-127DUP	
Sample Number	Sample Date	Sample Number	Sample Date
FL 01646	7/19/00	FL 01647	7/19/00

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
VOA	< 5	ug/L	1.1.1-TRICHLOROETHANE	ug/L	< 5	NA
	< 5	ug/L	1.1.2.2-TETRACHLOROETHANE	ug/L	< 5.	NA
	< 5.	ug/L	1.1.2-TRICHLOROETHANE	ug/L	< 5.	NA
	7.	ug/L	1.1-DICHLOROETHANE	ug/L	7.	0.0
	< 5	ug/L	1.1-DICHLOROETHENE	ug/L	< 5.	NA
	< 5	ug/L	1.2-DICHLOROETHANE	ug/L	< 5.	NA
	< 5.	ug/L	1.2-DICHLOROETHENE(TOTAL)	ug/L	< 5.	NA
	< 5	ug/L	1.2-DICHLOROPROPANE	ug/L	< 5	NA
	< 50	ug/L	2-BUTANONE	ug/L	< 50.	NA
	< 5	ug/L	2-HEXANONE	ug/L	< 5	NA
	< 5.	ug/L	4-METHYL-2-PENTANONE	ug/L	< 5	NA
	< 5.	ug/L	ACETONE	ug/L	< 5.	NA
	180.	ug/L	BENZENE	ug/L	180.	0.0
	< 5.	ug/L	BROMODICHLOROMETHANE	ug/L	< 5.	NA
	< 5	ug/L	BROMOFORM	ug/L	< 5	NA
	< 5	ug/L	BROMOMETHANE	ug/L	< 5	NA
	< 5	ug/L	CARBON DISULFIDE	ug/L	< 5.	NA
	< 5	ug/L	CARBON TETRACHLORIDE	ug/L	< 5	NA
	< 5	ug/L	CHLOROBENZENE	ug/L	< 5	NA
	18.	ug/L	CHLOROETHANE	ug/L	18.	0.0
	< 5	ug/L	CHLOROFORM	ug/L	< 5.	NA
	< 5	ug/L	CHLOROMETHANE	ug/L	< 5.	NA
	< 5	ug/L	CIS-1.2-DICHLOROETHENE	ug/L	< 5.	NA
	< 5	ug/L	CIS-1.3-DICHLOROPROPENE	ug/L	< 5	NA
	< 5	ug/L	DIBROMOCHLOROMETHANE	ug/L	< 5.	NA
	< 5.	ug/L	ETHYLBENZENE	ug/L	< 5	NA
	< 5	ug/L	METHYLENE CHLORIDE	ug/L	< 5.	NA
	< 5	ug/L	STYRENE	ug/L	< 5	NA
	< 5	ug/L	TETRACHLOROETHENE	ug/L	< 5	NA
	J 5.	ug/L	TOLUENE	ug/L	J 5.	0.0
	< 5	ug/L	TRANS-1.2-DICHLOROETHENE	ug/L	< 5	NA
	< 5	ug/L	TRANS-1.3-DICHLOROPROPENE	ug/L	< 5.	NA
	< 5	ug/L	TRICHLOROETHENE	ug/L	< 5	NA
	< 2	ug/L	VINYL CHLORIDE	ug/L	< 2.	NA
	J 9.	ug/L	XYLENE(TOTAL)	ug/L	J 9.	0.0
SV	< 10	ug/L	NAPHTHALENE	ug/L	< 10.	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

Field Duplicate Precision Report

Sample		Duplicate	
INT-127		INT-127DUP	
Sample Number	Sample Date	Sample Number	Sample Date
FL 01658	7/19/00	FL 01659	7/19/00

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
SV	< 10	ug/L	1.2.4-TRICHLOROBENZENE	ug/L	< 10.	NA
	< 10.	ug/L	1.2-DICHLOROBENZENE	ug/L	< 10.	NA
	< 10	ug/L	1.3-DICHLOROBENZENE	ug/L	< 10.	NA
	< 10	ug/L	1.4-DICHLOROBENZENE	ug/L	< 10.	NA
	< 50.	ug/L	2.4.5-TRICHLOROPHENOL	ug/L	< 50.	NA
	< 10.	ug/L	2.4.6-TRICHLOROPHENOL	ug/L	< 10.	NA
	< 10	ug/L	2.4-DICHLOROPHENOL	ug/L	< 10.	NA
	< 10	ug/L	2.4-DIMETHYLPHENOL	ug/L	< 10.	NA
	< 50	ug/L	2.4-DINITROPHENOL	ug/L	< 50	NA
	< 10	ug/L	2.4-DINITROTOLUENE	ug/L	< 10.	NA
	< 10	ug/L	2.6-DINITROTOLUENE	ug/L	< 10	NA
	< 10	ug/L	2-CHLORONAPHTHALENE	ug/L	< 10.	NA
	< 10	ug/L	2-CHLOROPHENOL	ug/L	< 10.	NA
	< 10	ug/L	2-METHYLNAPHTHALENE	ug/L	< 10.	NA
	< 10	ug/L	2-METHYLPHENOL	ug/L	< 10.	NA
	< 50	ug/L	2-NITROANILINE	ug/L	< 50.	NA
	< 10	ug/L	2-NITROPHENOL	ug/L	< 10.	NA
	< 10	ug/L	3.3'-DICHLOROBENZIDINE	ug/L	< 10	NA
	< 50	ug/L	3-NITROANILINE	ug/L	< 50.	NA
	< 50	ug/L	4.6-DINITRO-2-METHYLPHENO	ug/L	< 50	NA
	< 10	ug/L	4-BROMOPHENYL-PHENYLETH	ug/L	< 10	NA
	< 10	ug/L	4-CHLORO-3-METHYLPHENOL	ug/L	< 10	NA
	< 10	ug/L	4-CHLOROANILINE	ug/L	< 10	NA
	< 10	ug/L	4-CHLOROPHENYL-PHENYLET	ug/L	< 10	NA
	< 10	ug/L	4-METHYLPHENOL	ug/L	< 10	NA
	< 50	ug/L	4-NITROANILINE	ug/L	< 50.	NA
	< 50	ug/L	4-NITROPHENOL	ug/L	< 50.	NA
	< 10	ug/L	ACENAPHTHENE	ug/L	< 10	NA
	< 10	ug/L	ACENAPHTHYLENE	ug/L	< 10	NA
	< 10	ug/L	ANTHRACENE	ug/L	< 10.	NA
	< 10	ug/L	BENZO(A)ANTHRACENE	ug/L	< 10	NA
	< 10	ug/L	BENZO(A)PYRENE	ug/L	< 10	NA
	< 10	ug/L	BENZO(B)FLUORANTHENE	ug/L	< 10.	NA
	< 10.	ug/L	BENZO(G.H.I)PERYLENE	ug/L	< 10.	NA
	< 10	ug/L	BENZO(K)FLUORANTHENE	ug/L	< 10.	NA
	< 50	ug/L	BENZOIC ACID	ug/L	< 50	NA
	< 10	ug/L	BENZYL ALCOHOL	ug/L	< 10	NA
	< 10	ug/L	BIS(2-CHLOROETHOXY)METHA	ug/L	< 10	NA
	< 10	ug/L	BIS(2-CHLOROETHYL)ETHER	ug/L	< 10	NA
	< 10	ug/L	BIS(2-CHLOROISOPROPYL)ETH	ug/L	< 10.	NA
	B 24.	ug/L	BIS(2-ETHYLHEXYL)PHTHAL	ug/L	B 28.	15.4
	< 10	ug/L	BUTYLBENZYLPHTHALATE	ug/L	< 10	NA
	< 10	ug/L	CHRYSENE	ug/L	< 10.	NA
	B 2.	ug/L	DI-N-BUTYLPHTHALATE	ug/L	B 1.	66.7
	< 10	ug/L	DI-N-OCTYLPHTHALATE	ug/L	< 10	NA
	< 10	ug/L	DIBENZ(A.H)ANTHRACENE	ug/L	< 10	NA
	< 10	ug/L	DIBENZOFURAN	ug/L	< 10.	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
SV	< 10.	ug/L	DIETHYLPHTHALATE	ug/L	< 10.	NA
	< 10	ug/L	DIMETHYLPHTHALATE	ug/L	< 10.	NA
	< 10	ug/L	FLUORANTHENE	ug/L	< 10	NA
	< 10.	ug/L	FLUORENE	ug/L	< 10.	NA
	< 10.	ug/L	HEXACHLOROBENZENE	ug/L	< 10.	NA
	< 10.	ug/L	HEXACHLOROBUTADIENE	ug/L	< 10	NA
	< 10.	ug/L	HEXACHLOROCYCLOPENTADI	ug/L	< 10.	NA
	< 10.	ug/L	HEXACHLOROETHANE	ug/L	< 10.	NA
	< 10.	ug/L	INDENO(1.2.3-CD)PYRENE	ug/L	< 10.	NA
	< 10	ug/L	ISOPHORONE	ug/L	< 10.	NA
	< 10	ug/L	N-NITROSO-DI-N-PROPYLAMIN	ug/L	< 10	NA
	< 10	ug/L	N-NITROSODIPHENYLAMINE	ug/L	< 10.	NA
	J 7	ug/L	NAPHTHALENE	ug/L	< 10.	NA
	< 10	ug/L	NITROBENZENE	ug/L	< 10.	NA
	< 50	ug/L	PENTACHLOROPHENOL	ug/L	< 50.	NA
	< 10.	ug/L	PHENANTHRENE	ug/L	< 10.	NA
	< 10	ug/L	PHENOL	ug/L	< 10	NA
	< 10	ug/L	PYRENE	ug/L	< 10.	NA
PEST	< 1	ug/L	4.4-DDD	ug/L	< .1	NA
	< 1	ug/L	4.4-DDE	ug/L	< .1	NA
	< 1	ug/L	4.4-DDT	ug/L	< .1	NA
	< 05	ug/L	ALDRIN	ug/L	< 05	NA
	< 05	ug/L	ALPHA-BHC	ug/L	< .05	NA
	< .05	ug/L	ALPHA-CHLORDANE	ug/L	< .05	NA
	< 1	ug/L	AROCLOR-1016	ug/L	< 1	NA
	< 2	ug/L	AROCLOR-1221	ug/L	< 2	NA
	< 1	ug/L	AROCLOR-1232	ug/L	< 1	NA
	< 1	ug/L	AROCLOR-1242	ug/L	< 1	NA
	< 1.	ug/L	AROCLOR-1248	ug/L	< 1	NA
	< 1	ug/L	AROCLOR-1254	ug/L	< 1.	NA
	< 1.	ug/L	AROCLOR-1260	ug/L	< 1.	NA
	.06	ug/L	BETA-BHC	ug/L	.05	8.7
	< .05	ug/L	DELTA-BHC	ug/L	< .05	NA
	< 1	ug/L	DIELDRIN	ug/L	< .1	NA
	< 05	ug/L	ENDOSULFAN I	ug/L	< .05	NA
	< 1	ug/L	ENDOSULFAN II	ug/L	< 1	NA
	< 1	ug/L	ENDOSULFAN SULFATE	ug/L	< 1	NA
	< 1	ug/L	ENDRIN	ug/L	< .1	NA
	< 1	ug/L	ENDRIN ALDEHYDE	ug/L	< 1	NA
	< .05	ug/L	GAMMA-BHC(LINDANE)	ug/L	< .05	NA
	< 05	ug/L	GAMMA-CHLORDANE	ug/L	< 05	NA
	< 05	ug/L	HEPTACHLOR	ug/L	< 05	NA
	< 05	ug/L	HEPTACHLOR EPOXIDE	ug/L	< .05	NA
	< 5	ug/L	TOXAPHENE	ug/L	< 5	NA
NUT	.13	mg/L	AMMONIA-N	mg/L	.34	89.4
	< 2	mg/L	NITRATE-N	mg/L	< .2	NA
	.1	mg/L	ORTHOPHOSPHATE-P	mg/L	.1	0.0
	4.980.	ug/L	POTASSIUM	ug/L	4.850.	2.6
MISC	61.5	mg/L	TOTAL ORGANIC CARBON	mg/L	62.	0.8
MET	1 7	ug/L	ANTIMONY	ug/L	< 1.7	NA
	128.	ug/L	ARSENIC	ug/L	121.	5.6
	< 2	ug/L	BERYLLIUM	ug/L	< .2	NA
	.51	ug/L	CADMIUM	ug/L	.42	19.4
	< 5	ug/L	CHROMIUM	ug/L	< .5	NA
	< 1.8	ug/L	LEAD	ug/L	< 1.8	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
MET	< .2	ug/L	MERCURY	ug/L	< .2	NA
	6.6	ug/L	NICKEL	ug/L	6.6	0.0
	4.9	ug/L	SELENIUM	ug/L	< 3.8	NA
	< 1.1	ug/L	SILVER	ug/L	< 1.1	NA
	7.2	ug/L	THALLIUM	ug/L	3.3	74.3
	6.9	ug/L	ZINC	ug/L	7.7	11.0

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

Field Duplicate Precision Report

Sample		Duplicate	
INT-134		INT-134-D	
Sample Number	Sample Date	Sample Number	Sample Date
FL 01608	7/14/00	FL 01611	7/14/00

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
VOA	< 5	ug/L	1.1.1-TRICHLOROETHANE	ug/L	< 5	NA
	< 5	ug/L	1.1.2.2-TETRACHLOROETHANE	ug/L	< 5.	NA
	< 5.	ug/L	1.1.2-TRICHLOROETHANE	ug/L	< 5.	NA
	32.	ug/L	1.1-DICHLOROETHANE	ug/L	32.	0.0
	< 5	ug/L	1.1-DICHLOROETHENE	ug/L	< 5.	NA
	57.	ug/L	1.2-DICHLOROETHANE	ug/L	57.	0.0
	17.	ug/L	1.2-DICHLOROETHENE(TOTA	ug/L	16.	6.1
	< 5	ug/L	1.2-DICHLOROPROPANE	ug/L	< 5.	NA
	< 50	ug/L	2-BUTANONE	ug/L	< 50	NA
	< 5	ug/L	2-HEXANONE	ug/L	< 5.	NA
	< 5	ug/L	4-METHYL-2-PENTANONE	ug/L	< 5.	NA
	< 5.	ug/L	ACETONE	ug/L	< 5.	NA
	5.	ug/L	BENZENE	ug/L	5.	0.0
	< 5	ug/L	BROMODICHLOROMETHANE	ug/L	< 5	NA
	< 5.	ug/L	BROMOFORM	ug/L	< 5.	NA
	< 5.	ug/L	BROMOMETHANE	ug/L	< 5.	NA
	< 5	ug/L	CARBON DISULFIDE	ug/L	< 5.	NA
	< 5	ug/L	CARBON TETRACHLORIDE	ug/L	< 5	NA
	< 5	ug/L	CHLOROBENZENE	ug/L	< 5.	NA
	< 5	ug/L	CHLOROETHANE	ug/L	< 5	NA
	J 5.	ug/L	CHLOROFORM	ug/L	J 5.	0.0
	< 5	ug/L	CHLOROMETHANE	ug/L	< 5.	NA
	< 5	ug/L	CIS-1.2-DICHLOROETHENE	ug/L	< 5.	NA
	< 5.	ug/L	CIS-1.3-DICHLOROPROPENE	ug/L	< 5.	NA
	< 5	ug/L	DIBROMOCHLOROMETHANE	ug/L	< 5	NA
	< 5	ug/L	ETHYLBENZENE	ug/L	< 5.	NA
	< 5.	ug/L	METHYLENE CHLORIDE	ug/L	< 5.	NA
	< 5	ug/L	STYRENE	ug/L	< 5	NA
	< 5	ug/L	TETRACHLOROETHENE	ug/L	< 5.	NA
	< 5	ug/L	TOLUENE	ug/L	< 5	NA
	17.	ug/L	TRANS-1.2-DICHLOROETHEN	ug/L	16.	6.1
	< 5	ug/L	TRANS-1.3-DICHLOROPROPENE	ug/L	< 5	NA
	< 5	ug/L	TRICHLOROETHENE	ug/L	< 5.	NA
	86.	ug/L	VINYL CHLORIDE	ug/L	84.	2.4
	< 5.	ug/L	XYLENE(TOTAL)	ug/L	< 5.	NA
SV	< 10	ug/L	NAPHTHALENE	ug/L	< 10.	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

Field Duplicate Precision Report

Sample			Duplicate		
INT-134			INT-134-D		
Sample Number	Sample Date		Sample Number	Sample Date	
FL 01615	7/14/00		FL 01618	7/14/00	

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
SV	< 10.	ug/L	1.2.4-TRICHLOROBENZENE	ug/L	< 10.	NA
	< 10.	ug/L	1.2-DICHLOROBENZENE	ug/L	< 10.	NA
	< 10	ug/L	1.3-DICHLOROBENZENE	ug/L	< 10.	NA
	< 10.	ug/L	1.4-DICHLOROBENZENE	ug/L	< 10.	NA
	< 50	ug/L	2.4.5-TRICHLOROPHENOL	ug/L	< 50.	NA
	< 10.	ug/L	2.4.6-TRICHLOROPHENOL	ug/L	< 10.	NA
	< 10	ug/L	2.4-DICHLOROPHENOL	ug/L	< 10	NA
	< 10	ug/L	2.4-DIMETHYLPHENOL	ug/L	< 10	NA
	< 50	ug/L	2.4-DINITROPHENOL	ug/L	< 50	NA
	< 10	ug/L	2.4-DINITROTOLUENE	ug/L	< 10	NA
	< 10	ug/L	2.6-DINITROTOLUENE	ug/L	< 10.	NA
	< 10.	ug/L	2-CHLORONAPHTHALENE	ug/L	< 10.	NA
	< 10	ug/L	2-CHLOROPHENOL	ug/L	< 10.	NA
	< 10	ug/L	2-METHYLNAPHTHALENE	ug/L	< 10.	NA
	< 10	ug/L	2-METHYLPHENOL	ug/L	< 10.	NA
	< 50.	ug/L	2-NITROANILINE	ug/L	< 50.	NA
	< 10.	ug/L	2-NITROPHENOL	ug/L	< 10	NA
	< 10	ug/L	3.3'-DICHLOROBENZIDINE	ug/L	< 10.	NA
	< 50	ug/L	3-NITROANILINE	ug/L	< 50	NA
	< 50	ug/L	4.6-DINITRO-2-METHYLPHENO	ug/L	< 50	NA
	< 10	ug/L	4-BROMOPHENYL-PHENYLETH	ug/L	< 10	NA
	< 10	ug/L	4-CHLORO-3-METHYLPHENOL	ug/L	< 10.	NA
	< 10	ug/L	4-CHLOROANILINE	ug/L	< 10.	NA
	< 10	ug/L	4-CHLOROPHENYL-PHENYLET	ug/L	< 10	NA
	< 10	ug/L	4-METHYLPHENOL	ug/L	< 10.	NA
	< 50	ug/L	4-NITROANILINE	ug/L	< 50.	NA
	< 50	ug/L	4-NITROPHENOL	ug/L	< 50.	NA
	< 10	ug/L	ACENAPHTHENE	ug/L	< 10	NA
	< 10.	ug/L	ACENAPHTHYLENE	ug/L	< 10	NA
	< 10	ug/L	ANTHRACENE	ug/L	< 10.	NA
	< 10	ug/L	BENZO(A)ANTHRACENE	ug/L	< 10.	NA
	< 10	ug/L	BENZO(A)PYRENE	ug/L	< 10	NA
	< 10	ug/L	BENZO(B)FLUORANTHENE	ug/L	< 10	NA
	< 10	ug/L	BENZO(G.H.I)PERYLENE	ug/L	< 10	NA
	< 10	ug/L	BENZO(K)FLUORANTHENE	ug/L	< 10	NA
	< 50	ug/L	BENZOIC ACID	ug/L	< 50	NA
	< 10	ug/L	BENZYL ALCOHOL	ug/L	< 10.	NA
	< 10	ug/L	BIS(2-CHLOROETHOXY)METHA	ug/L	< 10	NA
	< 10	ug/L	BIS(2-CHLOROETHYL)ETHER	ug/L	< 10.	NA
	< 10	ug/L	BIS(2-CHLOROISOPROPYL)ETH	ug/L	< 10	NA
	12.	ug/L	BIS(2-ETHYLHEXYL)PHTHAL	ug/L	12.	0.0
	< 10	ug/L	BUTYLBENZYLPHTHALATE	ug/L	< 10.	NA
	< 10	ug/L	CHRYSENE	ug/L	< 10.	NA
	J 1.	ug/L	DI-N-BUTYLPHTHALATE	ug/L	J 2.	66.7
	< 10	ug/L	DI-N-OCTYLPHTHALATE	ug/L	< 10	NA
	< 10	ug/L	DIBENZ(A.H)ANTHRACENE	ug/L	< 10	NA
	< 10	ug/L	DIBENZOFURAN	ug/L	< 10.	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
SV	< 10	ug/L	DIETHYLPHTHALATE	ug/L	< 10	NA
	< 10	ug/L	DIMETHYLPHTHALATE	ug/L	< 10	NA
	< 10	ug/L	FLUORANTHENE	ug/L	< 10.	NA
	< 10.	ug/L	FLUORENE	ug/L	< 10.	NA
	< 10	ug/L	HEXACHLOROBENZENE	ug/L	< 10.	NA
	< 10	ug/L	HEXACHLOROBUTADIENE	ug/L	< 10.	NA
	< 10	ug/L	HEXACHLOROCYCLOPENTADI	ug/L	< 10.	NA
	< 10	ug/L	HEXACHLOROETHANE	ug/L	< 10.	NA
	< 10.	ug/L	INDENO(1.2.3-CD)PYRENE	ug/L	< 10	NA
	< 10	ug/L	ISOPHORONE	ug/L	< 10.	NA
	< 10.	ug/L	N-NITROSO-DI-N-PROPYLAMIN	ug/L	< 10.	NA
	< 10	ug/L	N-NITROSODIPHENYLAMINE	ug/L	< 10.	NA
	< 10.	ug/L	NAPHTHALENE	ug/L	< 10.	NA
	< 10	ug/L	NITROBENZENE	ug/L	< 10.	NA
	< 50.	ug/L	PENTACHLOROPHENOL	ug/L	< 50.	NA
	< 10	ug/L	PHENANTHRENE	ug/L	< 10.	NA
	< 10	ug/L	PHENOL	ug/L	< 10	NA
	< 10	ug/L	PYRENE	ug/L	< 10	NA
PEST	< 1	ug/L	4.4-DDD	ug/L	< .1	NA
	< 1	ug/L	4.4-DDE	ug/L	< 1	NA
	< .1	ug/L	4.4-DDT	ug/L	< 1	NA
	< 05	ug/L	ALDRIN	ug/L	< 05	NA
	< 05	ug/L	ALPHA-BHC	ug/L	< 05	NA
	< .05	ug/L	ALPHA-CHLORDANE	ug/L	< 05	NA
	< 1	ug/L	AROCLOR-1016	ug/L	< 1.	NA
	< 2	ug/L	AROCLOR-1221	ug/L	< 2	NA
	< 1	ug/L	AROCLOR-1232	ug/L	< 1.	NA
	< 1	ug/L	AROCLOR-1242	ug/L	< 1.	NA
	< 1	ug/L	AROCLOR-1248	ug/L	< 1.	NA
	< 1	ug/L	AROCLOR-1254	ug/L	< 1	NA
	< 1	ug/L	AROCLOR-1260	ug/L	< 1.	NA
	< 05	ug/L	BETA-BHC	ug/L	< 05	NA
	< 05	ug/L	DELTA-BHC	ug/L	< .05	NA
	< 1	ug/L	DIELDRIN	ug/L	< .1	NA
	< 05	ug/L	ENDOSULFAN I	ug/L	< .05	NA
	< .1	ug/L	ENDOSULFAN II	ug/L	< .1	NA
	< .1	ug/L	ENDOSULFAN SULFATE	ug/L	< 1	NA
	< .1	ug/L	ENDRIN	ug/L	< .1	NA
	< .1	ug/L	ENDRIN ALDEHYDE	ug/L	< 1	NA
	< 05	ug/L	GAMMA-BHC(LINDANE)	ug/L	< 05	NA
	< 05	ug/L	GAMMA-CHLORDANE	ug/L	< 05	NA
	< .05	ug/L	HEPTACHLOR	ug/L	< 05	NA
	< 05	ug/L	HEPTACHLOR EPOXIDE	ug/L	< .05	NA
	< 5	ug/L	TOXAPHENE	ug/L	< 5	NA
NUT	< 1	mg/L	AMMONIA-N	mg/L	< .1	NA
	25.4	mg/L	NITRATE-N	mg/L	25.2	0.8
	.22	mg/L	ORTHOPHOSPHATE-P	mg/L	.22	0.0
	1.860.	ug/L	POTASSIUM	ug/L	1.800.	3.3
MISC	17.	mg/L	TOTAL ORGANIC CARBON	mg/L	17.	0.0
MET	< 1 7	ug/L	ANTIMONY	ug/L	< 1.7	NA
	3.3	ug/L	ARSENIC	ug/L	1.9	53.8
	< .2	ug/L	BERYLLIUM	ug/L	< 2	NA
	< 2	ug/L	CADMIUM	ug/L	< .2	NA
	< 5	ug/L	CHROMIUM	ug/L	< .5	NA
	< 1 8	ug/L	LEAD	ug/L	< 1.8	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
MET	< .2	ug/L	MERCURY	ug/L	< .2	NA
	3.8	ug/L	NICKEL	ug/L	2.6	37.5
	7.9	ug/L	SELENIUM	ug/L	8.8	10.8
	< 1.1	ug/L	SILVER	ug/L	< 1.1	NA
	2.6	ug/L	THALLIUM	ug/L	< 2.3	NA
	13.	ug/L	ZINC	ug/L	9.9	27.1

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

Field Duplicate Precision Report

Sample		Duplicate	
S1-121		S1-121DUP	
Sample Number	Sample Date	Sample Number	Sample Date
FL 01591	7/12/00	FL 01592	7/12/00

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
VOA	< 5	ug/L	1.1.1-TRICHLOROETHANE	ug/L	< 5.	NA
	< 5.	ug/L	1.1.2.2-TETRACHLOROETHANE	ug/L	< 5.	NA
	< 5.	ug/L	1.1.2-TRICHLOROETHANE	ug/L	< 5.	NA
	23.	ug/L	1.1-DICHLOROETHANE	ug/L	23.	0.0
	< 5.	ug/L	1.1-DICHLOROETHENE	ug/L	< 5.	NA
	21.	ug/L	1.2-DICHLOROETHANE	ug/L	22.	4.7
	120.	ug/L	1.2-DICHLOROETHENE(TOTA	ug/L	120.	0.0
	< 5	ug/L	1.2-DICHLOROPROPANE	ug/L	< 5	NA
	< 50	ug/L	2-BUTANONE	ug/L	< 50.	NA
	< 5	ug/L	2-HEXANONE	ug/L	< 5.	NA
	< 5	ug/L	4-METHYL-2-PENTANONE	ug/L	< 5	NA
	< 5.	ug/L	ACETONE	ug/L	< 5.	NA
	J 2.	ug/L	BENZENE	ug/L	J 2.	0.0
	< 5	ug/L	BROMODICHLOROMETHANE	ug/L	< 5	NA
	< 5.	ug/L	BROMOFORM	ug/L	< 5.	NA
	< 5	ug/L	BROMOMETHANE	ug/L	< 5.	NA
	< 5	ug/L	CARBON DISULFIDE	ug/L	< 5	NA
	< 5	ug/L	CARBON TETRACHLORIDE	ug/L	< 5	NA
	< 5	ug/L	CHLOROBENZENE	ug/L	< 5	NA
	< 5	ug/L	CHLOROETHANE	ug/L	< 5	NA
	J 2.	ug/L	CHLOROFORM	ug/L	J 2.	0.0
	< 5	ug/L	CHLOROMETHANE	ug/L	< 5.	NA
	92.	ug/L	CIS-1.2-DICHLOROETHENE	ug/L	94.	2.2
	< 5	ug/L	CIS-1.3-DICHLOROPROPENE	ug/L	< 5	NA
	< 5	ug/L	DIBROMOCHLOROMETHANE	ug/L	< 5.	NA
	< 5	ug/L	ETHYLBENZENE	ug/L	< 5.	NA
	< 5	ug/L	METHYLENE CHLORIDE	ug/L	< 5.	NA
	< 5	ug/L	STYRENE	ug/L	< 5.	NA
	78.	ug/L	TETRACHLOROETHENE	ug/L	82.	5.0
	< 5	ug/L	TOLUENE	ug/L	< 5.	NA
	23.	ug/L	TRANS-1.2-DICHLOROETHEN	ug/L	24.	4.3
	< 5	ug/L	TRANS-1.3-DICHLOROPROPENE	ug/L	< 5	NA
	139.	ug/L	TRICHLOROETHENE	ug/L	145.	4.2
	17.	ug/L	VINYL CHLORIDE	ug/L	17.	0.0
	< 5	ug/L	XYLENE(TOTAL)	ug/L	< 5	NA
SV	< 10	ug/L	NAPHTHALENE	ug/L	< 10.	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

Field Duplicate Precision Report

Sample			Duplicate		
S1-121			S1-121DUP		
Sample Number	Sample Date		Sample Number	Sample Date	
FL 01586	7/12/00		FL 01587	7/12/00	

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
SV	< 20	ug/L	1.2.4-TRICHLOROBENZENE	ug/L	< 20	NA
	< 20	ug/L	1.2-DICHLOROBENZENE	ug/L	< 20	NA
	< 20.	ug/L	1.3-DICHLOROBENZENE	ug/L	< 20	NA
	< 20	ug/L	1.4-DICHLOROBENZENE	ug/L	< 20.	NA
	< 50	ug/L	2.4.5-TRICHLOROPHENOL	ug/L	< 50.	NA
	< 20	ug/L	2.4.6-TRICHLOROPHENOL	ug/L	< 20.	NA
	< 20.	ug/L	2.4-DICHLOROPHENOL	ug/L	< 20.	NA
	< 20	ug/L	2.4-DIMETHYLPHENOL	ug/L	< 20.	NA
	< 50	ug/L	2.4-DINITROPHENOL	ug/L	< 50.	NA
	< 20	ug/L	2.4-DINITROTOLUENE	ug/L	< 20.	NA
	< 20.	ug/L	2.6-DINITROTOLUENE	ug/L	< 20.	NA
	< 20	ug/L	2-CHLORONAPHTHALENE	ug/L	< 20	NA
	< 20.	ug/L	2-CHLOROPHENOL	ug/L	< 20.	NA
	< 20.	ug/L	2-METHYLNAPHTHALENE	ug/L	< 20.	NA
	< 20	ug/L	2-METHYLPHENOL	ug/L	< 20.	NA
	< 50.	ug/L	2-NITROANILINE	ug/L	< 50.	NA
	< 20.	ug/L	2-NITROPHENOL	ug/L	< 20	NA
	< 20	ug/L	3.3'-DICHLOROBENZIDINE	ug/L	< 20	NA
	< 50	ug/L	3-NITROANILINE	ug/L	< 50.	NA
	< 50.	ug/L	4.6-DINITRO-2-METHYLPHENO	ug/L	< 50.	NA
	< 20.	ug/L	4-BROMOPHENYL-PHENYLETH	ug/L	< 20	NA
	< 20	ug/L	4-CHLORO-3-METHYLPHENOL	ug/L	< 20	NA
	< 20	ug/L	4-CHLOROANILINE	ug/L	< 20	NA
	< 20.	ug/L	4-CHLOROPHENYL-PHENYLET	ug/L	< 20	NA
	< 20	ug/L	4-METHYLPHENOL	ug/L	< 20.	NA
	< 50.	ug/L	4-NITROANILINE	ug/L	< 50	NA
	< 50	ug/L	4-NITROPHENOL	ug/L	< 50	NA
	< 20	ug/L	ACENAPHTHENE	ug/L	< 20	NA
	< 20	ug/L	ACENAPHTHYLENE	ug/L	< 20.	NA
	< 20	ug/L	ANTHRACENE	ug/L	< 20.	NA
	< 20	ug/L	BENZO(A)ANTHRACENE	ug/L	< 20.	NA
	< 20	ug/L	BENZO(A)PYRENE	ug/L	< 20	NA
	< 20.	ug/L	BENZO(B)FLUORANTHENE	ug/L	< 20	NA
	< 20	ug/L	BENZO(G.H.I)PERYLENE	ug/L	< 20.	NA
	< 20	ug/L	BENZO(K)FLUORANTHENE	ug/L	< 20.	NA
	< 100	ug/L	BENZOIC ACID	ug/L	< 100	NA
	< 20.	ug/L	BENZYL ALCOHOL	ug/L	< 20.	NA
	< 20.	ug/L	BIS(2-CHLOROETHOXY)METHA	ug/L	< 20	NA
	< 20	ug/L	BIS(2-CHLOROETHYL)ETHER	ug/L	< 20.	NA
	< 20.	ug/L	BIS(2-CHLOROISOPROPYL)ETH	ug/L	< 20	NA
	J 4.	ug/L	BIS(2-ETHYLHEXYL)PHTHAL	ug/L	J 12.	100.0
	< 20	ug/L	BUTYLBENZYLPHTHALATE	ug/L	< 20.	NA
	< 20	ug/L	CHRYSENE	ug/L	< 20.	NA
	J 6.	ug/L	DI-N-BUTYLPHTHALATE	ug/L	J 3.	66.7
	< 20	ug/L	DI-N-OCTYLPHTHALATE	ug/L	< 20.	NA
	< 20.	ug/L	DIBENZ(A.H)ANTHRACENE	ug/L	< 20	NA
	< 20	ug/L	DIBENZOFURAN	ug/L	< 20.	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
SV	<20.	ug/L	DIETHYLPHTHALATE	ug/L	<20	NA
	<20	ug/L	DIMETHYLPHTHALATE	ug/L	<20.	NA
	<20.	ug/L	FLUORANTHENE	ug/L	<20	NA
	<20.	ug/L	FLUORENE	ug/L	<20	NA
	<20.	ug/L	HEXACHLOROBENZENE	ug/L	<20.	NA
	J 5.	ug/L	HEXACHLOROBUTADIENE	ug/L	J 5.	0.0
	<20.	ug/L	HEXACHLOROCYCLOPENTADI	ug/L	<20.	NA
	<20.	ug/L	HEXACHLOROETHANE	ug/L	<20.	NA
	<20.	ug/L	INDENO(1.2.3-CD)PYRENE	ug/L	<20	NA
	<20.	ug/L	ISOPHORONE	ug/L	<20.	NA
	<20.	ug/L	N-NITROSO-DI-N-PROPYLAMIN	ug/L	<20.	NA
	<20.	ug/L	N-NITROSODIPHENYLAMINE	ug/L	<20.	NA
	<20.	ug/L	NAPHTHALENE	ug/L	<20	NA
	<20	ug/L	NITROBENZENE	ug/L	<20.	NA
	<50.	ug/L	PENTACHLOROPHENOL	ug/L	<50.	NA
	<20.	ug/L	PHENANTHRENE	ug/L	<20.	NA
	<20	ug/L	PHENOL	ug/L	<20	NA
	<20	ug/L	PYRENE	ug/L	<20	NA
PEST	<.2	ug/L	4.4-DDD	ug/L	<.2	NA
	<.2	ug/L	4.4-DDE	ug/L	<.2	NA
	<.2	ug/L	4.4-DDT	ug/L	<.2	NA
	<.1	ug/L	ALDRIN	ug/L	<.1	NA
	<.1	ug/L	ALPHA-BHC	ug/L	<.1	NA
	< 1	ug/L	ALPHA-CHLORDANE	ug/L	<.1	NA
	<2	ug/L	AROCLOR-1016	ug/L	<2	NA
	<2	ug/L	AROCLOR-1221	ug/L	<2	NA
	<2	ug/L	AROCLOR-1232	ug/L	<2.	NA
	<2	ug/L	AROCLOR-1242	ug/L	<2.	NA
	<2	ug/L	AROCLOR-1248	ug/L	<2	NA
	<2.	ug/L	AROCLOR-1254	ug/L	<2	NA
	<2.	ug/L	AROCLOR-1260	ug/L	<2.	NA
	< 1	ug/L	BETA-BHC	ug/L	<.1	NA
	< 1	ug/L	DELTA-BHC	ug/L	<.1	NA
	<.2	ug/L	DIELDRIN	ug/L	<.2	NA
	< 1	ug/L	ENDOSULFAN I	ug/L	< 1	NA
	<.2	ug/L	ENDOSULFAN II	ug/L	<.2	NA
	< 2	ug/L	ENDOSULFAN SULFATE	ug/L	<.2	NA
	< 2	ug/L	ENDRIN	ug/L	<.2	NA
	< 2	ug/L	ENDRIN ALDEHYDE	ug/L	< 2	NA
	< 1	ug/L	GAMMA-BHC(LINDANE)	ug/L	<.1	NA
	<.1	ug/L	GAMMA-CHLORDANE	ug/L	< 1	NA
	<.1	ug/L	HEPTACHLOR	ug/L	<.1	NA
	< 1	ug/L	HEPTACHLOR EPOXIDE	ug/L	<.1	NA
	<10	ug/L	TOXAPHENE	ug/L	<10	NA
NUT	.15	mg/L	AMMONIA-N	mg/L	.15	0.0
	< 2	mg/L	NITRATE-N	mg/L	<.2	NA
	.34	mg/L	ORTHOPHOSPHATE-P	mg/L	.33	3.0
	29.800.	ug/L	POTASSIUM	ug/L	30.900.	3.6
MISC	11.2	mg/L	TOTAL ORGANIC CARBON	mg/L	11.6	3.5
MET	5.	ug/L	ARSENIC	ug/L	4.5	10.5
	.92	ug/L	COPPER	ug/L	.92	0.0
	<1 7	ug/L	ANTIMONY	ug/L	<1.7	NA
	.27	ug/L	BERYLLIUM	ug/L	.23	16.0
	.26	ug/L	CADMIUM	ug/L	.26	0.0
	<.5	ug/L	CHROMIUM	ug/L	<.5	NA

< = Compound Not Detected at the limited detection limit.
NA = Not Applicable

	Concentration	Units	Compound	Units	Concentration	Relative Percent Difference
MET	< 1.8	ug/L	LEAD	ug/L	< 1.8	NA
	< .2	ug/L	MERCURY	ug/L	< .2	NA
	9.	ug/L	NICKEL	ug/L	7.2	22.2
	< 3.8	ug/L	SELENIUM	ug/L	< 3.8	NA
	< 1.1	ug/L	SILVER	ug/L	< 1.1	NA
	< 2.3	ug/L	THALLIUM	ug/L	3.2	NA
	15.4	ug/L	ZINC	ug/L	8.9	53.5

< = Compound Not Detected at the limited detection limit.

NA = Not Applicable

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0105

Sample Name: TRIP BLK #1

Sample # : FL 01595

Date Coll'd : 7/12/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0105				Sample Name:	TRIP BLK #2
Sample # :	FL 01596	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5	ug/L		
		4-METHYL-2-PENTANONE	< 5	ug/L		
		ACETONE	< 5	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0107

Sample Name: TRIP BLK #3

Sample # : FL01606

Date Coll'd : 7/13/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5	ug/L
	BENZENE	< 5	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0108

Sample Name: Trip Blank #4

Sample # : FL01613

Date Coll'd : 7/14/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0112

Sample Name: TRIP BLK#5

Sample # : FL01641

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5	ug/L
	ACETONE	< 5	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5.	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	< 2	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT
Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114

Sample Name: TRIP BLK#6

Sample # : FL 01657

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5.	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0105				Sample Name:	FIELD BLK#1
Sample # :	FL01594	Compound	Concentration	Units	Date Coll'd :	7/12/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0107				Sample Name:	FIELD BLANK
Sample # :	FL 01605	Compound	Concentration	Units	Date Coll'd :	7/13/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5.	ug/L		
		1,2-DICHLOROETHANE	< 5	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5.	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5.	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5	ug/L		
		TETRACHLOROETHENE	< 5.	ug/L		
		TOLUENE	< 5.	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0108				Sample Name:	Field Blank
Sample # :	FL 01612	Compound	Concentration	Units	Date Coll'd :	7/14/2000
	VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L		
		1,1,2-TRICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHANE	< 5.	ug/L		
		1,1-DICHLOROETHENE	< 5	ug/L		
		1,2-DICHLOROETHANE	< 5.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L		
		1,2-DICHLOROPROPANE	< 5	ug/L		
		2-BUTANONE	< 50.	ug/L		
		2-HEXANONE	< 5.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	< 5.	ug/L		
		BENZENE	< 5.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5	ug/L		
		CARBON DISULFIDE	< 5.	ug/L		
		CARBON TETRACHLORIDE	< 5.	ug/L		
		CHLOROBENZENE	< 5.	ug/L		
		CHLOROETHANE	< 5	ug/L		
		CHLOROFORM	< 5.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	< 5	ug/L		
		METHYLENE CHLORIDE	< 5.	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	< 5	ug/L		
		TOLUENE	< 5	ug/L		
		TRANS-1,2-DICHLOROETHENE	< 5.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5	ug/L		
		TRICHLOROETHENE	< 5.	ug/L		
		VINYL CHLORIDE	< 2.	ug/L		
		XYLENE(TOTAL)	< 5.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0112

Sample # : FL01640

Sample Name: FIELD BLK

Date Coll'd : 7/18/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5.	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5.	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114

Sample Name: FIELD BLK

Sample # : FL 01656

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	< 5	ug/L
	1,2-DICHLOROETHANE	< 5.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	< 5.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5	ug/L
	BROMOMETHANE	< 5	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	< 5	ug/L
	CHLOROETHANE	< 5	ug/L
	CHLOROFORM	< 5.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5	ug/L
	STYRENE	< 5	ug/L
	TETRACHLOROETHENE	< 5	ug/L
	TOLUENE	< 5.	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	< 5	ug/L
	VINYL CHLORIDE	< 2.	ug/L
	XYLENE(TOTAL)	< 5	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0114

Sample Name: INT-233MS

Sample # : FL 01654

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	**45.**	ug/L
	1,2-DICHLOROETHANE	**11.**	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	< 5.	ug/L
	BENZENE	**385.**	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	**51.**	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	**12.**	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5.	ug/L
	DIBROMOCHLOROMETHANE	< 5	ug/L
	ETHYLBENZENE	< 5.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	**14.**	ug/L
	TOLUENE	**49.**	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	**47.**	ug/L
	VINYL CHLORIDE	**53.**	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115 | Sample Name: INT-233MS

Sample # : FL01666 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	20.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	31.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	23.	ug/L	FS
	2,6-DINITROTOLUENE	< 10	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	57.	ug/L	FS
	2-METHYLNAPHTHALENE	< 10	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	61.	ug/L	FS
	4-CHLOROANILINE	< 10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	< 50.	ug/L	FS
	ACENAPHTHENE	46.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10.	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	< 10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	< 10.	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115				Sample Name:	INT-233MS
Sample # :	FL 01666	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	< 10	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	42.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	51.	ug/L		FS
		PHENANTHRENE	< 10	ug/L		FS
		PHENOL	53.	ug/L		FS
		PYRENE	48.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0114

Sample Name: INT-233MSD

Sample # : FL01655

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	< 5.	ug/L
	1,1,2,2-TETRACHLOROETHANE	< 5.	ug/L
	1,1,2-TRICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHANE	< 5.	ug/L
	1,1-DICHLOROETHENE	**47.**	ug/L
	1,2-DICHLOROETHANE	**9.**	ug/L
	1,2-DICHLOROETHENE(TOTAL)	< 5.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	< 5.	ug/L
	4-METHYL-2-PENTANONE	< 5	ug/L
	ACETONE	< 5	ug/L
	BENZENE	**379.**	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	< 5.	ug/L
	CHLOROBENZENE	**54.**	ug/L
	CHLOROETHANE	< 5.	ug/L
	CHLOROFORM	**11.**	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5.	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	< 5	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	**10.**	ug/L
	TOLUENE	**51.**	ug/L
	TRANS-1,2-DICHLOROETHENE	< 5.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	**47.**	ug/L
	VINYL CHLORIDE	**56.**	ug/L
	XYLENE(TOTAL)	< 5.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample Name: INT-233MSD

Sample # : FL01667

Date Coll'd : 7/19/2000

	Compound		Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE		20.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE		30.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE		22.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL		57.	ug/L	FS
	2-METHYLNAPHTHALENE	<	10.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL		62.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	<	50.	ug/L	FS
	ACENAPHTHENE		45.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10	ug/L	FS
	BENZO(A)PYRENE	<	10	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	<	10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	<	10	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0115				Sample Name:	INT-233MSD
Sample # :	FL01667	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	< 10.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	43.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	< 10.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	59.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	53.	ug/L		FS
		PYRENE	47.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL0114				Sample Name:	S1-123MS
Sample # :	FL01650	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	VOA	1,1,1-TRICHLOROETHANE	13.	ug/L		
		1,1,2,2-TETRACHLOROETHANE	96.	ug/L		
		1,1,2-TRICHLOROETHANE	83.	ug/L		
		1,1-DICHLOROETHANE	3,043.	ug/L		
		1,1-DICHLOROETHENE	216.	ug/L		
		1,2-DICHLOROETHANE	2,431.	ug/L		
		1,2-DICHLOROETHENE(TOTAL)	5,785.	ug/L		
		1,2-DICHLOROPROPANE	< 5.	ug/L		
		2-BUTANONE	< 50	ug/L		
		2-HEXANONE	218.	ug/L		
		4-METHYL-2-PENTANONE	< 5.	ug/L		
		ACETONE	509.	ug/L		
		BENZENE	395.	ug/L		
		BROMODICHLOROMETHANE	< 5.	ug/L		
		BROMOFORM	< 5.	ug/L		
		BROMOMETHANE	< 5.	ug/L		
		CARBON DISULFIDE	< 5	ug/L		
		CARBON TETRACHLORIDE	144.	ug/L		
		CHLOROBENZENE	47.	ug/L		
		CHLOROETHANE	964.	ug/L		
		CHLOROFORM	5,113.	ug/L		
		CHLOROMETHANE	< 5.	ug/L		
		CIS-1,2-DICHLOROETHENE	< 5.	ug/L		
		CIS-1,3-DICHLOROPROPENE	< 5.	ug/L		
		DIBROMOCHLOROMETHANE	< 5.	ug/L		
		ETHYLBENZENE	78.	ug/L		
		METHYLENE CHLORIDE	< 5	ug/L		
		STYRENE	< 5.	ug/L		
		TETRACHLOROETHENE	3,829.	ug/L		
		TOLUENE	254.	ug/L		
		TRANS-1,2-DICHLOROETHENE	5,785.	ug/L		
		TRANS-1,3-DICHLOROPROPENE	< 5	ug/L		
		TRICHLOROETHENE	3,411.	ug/L		
		VINYL CHLORIDE	2,930.	ug/L		
		XYLENE(TOTAL)	298.	ug/L		

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL 0115 | Sample Name: S1-123MS

Sample # : FL 01662 | Date Coll'd : 7/19/2000

	Compound	Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE	20.	ug/L	FS
	1,2-DICHLOROBENZENE	< 10.	ug/L	FS
	1,3-DICHLOROBENZENE	< 10.	ug/L	FS
	1,4-DICHLOROBENZENE	31.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	< 50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DICHLOROPHENOL	< 10.	ug/L	FS
	2,4-DIMETHYLPHENOL	< 10.	ug/L	FS
	2,4-DINITROPHENOL	< 50.	ug/L	FS
	2,4-DINITROTOLUENE	20.	ug/L	FS
	2,6-DINITROTOLUENE	< 10.	ug/L	FS
	2-CHLORONAPHTHALENE	< 10.	ug/L	FS
	2-CHLOROPHENOL	54.	ug/L	FS
	2-METHYLNAPHTHALENE	12.	ug/L	FS
	2-METHYLPHENOL	< 10.	ug/L	FS
	2-NITROANILINE	< 50.	ug/L	FS
	2-NITROPHENOL	< 10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	< 10.	ug/L	FS
	3-NITROANILINE	< 50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	< 50.	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL	51.	ug/L	FS
	4-CHLOROANILINE	< 10	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	< 10.	ug/L	FS
	4-METHYLPHENOL	< 10.	ug/L	FS
	4-NITROANILINE	< 50.	ug/L	FS
	4-NITROPHENOL	77.	ug/L	FS
	ACENAPHTHENE	58.	ug/L	FS
	ACENAPHTHYLENE	< 10.	ug/L	FS
	ANTHRACENE	< 10	ug/L	FS
	BENZO(A)ANTHRACENE	< 10.	ug/L	FS
	BENZO(A)PYRENE	< 10	ug/L	FS
	BENZO(B)FLUORANTHENE	< 10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	< 10.	ug/L	FS
	BENZO(K)FLUORANTHENE	< 10.	ug/L	FS
	BENZOIC ACID	< 50.	ug/L	FS
	BENZYL ALCOHOL	< 10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	< 10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	< 10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	< 10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	< 10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	< 10	ug/L	FS
	CHRYSENE	< 10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	< 10	ug/L	FS
	DI-N-OCTYLPHTHALATE	< 10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	< 10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115				Sample Name:	S1-123MS
Sample # :	FL 01662	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	26.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	39.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	E 210.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	55.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	78.	ug/L		FS
		PYRENE	41.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0114

Sample Name: S1-123MSD

Sample # : FL01651

Date Coll'd : 7/19/2000

	Compound	Concentration	Units
VOA	1,1,1-TRICHLOROETHANE	13.	ug/L
	1,1,2,2-TETRACHLOROETHANE	94.	ug/L
	1,1,2-TRICHLOROETHANE	82.	ug/L
	1,1-DICHLOROETHANE	3,131.	ug/L
	1,1-DICHLOROETHENE	214.	ug/L
	1,2-DICHLOROETHANE	2,295.	ug/L
	1,2-DICHLOROETHENE(TOTAL)	5,926.	ug/L
	1,2-DICHLOROPROPANE	< 5.	ug/L
	2-BUTANONE	< 50.	ug/L
	2-HEXANONE	216.	ug/L
	4-METHYL-2-PENTANONE	< 5.	ug/L
	ACETONE	509.	ug/L
	BENZENE	385.	ug/L
	BROMODICHLOROMETHANE	< 5.	ug/L
	BROMOFORM	< 5.	ug/L
	BROMOMETHANE	< 5.	ug/L
	CARBON DISULFIDE	< 5.	ug/L
	CARBON TETRACHLORIDE	140.	ug/L
	CHLOROBENZENE	44.	ug/L
	CHLOROETHANE	996.	ug/L
	CHLOROFORM	5,427.	ug/L
	CHLOROMETHANE	< 5.	ug/L
	CIS-1,2-DICHLOROETHENE	< 5	ug/L
	CIS-1,3-DICHLOROPROPENE	< 5	ug/L
	DIBROMOCHLOROMETHANE	< 5.	ug/L
	ETHYLBENZENE	75.	ug/L
	METHYLENE CHLORIDE	< 5.	ug/L
	STYRENE	< 5.	ug/L
	TETRACHLOROETHENE	3,754.	ug/L
	TOLUENE	246.	ug/L
	TRANS-1,2-DICHLOROETHENE	5,926.	ug/L
	TRANS-1,3-DICHLOROPROPENE	< 5.	ug/L
	TRICHLOROETHENE	3,390.	ug/L
	VINYL CHLORIDE	3,006.	ug/L
	XYLENE(TOTAL)	290.	ug/L

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #: FL0115

Sample Name: S1-123MSD

Sample # : FL01663

Date Coll'd : 7/19/2000

	Compound		Concentration	Units	
SV	1,2,4-TRICHLOROBENZENE		23.	ug/L	FS
	1,2-DICHLOROBENZENE	<	10.	ug/L	FS
	1,3-DICHLOROBENZENE	<	10.	ug/L	FS
	1,4-DICHLOROBENZENE		35.	ug/L	FS
	2,4,5-TRICHLOROPHENOL	<	50.	ug/L	FS
	2,4,6-TRICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DICHLOROPHENOL	<	10.	ug/L	FS
	2,4-DIMETHYLPHENOL	<	10.	ug/L	FS
	2,4-DINITROPHENOL	<	50.	ug/L	FS
	2,4-DINITROTOLUENE		25.	ug/L	FS
	2,6-DINITROTOLUENE	<	10.	ug/L	FS
	2-CHLORONAPHTHALENE	<	10.	ug/L	FS
	2-CHLOROPHENOL		65.	ug/L	FS
	2-METHYLNAPHTHALENE		14.	ug/L	FS
	2-METHYLPHENOL	<	10.	ug/L	FS
	2-NITROANILINE	<	50.	ug/L	FS
	2-NITROPHENOL	<	10.	ug/L	FS
	3,3'-DICHLOROBENZIDINE	<	10.	ug/L	FS
	3-NITROANILINE	<	50.	ug/L	FS
	4,6-DINITRO-2-METHYLPHENOL	<	50	ug/L	FS
	4-BROMOPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-CHLORO-3-METHYLPHENOL		63.	ug/L	FS
	4-CHLOROANILINE	<	10.	ug/L	FS
	4-CHLOROPHENYL-PHENYLETHER	<	10.	ug/L	FS
	4-METHYLPHENOL	<	10.	ug/L	FS
	4-NITROANILINE	<	50.	ug/L	FS
	4-NITROPHENOL	E	82.	ug/L	FS
	ACENAPHTHENE		70.	ug/L	FS
	ACENAPHTHYLENE	<	10.	ug/L	FS
	ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)ANTHRACENE	<	10.	ug/L	FS
	BENZO(A)PYRENE	<	10	ug/L	FS
	BENZO(B)FLUORANTHENE	<	10.	ug/L	FS
	BENZO(G,H,I)PERYLENE	<	10.	ug/L	FS
	BENZO(K)FLUORANTHENE	<	10.	ug/L	FS
	BENZOIC ACID	<	50	ug/L	FS
	BENZYL ALCOHOL	<	10.	ug/L	FS
	BIS(2-CHLOROETHOXY)METHANE	<	10.	ug/L	FS
	BIS(2-CHLOROETHYL)ETHER	<	10.	ug/L	FS
	BIS(2-CHLOROISOPROPYL)ETHER	<	10.	ug/L	FS
	BIS(2-ETHYLHEXYL)PHTHALATE	<	10.	ug/L	FS
	BUTYLBENZYLPHTHALATE	<	10.	ug/L	FS
	CHRYSENE	<	10.	ug/L	FS
	DI-N-BUTYLPHTHALATE	<	10.	ug/L	FS
	DI-N-OCTYLPHTHALATE	<	10.	ug/L	FS
	DIBENZ(A,H)ANTHRACENE	<	10.	ug/L	FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

ANALYTICAL DATA SUMMARY REPORT

Ground Water

FLTG, INC.

French Limited

ArCoC #:	FL 0115				Sample Name:	S1-123MSD
Sample # :	FL 01663	Compound	Concentration	Units	Date Coll'd :	7/19/2000
	SV	DIBENZOFURAN	< 10.	ug/L		FS
		DIETHYLPHTHALATE	< 10.	ug/L		FS
		DIMETHYLPHTHALATE	< 10.	ug/L		FS
		FLUORANTHENE	< 10.	ug/L		FS
		FLUORENE	< 10.	ug/L		FS
		HEXACHLOROBENZENE	< 10.	ug/L		FS
		HEXACHLOROBUTADIENE	30.	ug/L		FS
		HEXACHLOROCYCLOPENTADIENE	< 10.	ug/L		FS
		HEXACHLOROETHANE	< 10.	ug/L		FS
		INDENO(1,2,3-CD)PYRENE	< 10.	ug/L		FS
		ISOPHORONE	< 10.	ug/L		FS
		N-NITROSO-DI-N-PROPYLAMINE	46.	ug/L		FS
		N-NITROSODIPHENYLAMINE	< 10.	ug/L		FS
		NAPHTHALENE	E 240.	ug/L		FS
		NITROBENZENE	< 10.	ug/L		FS
		PENTACHLOROPHENOL	75.	ug/L		FS
		PHENANTHRENE	< 10.	ug/L		FS
		PHENOL	E 93.	ug/L		FS
		PYRENE	49.	ug/L		FS

E = analyte concentration exceeded calibration range of instrument

J = analyte concentration detected below detection limit

Attachment D

French Ltd. Project

Ron Jansen's Memo dated June 30, 1999

Hybrid micro-purge sampling method

Remedial Operations Group, Inc.

5514 Decker Drive
Baytown, TX 77520

Phone: (281)838-1086
FAX: (281)838-4024

MEMO

TO: Mark Collins, Operators
FROM: Ron Jansen
CC: Dick Sloan, Jim Thomson
DATE: 06/30/99
SUBJECT: Semi-annual Sampling Event at French Ltd. Project, July, 1999

This memo describes a procedure to be utilized for the groundwater sampling event to take place the week of July 5, 1999. The following procedure will be used to collect groundwater samples from all of the normal remediation progress monitoring wells at the French Ltd. Site.

Prior to sampling any wells, the following wells will be rehabilitated according to the "Post-Flood Rehabilitation Check List" : INT-127, INT-130R, INT-130RS, S1-106A and S1-108A.

General Description

This method describes a hybrid of micro-purge and standard well bailing groundwater sampling(purging three well volumes). As with the micro-purge method, there will be a relatively small volume of purge water. As with conventional well bailing, the confidence in sample representativeness should be greater.

A pump will be placed between the water surface and the top of the screen (10 feet below water surface is ideal). As water is purged from the well, water from the aquifer will displace the stagnant water between the top of the casing and the pump. Because each well is different (water level, screen depth/length, etc.), the levels at which the pump should be placed and the number of purge cycles may be different.

Equipment / Material

Groundwater sampling trailer (with variable speed pump, decon facilities and purge water holding tank); micro-purge pump; standard sampling supplies (sample containers, ice chests; field measurement instruments, PPE, etc.)

Procedure

Before measuring water levels, all wells fitted with sealing-type well caps should have the caps removed, and water levels should be allowed to equilibrate with the surface air pressure(this process takes approximately one hour). All wells should initially be measured for depth to water level and all readings recorded properly. The well sampling sequence should strictly follow the attached sheet. Prior to collecting a sample, the well purge pump should be placed at the levels specified on the attached Table. Water should be purged out of the well according to the depths and intervals shown in Table 1. The water will be pumped out of the well until the water level is down to the level of the pump. The water level will be allowed to recover to within 1½ feet of the original water level. Repeat this procedure the number of times specified in Table 1 for each well. After the last cycle of purging, the pump and purge hose should be removed from the well and decontaminated thoroughly. The water level will be allowed to recover to within 1½ feet of the original water level prior to collecting a sample via the stainless steel micro-purge tubing installed in the well.

Analytical requirements for the groundwater samples and field data sheets are attached. Please note that samples for metals analysis should be filtered in the field with a 0.45 micron in-line filter. Only use the in-line filter when filling the sample containers for metals analysis (250 ml to 1000 ml plastic with nitric acid). Other than the above stated changes in sampling/purging protocol, the remainder of the sampling event should be the same as in all previous sampling events (e.g. requested analytical tests, field measurements, etc.)

Appendix B

Migration Wall Evaluation

French, Ltd. Project

FLTG, Incorporated

Lyondell, White House, 2502 Sheldon Rd., Channelview, TX 77530 PHONE 281-862-5570 FAX 281-862-6143
R.L. SLOAN, PROJECT COORDINATOR

October 9, 2000

Ernest Franke
USEPA-Superfund Enforcement Section
1445 Ross Ave., (6SF-AP)
Dallas, TX 75202

Re: Migration Wall Evaluation

Dear Ernest:

The French site closure plan calls for evaluation of the migration control wall every five years. The attached report summarizes the evaluation that was done in May, 2000.

The thickness of the steel wall was measured at three locations above the water table and at three locations below the water table. The wall retains 95% to 100% of the original wall thickness; there is no indication of any corrosion or degradation since the wall was installed in 1989.

Please contact me if you have any questions or comments.

Sincerely,

R.L. Sloan

R.L. Sloan

RS/ks

c: Any Lange
Emmanuel Ndame
Mike Day
Will Schorp
Mark Collins

Attachment

French, Ltd. Project

FLTG, Incorporated

Lyondell, White House, 2502 Sheldon Rd., Channelview, TX 77530 PHONE 281-862-5570 FAX 281-862-6143

Date: September 20, 2000

To: Dick Sloan c: Will Schorp

From: Mark Collins

Subject: Ultrasonic and Visual Permeability Examination of Lagoon Sheet Piles

Enclosed are the results of the sheet pile test conducted during the 5-year scheduled examination.

The test was conducted at a different location than was stated in the work plan. Water levels in the west marsh prevented the operators from excavating in the area of the 1995 test. The May, 2000, test was conducted outside the wall opposite the P-6 monitoring well aligned with INT-59 P-2.

Since there has been no evidence of corrosion or degradation of the metal, please advise if any additional testing will be scheduled.

MC/ks

Enclosure

French Limited Project
Remedial Operation Group
FLTG Crosby Texas, Site

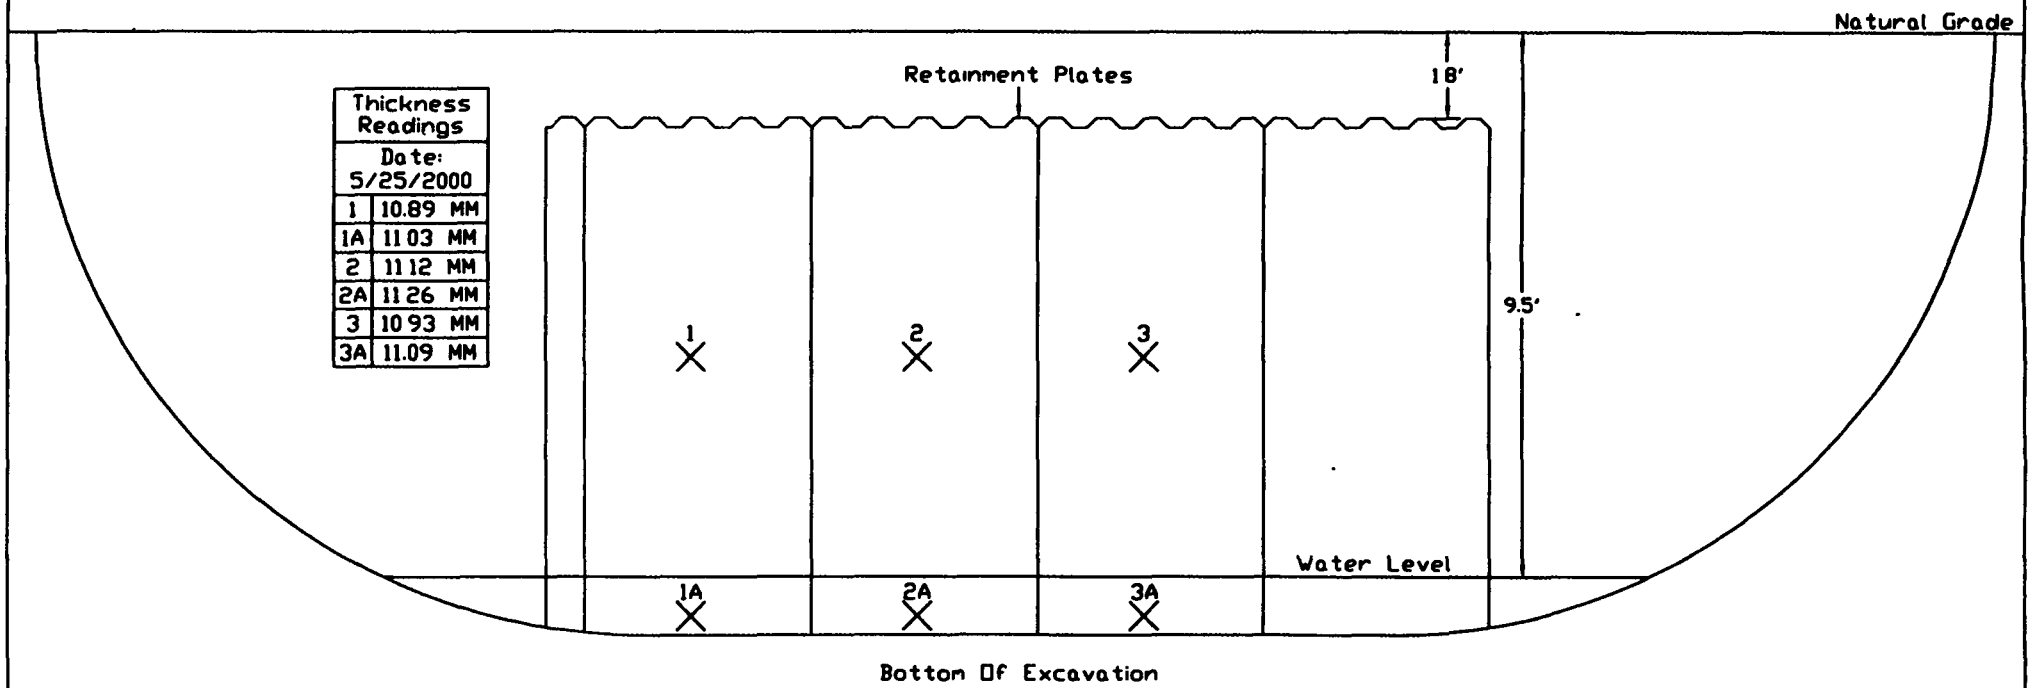

Thickness Readings	
Date: 5/25/2000	
1	10.89 MM
1A	11.03 MM
2	11.12 MM
2A	11.26 MM
3	10.93 MM
3A	11.09 MM

PREPARED BY
Petroleum Industry Inspectors
1817 Tidwell Lane
Houston, Texas 77093

PETROLEUM INDUSTRY INSPECTORS

FRENCH LIMITED PROJECT
REMEDIAL OPERATION GROUP
FLTG CROSBY, TX SITE

INSTRUMENT TYPE: 26 DL PLUS
INSTRUMENT SERIAL# 96333105
TRANSDUCER TYPE: D 790
TRANSDUCER SERIAL#20097
CAL. BLOCK SERIAL# A07284
TYPE COUPLANT: ULTRAGEL
JOB DESCRIPTION: THICKNESS READINGS ON RETAINMENT PLATES ABOVE AND BELOW WATER LEVEL.

* READINGS TAKEN IN MILLIMETERS

POINT	*														
1	12.51														
1A	9.91														
2	10.03														
2A	10.25														
3	10.59														
3A	10.12														

RESULTS: CURRENT THICKNESS READINGS AS COMPARED TO PREVIOUS READINGS SHOW VERY LITTLE OR NO WALL LOSE. CURRENT CONDITIONS IS GOOD WITH NO SIGN OF CORROSION.

TECHNICIAN: GEORGE SHEPERD DATE: 5-25-2000

REVIEWED BY: DATE: 5-25-2000

ARBED
Société anonyme
Division
d'Esch-Belval

Table 2

le 31/07/89

ESSAIS MECANIQUES
MECHANISCHE PRÜFUNGEN - MECHANICAL TESTS

QUALITE ET CONTROLE
RECEPTION - ABNAHME - TESTING Dpt.

CLIENT/KUNDE: Skyline

Trade ARBED No 9BE 1027/01

Qualité imposée / Gutevorschrift / Quality specification: ASTM A572 Grade 60
Limite élastique / Streckgrenze / Yield Strength: 415
Résistance / Festigkeit / Tensile Strength: 520
Allongement / Dehnung / Elongation: 16

N	Coulée N° / Schmelz N° / Heat N°	Matériel / Material	Essai de traction - Zugversuch - Tensile Test: Dimensions / Abmessungen / Sizes: Larg / Breite / Width mm	Epaiss / Dicke / Thickn mm	Section / Querschnitt mm²	Limite élastique / Streckgrenze / Yield Strength: Charge / Belastung / Load kN	N/mm²	Résistance / Festigkeit / Tensile Strength: Charge / Belastung / Load kN	N/mm²	Allongement / Dehnung / Elongation: L_0 mm 84	%	Essai de Résilience - Kerbschlagprobe - Impact Test: Type	Temp °C	1 J	2 J	3 J	Moyenne / Mittelwert / Average	Section / Querschn mm²	Essai pliage / Biegeprobe / Bend Test 180°
CW	1014	BZ 16.4	36.3	9.4	341	165	484	220	645	200	19,0								
CW	"			9.4	"	162	475	219	642		20,0								
CX	1018			9.4	"	155	455	200	587		20,0								
CX	"			9.4	"	152	446	191	560		21,5								
CY	1022			9.4	"	163	478	210	616		20,5								
CY	"			9.3	338	160	473	210	621		20,5								
CZ	1028			9.1	330	154	467	192	582		21,5								
CZ	"			10.0	363	168	463	214	590		22,0								
DA	1032			9.4	341	173	507	213	625		20,5								
DA	"			9.3	338	159	470	202	598		22,0								
DB	1033			9.3	"	154	456	192	568		23,5								
DB	"			9.3	"	156	462	191	565		23,0								

No 9002991
Surveyor to Lloyd's Register
Nancy
date: 31.07.89 Signature:
Sampling and mechanical tests witnessed
Material inspected - Identification checked
Manufacturer's Certificates accepted

BV 126

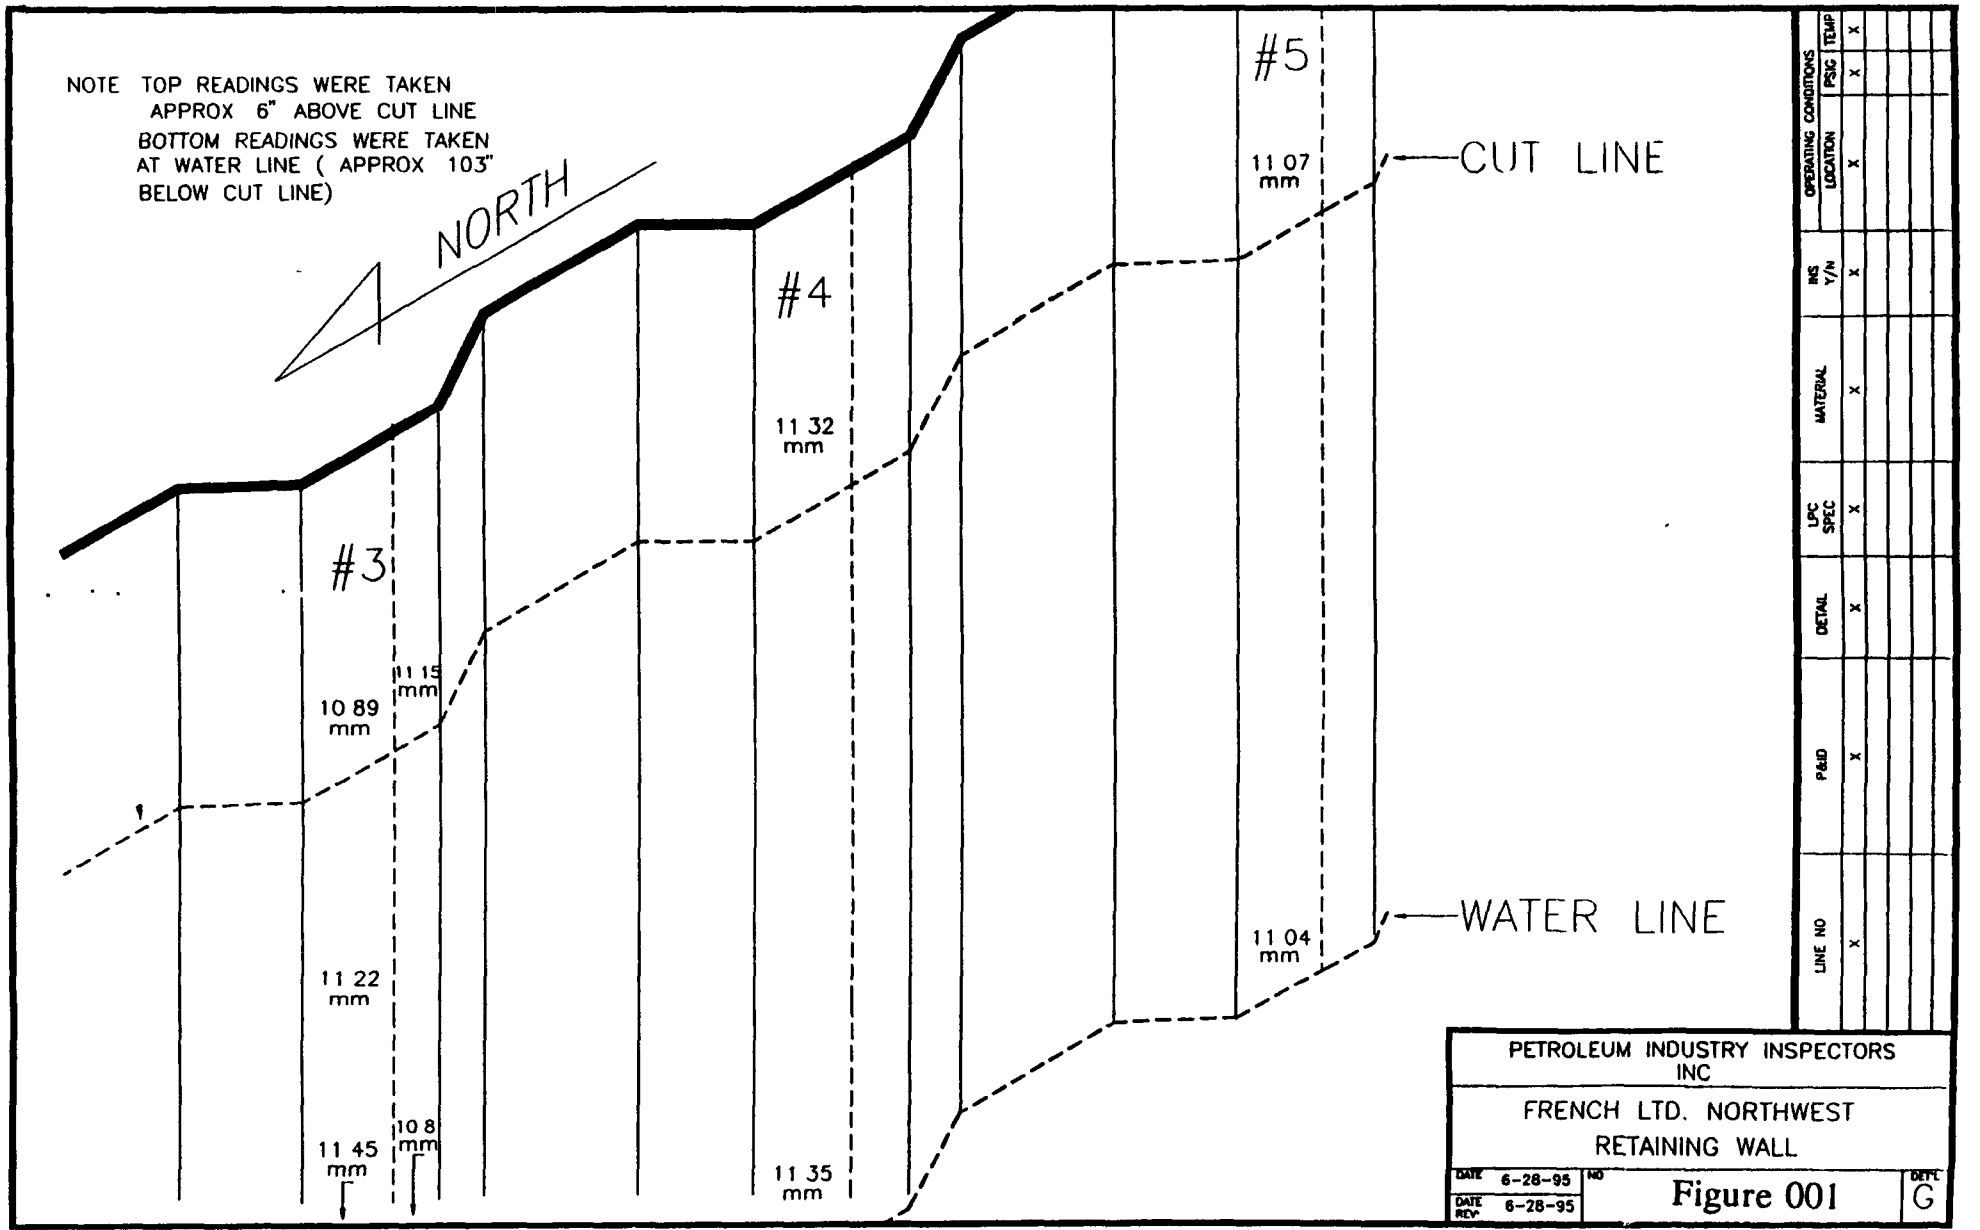
NOTE TOP READINGS WERE TAKEN
APPROX 6" ABOVE CUT LINE
BOTTOM READINGS WERE TAKEN
AT WATER LINE (APPROX 103"
BELOW CUT LINE)
NORTH
#3
#4
#5
10 89 mm
11 15 mm
11 22 mm
11 45 mm
10 8 mm
11 32 mm
11 35 mm
11 07 mm
11 04 mm
CUT LINE
WATER LINE
OPERATING CONDITIONS
LOCATION
PSIG
TEMP
INS Y/N
MATERIAL
LPC SPEC
DETAIL
P&ID
LINE NO
PETROLEUM INDUSTRY INSPECTORS INC
FRENCH LTD. NORTHWEST
RETAINING WALL
DATE 6-28-95
DATE REV 6-28-95
NO
Figure 001
DET'L G
LAST SAVE DATE= 6-28-95
FILENAME= ACAD

French Limited Project
Remedial Operation Group
FLTG Crosby Texas, Site

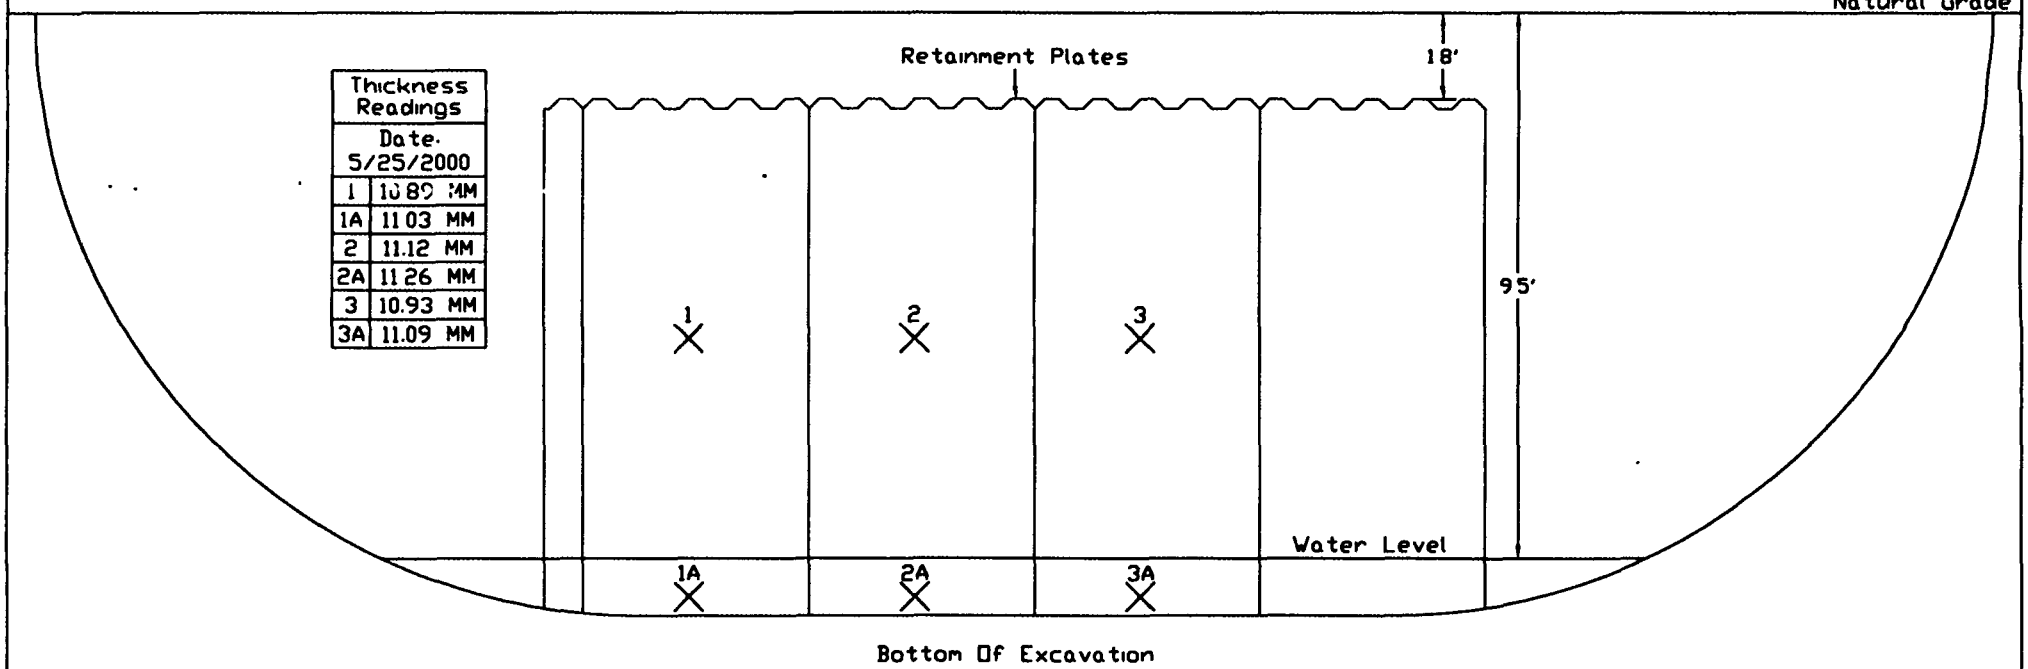

Thickness Readings	
Date: 5/25/2000	
1	10.89 MM
1A	11.03 MM
2	11.12 MM
2A	11.26 MM
3	10.93 MM
3A	11.09 MM

PREPARED BY:
Petroleum Industry Inspectors
1817 Tidwell Lane
Houston, Texas 77093

Appendix C

July, 2000, Water Level and Chemical Concentration Figures

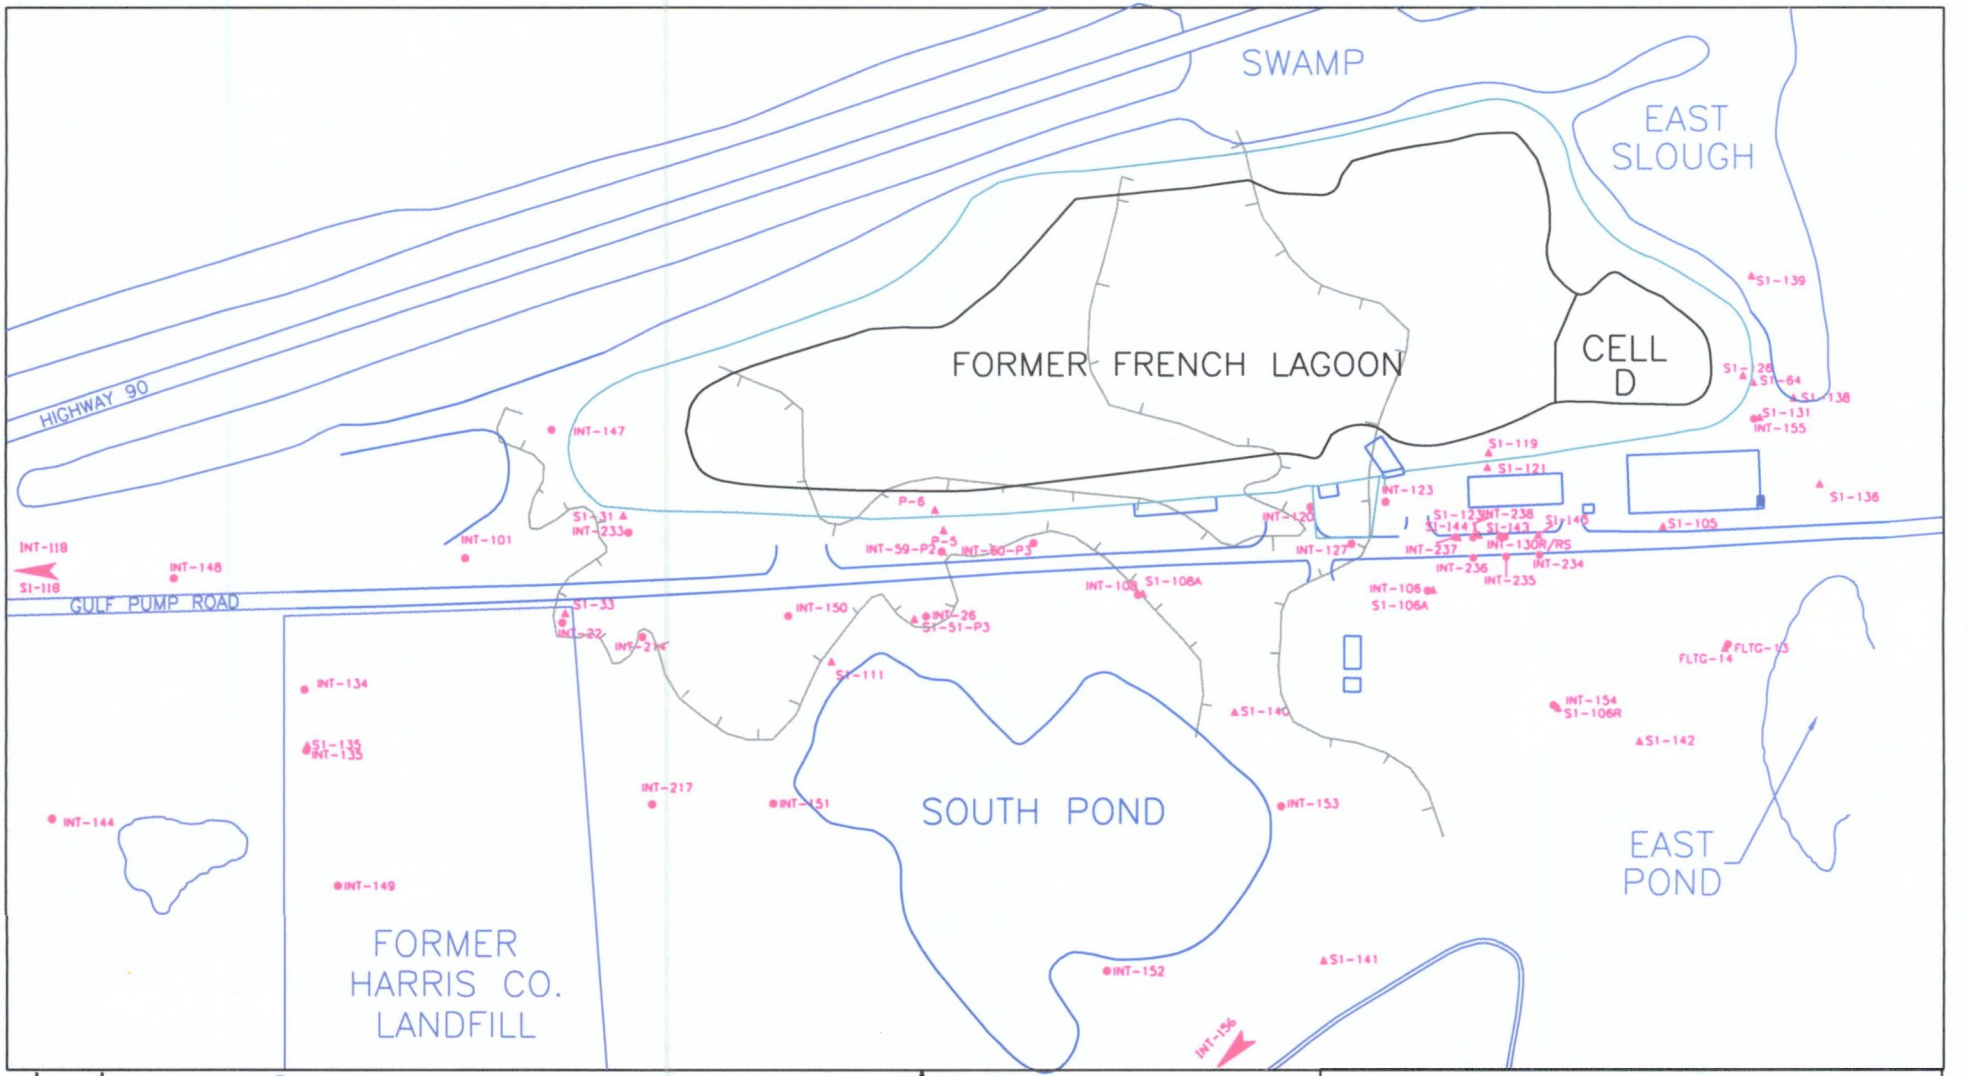

Legend

- INT-144 INT Well Designation
- S1-135 S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby, TX	
INT & S1 UNITS	Figure 2-1
July 2000	FRENCHQM.DWG (7/00 rev.)

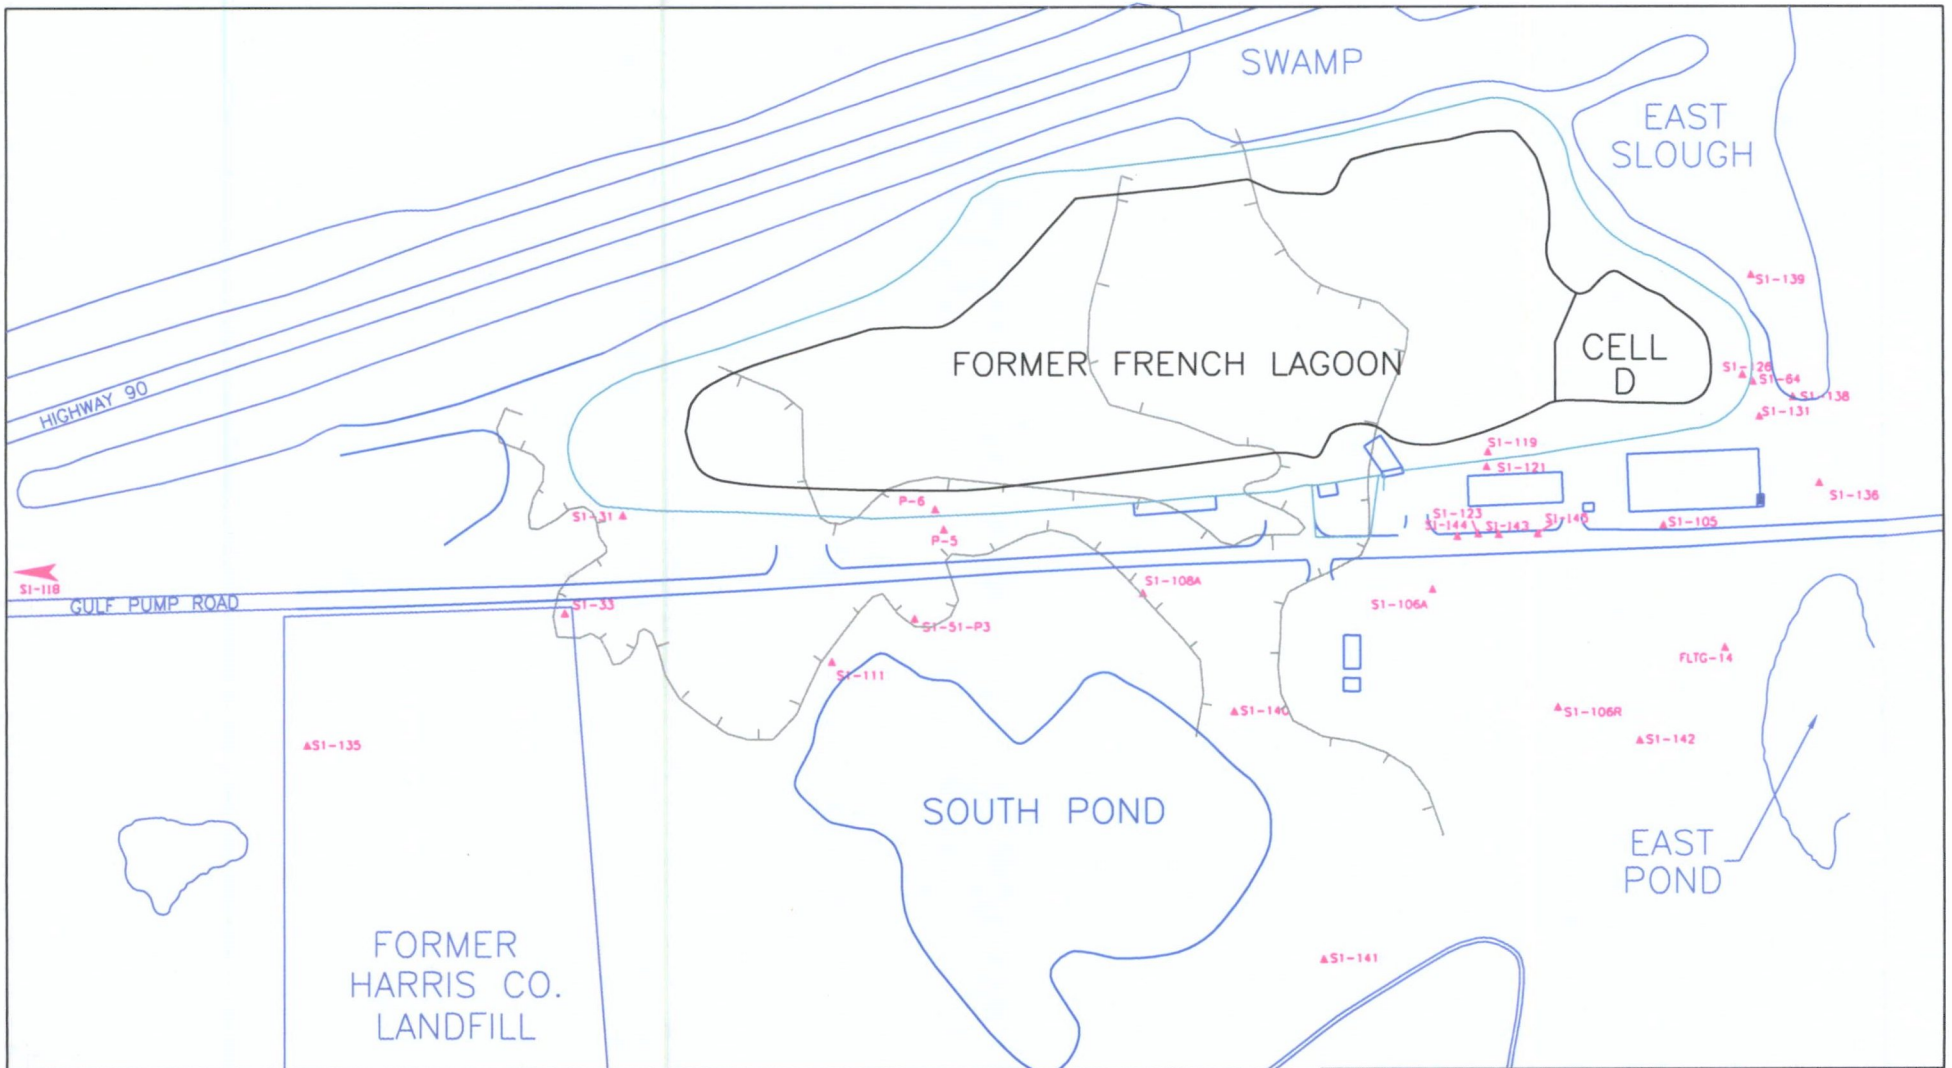

Legend

INT Well Designation

S1-135 S1 Well Designation

Surface Water Guage

C1 Layer Absent

Sheet Pile Wall

150' 0 150'

Scale in feet

FLTG., Inc. French Limited Site Crosby, TX

S1 UNIT
PROGRESS MONITORING WELLS
July 2000

Figure 2-2

FRENCHQM.DWG (7/00 rev.)

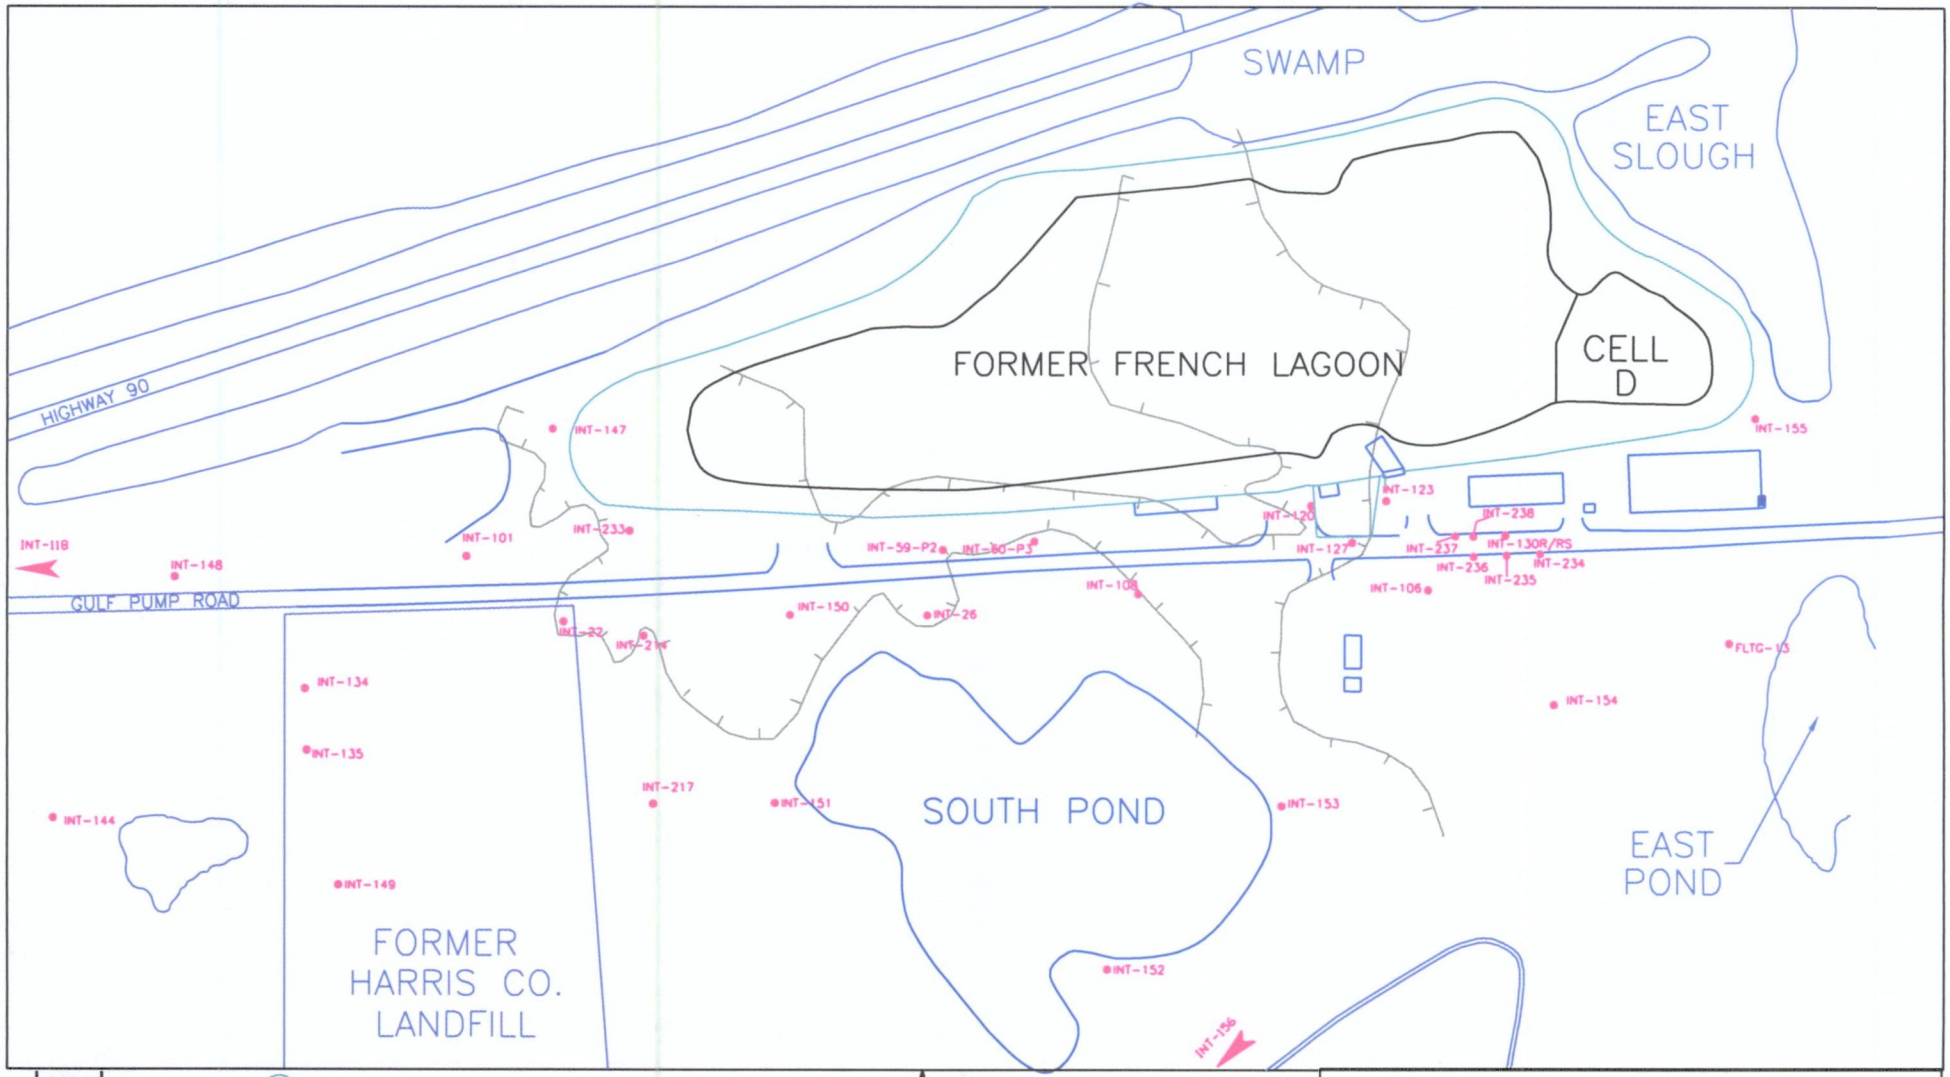

Legend

- INT-144 INT Well Designation
- S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall

N

150' 0 150'

Scale in feet

FLTG., Inc. French Limited Site Crosby,TX

INT UNIT
PROGRESS MONITORING WELLS
July 2000

Figure 2-3

FRENCHQM.DWG (7/00 rev.)

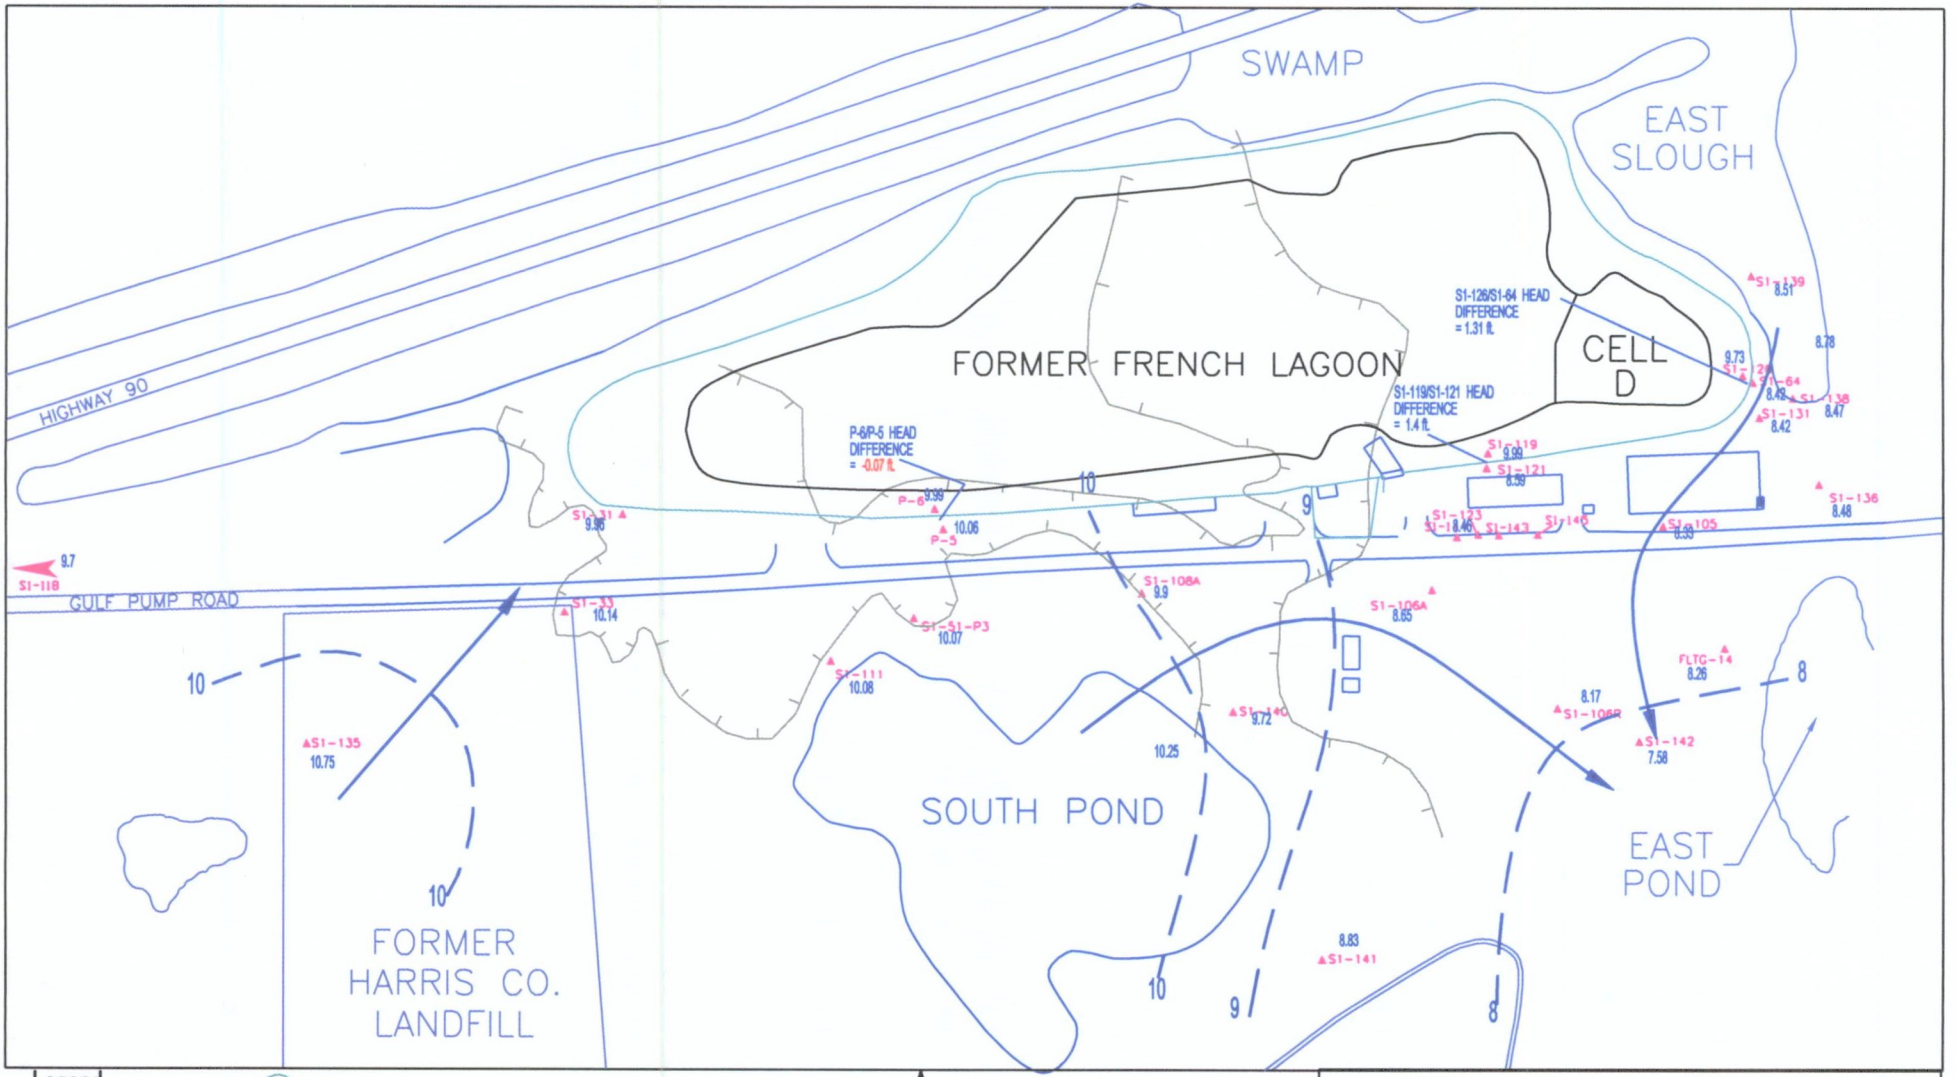

Legend

- INT Well Designation
- S1-135 S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 10.25 Water Level Measurement
- Water Level Contour
- Inferred Groundwater Flow Direction

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby,TX	
S1 UNIT Water Levels w/Inferred Flow July 2000	Figure 2-4 FRENCHQM.DWG (7/00 rev.)

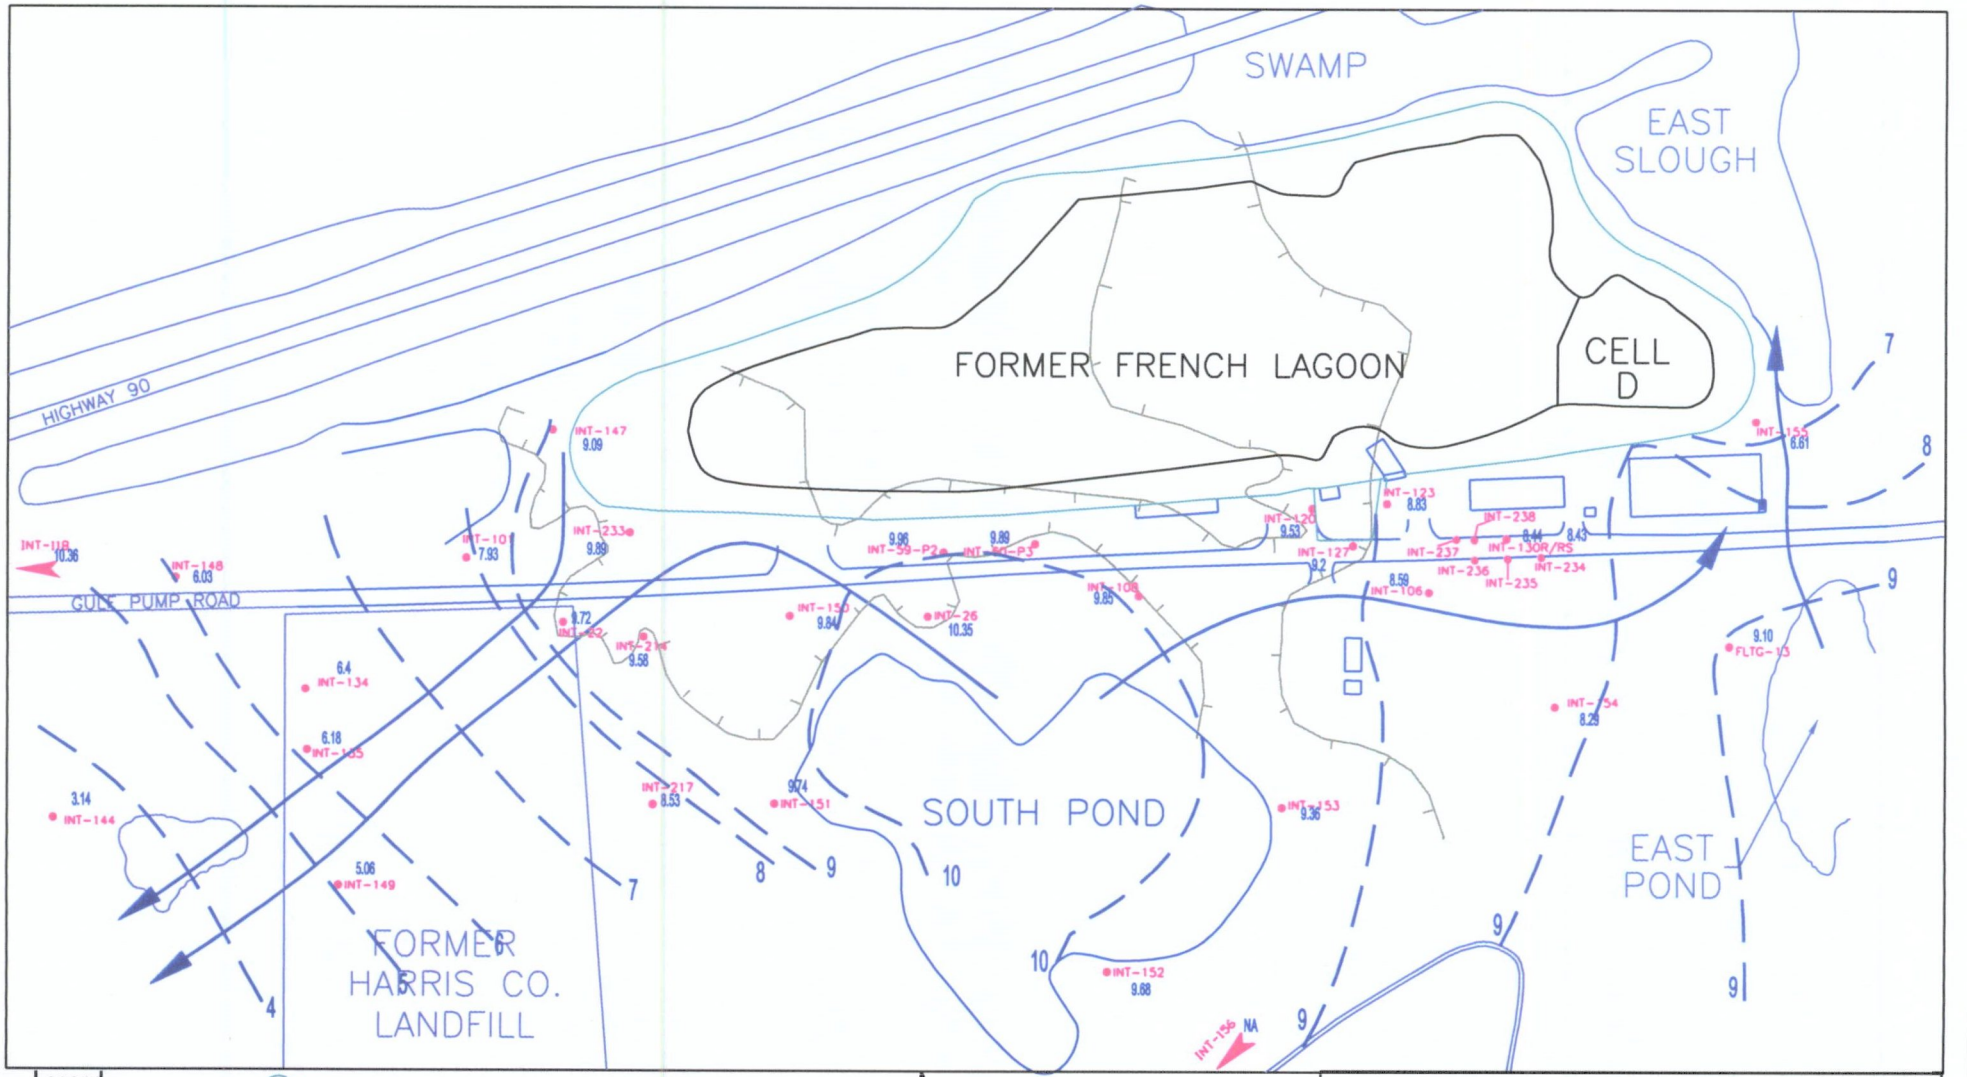
SWAMP
EAST SLOUGH
FORMER FRENCH LAGOON
CELL D
HIGHWAY 90
GULF PUMP ROAD
SOUTH POND
EAST POND
FORMER HARRIS CO. LANDFILL
INT-147 9.09
INT-118 10.36
INT-148 6.03
INT-101 7.93
INT-233 9.89
INT-59-P2 9.96
INT-59-P3 9.89
INT-120 9.53
INT-127 9.2
INT-123 8.83
INT-238
INT-237
INT-130R/RS 8.44
INT-236
INT-235
INT-234 8.43
INT-106 8.59
INT-155 6.61
INT-150 9.84
INT-26 10.35
INT-108 9.85
INT-214 9.58
INT-82 9.72
INT-134 6.4
INT-135 6.18
INT-144 3.14
INT-149 5.06
INT-217 8.53
INT-151 9.74
INT-153 9.36
INT-152 9.68
INT-156 NA
INT-154 8.29
FLTG-13 9.10
4
7
8
9
10
Legend
INT-144 INT Well Designation
S1 Well Designation
Surface Water Guage
C1 Layer Absent
Sheet Pile Wall
10.25 Water Level Measurement
Water Level Contour
Inferred Groundwater Flow Direction
150' 0 150'
Scale in feet
FLTG., Inc. French Limited Site Crosby, TX
INT UNIT
Water Levels w/Inferred Flow
July 2000
Figure 2-5
FRENCHQM.DWG (7/00 rev.)

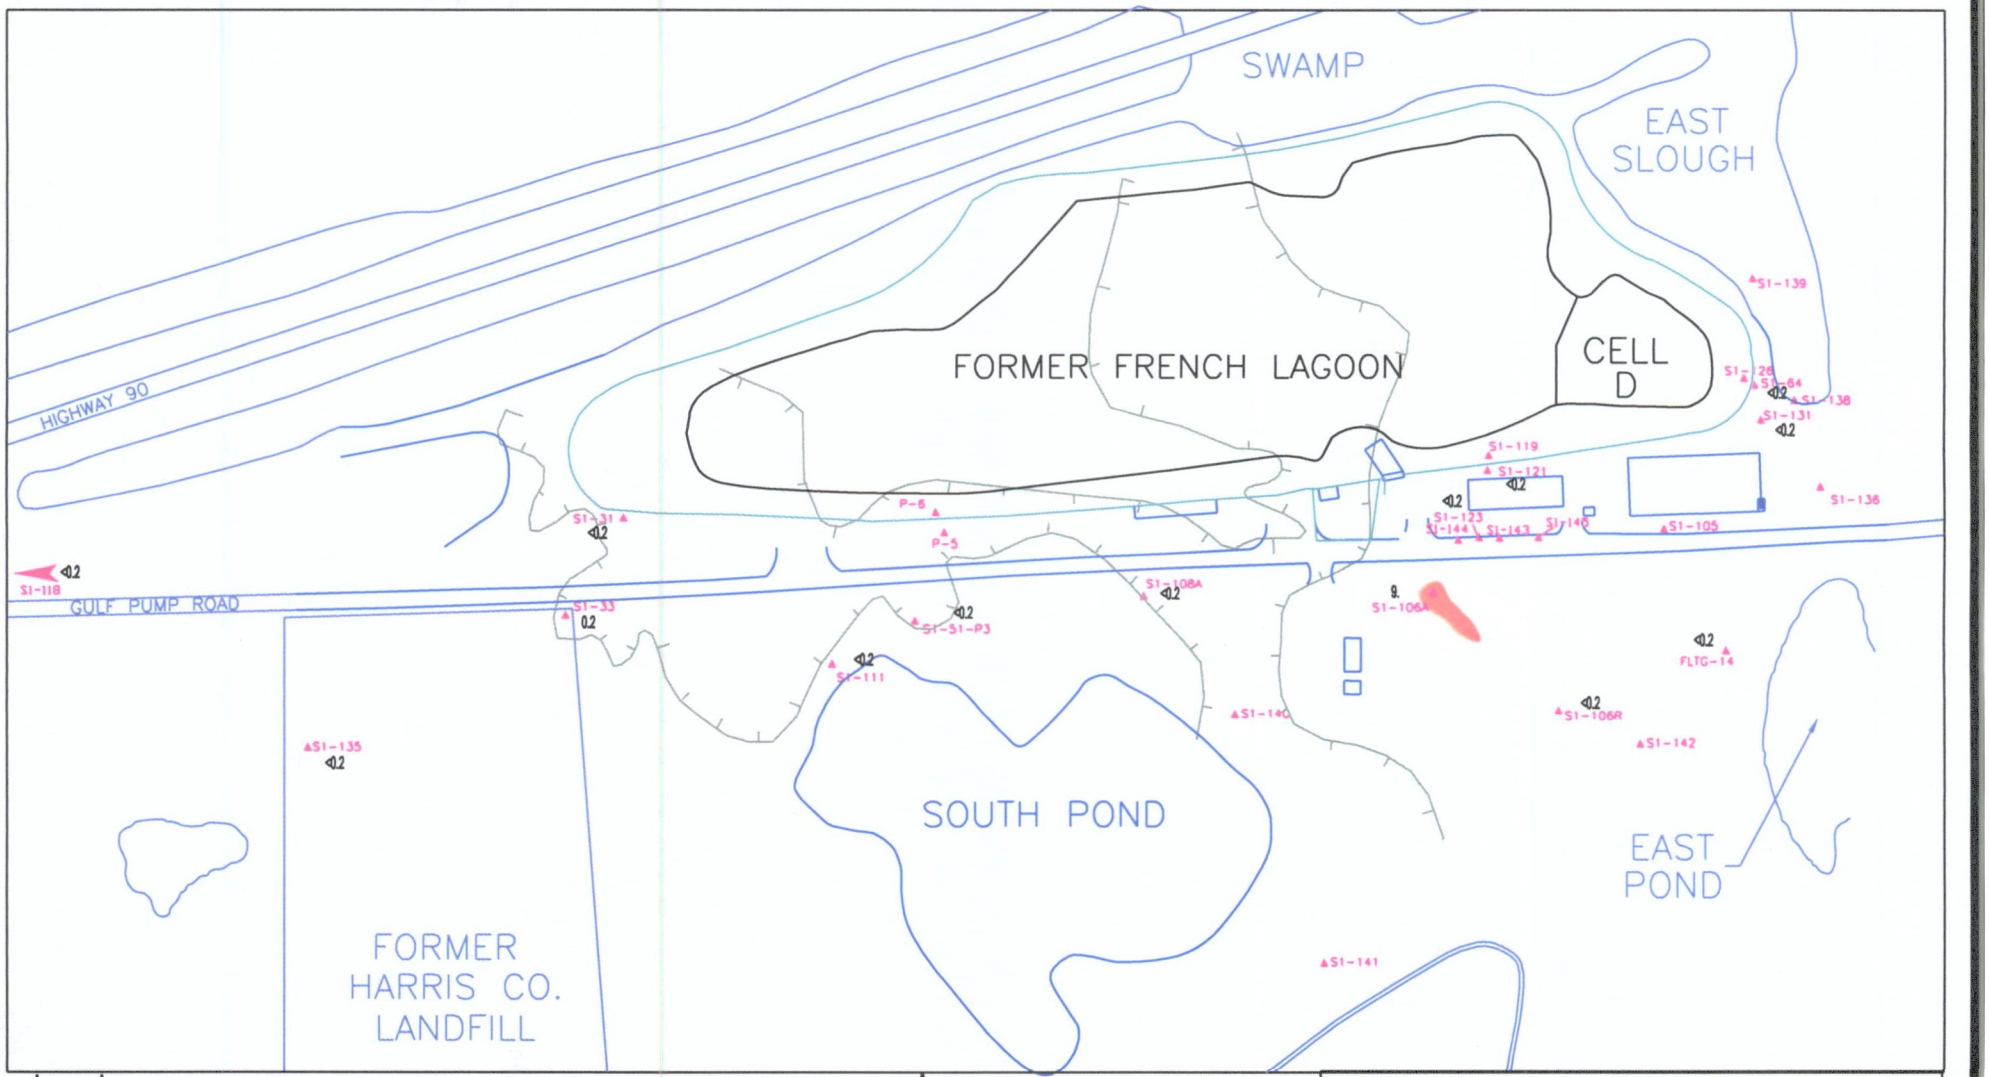

Legend

- INT Well Designation
- ▲S1-135 S1 Well Designation
- △ Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- <0.2 Nitrate-N Measurement
- Nitrate-N Contour (1-10 mg/L)
- Nitrate-N Contour (10+ mg/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby, TX	
S1 UNIT NITRATE-N July 2000	Figure 2-6 FRENCHQM.DWG (7/00 rev.)

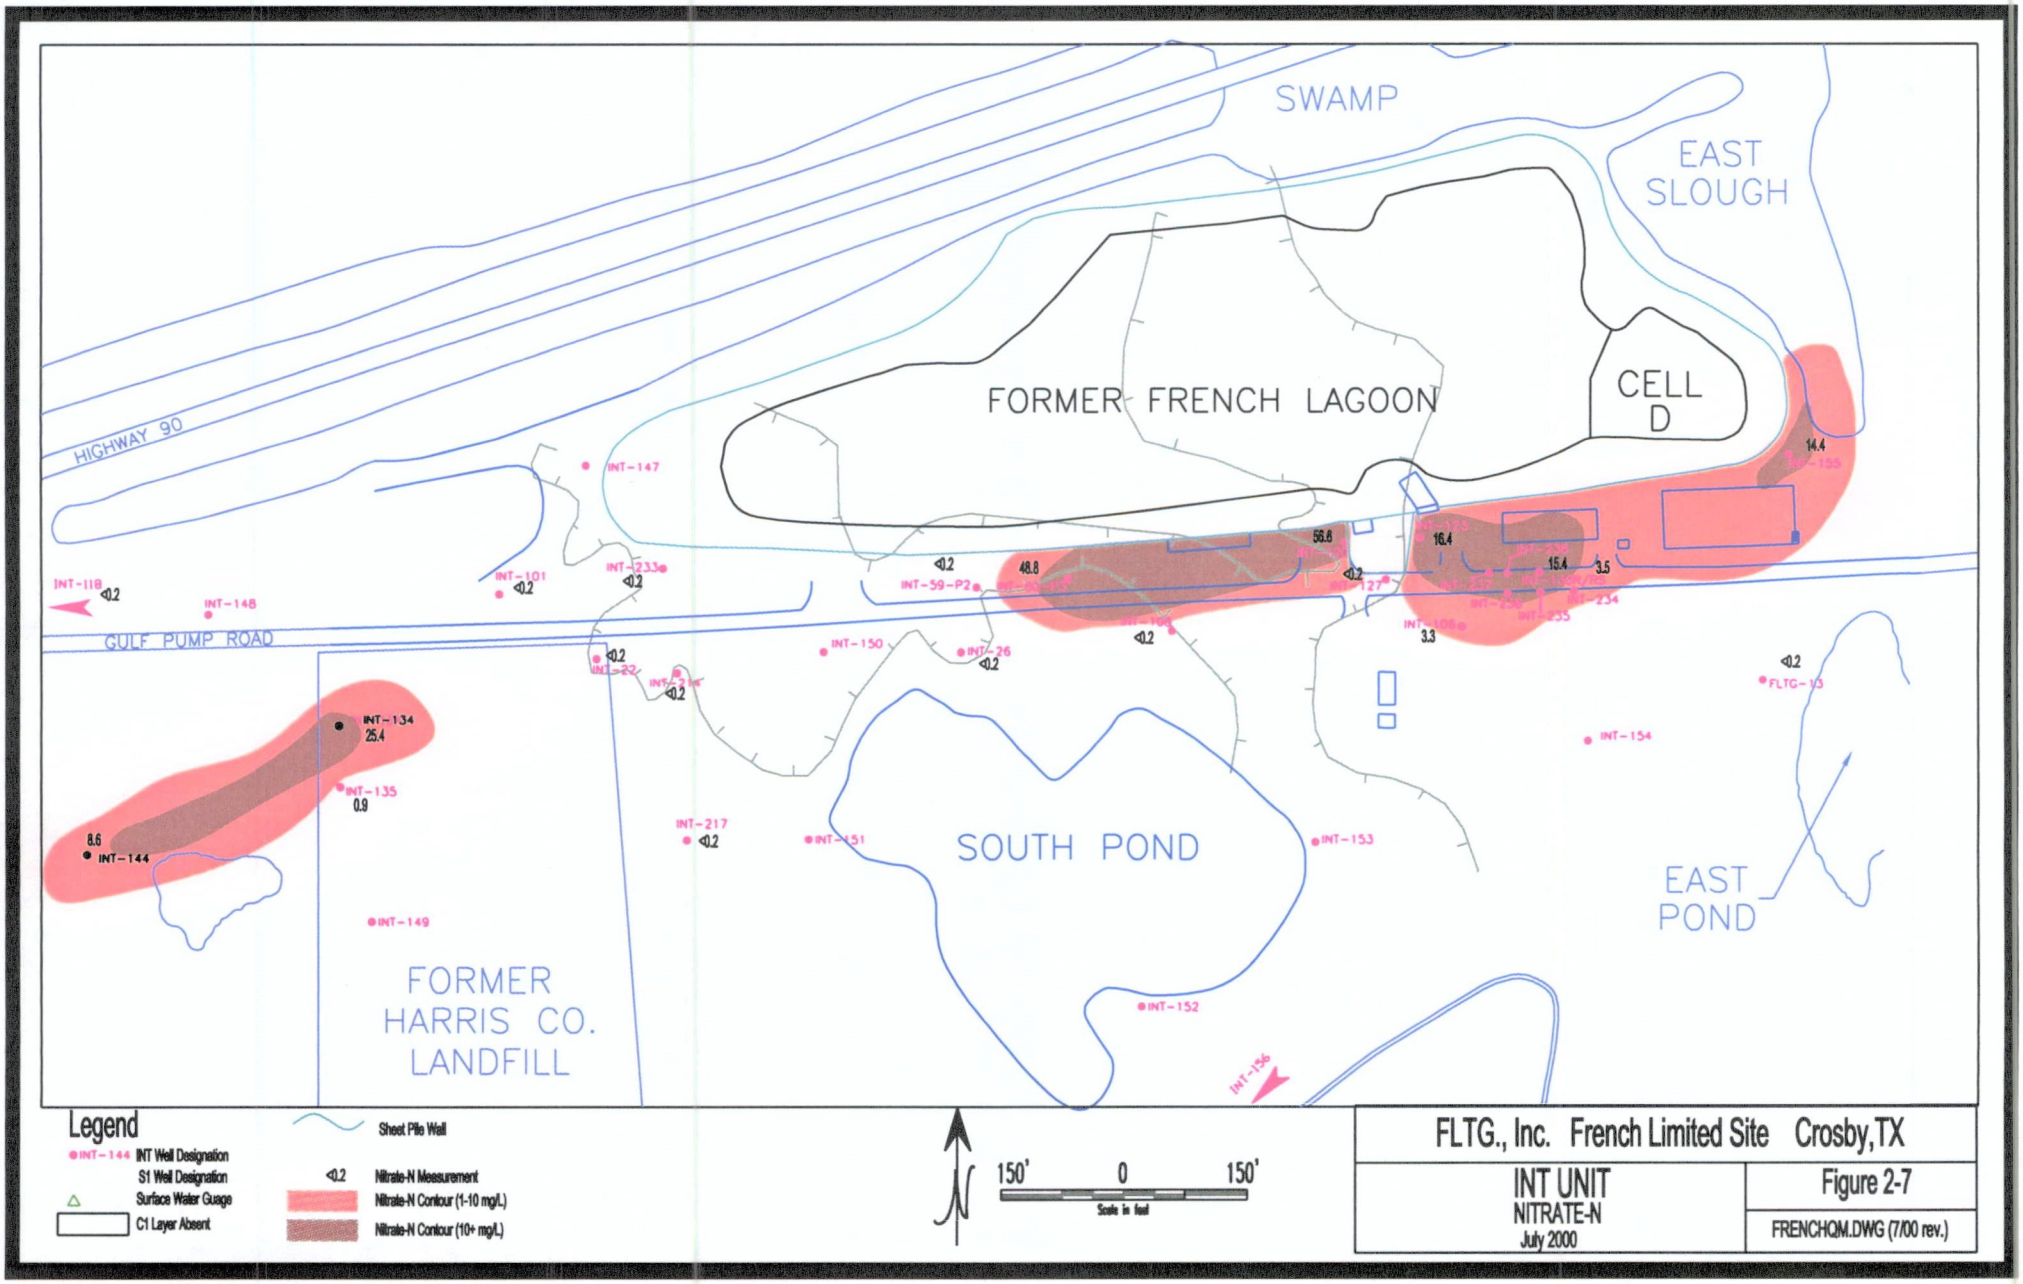
SWAMP
EAST SLOUGH
FORMER FRENCH LAGOON
CELL D
HIGHWAY 90
GULF PUMP ROAD
SOUTH POND
EAST POND
FORMER HARRIS CO. LANDFILL
INT-147
INT-101
INT-233
INT-118
INT-148
INT-59-P2
INT-150
INT-26
INT-22
INT-134
25.4
INT-135
0.9
8.6
INT-144
INT-217
INT-151
INT-149
INT-153
INT-152
INT-154
INT-156
FLTG-13
48.8
56.6
16.4
15.4
3.5
14.4
3.3
Legend
INT-144 INT Well Designation
S1 Well Designation
Surface Water Guage
C1 Layer Absent
Sheet Pile Wall
<0.2 Nitrate-N Measurement
Nitrate-N Contour (1-10 mg/L)
Nitrate-N Contour (10+ mg/L)
150' 0 150'
Scale in feet
FLTG., Inc. French Limited Site Crosby,TX
INT UNIT
NITRATE-N
July 2000
Figure 2-7
FRENCHQM.DWG (7/00 rev.)

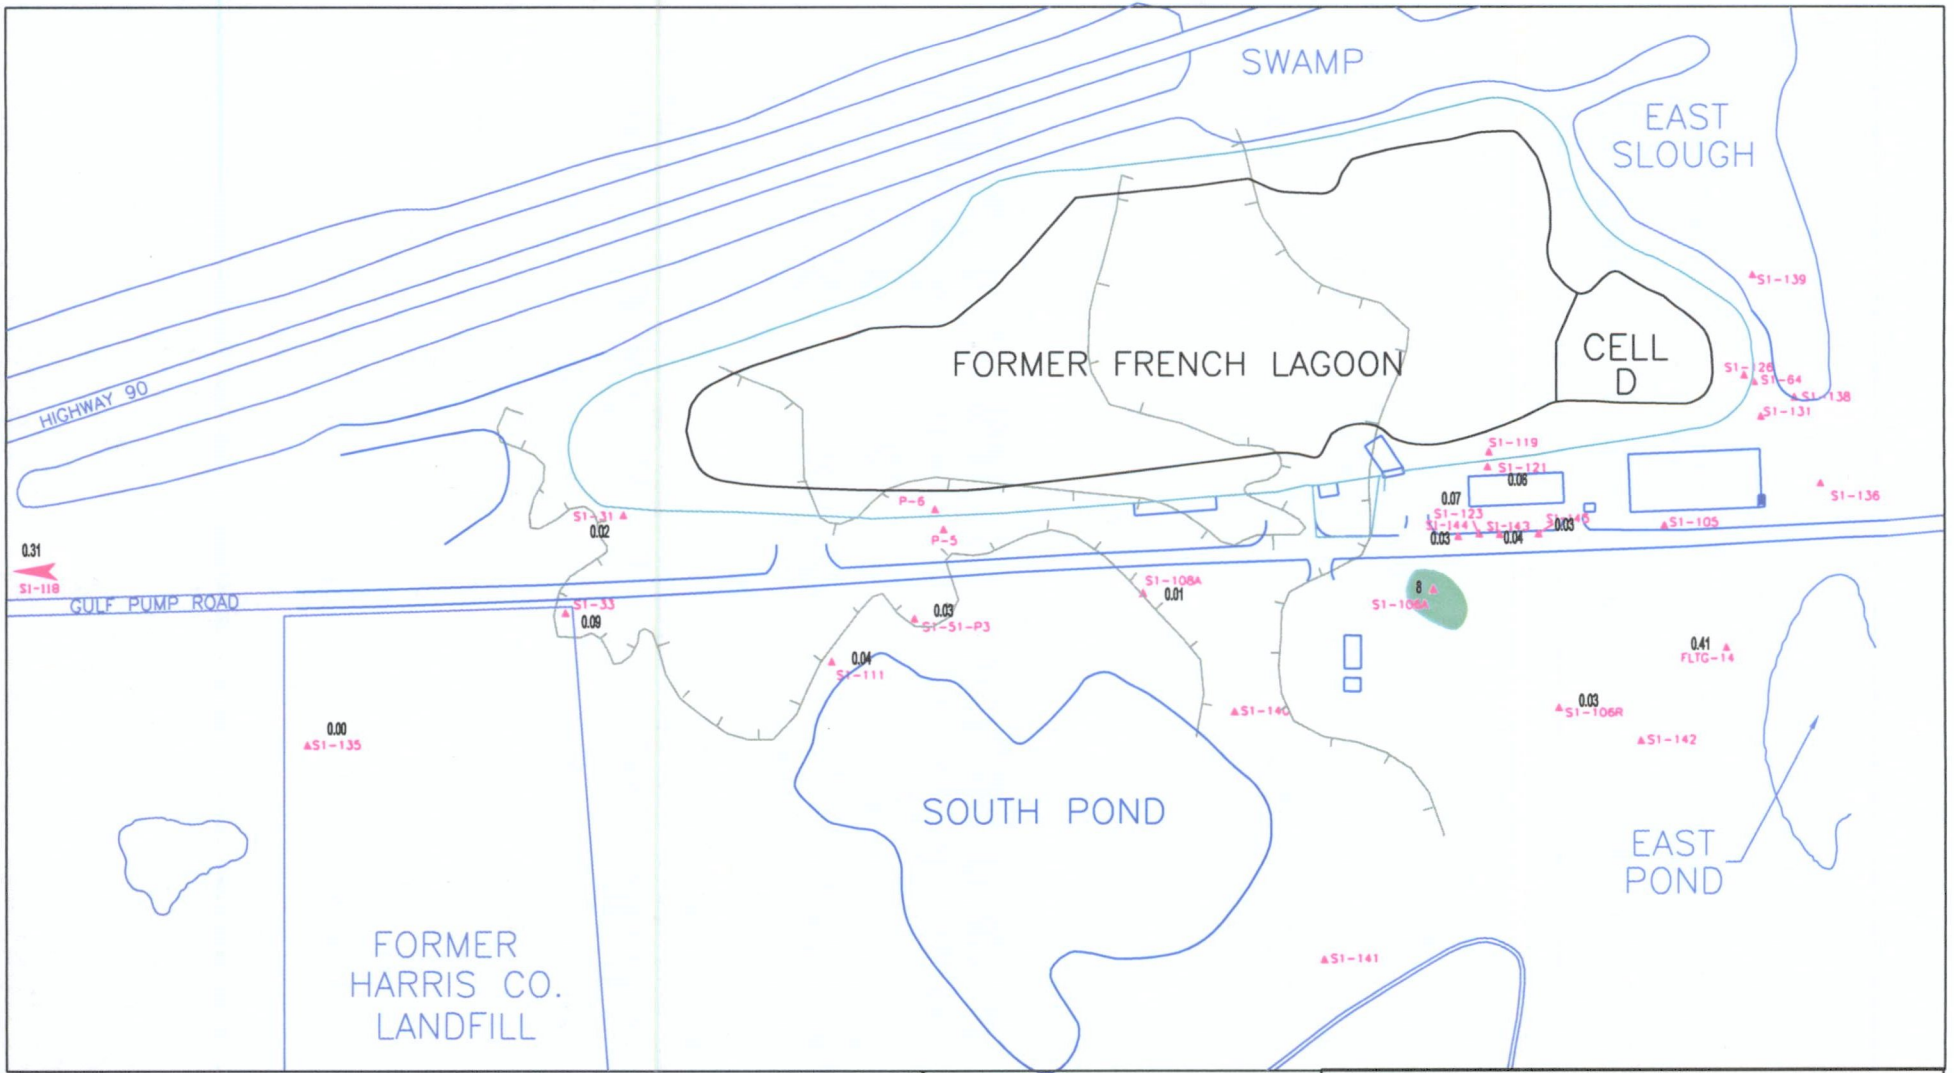

Legend

- INT Well Designation
- ▲S1-135 S1 Well Designation
- △ Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 Dissolved Oxygen Measurement
- Dissolved Oxygen Contour (2-10 mg/L)
- Dissolved Oxygen Contour(10+ mg/L)

N

150' 0 150'

Scale in feet

FLTG., Inc. French Limited Site Crosby,TX	
S1 UNIT DISSOLVED OXYGEN July 2000	Figure 2-8 FRENCHQM.DWG (7/00 rev.)

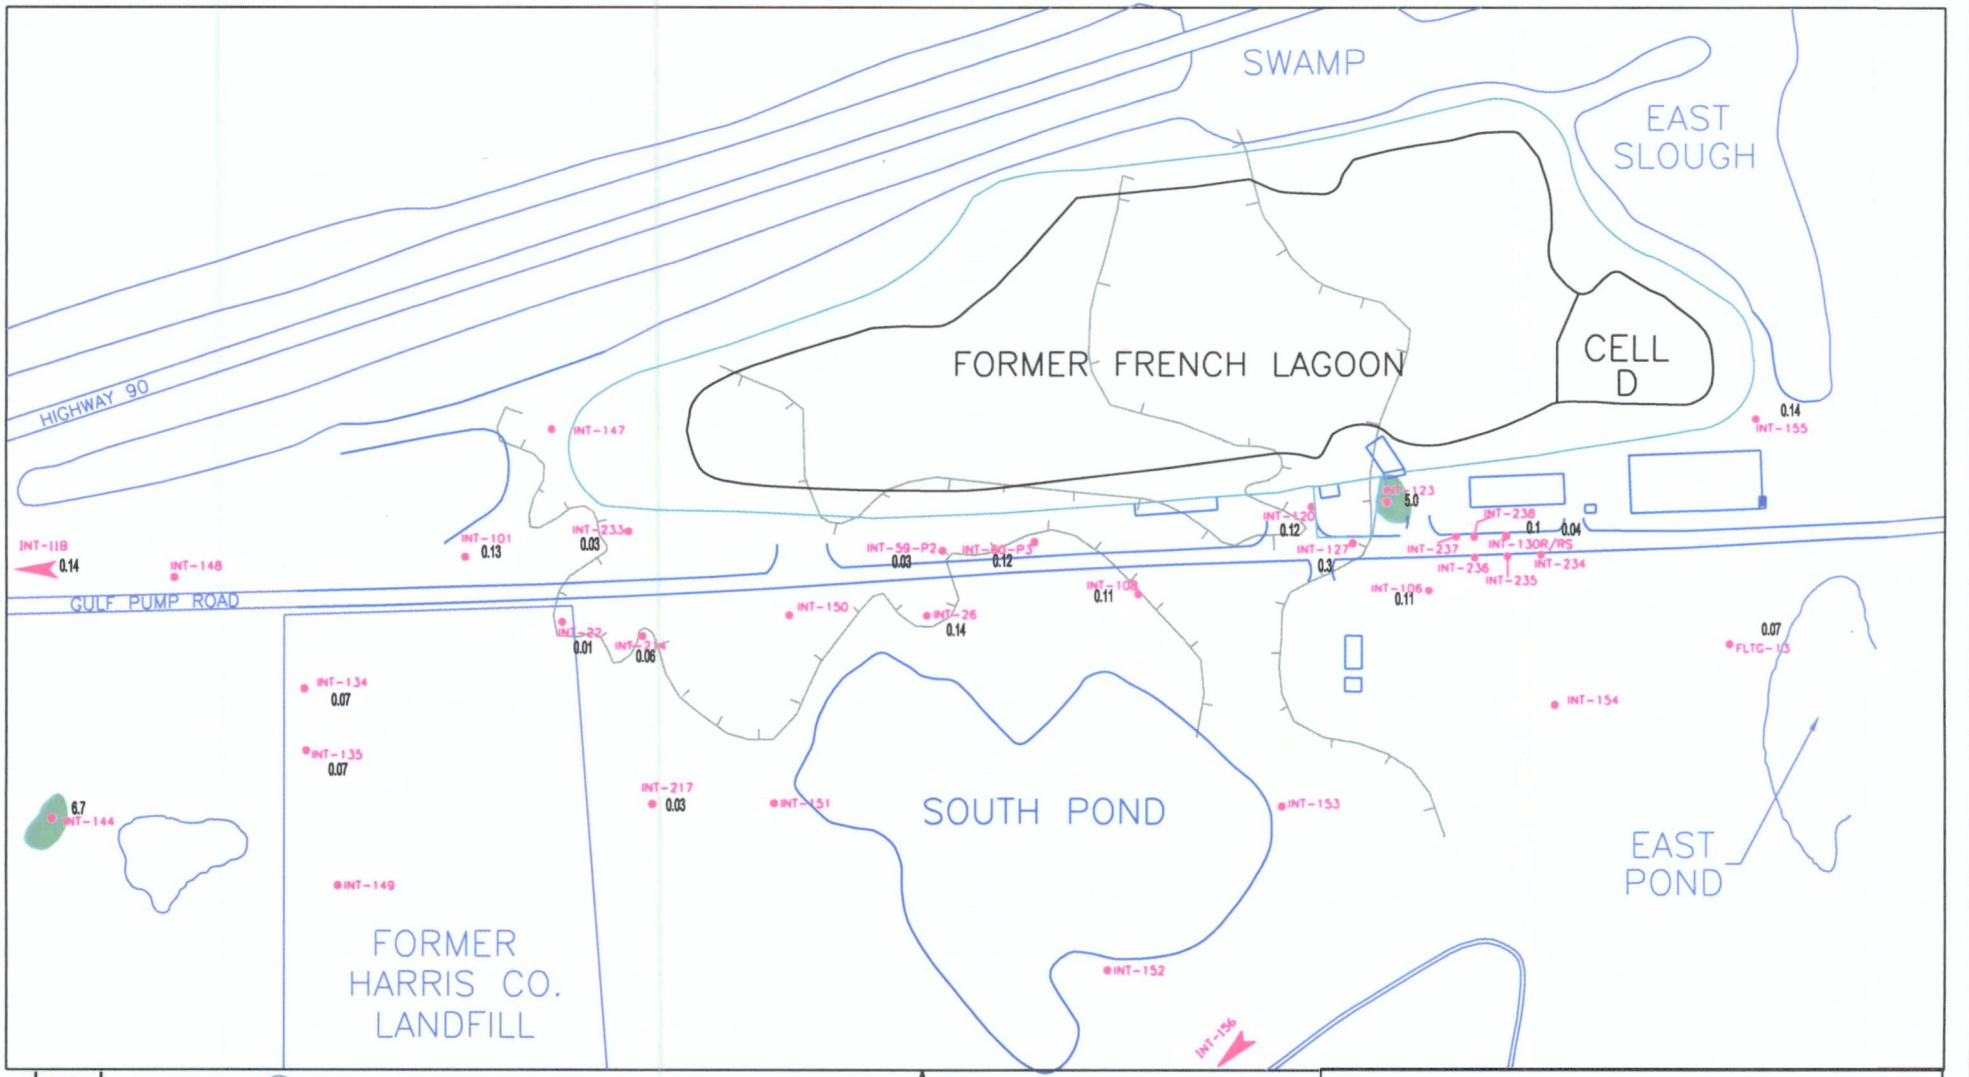

Legend

- INT-144 INT Well Designation
- S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 Dissolved Oxygen Measurement
- Dissolved Oxygen Contour (2-10 mg/L)
- Dissolved Oxygen Contour(10+ mg/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby, TX	
INT UNIT DISSOLVED OXYGEN July 2000	Figure 2-9 FRENCHQM.DWG (7/00 rev.)

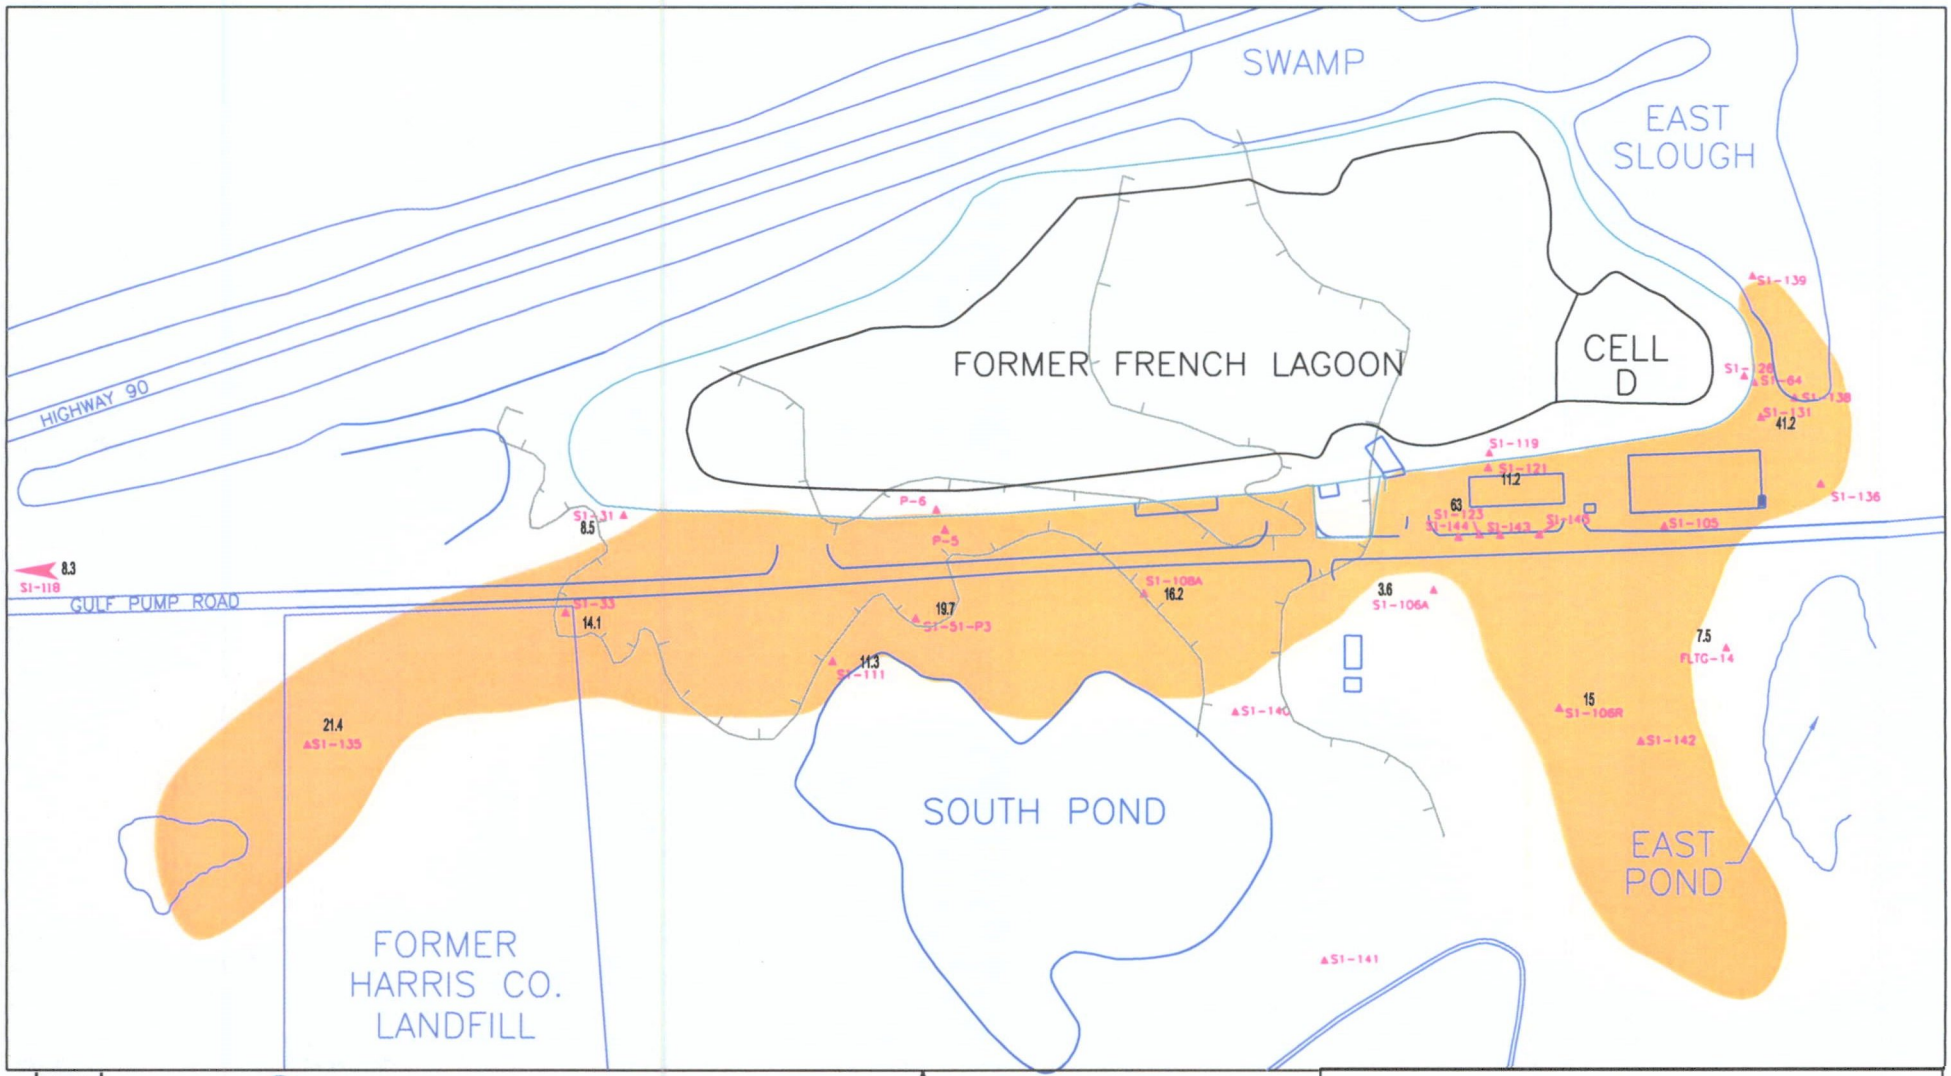

Legend

INT Well Designation
S1-135 S1 Well Designation
Surface Water Guage
C1 Layer Absent

Sheet Pile Wall
<1 Total Organic Carbon Measurement
Total Organic Carbon Contour (10-100 mg/L)
Total Organic Carbon Contour(100+ mg/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby,TX

S1 UNIT
TOTAL ORGANIC CARBON
July 2000

Figure 2-10

FRENCHQM.DWG (7/00 rev.)

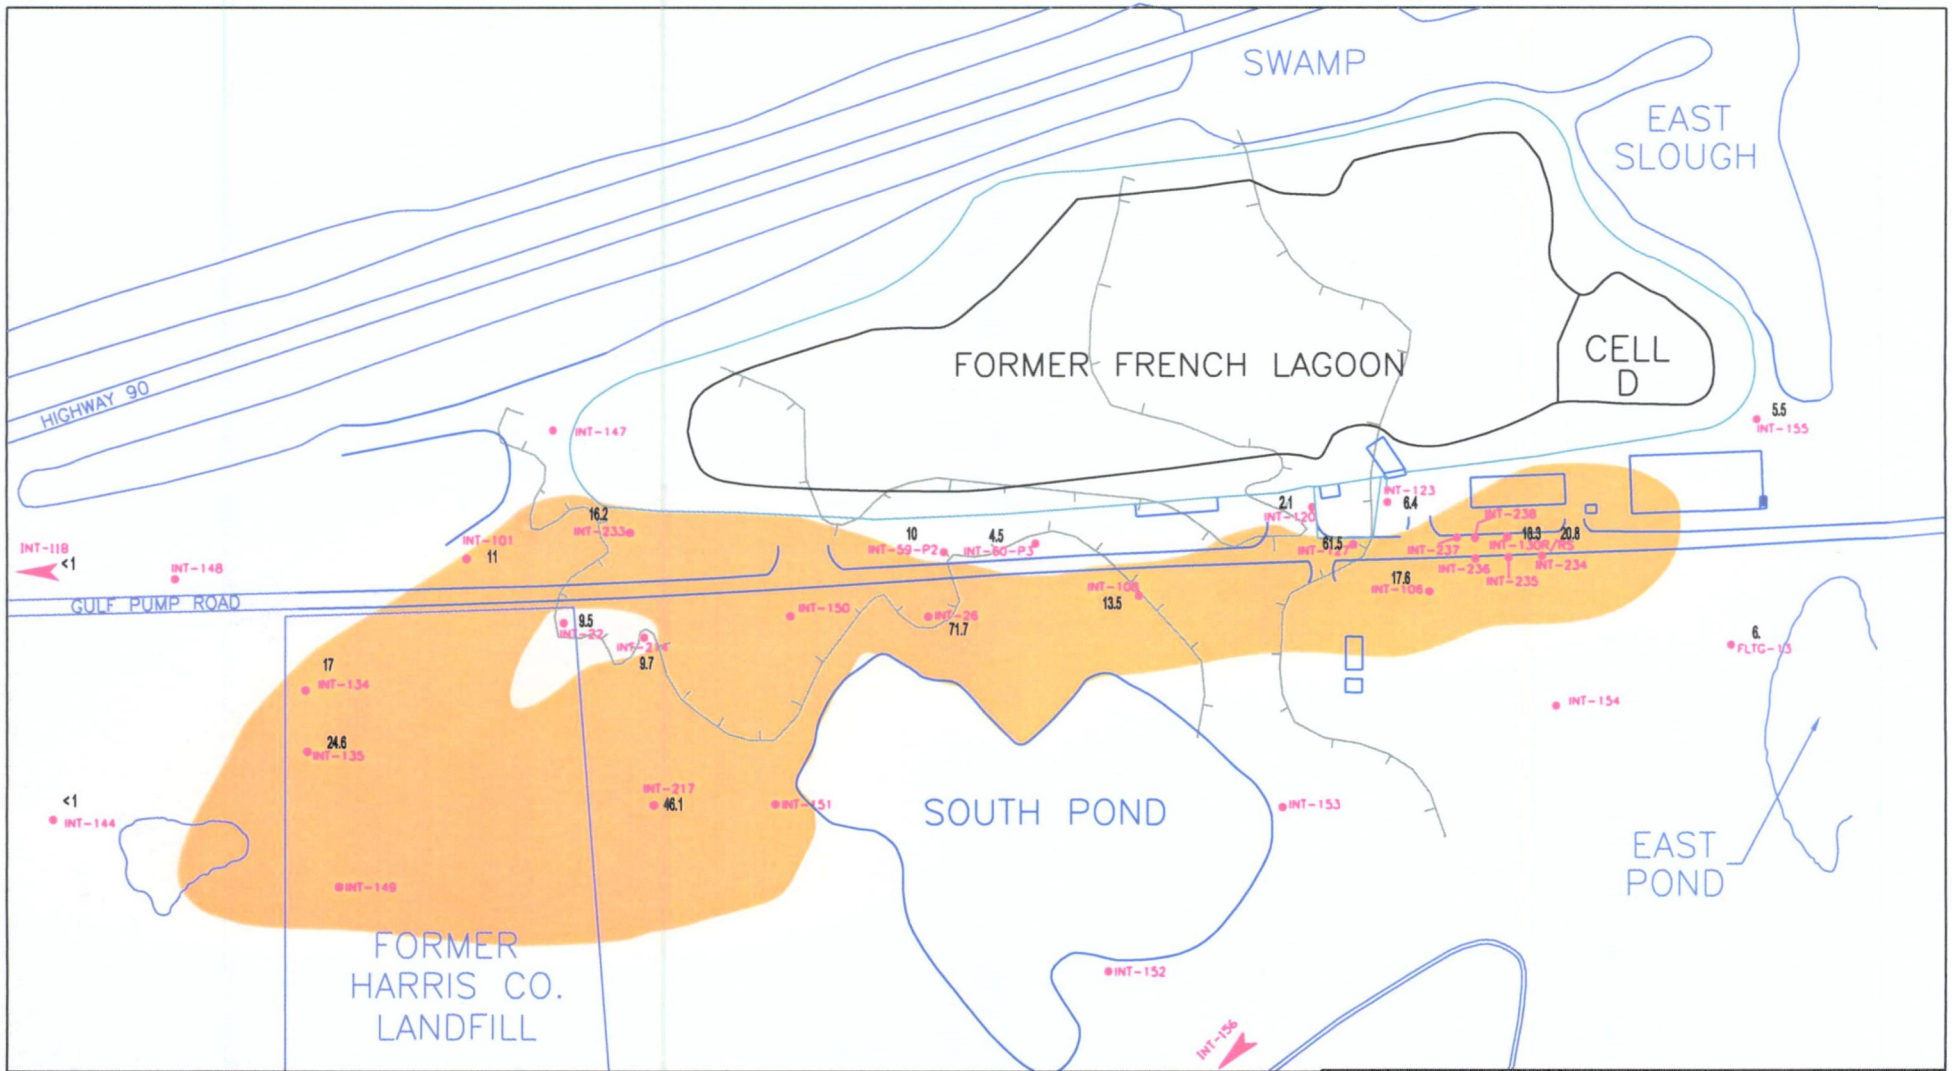

Legend

- INT-144 INT Well Designation
- S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- <1 Total Organic Carbon Measurement
- Total Organic Carbon Contour (10-100 mg/L)
- Total Organic Carbon Contour(100+ mg/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby,TX	
INT UNIT TOTAL ORGANIC CARBON July 2000	Figure 2-11 FRENCHQM.DWG (7/00 rev.)

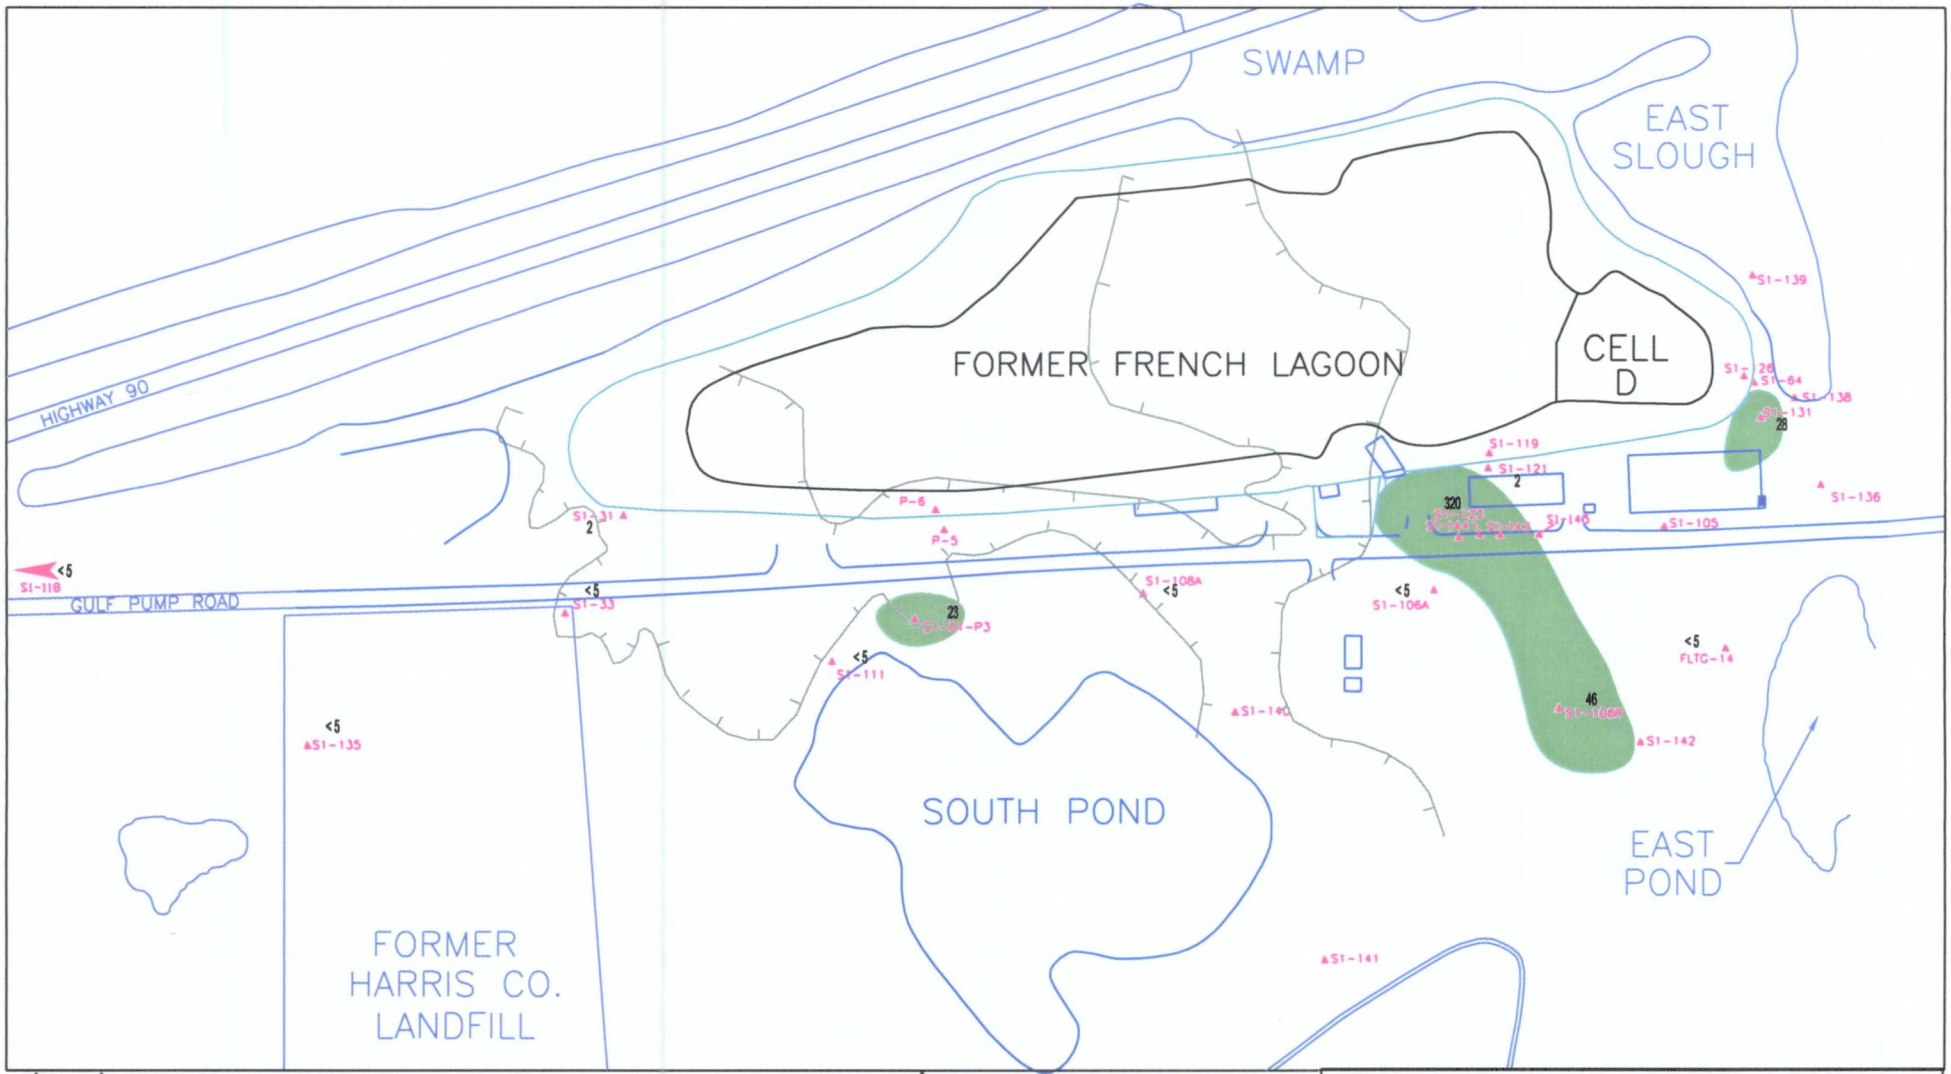

Legend

- INT Well Designation
- S1-135 S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 Benzene Measurement (ug/L)
- Benzene Contour (5+ ug/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby, TX	
S1 UNIT BENZENE July 2000	Figure 2-12 FRENCHQM.DWG (7/00 rev.)

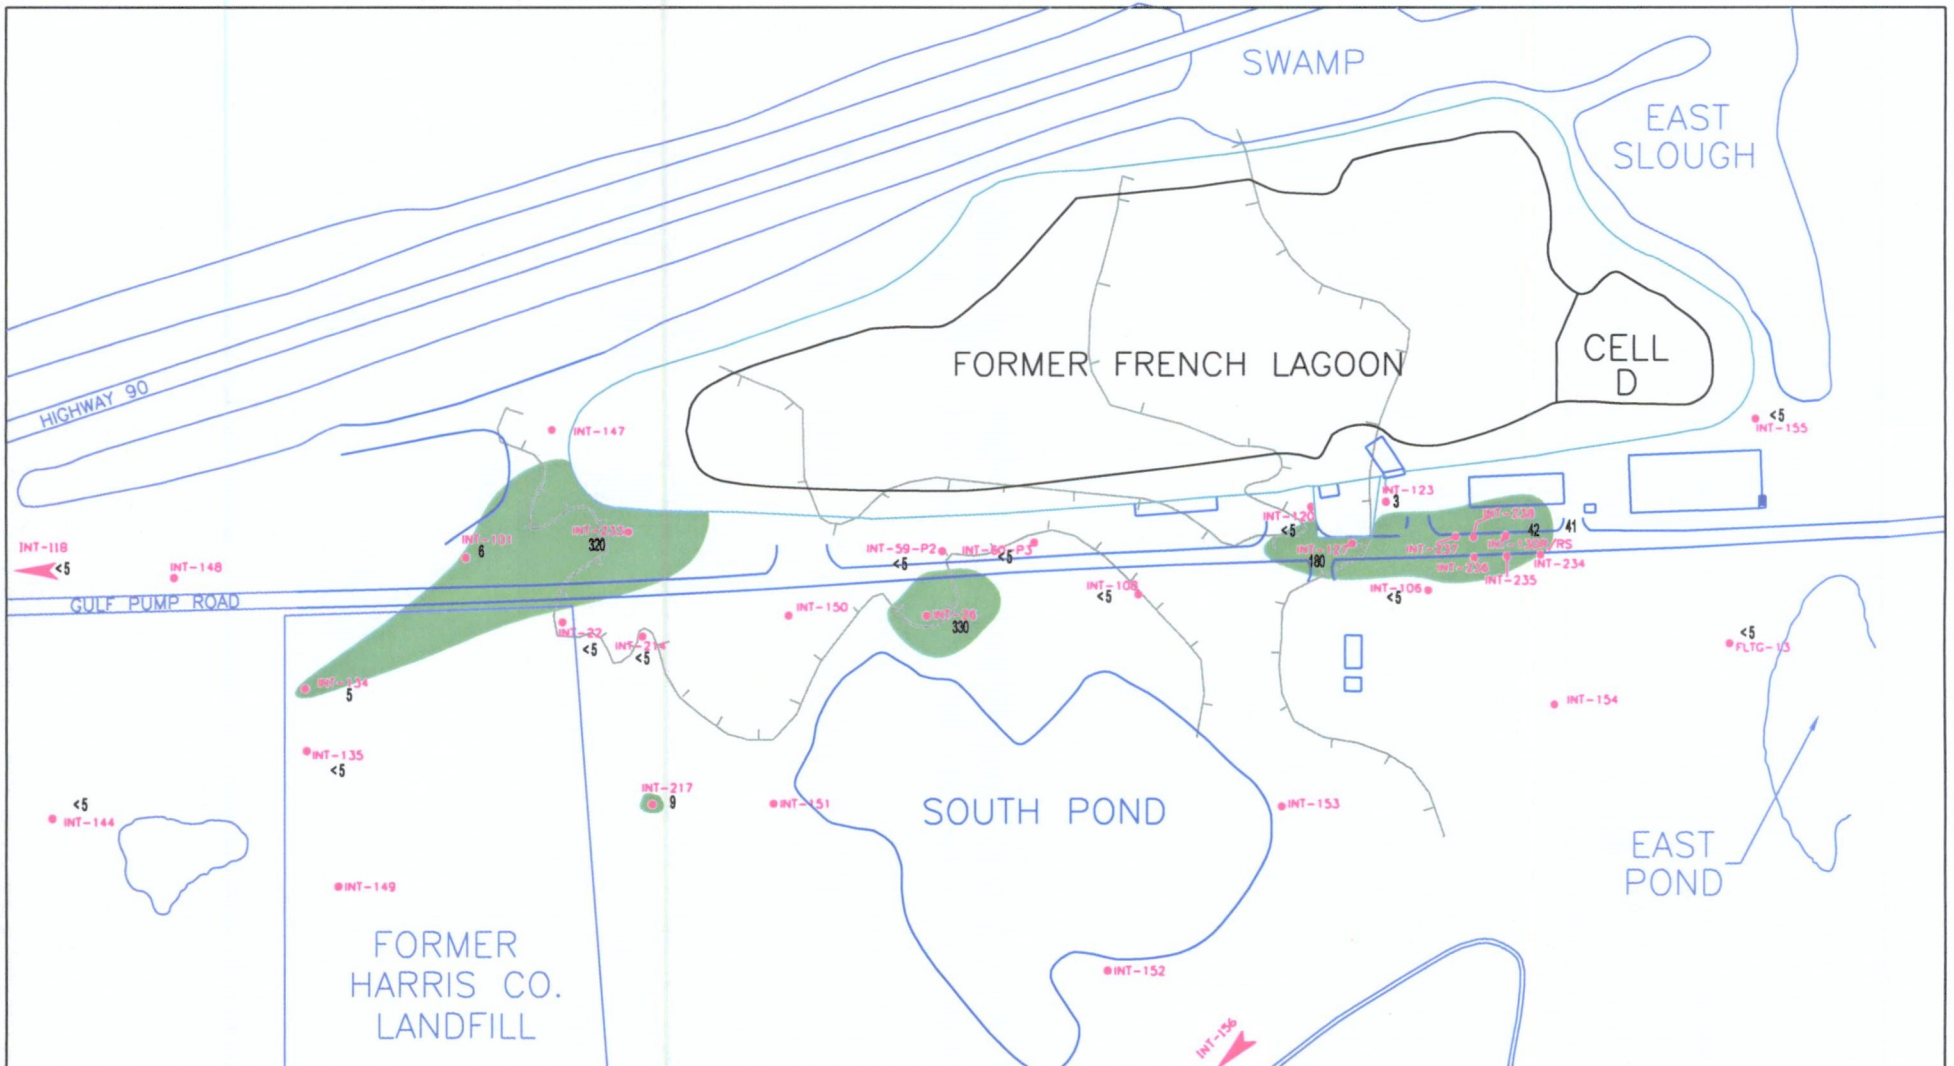

Legend

- INT-144 INT Well Designation
- S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 Benzene Measurement (ug/L)
- Benzene Contour (5+ ug/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby, TX	
INT UNIT BENZENE July 2000	Figure 2-13 FRENCHQM.DWG (7/00 rev.)

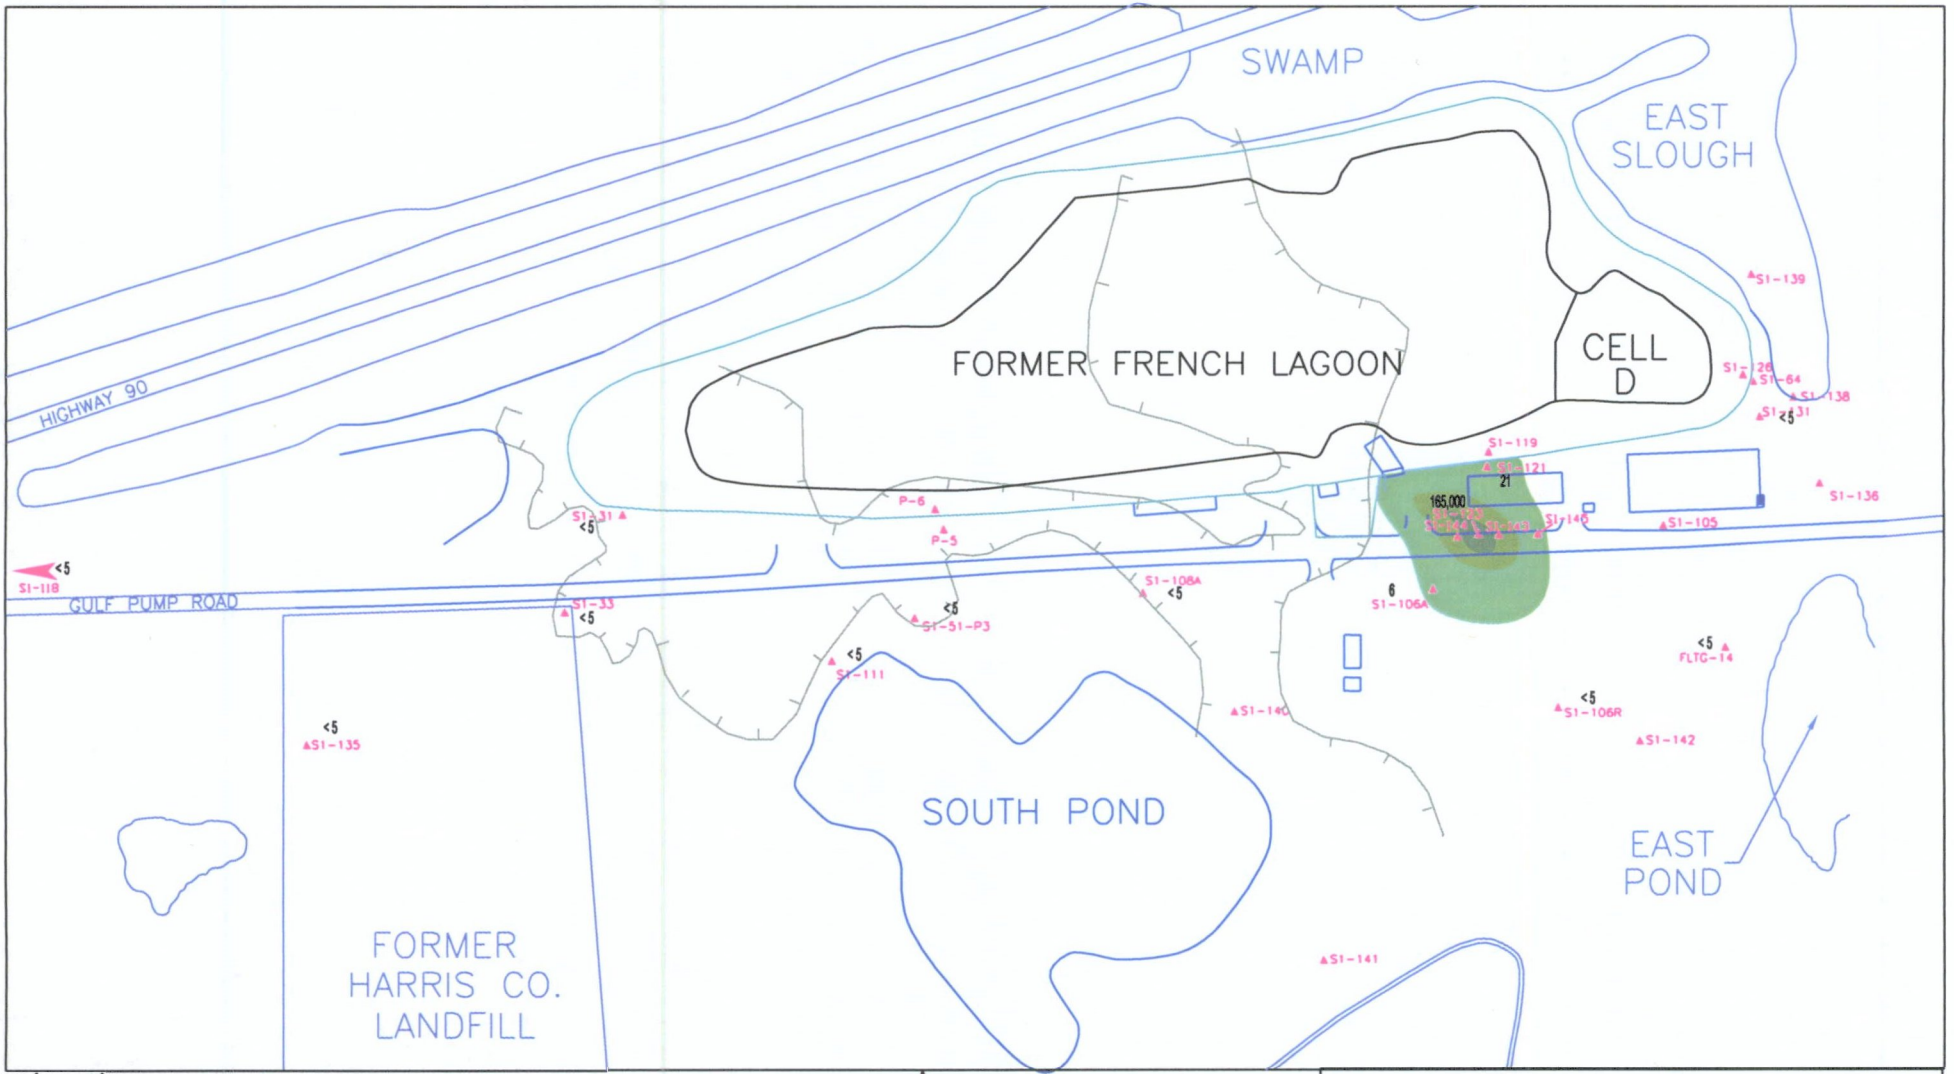

Legend

- INT Well Designation
- S1-135 S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 1,2-Dichloroethane Measurement (ug/L)
- 1,2-Dichloroethane Contour (5-1000 ug/L)
- 1,2-Dichloroethane Contour (1000 - 10000 ug/L)
- 1,2-Dichloroethane Contour (10000+ ug/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby,TX	
S1 UNIT 1,2-DICHLOROETHANE July 2000	Figure 2-14 FRENCHQM.DWG (7/00 rev.)

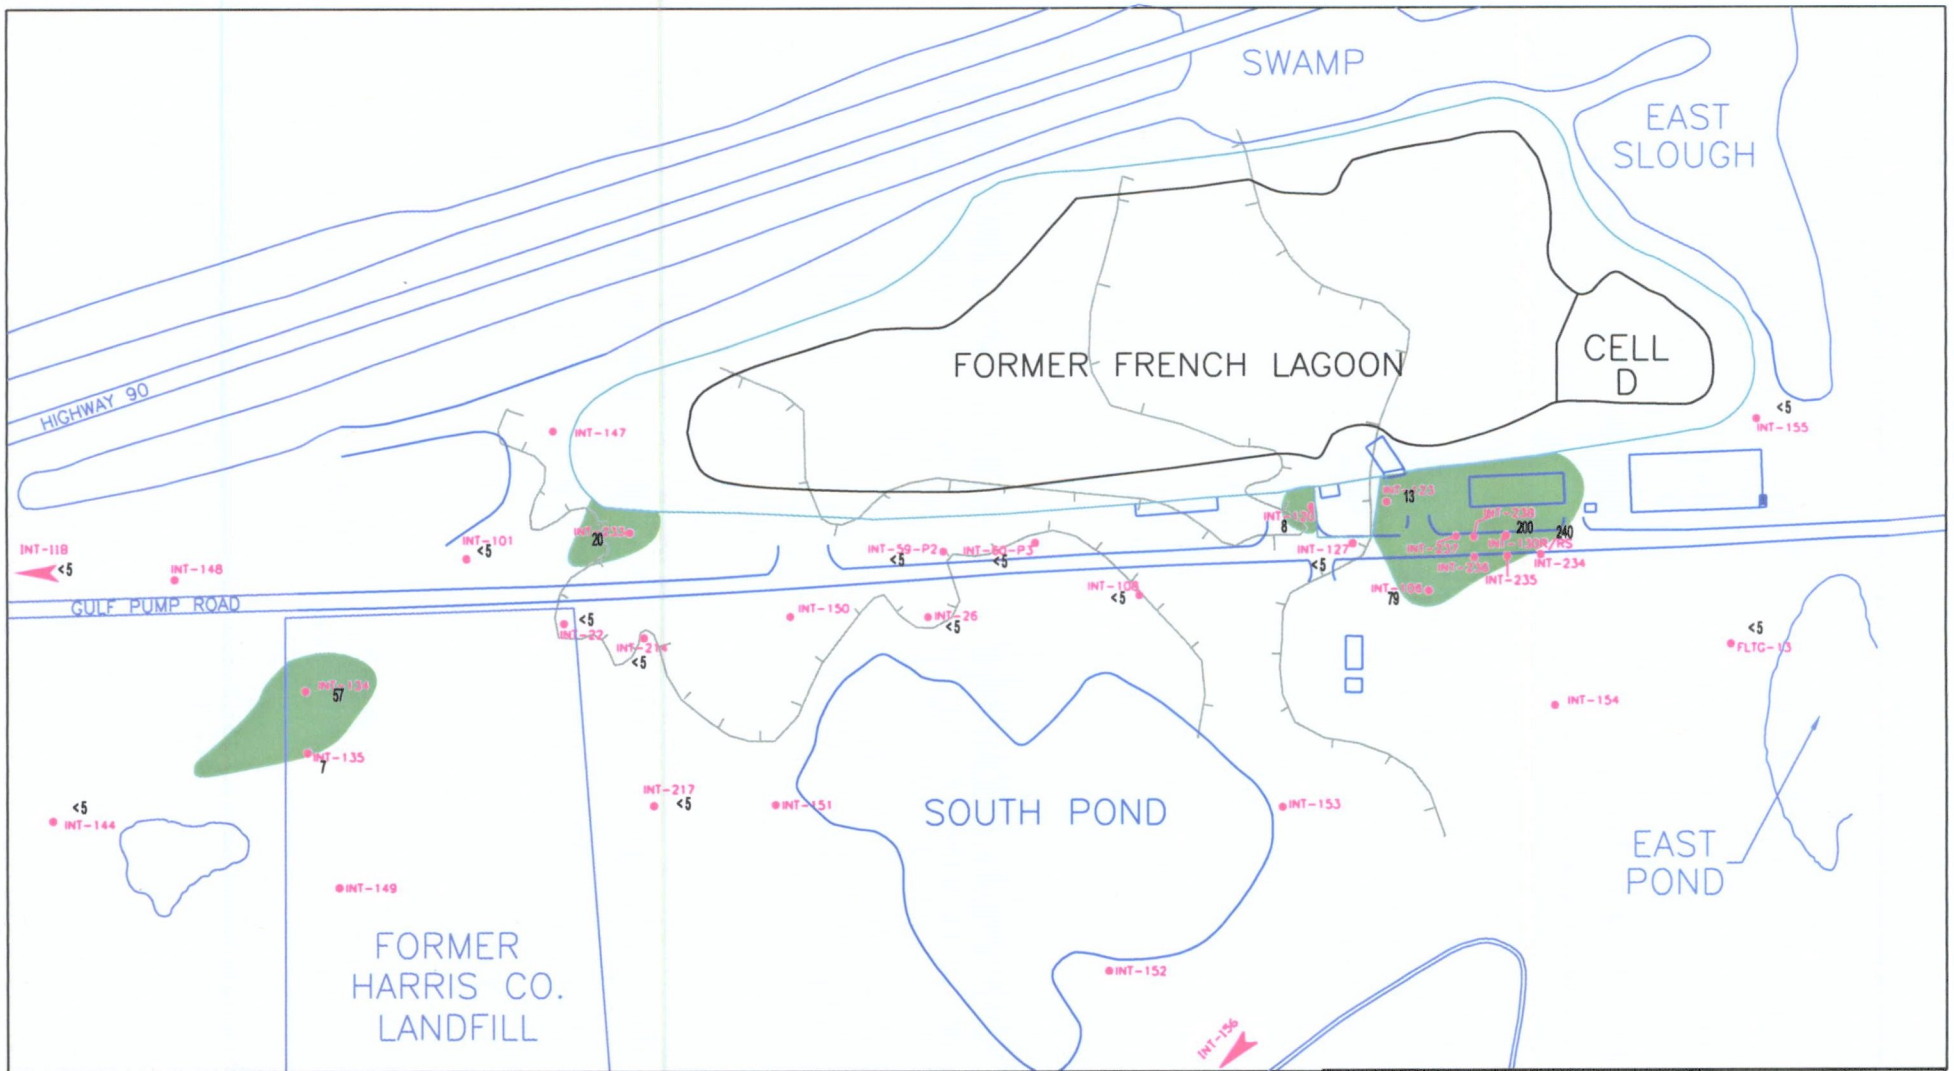

Legend

- INT-144 INT Well Designation
- S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 1,2-Dichloroethane Measurement (ug/L)
- 1,2-Dichloroethane Contour (5-1000 ug/L)
- 1,2-Dichloroethane Contour (1000 - 10000 ug/L)
- 1,2-Dichloroethane Contour (10000+ ug/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby,TX	
INT UNIT 1,2-DICHLOROETHANE July 2000	Figure 2-15 FRENCHQM.DWG (7/00 rev.)

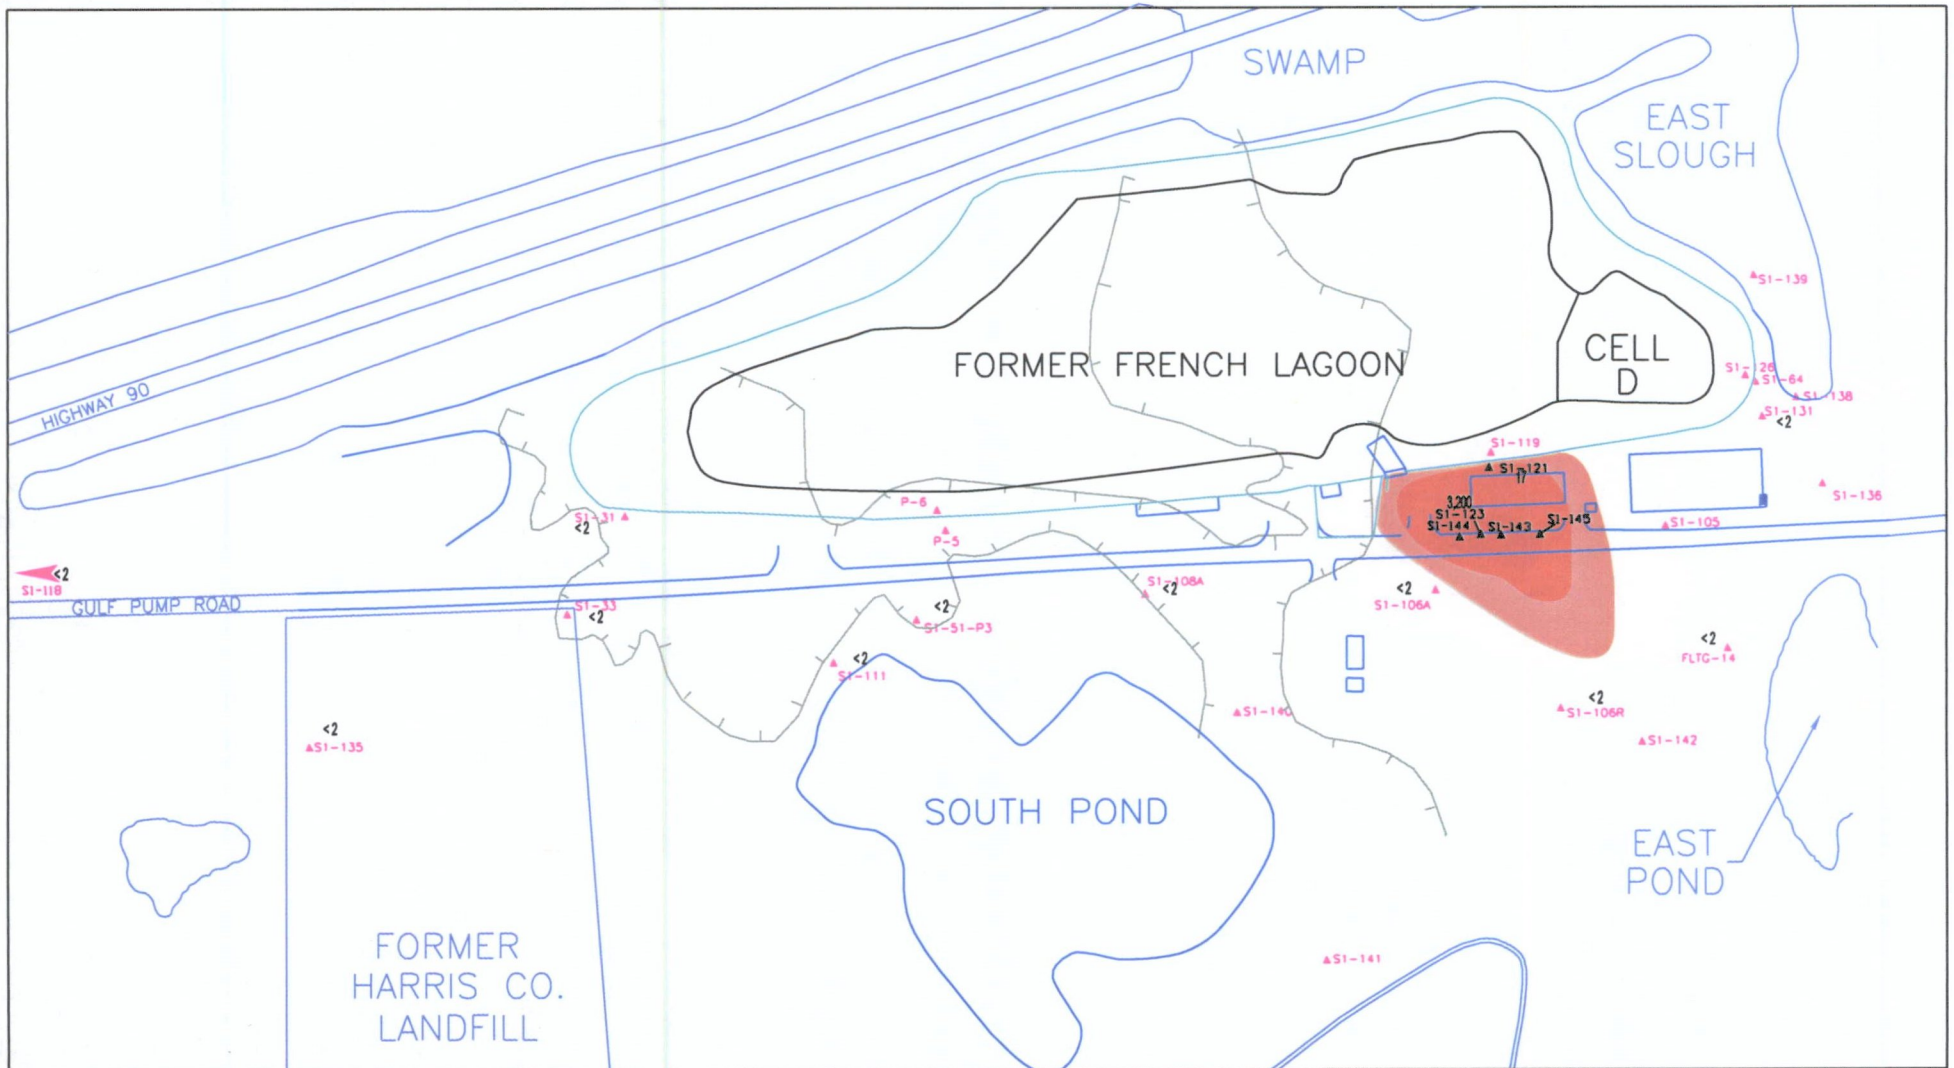

Legend

- INT Well Designation
- S1-135 S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 Vinyl Chloride Measurement (ug/L)
- Vinyl Chloride Contour (2-10 ug/L)
- Vinyl Chloride Contour (10 - 1000 ug/L)
- Vinyl Chloride Contour (1000+ ug/L)

150' 0 150'
Scale in feet

FLTG., Inc. French Limited Site Crosby,TX	
S1 UNIT VINYL CHLORIDE July 2000	Figure 2-16 FRENCHQM.DWG (7/00 rev.)

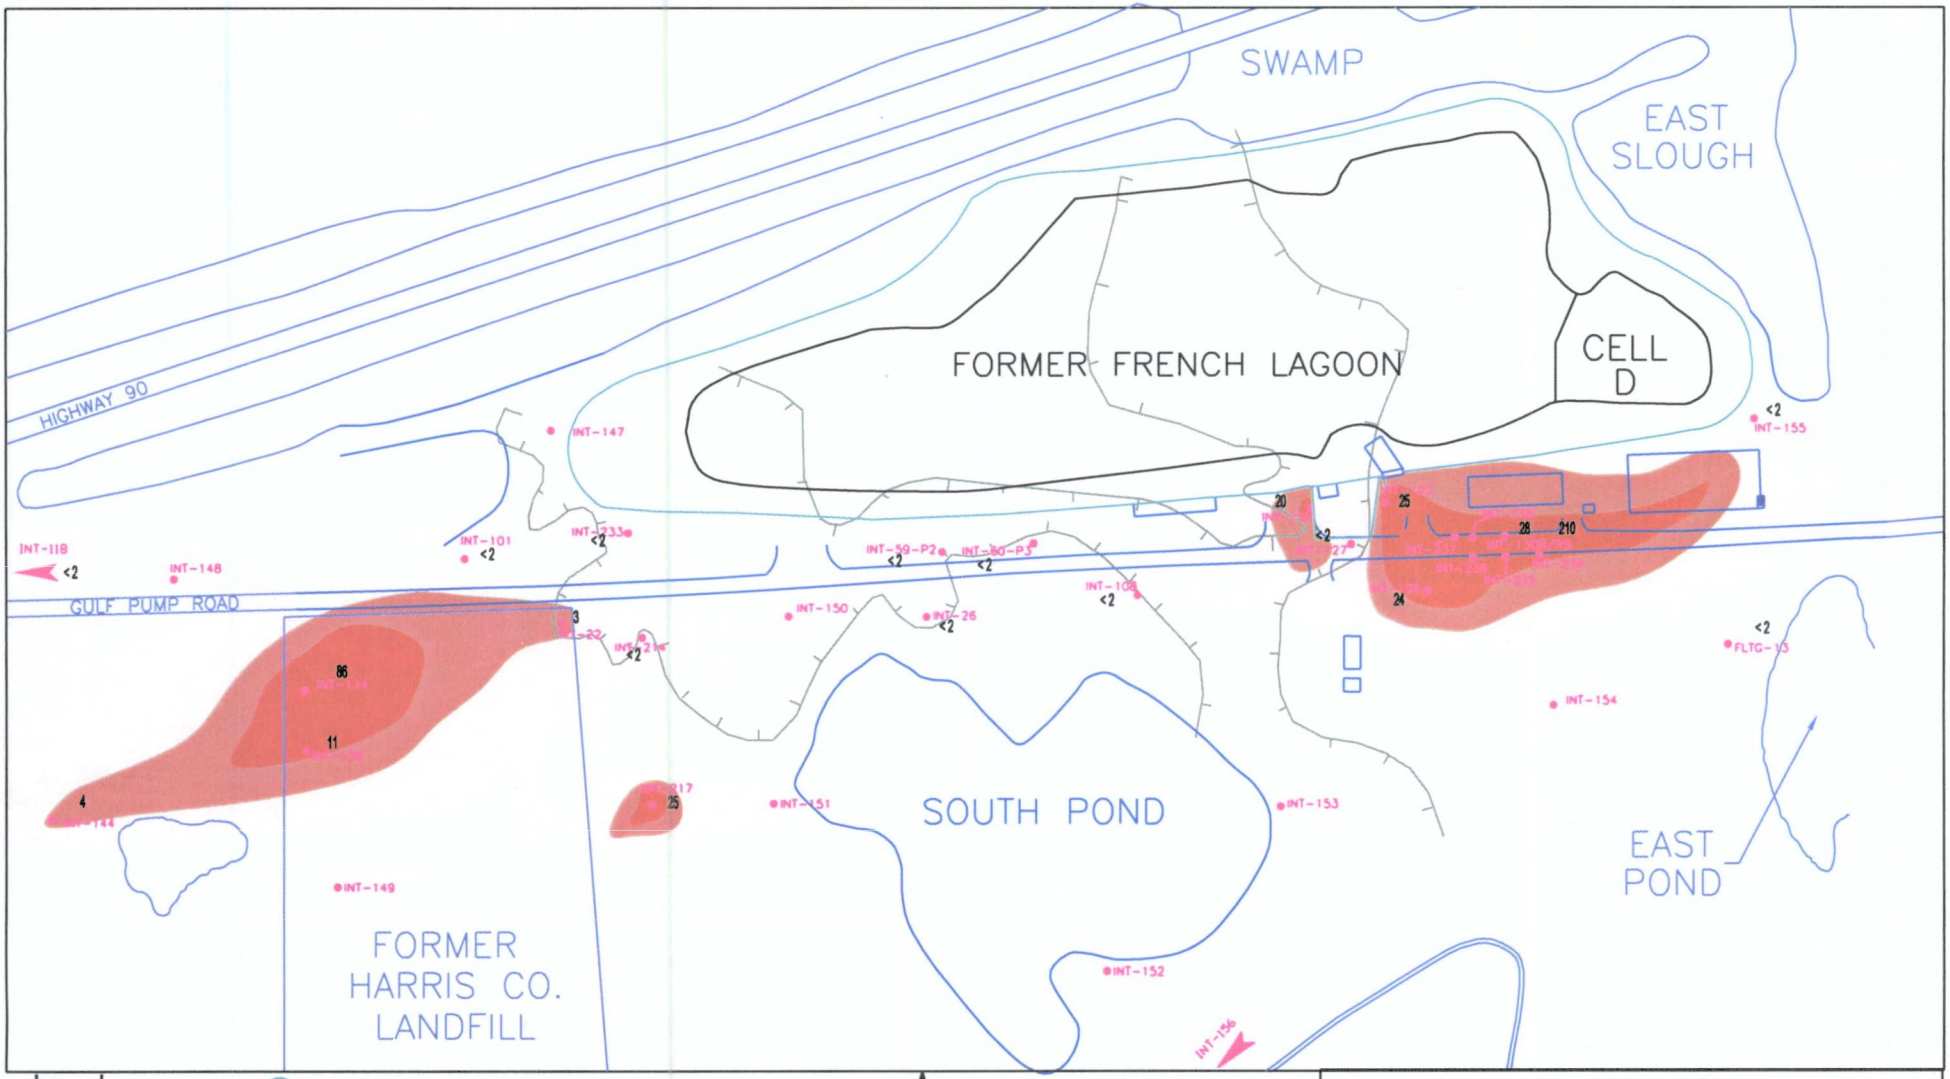

Legend

- INT-144 INT Well Designation
- S1 Well Designation
- Surface Water Guage
- C1 Layer Absent
- Sheet Pile Wall
- 2.0 Vinyl Chloride Measurement (ug/L)
- Vinyl Chloride Contour (2-10 ug/L)
- Vinyl Chloride Contour (10 - 1000 ug/L)
- Vinyl Chloride Contour (1000+ ug/L)

N

150' 0 150'

Scale in feet

FLTG., Inc. French Limited Site Crosby, TX

INT UNIT
VINYL CHLORIDE
July 2000

Figure 2-17

FRENCHQM.DWG (7/00 rev.)

Appendix D

Concentration Trend Graphs

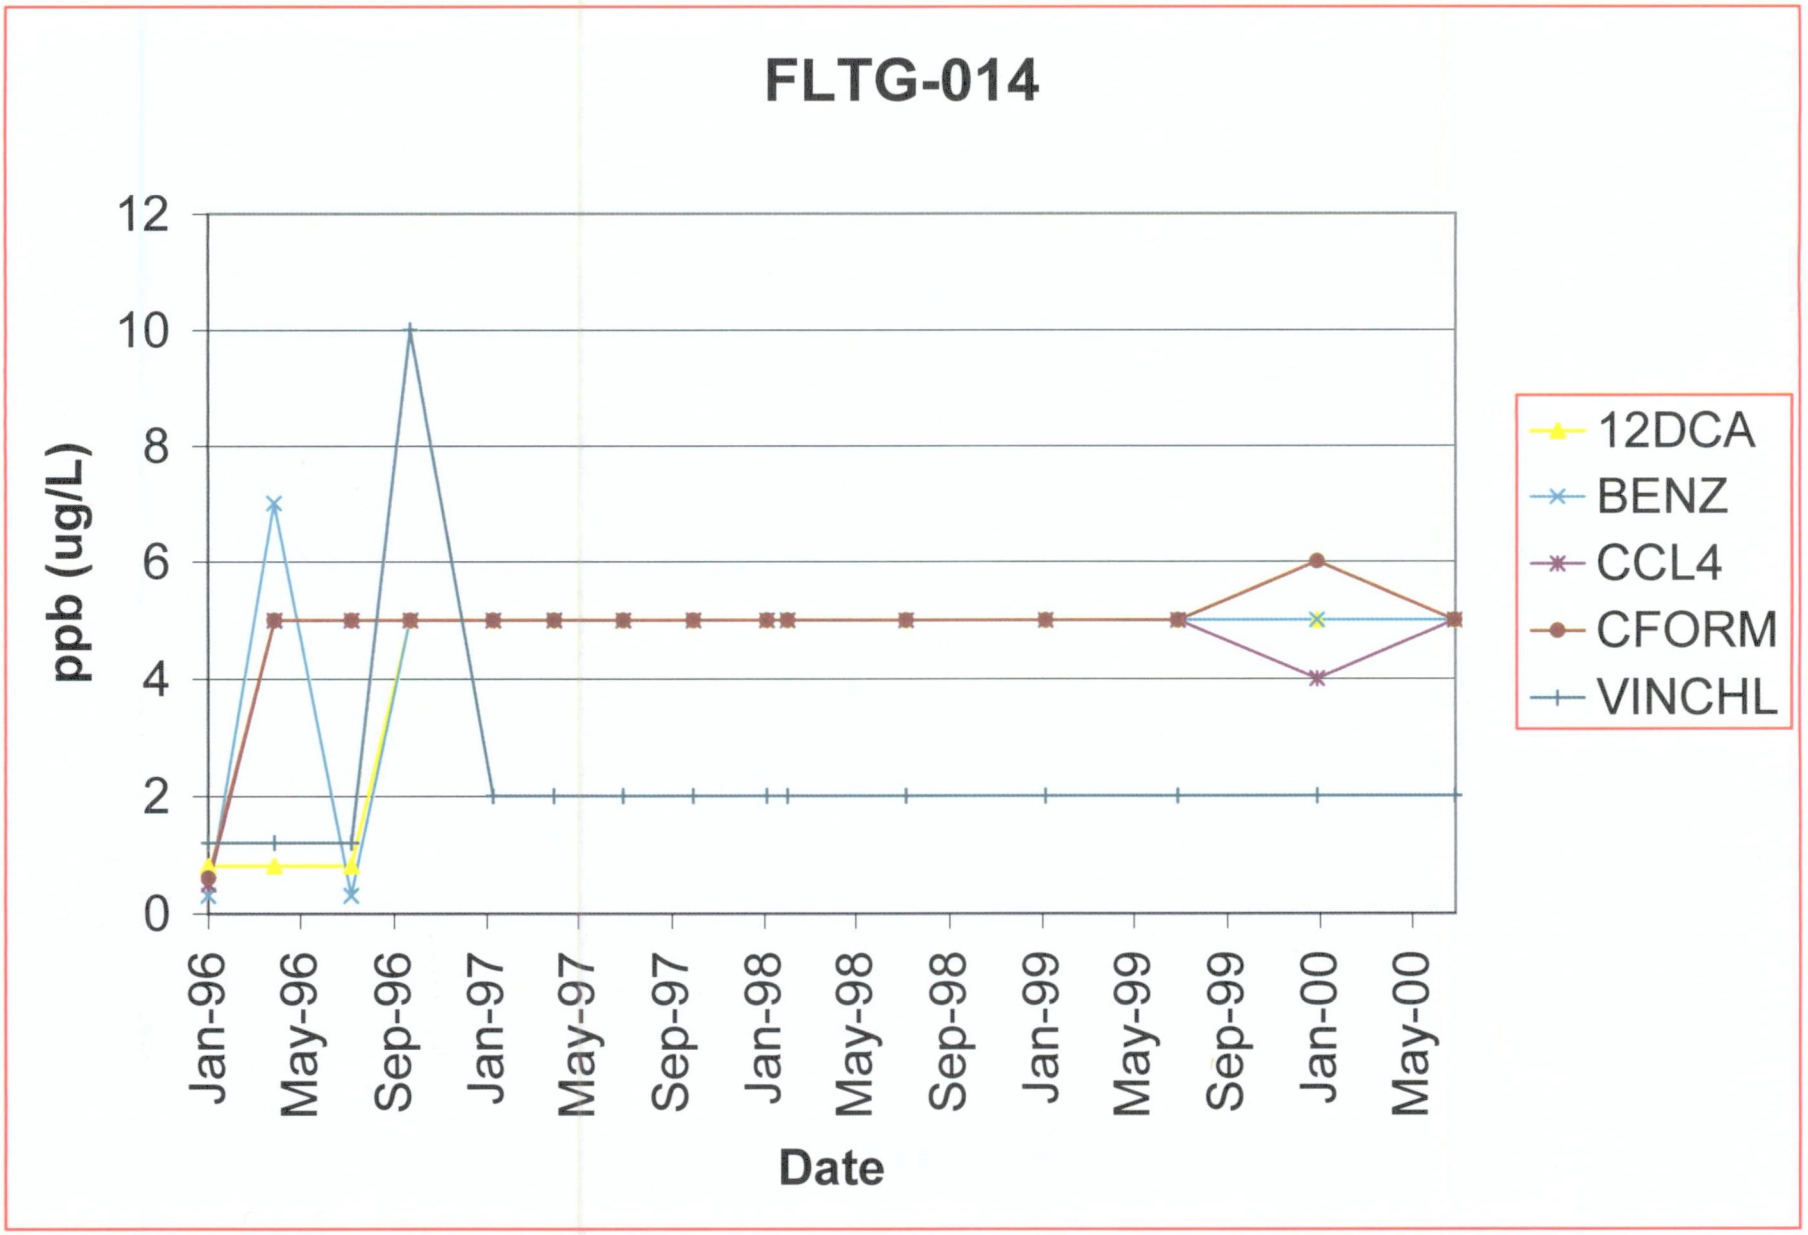
FLTG-014
ppb (ug/L)
12
10
8
6
4
2
0
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

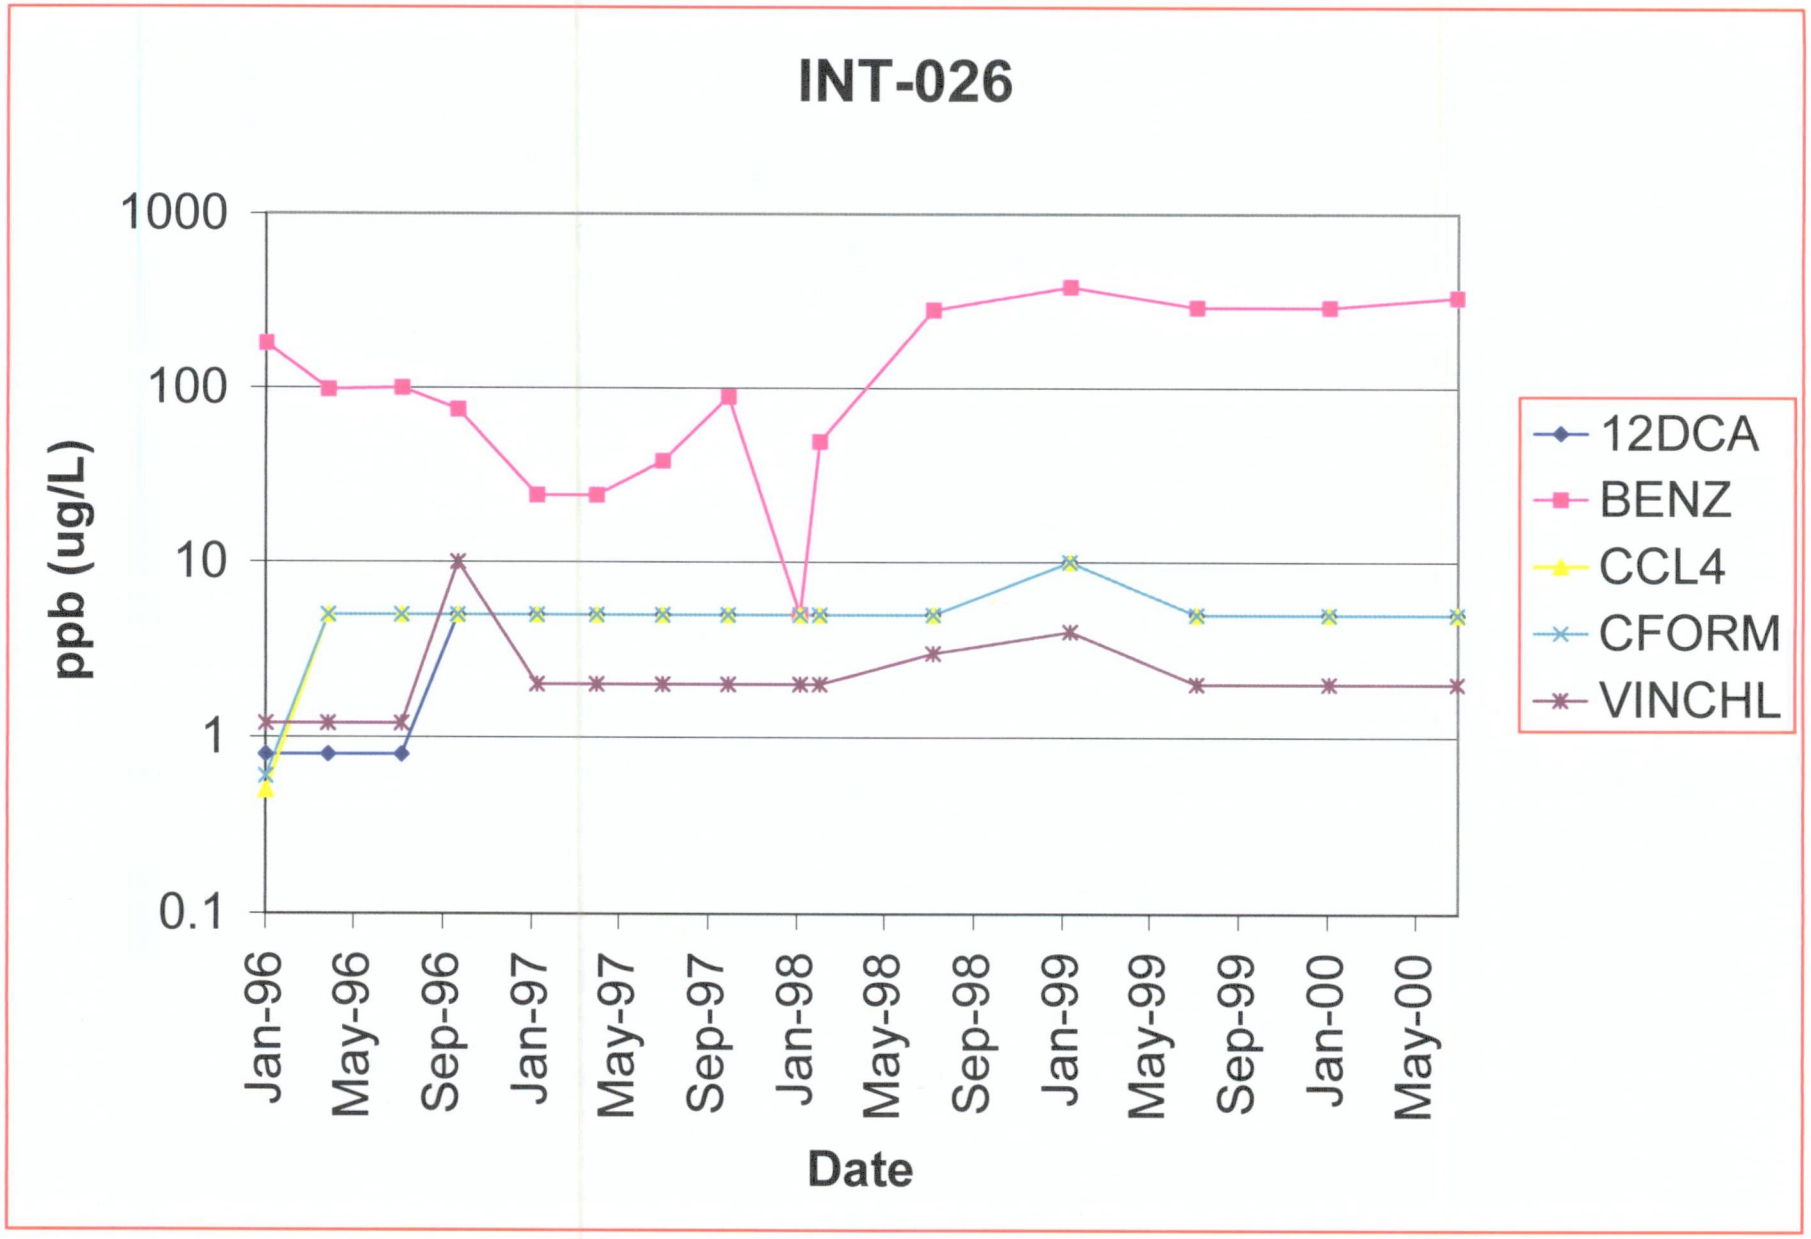
INT-026
1000
100
10
1
0.1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

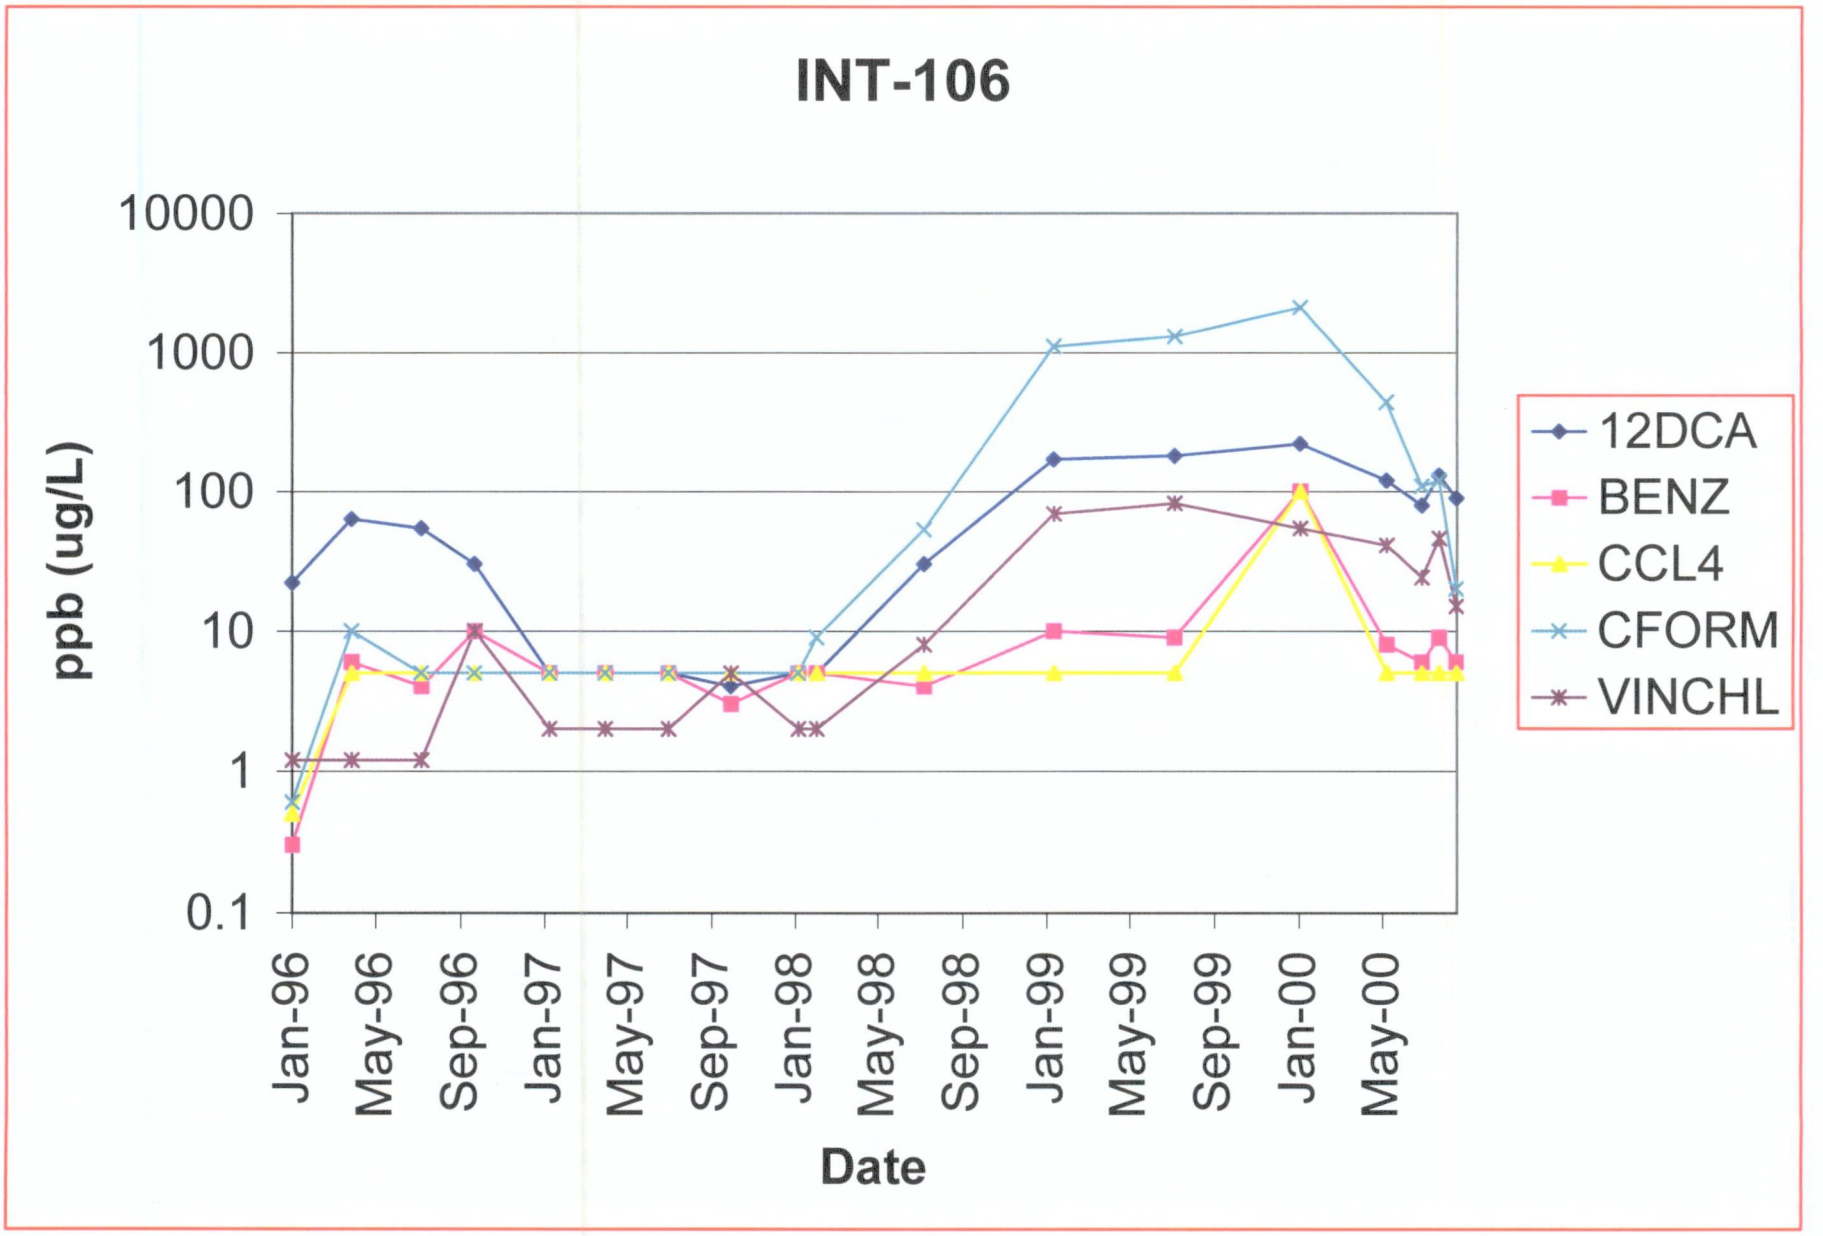
INT-106
10000
1000
100
10
1
0.1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

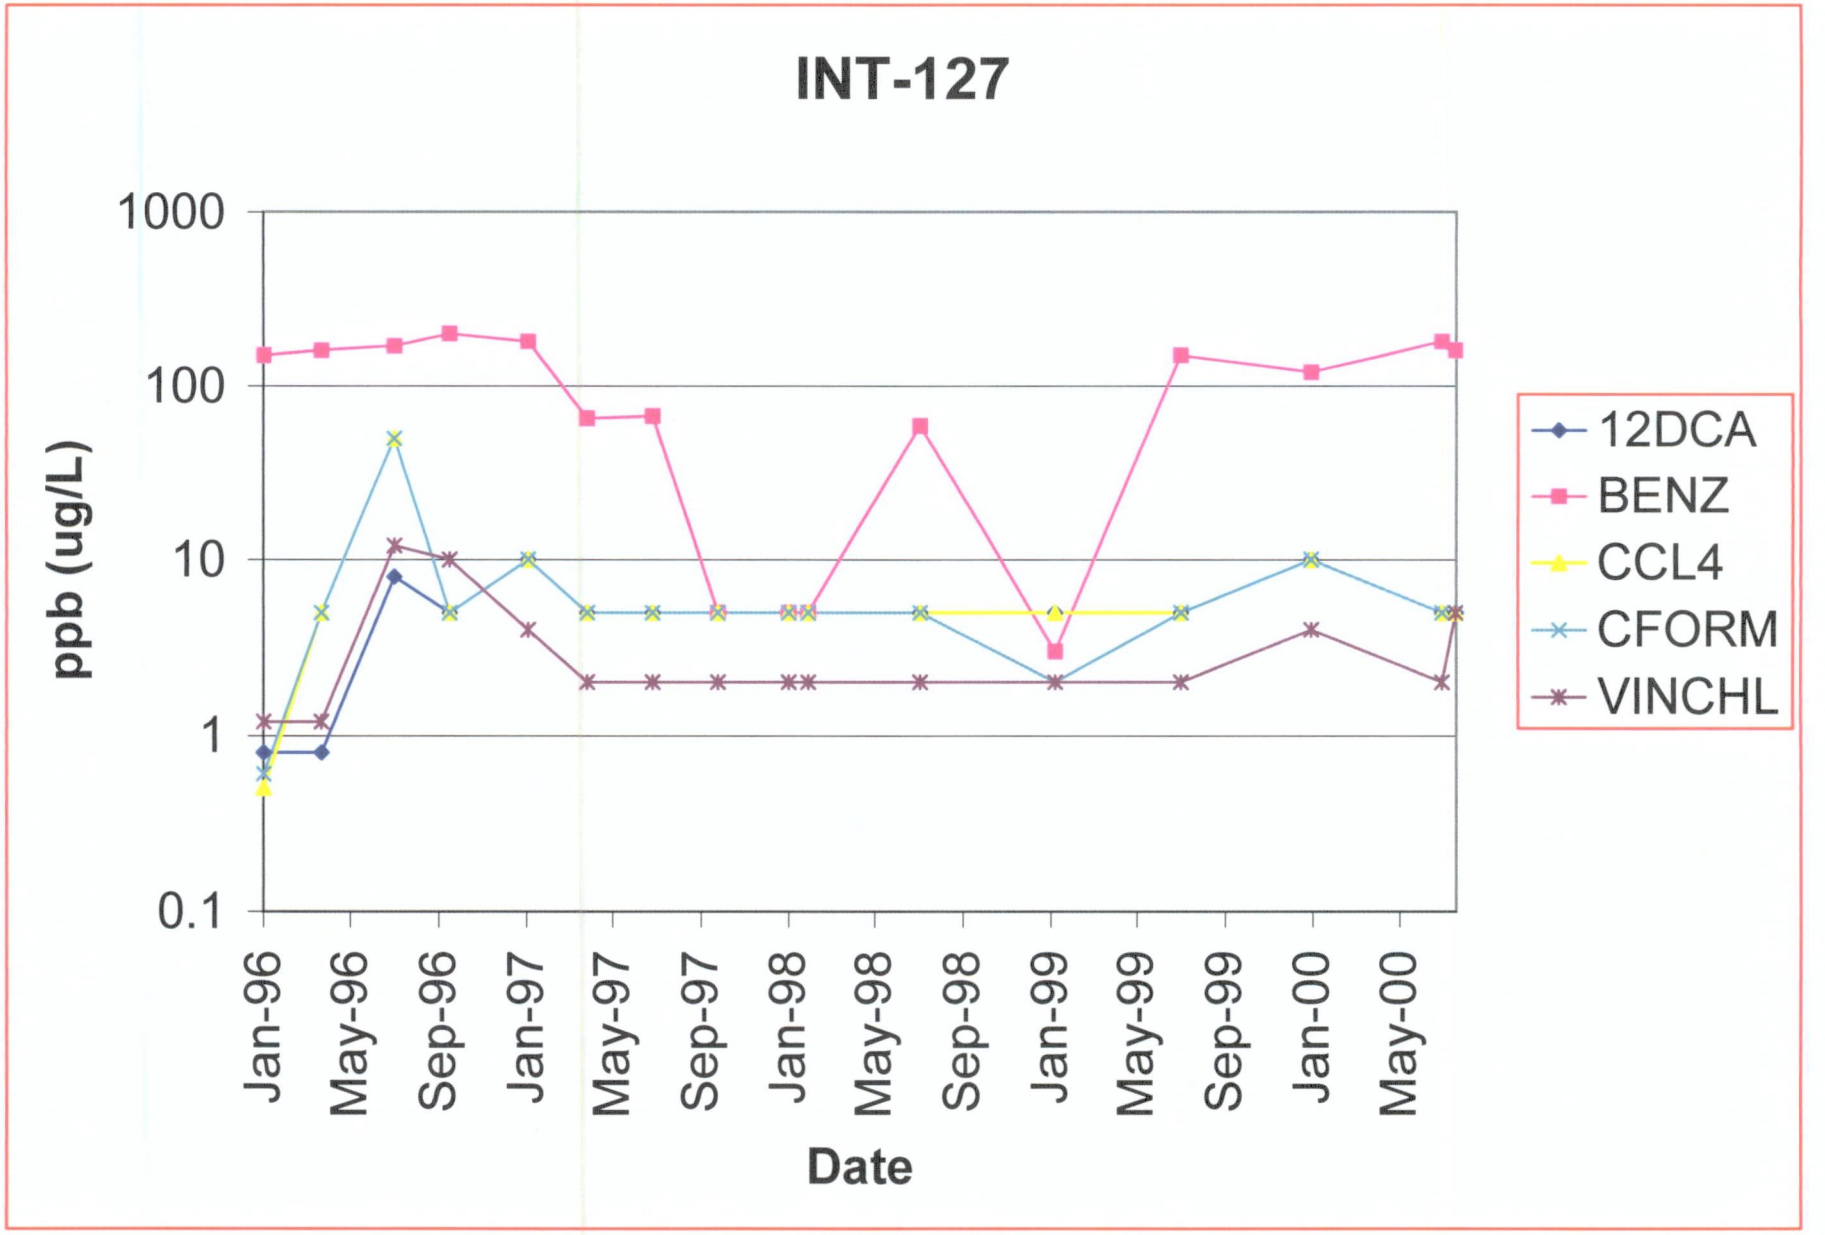
INT-127
1000
100
10
1
0.1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

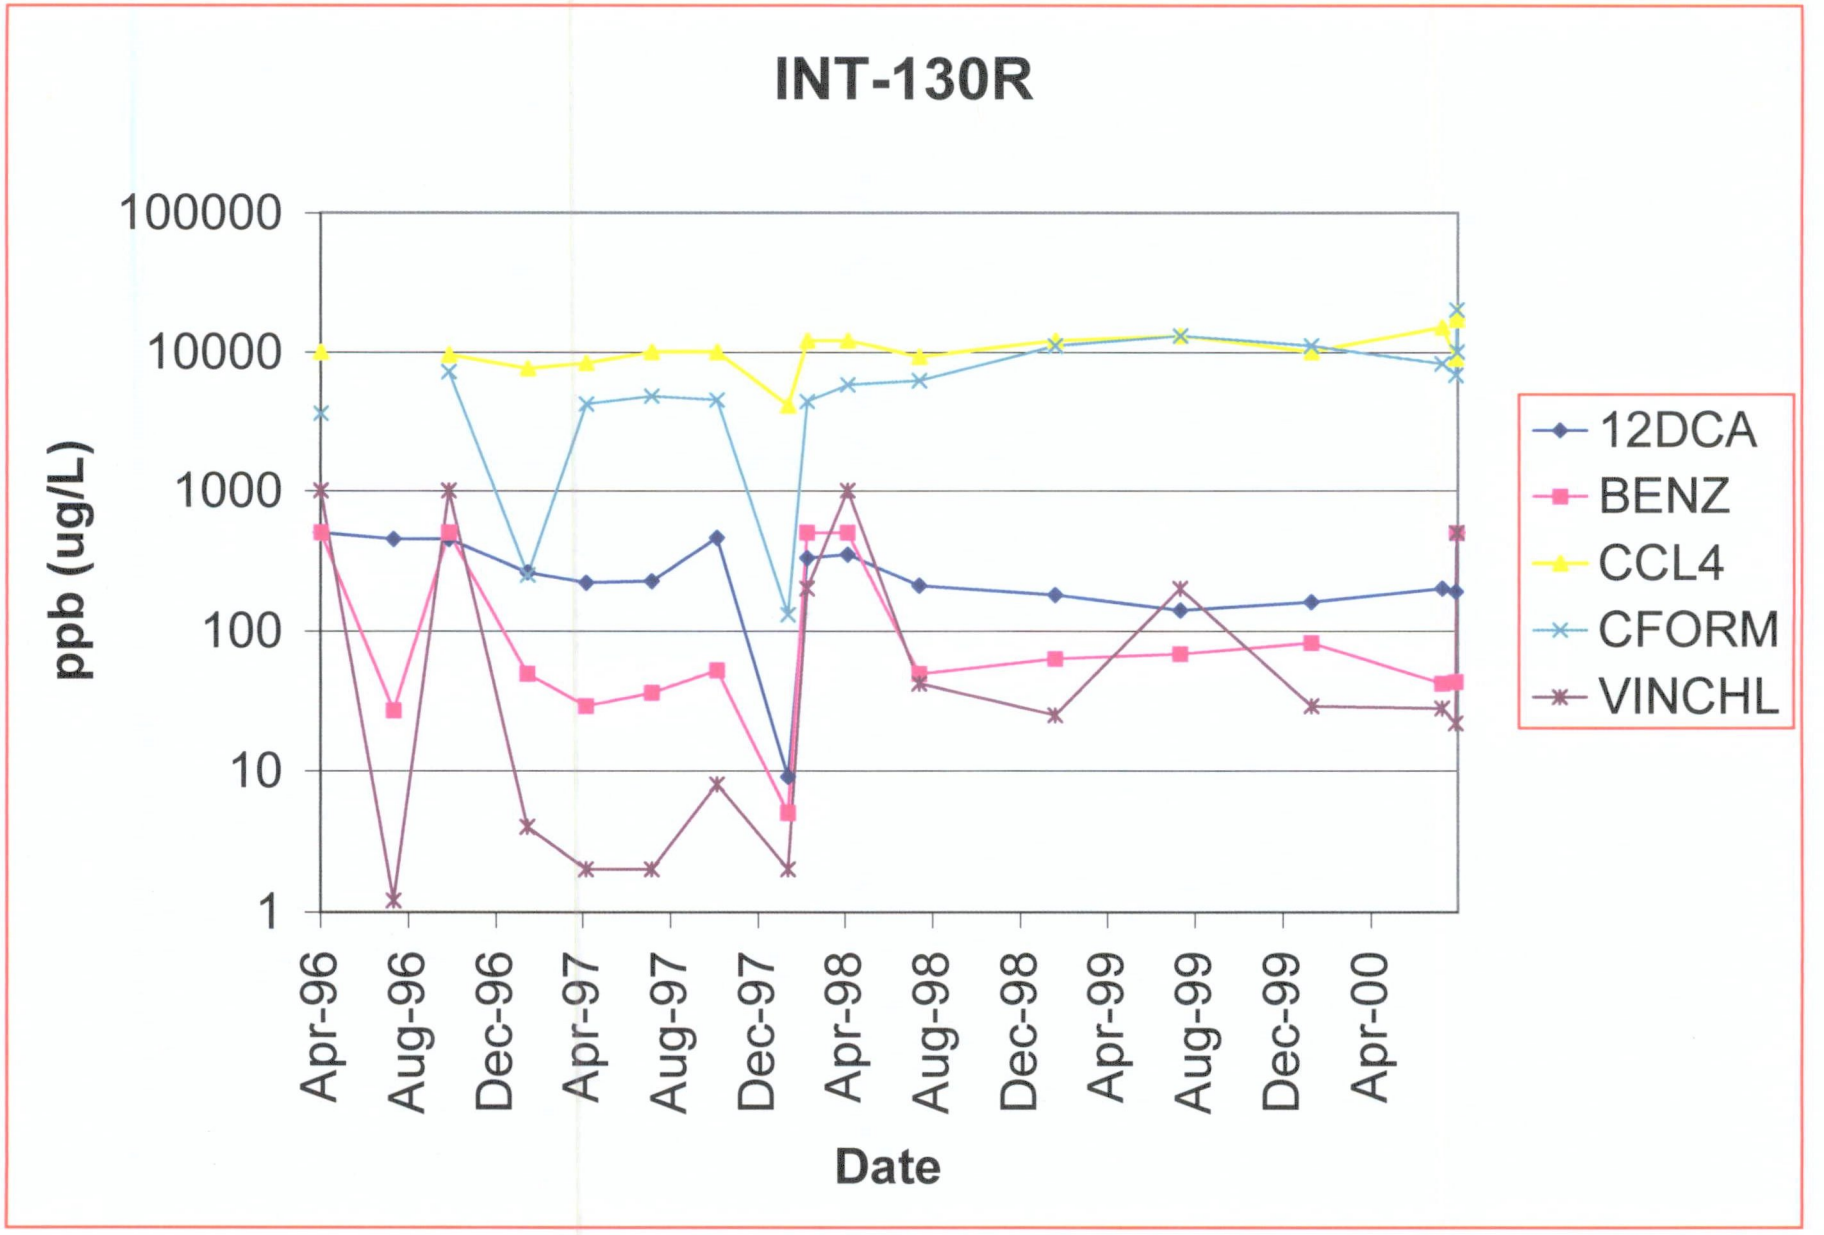
INT-130R
100000
10000
1000
100
10
1
ppb (ug/L)
Apr-96
Aug-96
Dec-96
Apr-97
Aug-97
Dec-97
Apr-98
Aug-98
Dec-98
Apr-99
Aug-99
Dec-99
Apr-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

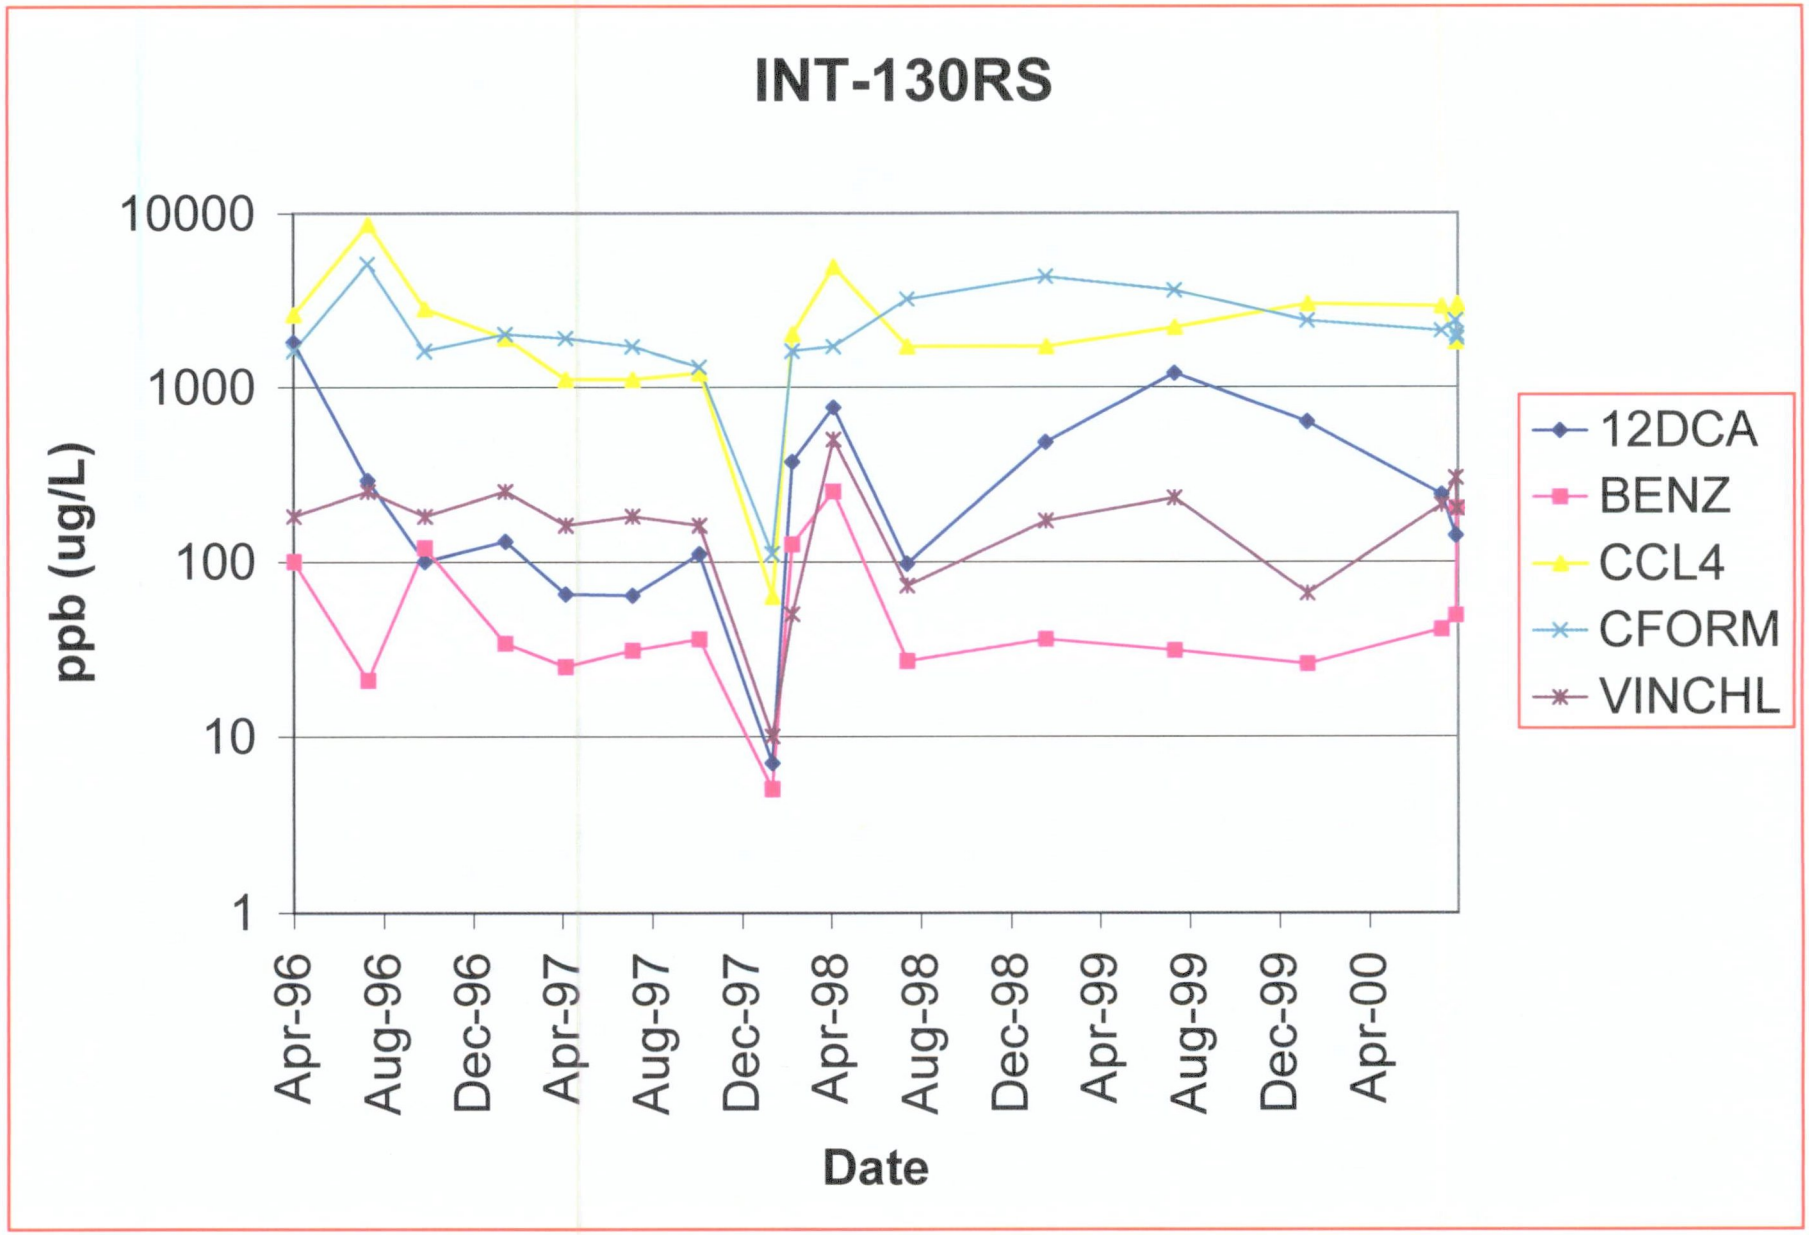
INT-130RS
10000
1000
100
10
1
ppb (ug/L)
Apr-96
Aug-96
Dec-96
Apr-97
Aug-97
Dec-97
Apr-98
Aug-98
Dec-98
Apr-99
Aug-99
Dec-99
Apr-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

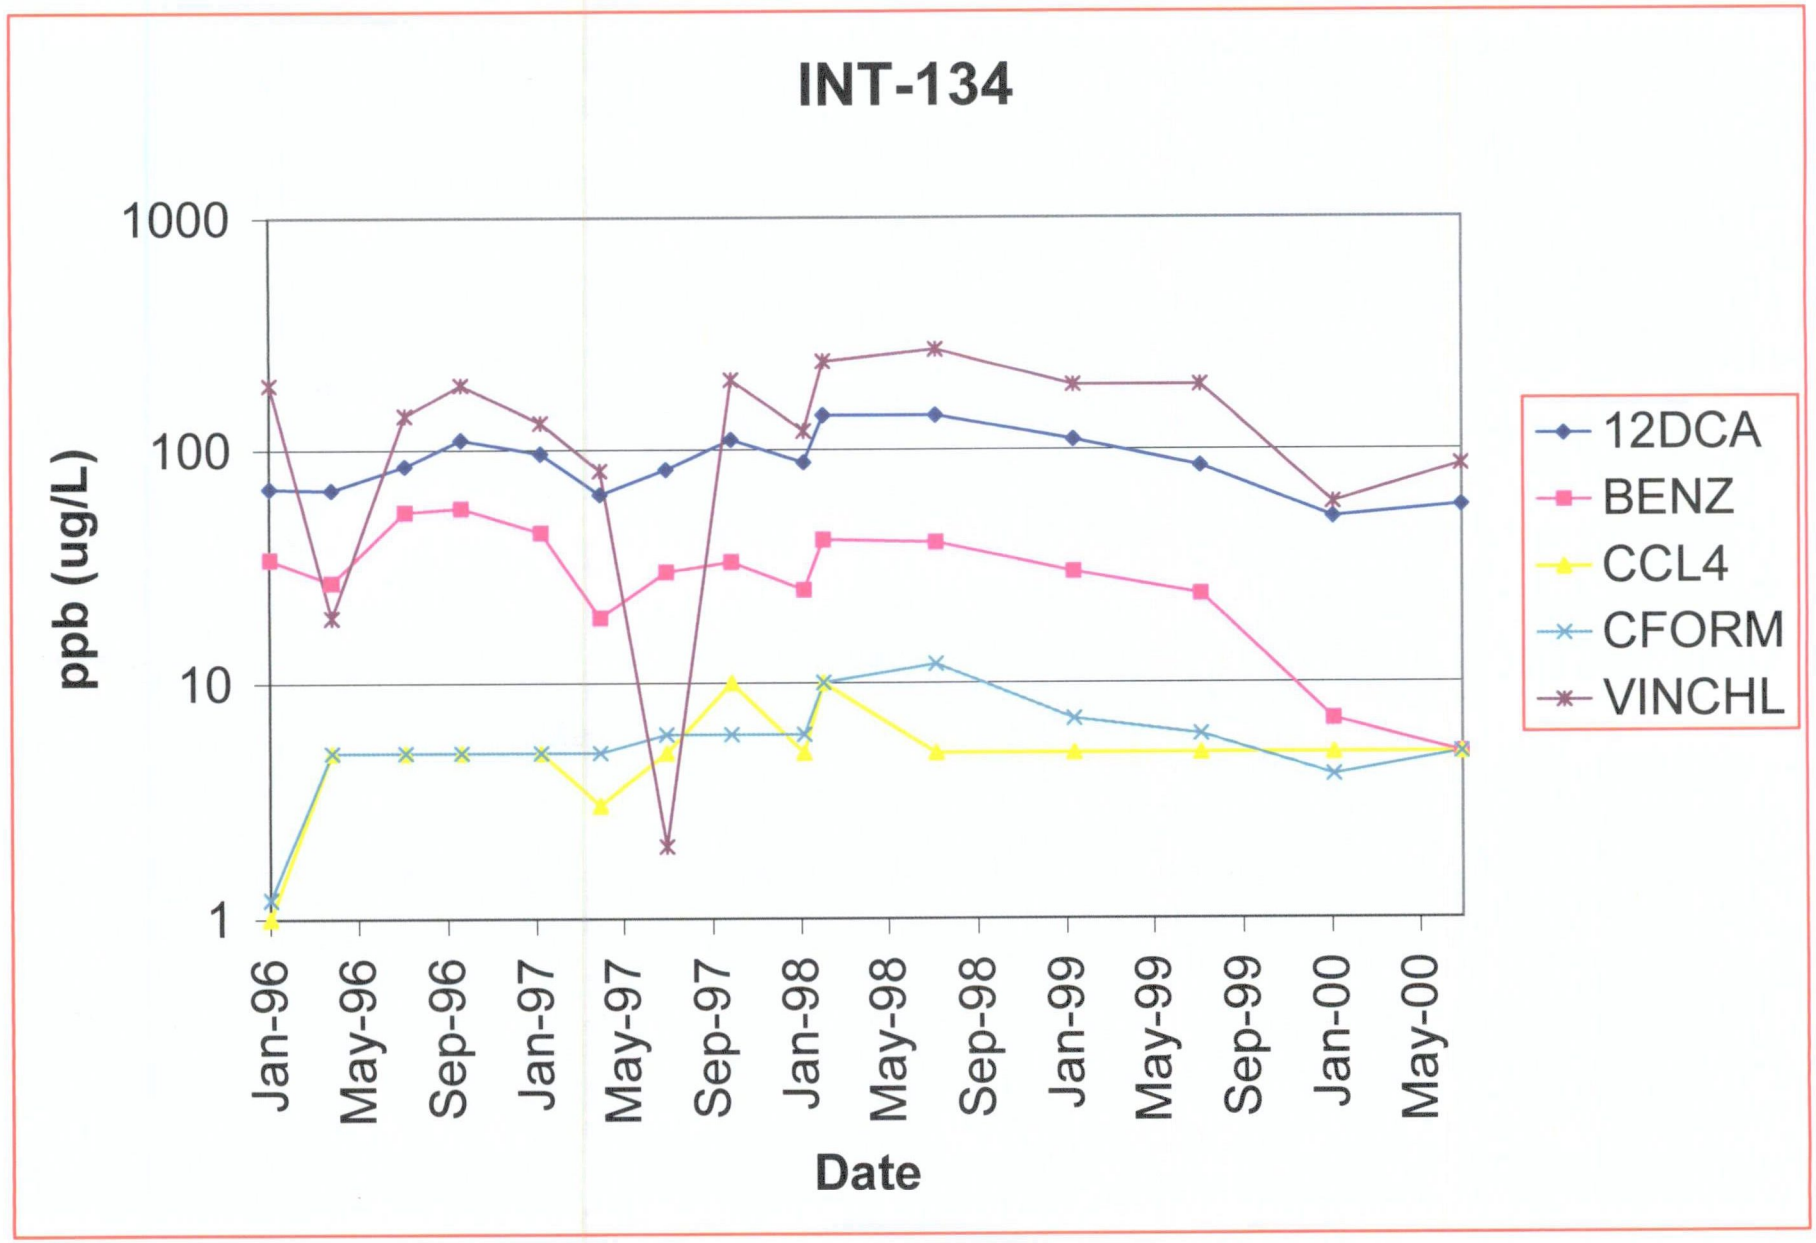
INT-134
1000
100
10
1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

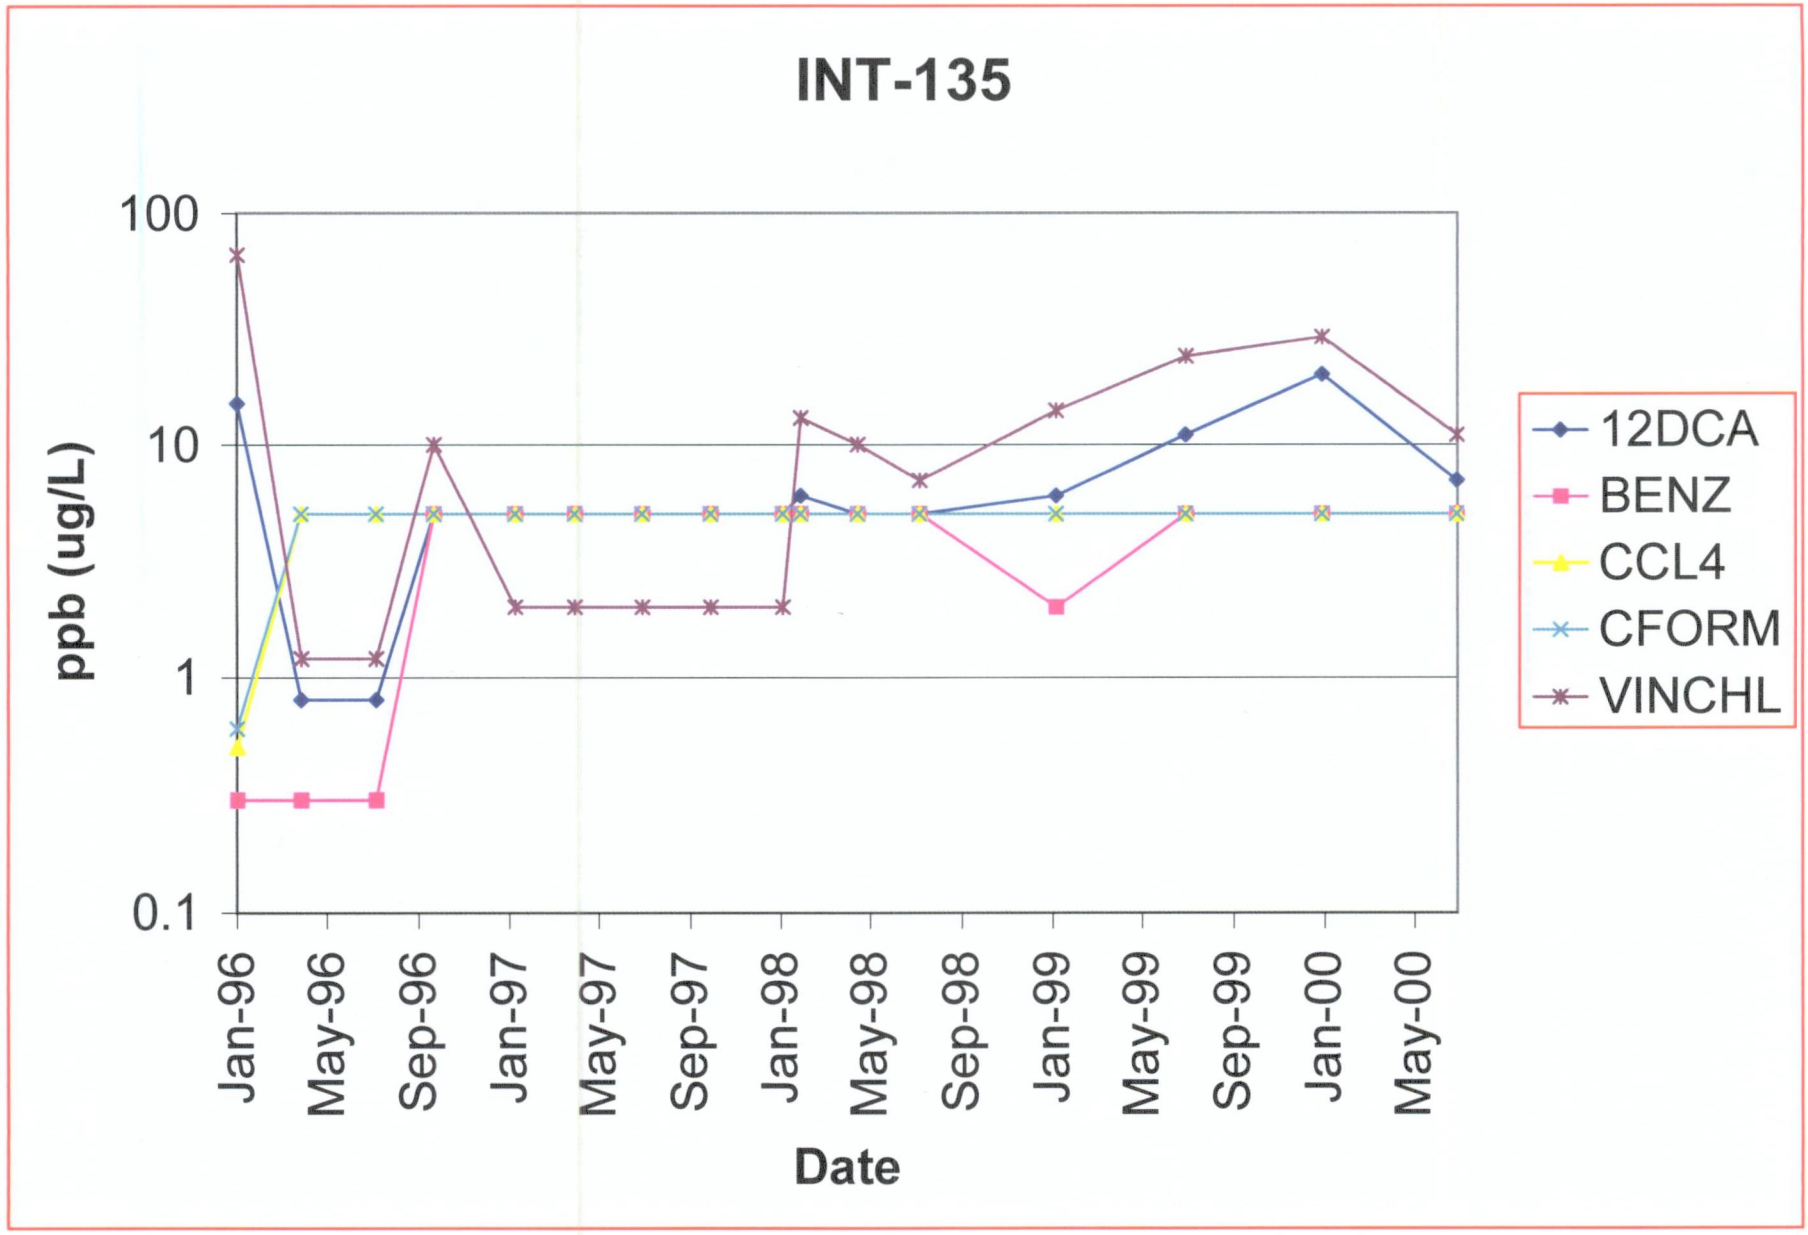
INT-135
100
10
1
0.1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

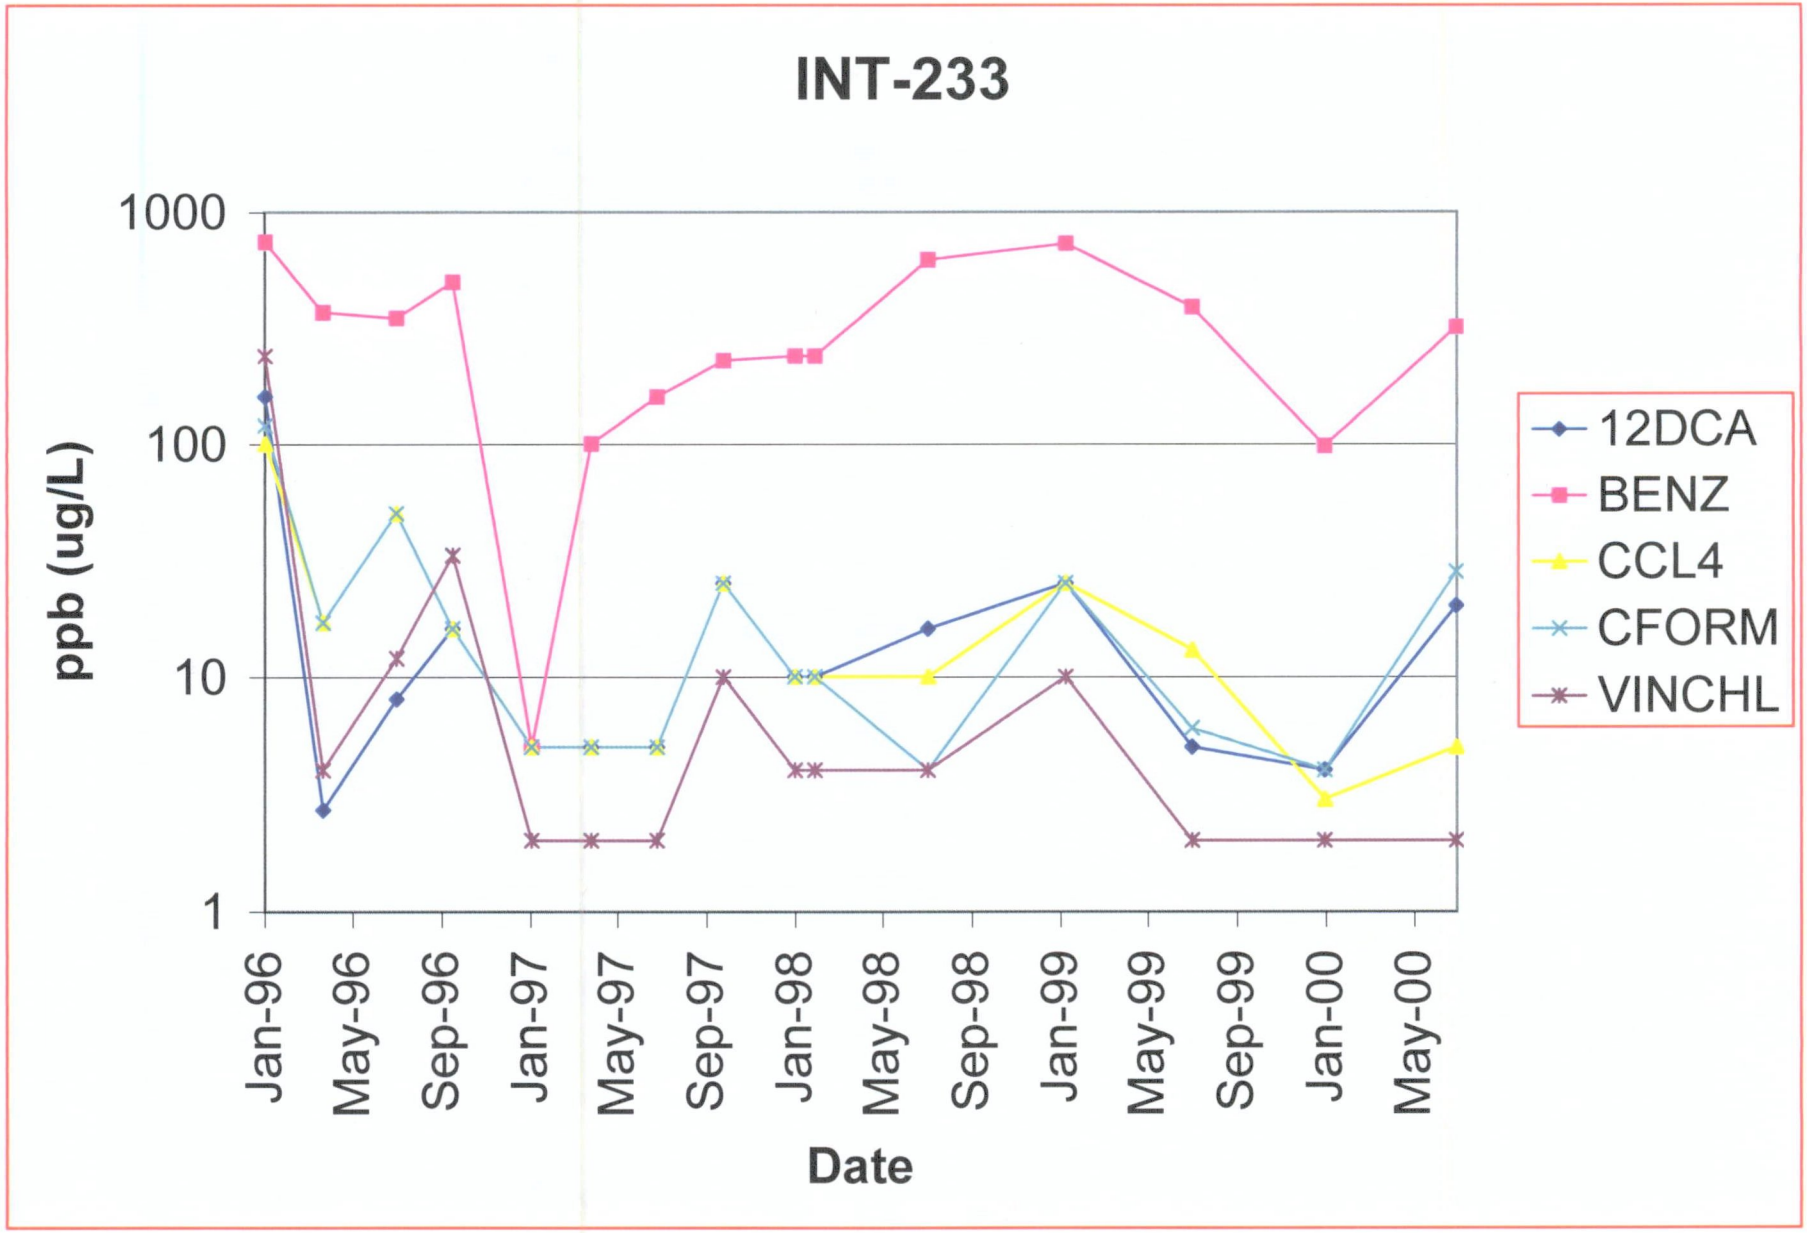
INT-233
1000
100
10
1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

S1-121
1000
100
10
1
0.1
ppb (ug/L)
Jan-96
May-96
Sep-96
Jan-97
May-97
Sep-97
Jan-98
May-98
Sep-98
Jan-99
May-99
Sep-99
Jan-00
May-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL

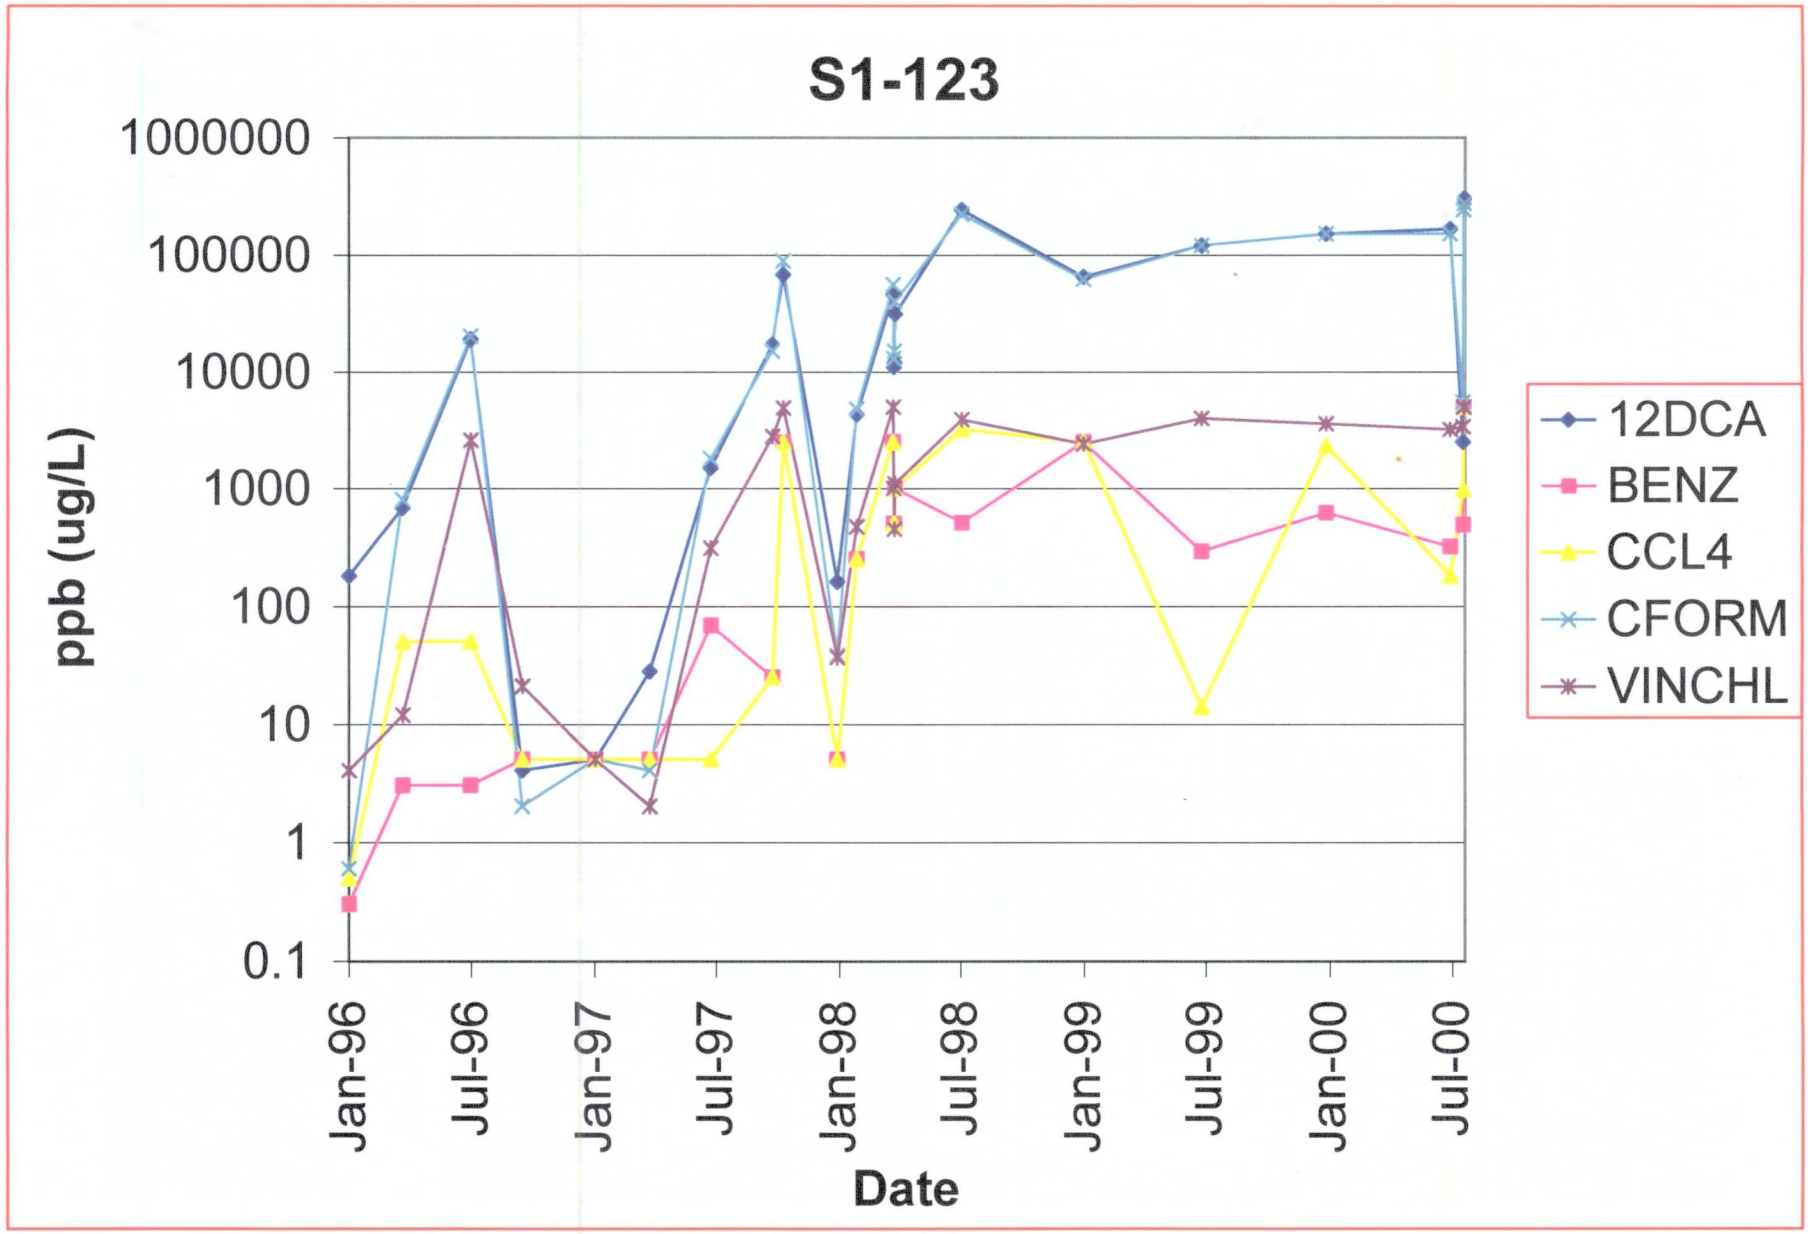
S1-123
1000000
100000
10000
1000
100
10
1
0.1
ppb (ug/L)
Jan-96
Jul-96
Jan-97
Jul-97
Jan-98
Jul-98
Jan-99
Jul-99
Jan-00
Jul-00
Date
12DCA
BENZ
CCL4
CFORM
VINCHL