2016 City of Corpus Christi Water Distribution System Model
60 MGD 5-Day EPS Scenario
Source Tracing Results - 6746 Up River Rd

December 15, 2016 - REV1 - 2PM

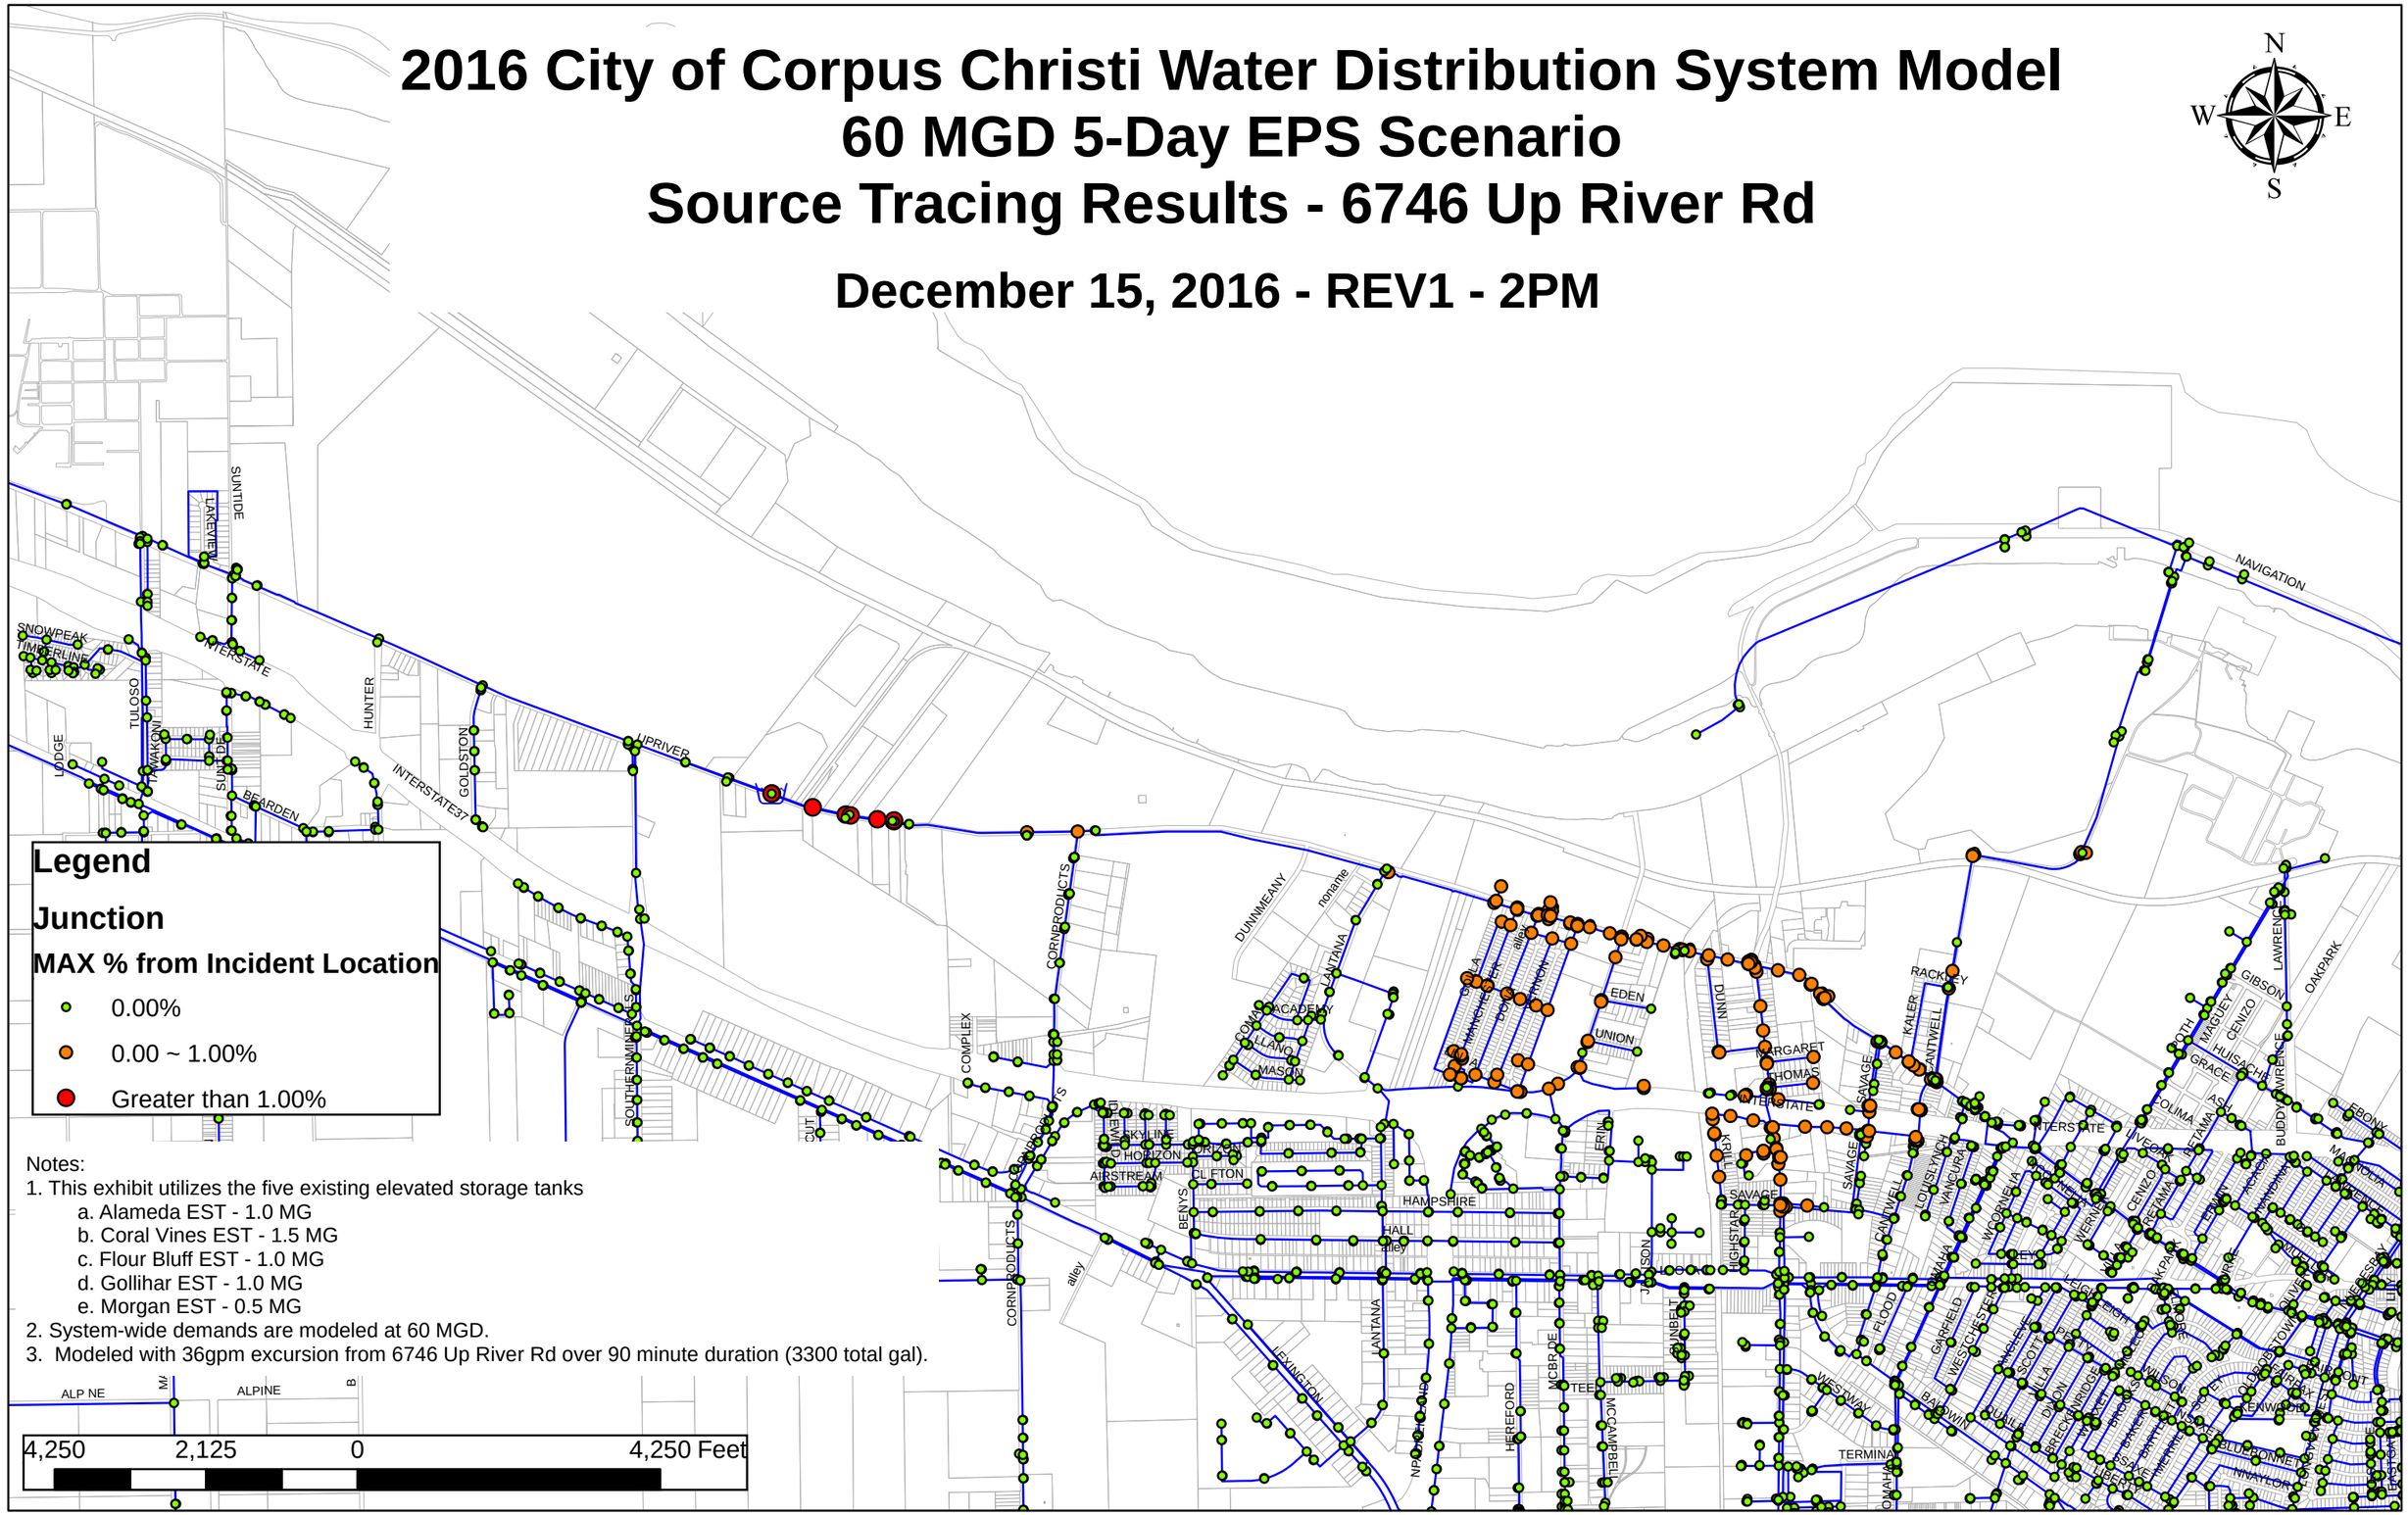

Notes:
1. This exhibit utilizes the five existing elevated storage tanks
   a. Alameda EST - 1.0 MG
   b. Coral Vines EST - 1.5 MG
   c. Flour Bluff EST - 1.0 MG
   d. Gollihar EST - 1.0 MG
   e. Morgan EST - 0.5 MG
2. System-wide demands are modeled at 60 MGD.
3. Modeled with 36gpm excursion from 6746 Up River Rd over 90 minute duration (3300 total gal).

9421555