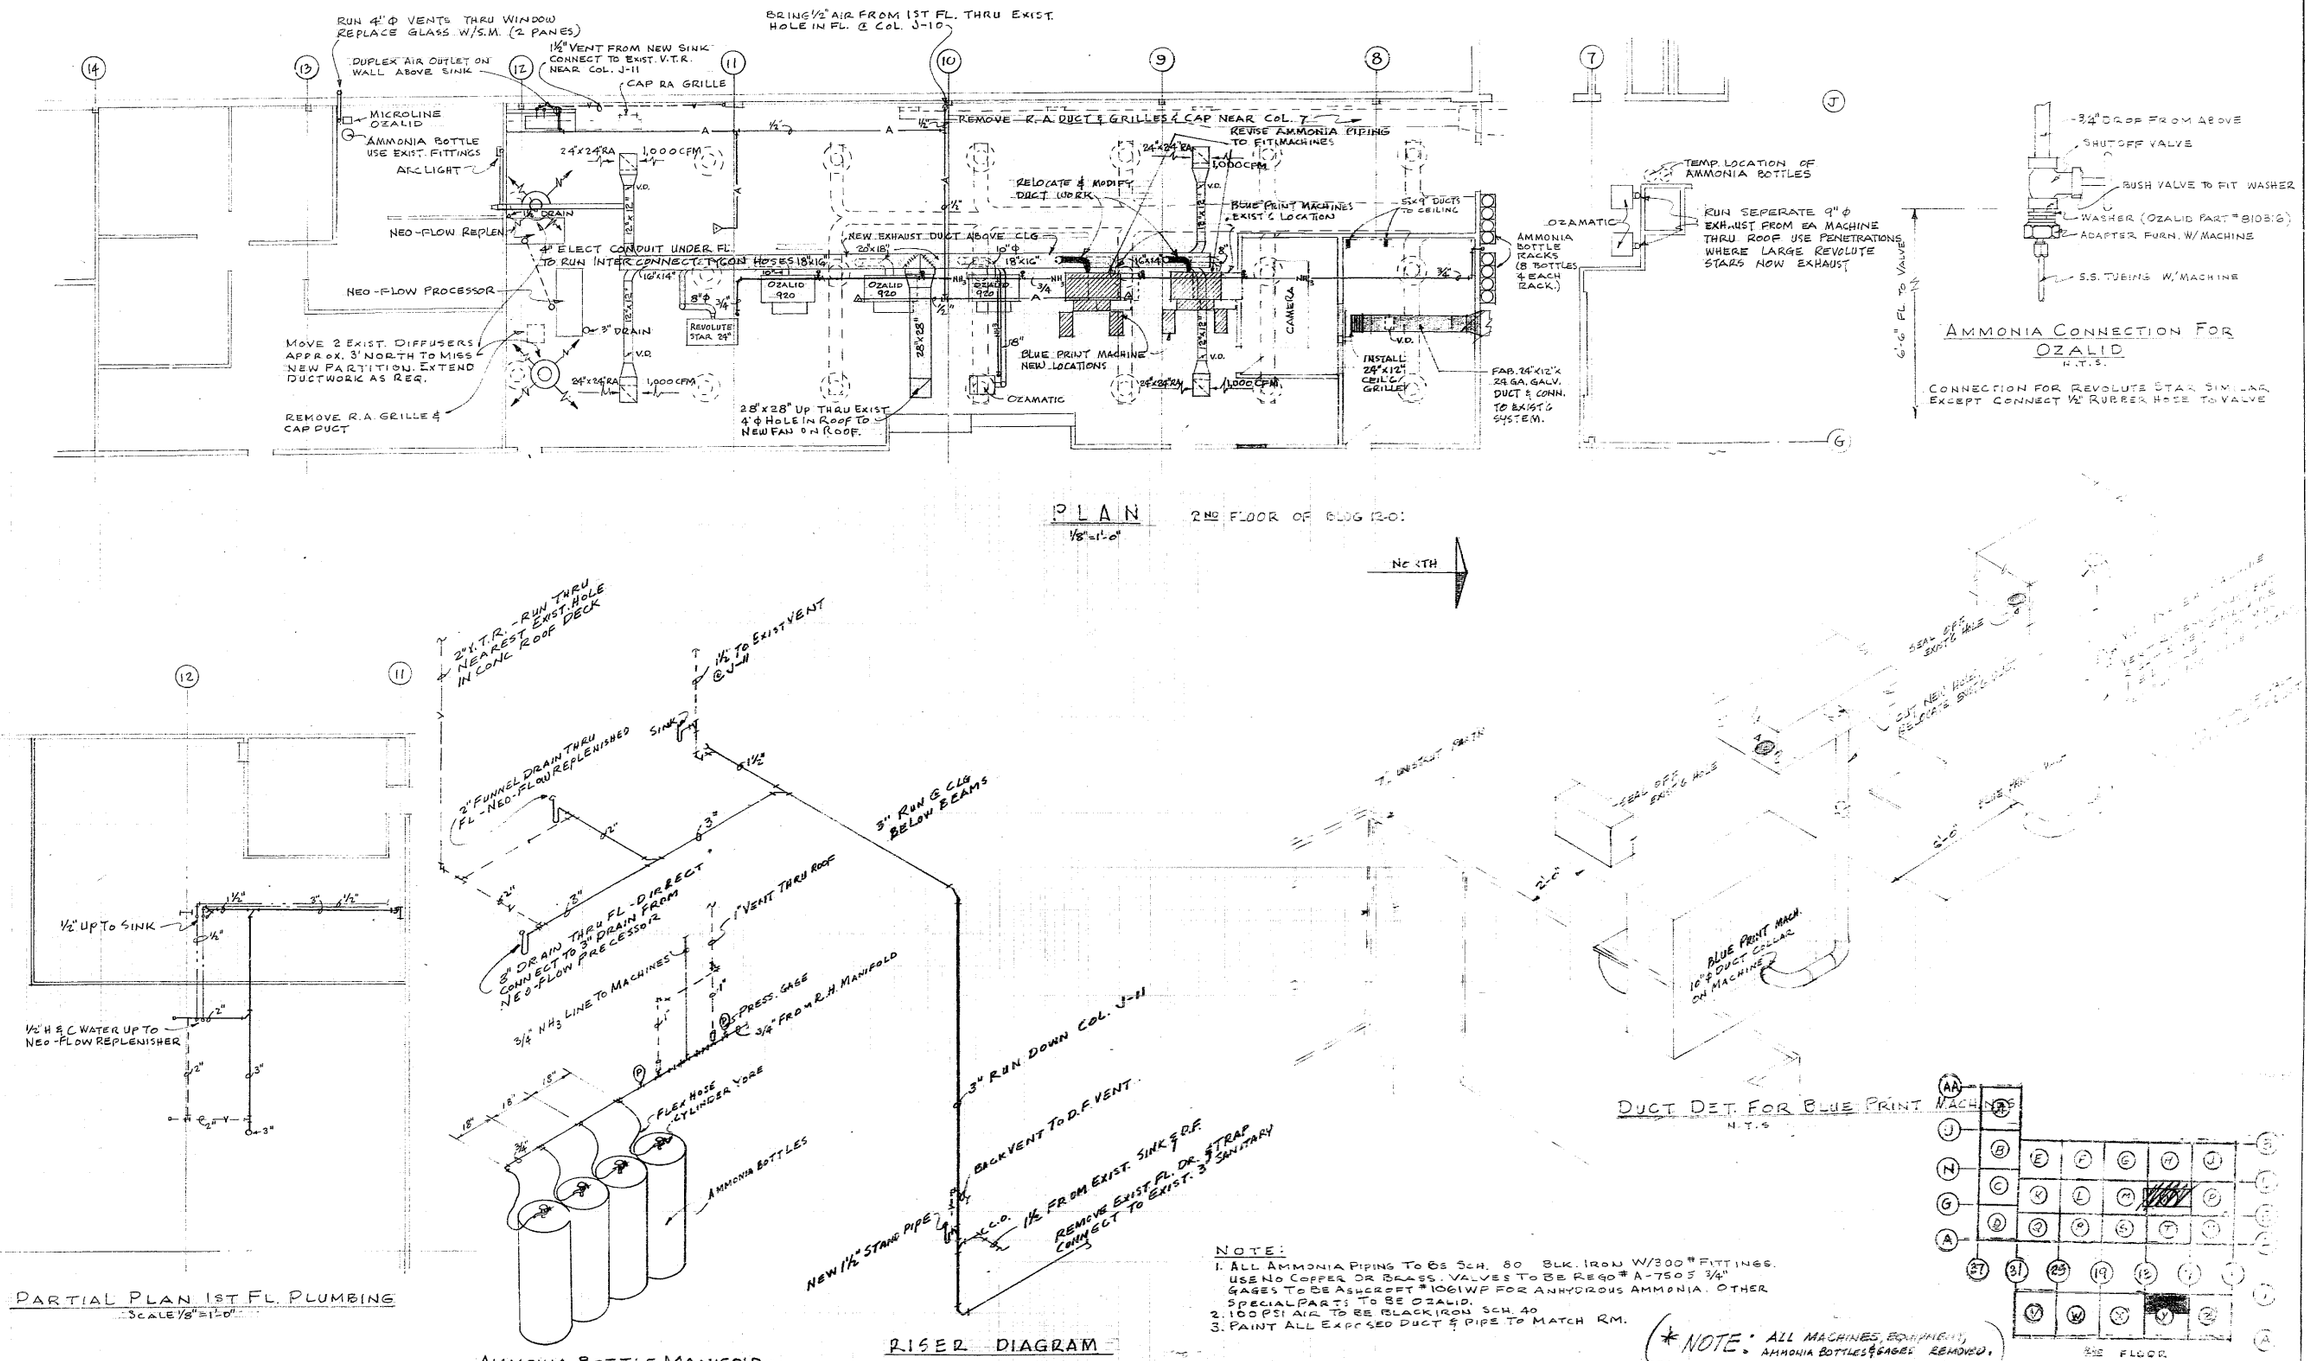

NOTE:
1. ALL AMMONIA PIPING TO BE SCH. 80 BLK. IRON W/300# FITTINGS. USE NO COPPER OR BRASS. VALVES TO BE REGO # A-7505 3/4" GAGES TO BE ASHCROFT # 1061WP FOR ANHYDROUS AMMONIA. OTHER SPECIAL PARTS TO BE OZALID.
2. 100 PSI AIR TO BE BLACK IRON SCH. 40
3. PAINT ALL EXPOSED DUCT & PIPE TO MATCH RM.

(* NOTE: ALL MACHINES, EQUIPMENT, AMMONIA BOTTLES & GAGES REMOVED.)

SYM.	REVISION	BY	APPROVED	DATE	SYM.	REVISION	BY	APPROVED	DATE

GRAPHIC SCALES

THE BOEING COMPANY
AEROSPACE GROUP
FACILITIES DEPARTMENT
SEATTLE, WASHINGTON 98124

24X -- DO NOT SCALE

		DATE
DRAWN BY	F. GONN	12/6/68
CHECKED	R. BENZE	12/13/68
CHECKED		
APPROVED		
APPROVED		
APPROVED		

SUB TITLE: EQUIPMENT RELOCATION

TITLE: RELOCATE M.M. ENGR. PERSONNEL

BLDG 12-01.2 MFC

WA0953KC

LAST REVISION | SYMBOL | DATE

SHEET M-1 1 OF 1

JOB NO. 8[illegible]

DWG. NO. [illegible]

1657

897164

EXCITUER DEVELOPMENT

TOP LIFE

JOB NO.

DRG. NO.