| City of Baltimore Wet Weather Consent Decree Smoke and Dyed Water Testing Form | | Page 1 of 4 |
|---|---|---|
| **Sewershed :** Gwynn Falls | **Company :** URS | **Date :** 05/28/2009 |
| **Test to be Performed :**<br>Smoke : X Dyed Water : __ | **Ground Condition :**<br>Dry : X Damp : __ Wet : __ | **Supervisor :** John Daly |
| **Manhole ID :** S03OO_005MH | **Test ID :** S1032-021002 | **Notifications (Residents, Fire, 311) :**<br>Yes |

**Field Sketch :** (Show All Manholes with Numbers, Blower Placement Location, Sandbag or Isolation Locations, Street Names, Building Addresses and Locations, Defect Locations and Photograph Numbers)

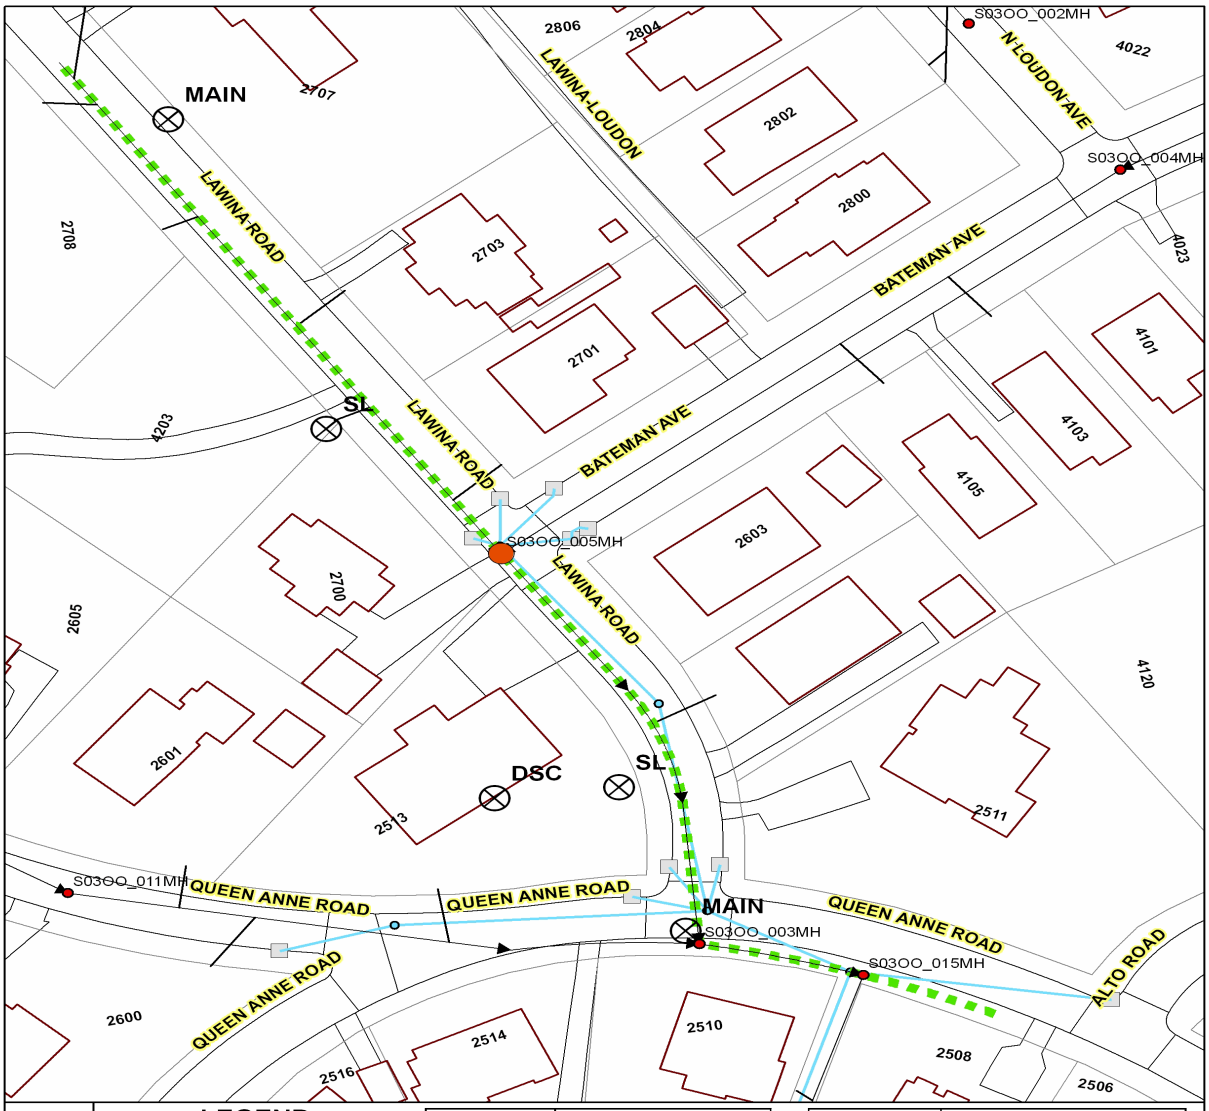


N

**LEGEND**

- SMOKE OBSERVATION
- BLOWER LOCATIONS
- MANHOLE
- SEWER LINE
- SMOKE RUN

| Defect Code | Defect Description |
|---|---|
| SL | Service Lateral |
| TJ | Transition Joint |
| DD | Driveway Drain |
| WWD | Window Well Drain |
| STRD | Stairwell Drain |
| AD | Area Drain |
| DS | Downspout |
| DSC | Downspout Connection |
| FD | Foundation Drain |

| Defect Code | Defect Description |
|---|---|
| CB | Catch Basin |
| SD | Storm Ditch |
| SWMH | Storm Manhole |
| MAIN | Main Sewer |
| SANMH | Sewer Manhole |
| CO | Cleanout |
| OTHER | Other |
| IOB | Inside of Building |

| City of Baltimore Wet Weather Consent Decree Smoke and Dyed Water Testing Form | | Page 2 of 4 |
|---|---|---|
| **Sewershed :** Gwynn Falls | **Company :** URS | **Date :** 05/28/2009 |
| **Test to be Performed :**<br>Smoke : X Dyed Water : __ | **Ground Condition :**<br>Dry : X Damp : __ Wet : __ | **Supervisor :** John Daly |
| **Manhole ID :** S03OO_005MH | **Test ID :** S1032-021002 | **Notifications (Residents, Fire, 311) :**<br>Yes |

**Field Sketch :** (Show All Manholes with Numbers, Blower Placement Location, Sandbag or Isolation Locations, Street Names, Building Addresses and Locations, Defect Locations and Photograph Numbers)

**ID**

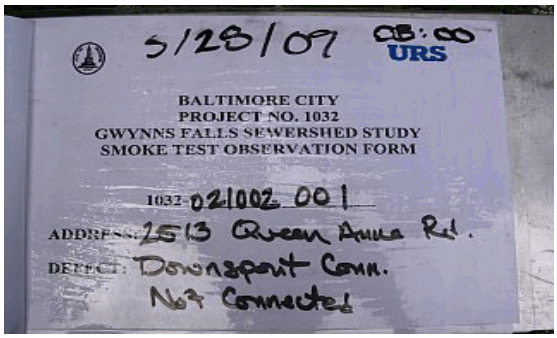


Location: N/A; Type: Downspout Connection; Smoke: Heavy; Status: Private Property

**Landscape**

**Defect**

**ID**

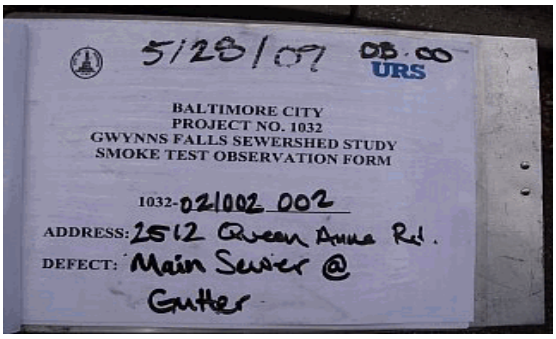


Location: N/A; Type: Main Sewer; Smoke: Heavy; Status: Public ROW

**Landscape**

**Defect**

| City of Baltimore Wet Weather Consent Decree Smoke and Dyed Water Testing Form | | Page 3 of 4 |
|---|---|---|
| **Sewershed :** Gwynn Falls | **Company :** URS | **Date :** 05/28/2009 |
| **Test to be Performed :**<br>Smoke : X Dyed Water : __ | **Ground Condition :**<br>Dry : X Damp : __ Wet : __ | **Supervisor :** John Daly |
| **Manhole ID :** S03OO_005MH | **Test ID :** S1032-021002 | **Notifications (Residents, Fire, 311) :**<br>Yes |

**Field Sketch :** (Show All Manholes with Numbers, Blower Placement Location, Sandbag or Isolation Locations, Street Names, Building Addresses and Locations, Defect Locations and Photograph Numbers)

**ID**

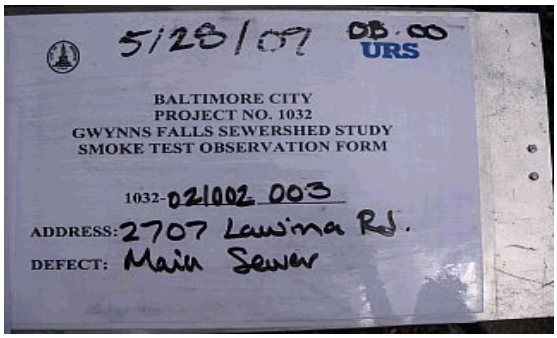


Location: N/A; Type: Main Sewer; Smoke: Heavy; Status: Private Property

**Landscape**

**Defect**

**ID**

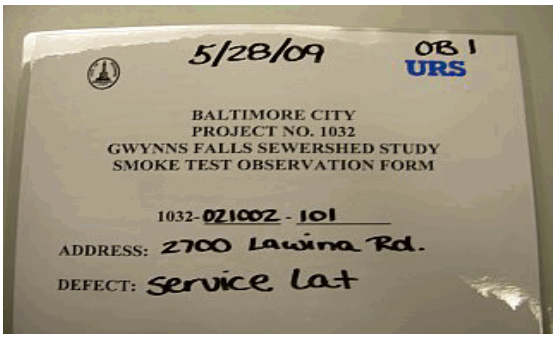


Location: N/A; Type: Service Lateral; Smoke: Medium; Status: Private Property

**Landscape**

**Defect**

| City of Baltimore Wet Weather Consent Decree Smoke and Dyed Water Testing Form | | Page 4 of 4 |
|---|---|---|
| **Sewershed :** Gwynn Falls | **Company :** URS | **Date :** 05/28/2009 |
| **Test to be Performed :**<br>Smoke : X Dyed Water : __ | **Ground Condition :**<br>Dry : X Damp : __ Wet : __ | **Supervisor :** John Daly |
| **Manhole ID :** S03OO_005MH | **Test ID :** S1032-021002 | **Notifications (Residents, Fire, 311) :**<br>Yes |

**Field Sketch :** (Show All Manholes with Numbers, Blower Placement Location, Sandbag or Isolation Locations, Street Names, Building Addresses and Locations, Defect Locations and Photograph Numbers)

**ID**

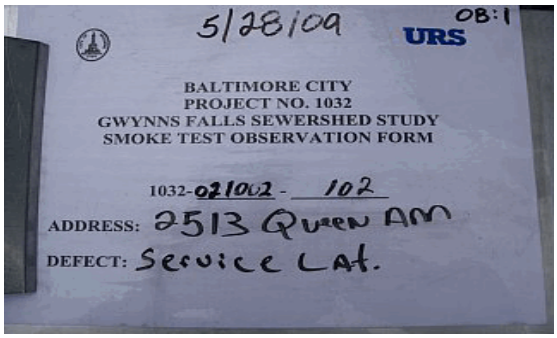


Location: N/A; Type: Service Lateral; Smoke: Medium; Status: Private Property

**Landscape**

**Defect**