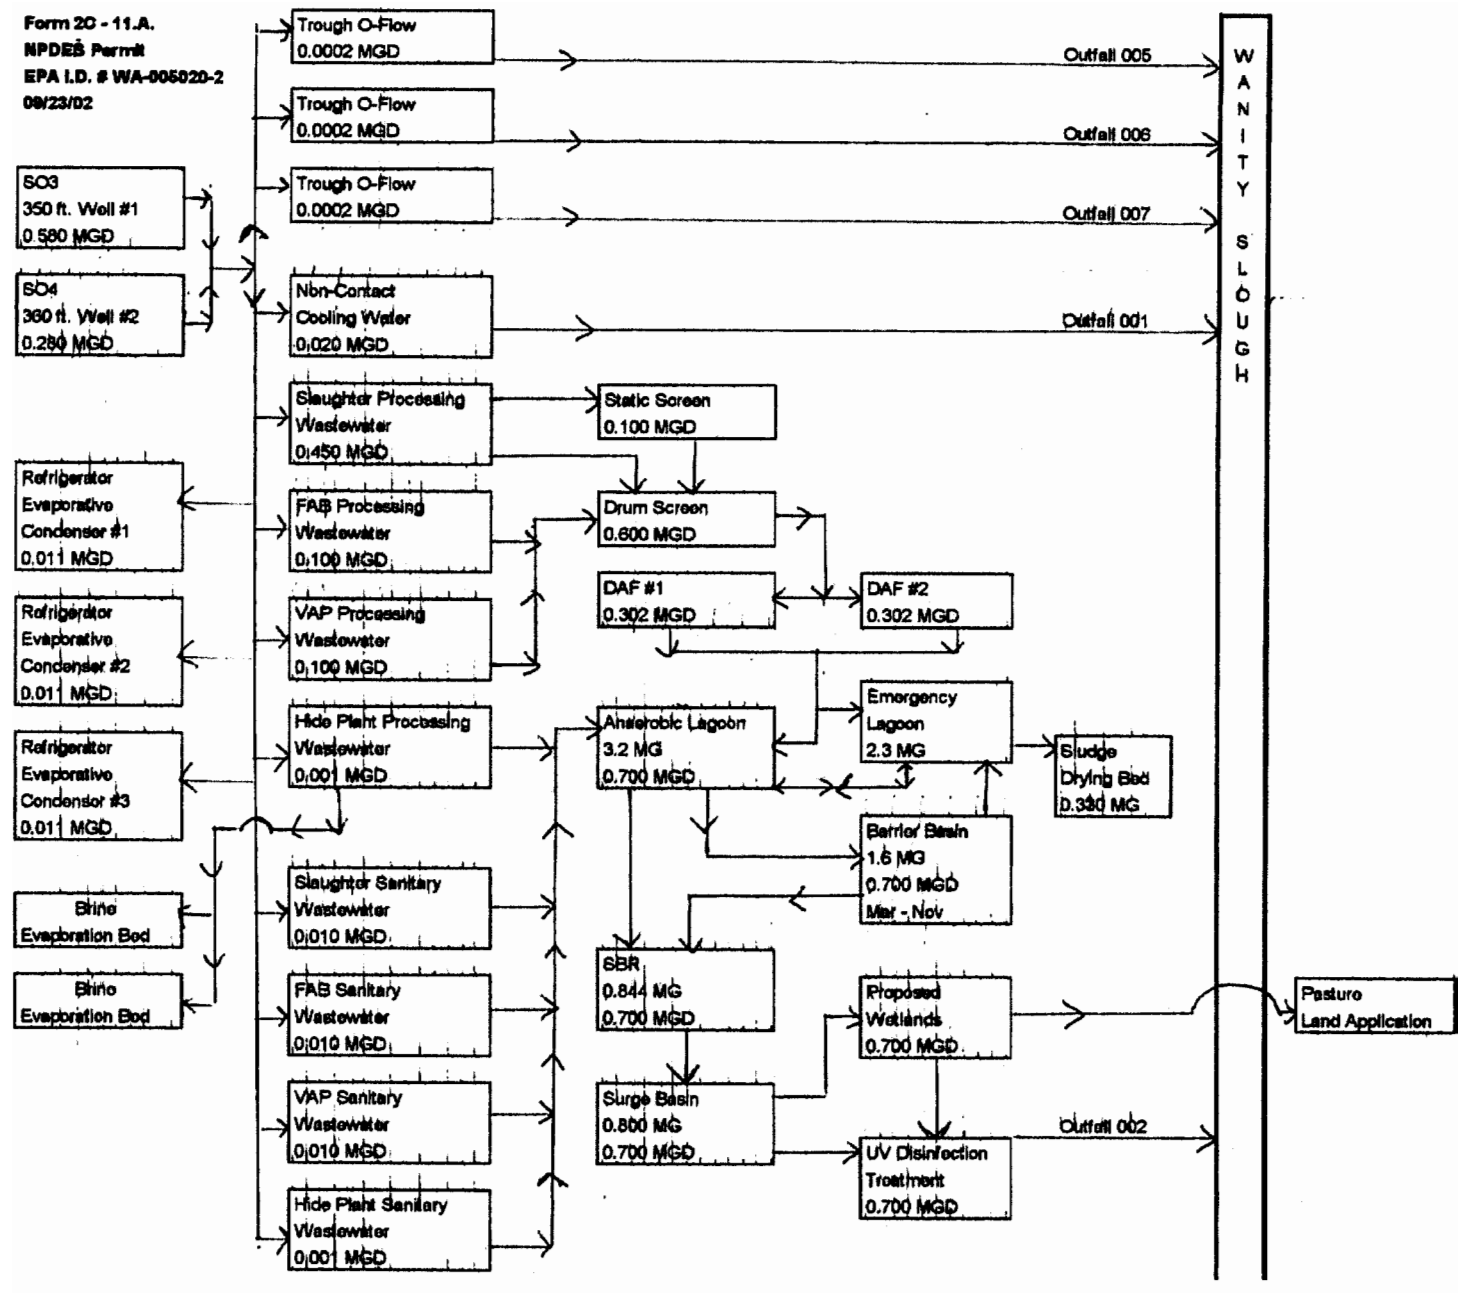
Form 2C - 11.A.
NPDES Permit
EPA I.D. # WA-005020-2
09/23/02
Trough O-Flow
0.0002 MGD
Trough O-Flow
0.0002 MGD
Trough O-Flow
0.0002 MGD
SO3
350 ft. Well #1
0.580 MGD
SO4
360 ft. Well #2
0.280 MGD
Non-Contact
Cooling Water
0.020 MGD
Outfall 005
Outfall 006
Outfall 007
Outfall 001
WANITY SLOUGH
Slaughter Processing
Wastewater
0.450 MGD
Static Screen
0.100 MGD
Refrigerator
Evaporative
Condenser #1
0.011 MGD
FAB Processing
Wastewater
0.100 MGD
Drum Screen
0.600 MGD
DAF #1
0.302 MGD
DAF #2
0.302 MGD
Refrigerator
Evaporative
Condenser #2
0.011 MGD
VAP Processing
Wastewater
0.100 MGD
Emergency
Lagoon
2.3 MG
Refrigerator
Evaporative
Condenser #3
0.011 MGD
Hide Plant Processing
Wastewater
0.001 MGD
Anaerobic Lagoon
3.2 MG
0.700 MGD
Sludge
Drying Bed
0.330 MG
Barrier Drain
1.6 MG
0.700 MGD
Mar - Nov
Brine
Evaporation Bed
Slaughter Sanitary
Wastewater
0.010 MGD
Brine
Evaporation Bed
SBR
0.844 MG
0.700 MGD
Proposed
Wetlands
0.700 MGD
Pasture
Land Application
FAB Sanitary
Wastewater
0.010 MGD
VAP Sanitary
Wastewater
0.010 MGD
Surge Basin
0.800 MG
0.700 MGD
Outfall 002
UV Disinfection
Treatment
0.700 MGD
Hide Plant Sanitary
Wastewater
0.001 MGD